


VAULT ABANDONMENT NOTES


THE FOLLOWING ARE GUIDELINES TO ABANDON AN EXISTING METER VAULT.

1. VAULT ABANDONMENT SHALL BE INSPECTED BY THE AKRON WATER SUPPLY BUREAU (AWSB). NOTIFY BOB GEISER AT (330) 375-2791 AT LEAST 48 HOURS PRIOR TO BEGINNING ABANDONMENT.
2. REMOVE ALL METERS AND VALVES INCLUDING ANY ELECTRONIC READING EQUIPMENT.
3. INSTALL A SPOOL PIECE (STRAIGHT PIPE) THAT REPLACES WHAT WAS REMOVED FROM THE SETTING. APPROVED SPOOL PIECE PIPE, FITTINGS, BOLTS, ETC. SHALL BE PER AWSB WATER MAIN NOTES, CURRENT EDITION.
4. THE FINAL METER READING SHALL BE RECORDED BY THE AWSB IN ORDER TO CLOSE THE ACCOUNT.
5. REMOVE THE VAULT TOP INCLUDING ACCESS DOORS OR MANHOLE AND CASTINGS.
6. HOLES SHALL BE PUNCHED IN THE FLOOR OF THE VAULT OR ALL WALLS CAN BE REMOVED TO ENSURE IT DOES NOT HOLD WATER.
7. COLLAPSE VAULT SIDES AS AN OPTIONAL METHOD.
8. FILL EXISTING VAULT WITH CLEAN SAND (COMPACTED) OR CONTROL DENSITY FILL.

PLAN VIEW

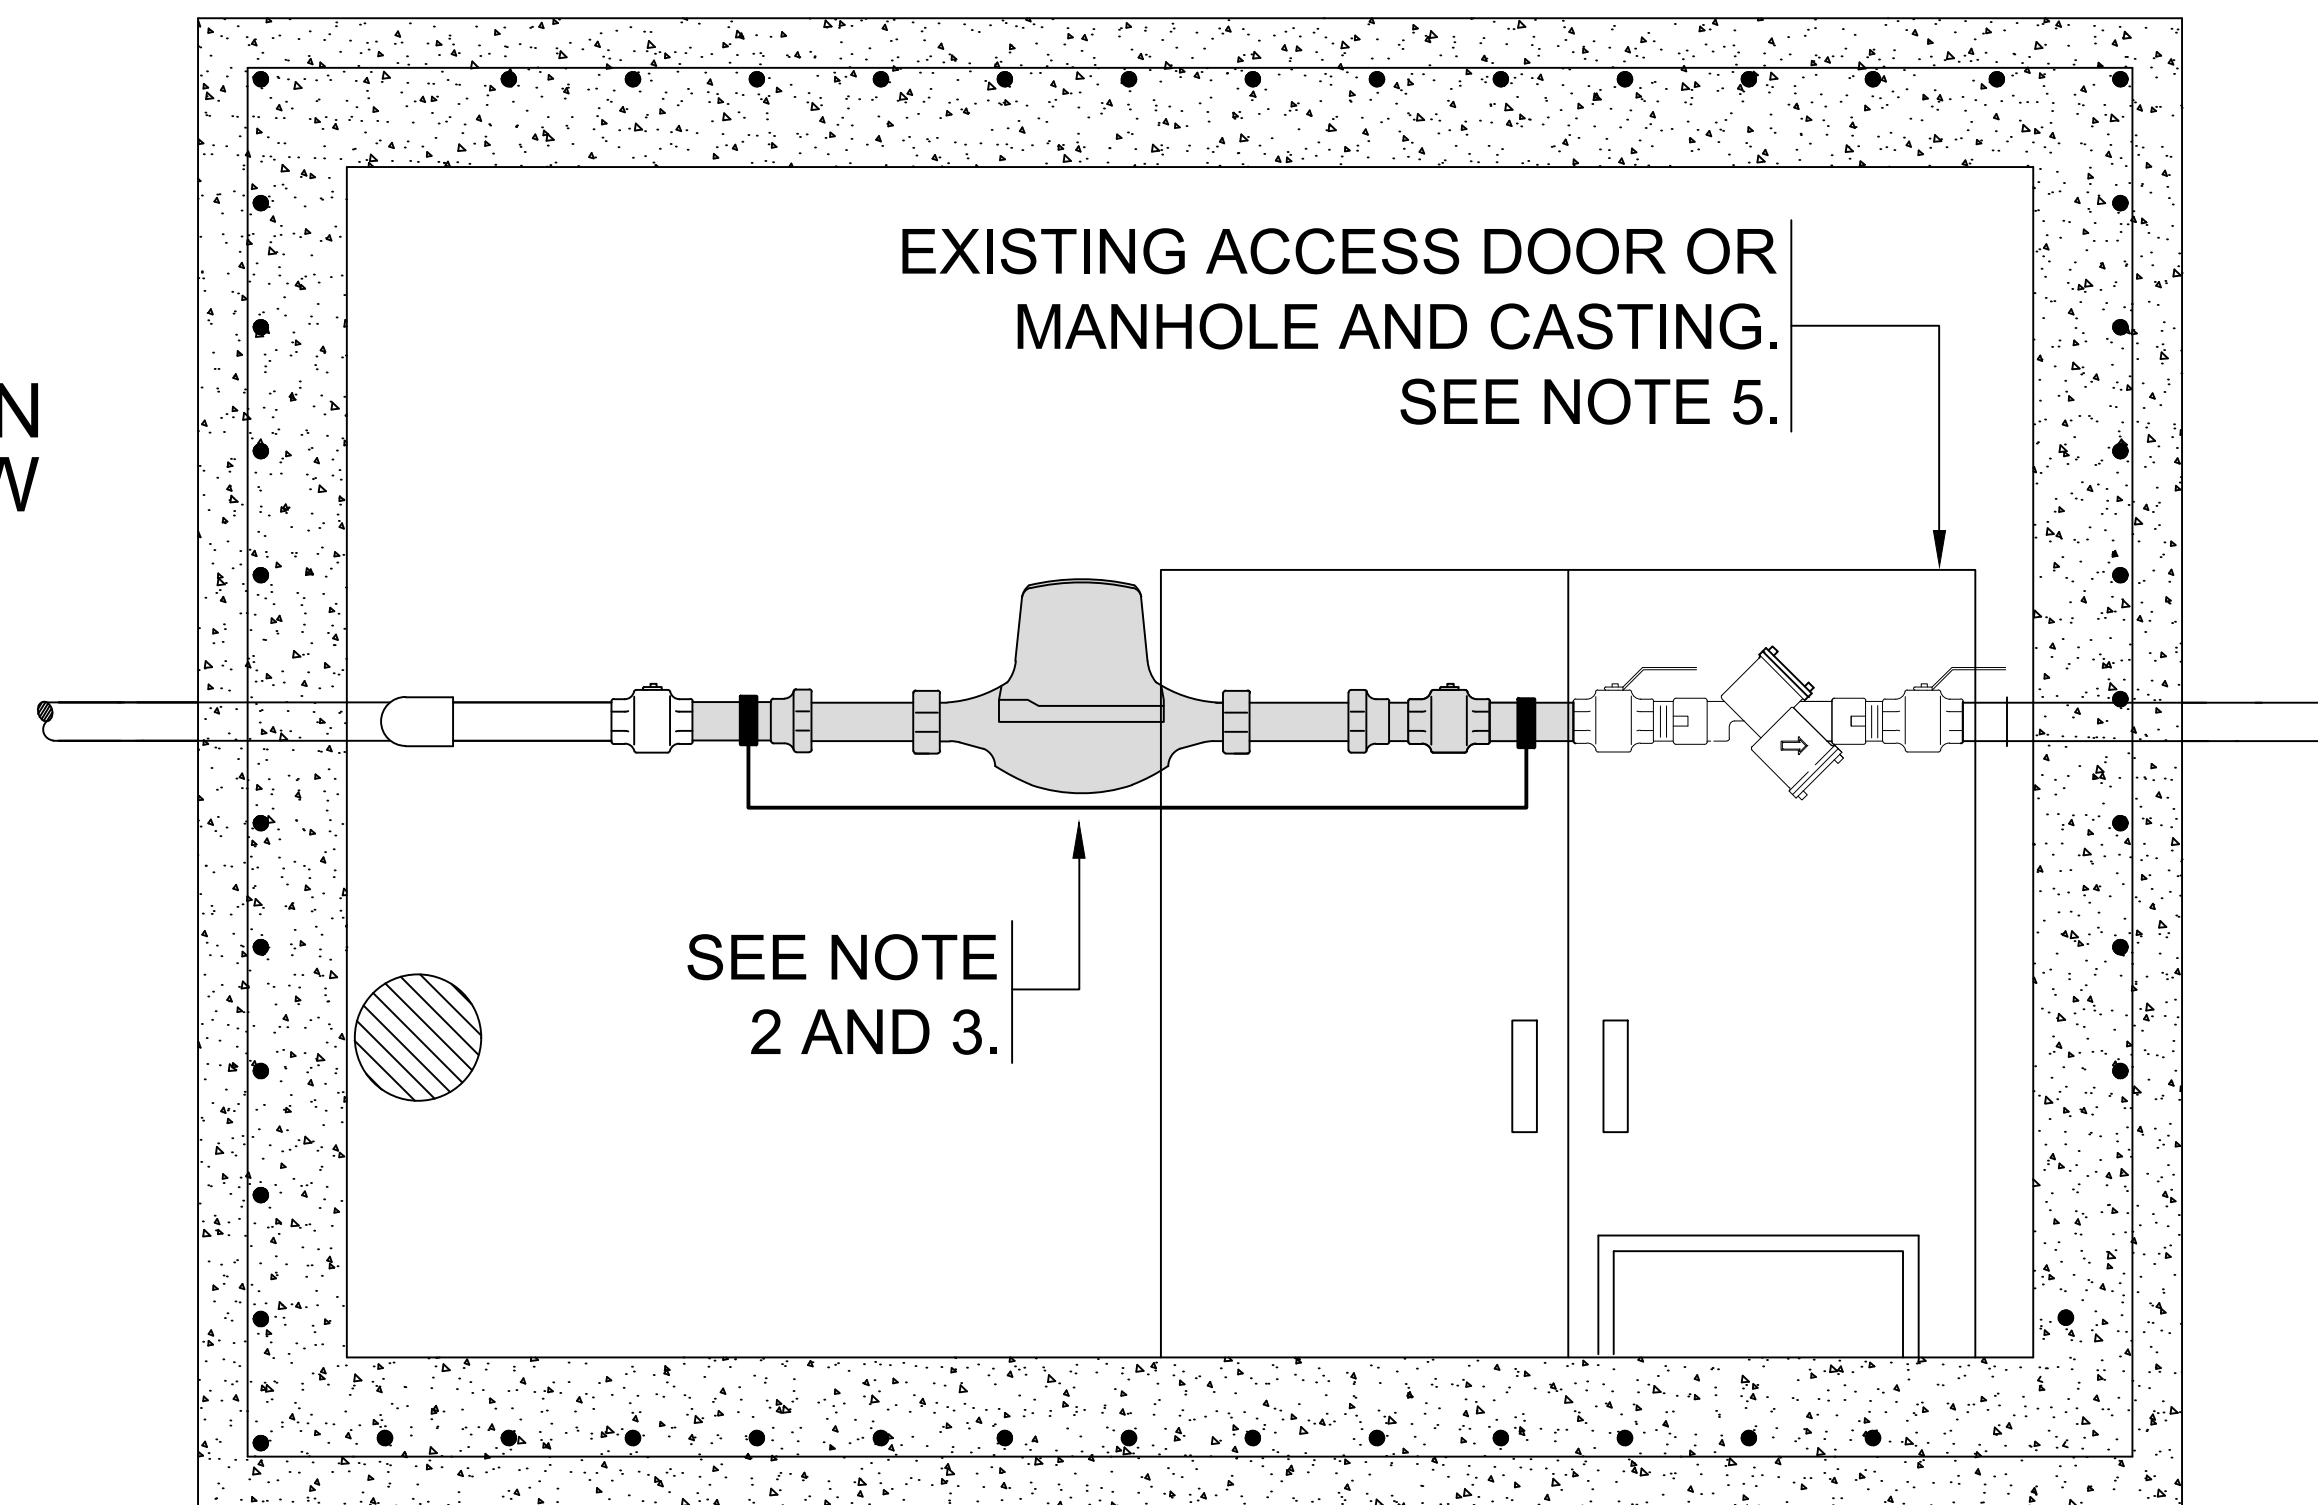

PROFILE VIEW

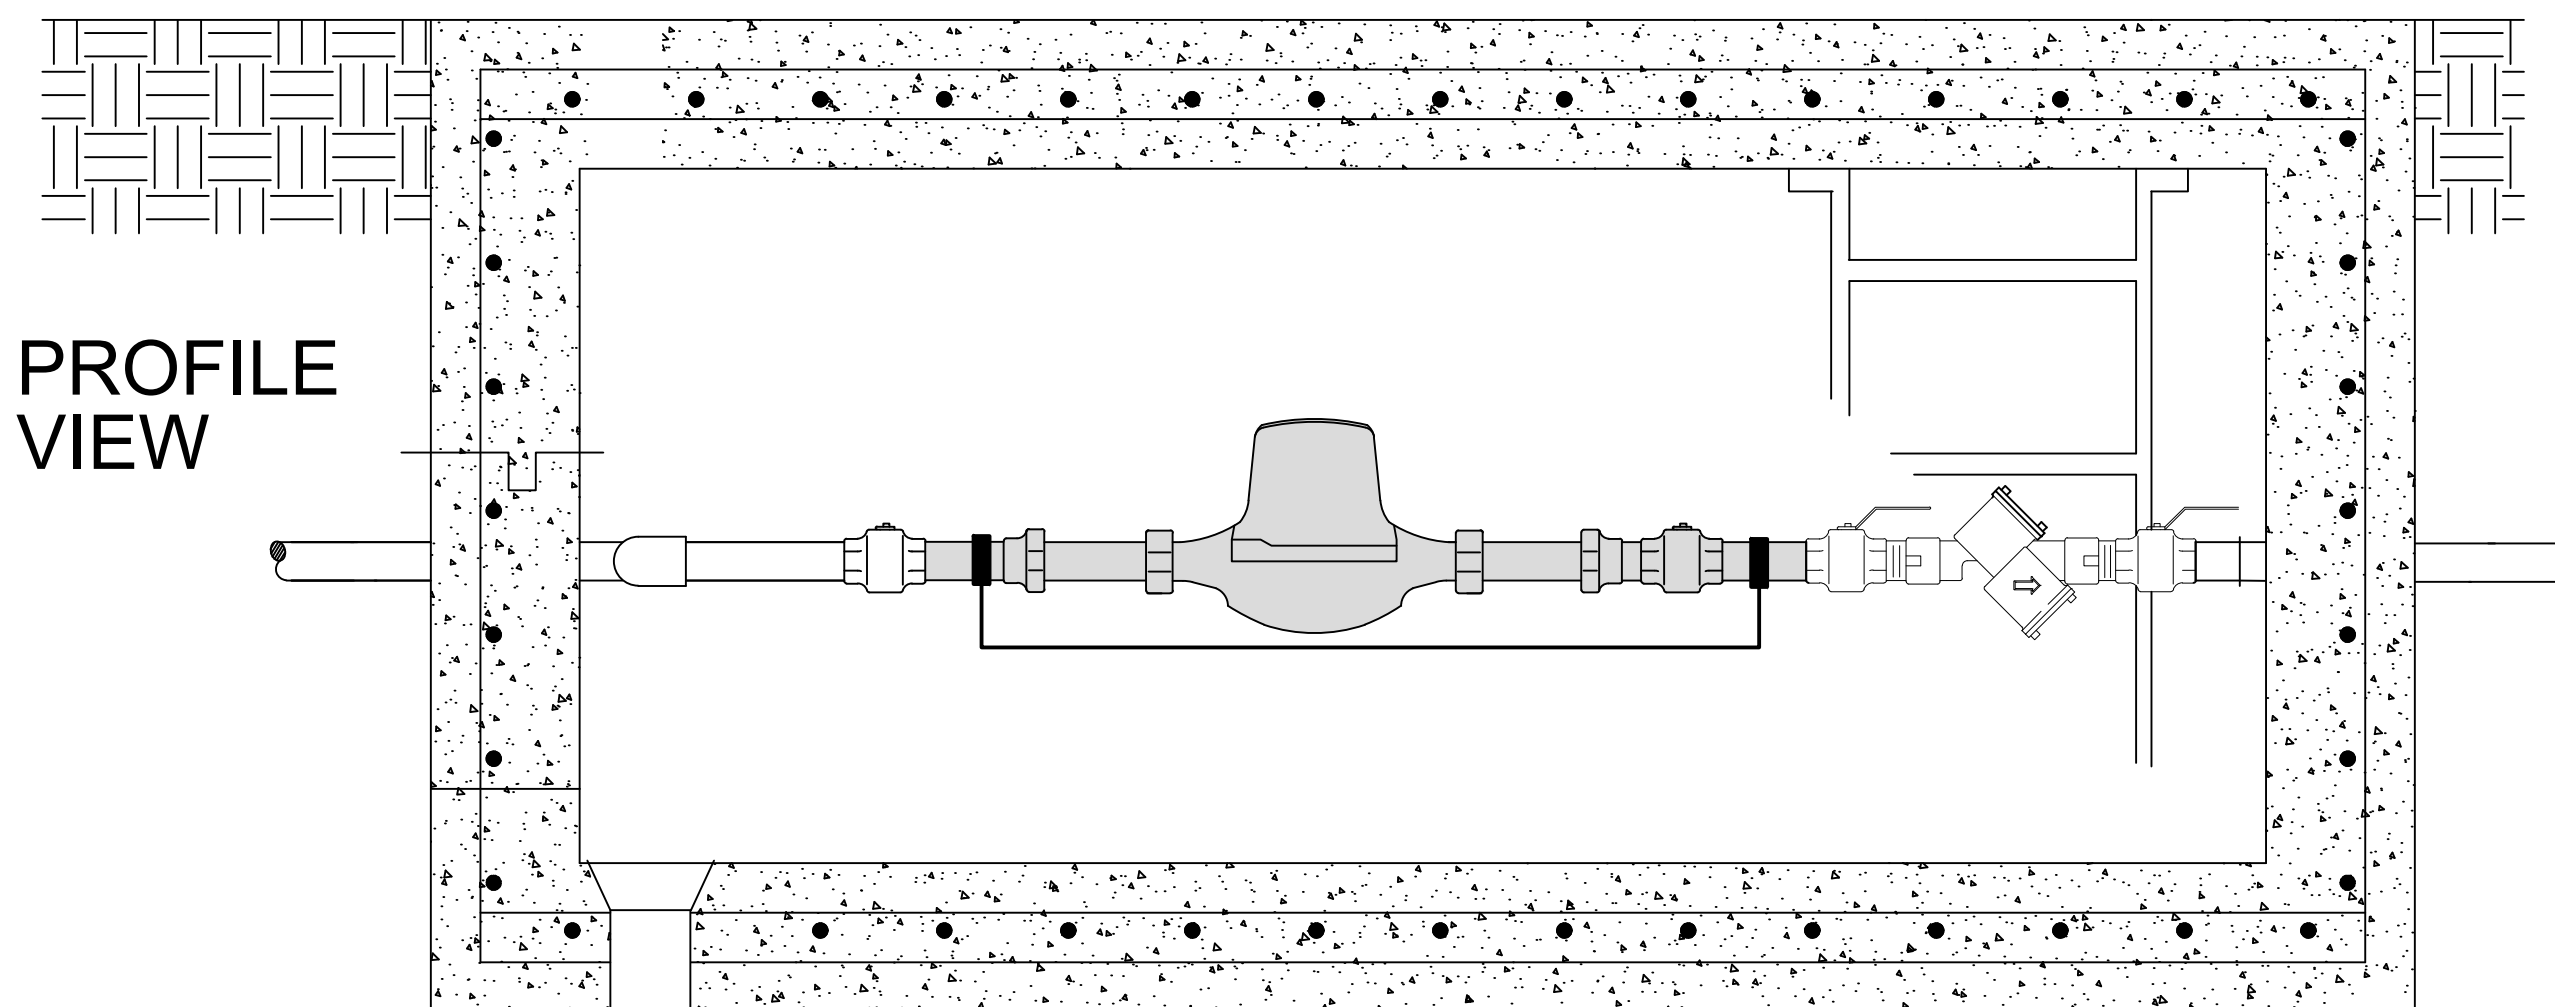

DO NOT SCALE - USE DIMENSIONS ONLY

CITY OF AKRON
DEPARTMENT OF PUBLIC SERVICE
WATER SUPPLY BUREAU

METER VAULT ABANDONMENT

REV. DECEMBER 13, 2023

RALD
UTILITIES ENGINEER

STANDARD CONSTRUCTION
DRAWING NO.

M-12.0