


NOTE:  
THE COMBINATION AIR VALVES SHALL HAVE A 2" IRON PIPE THREADS.

## 2" AUTOMATIC AIR RELEASE VALVE DETAIL

AKRON WATER SUPPLY BUREAU STANDARD DRAWINGS FOUND ONLINE AT  
<http://www.akronohio.gov/water>

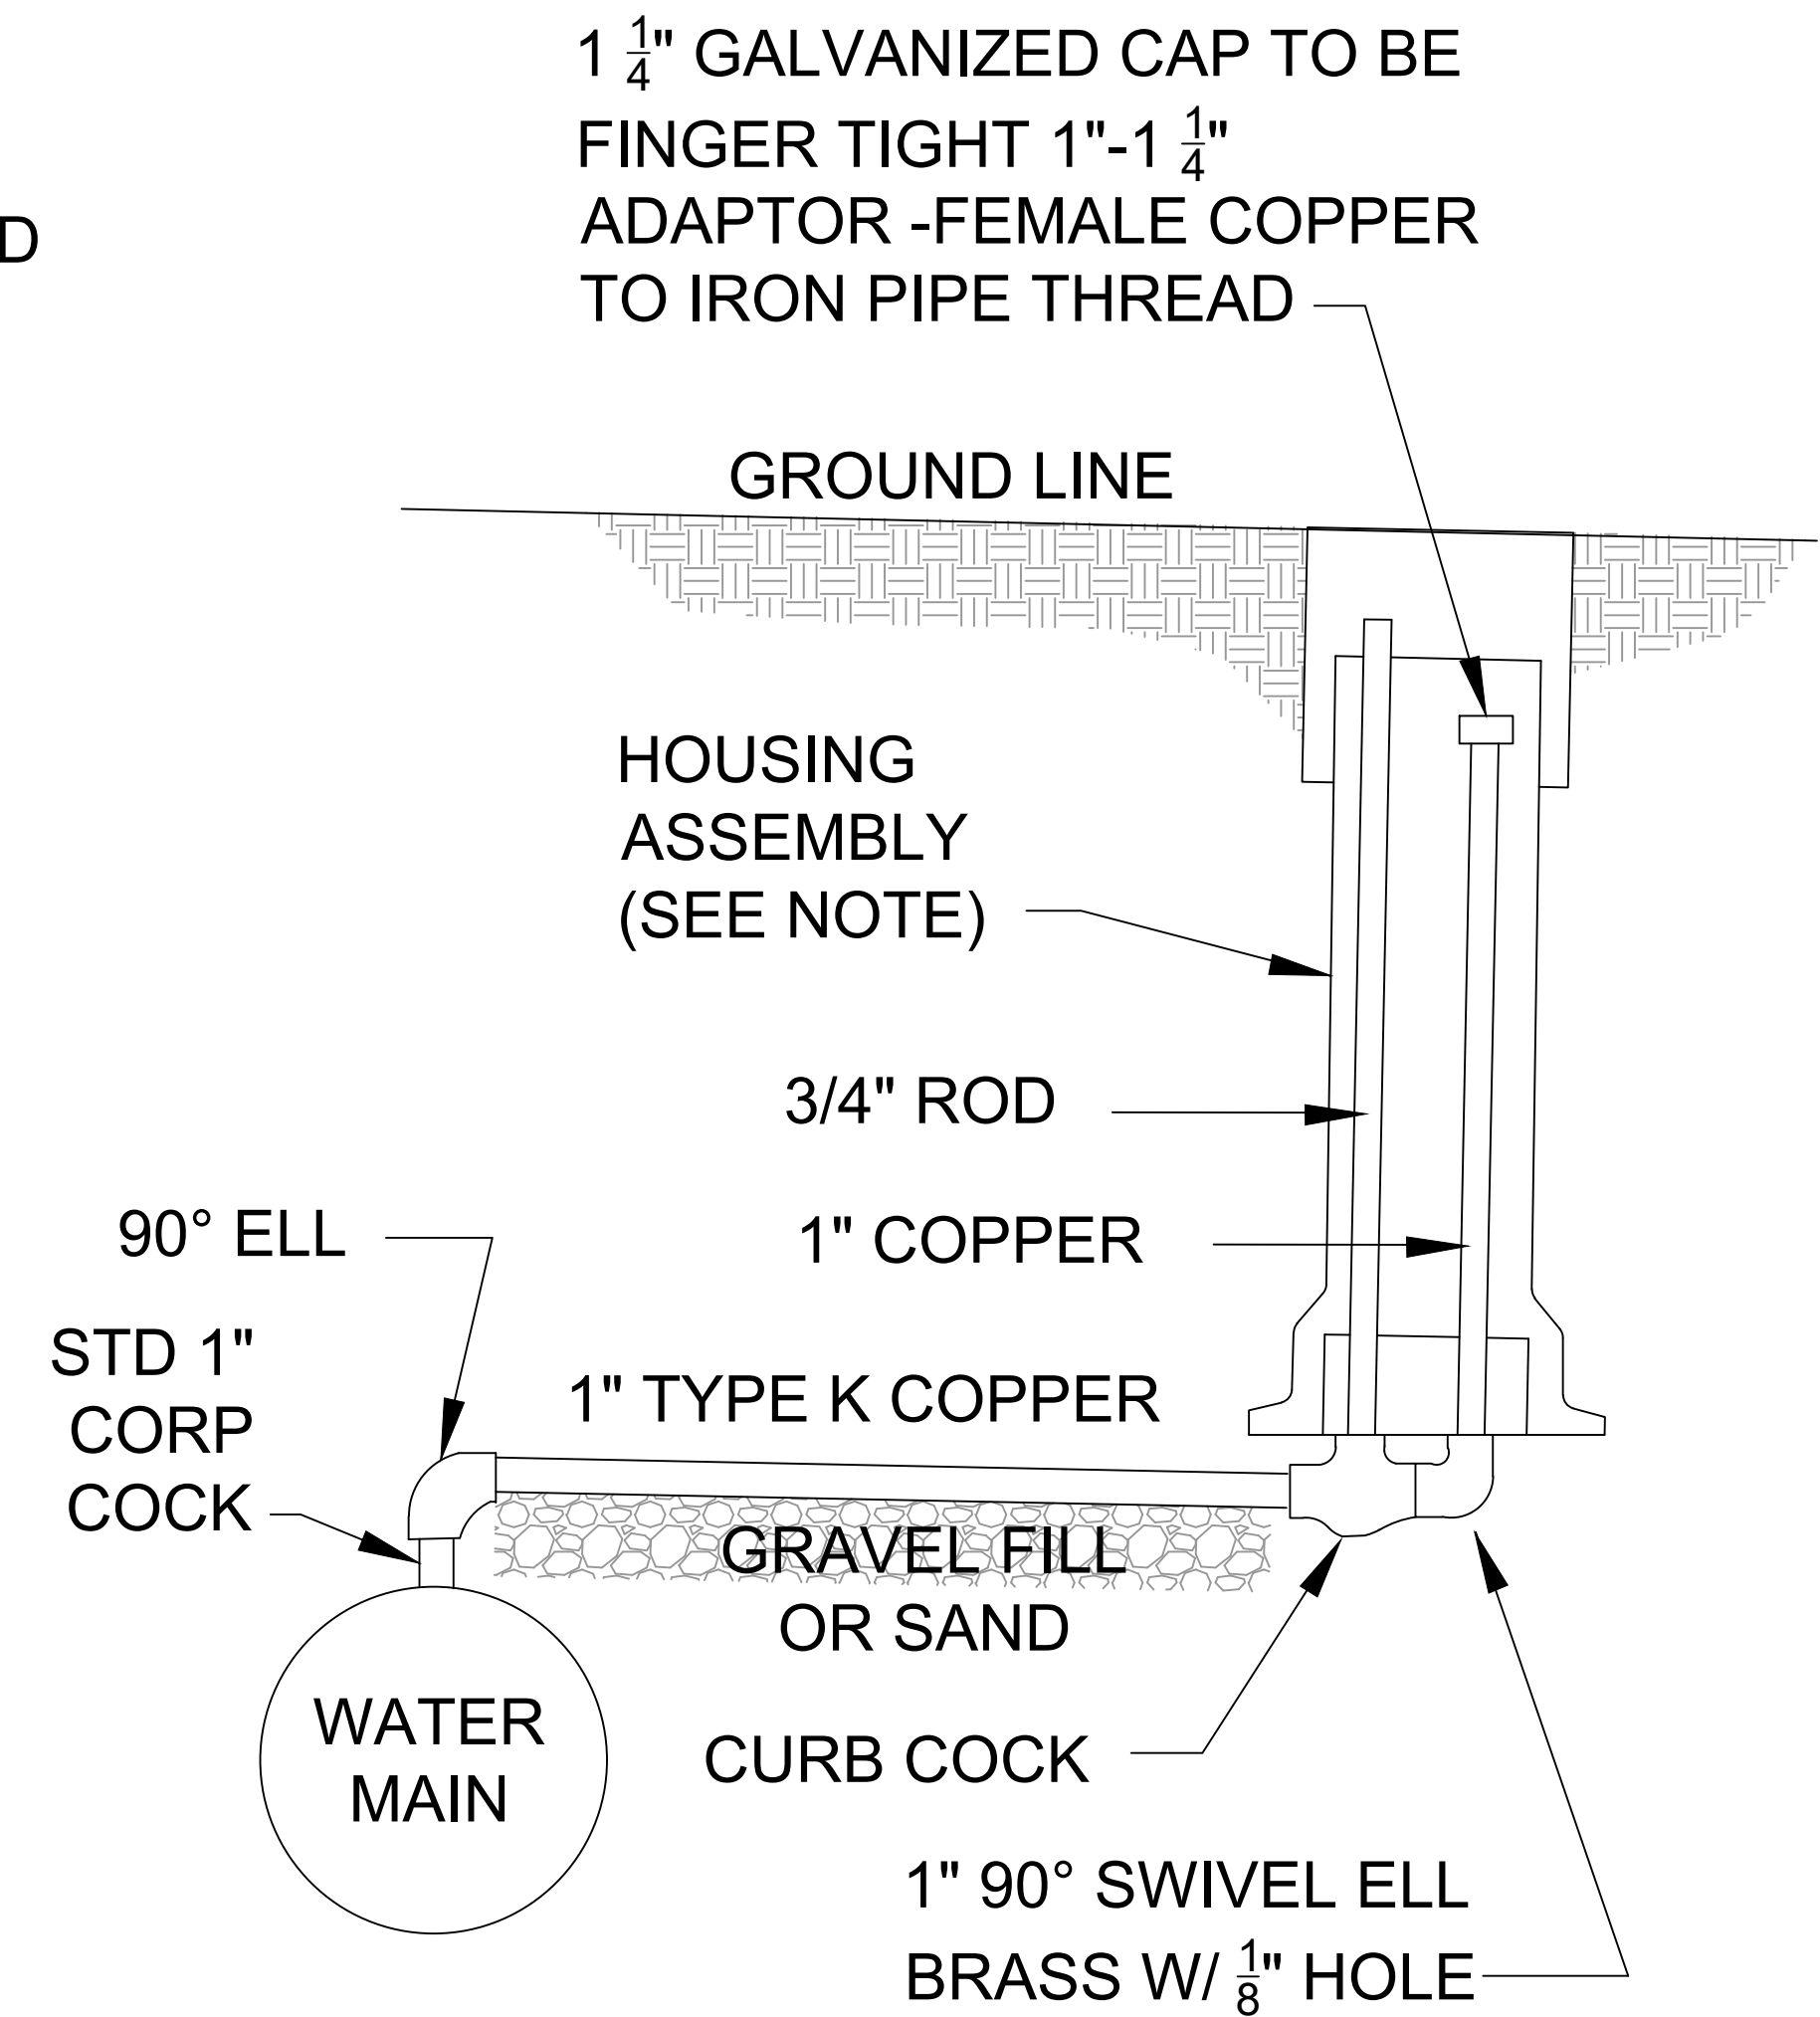

NOTE:  
THE HOUSING ASSEMBLY SHALL BE A VALVE BOX ASSEMBLY IN THE PAVEMENT OR A 24" DIA. METER PIT BEHIND THE CURB.

## 1" MANUAL AIR RELEASE VALVE DETAIL

DO NOT SCALE - USE DIMENSIONS ONLY

CITY OF AKRON  
DEPARTMENT OF PUBLIC SERVICE  
WATER SUPPLY BUREAU

AIR RELEASE DETAILS

REV. DECEMBER 13, 2023

*RAJL*  
UTILITIES ENGINEER

STANDARD CONSTRUCTION  
DRAWING NO. **W-10.0**