


AMERICAN FLOW CONTROL B62B WITH 6" INLET,  
 AMERICAN FLOW CONTROL B84B WITH 8" INLET,  
 EAST JORDAN MODEL CD-250,  
 KENNEDY GUARDIAN MODEL K-81,  
 MUELLER "CENTURIAN" MODEL A423.  
 HYDRANTS SHALL HAVE  
 AKRON THREADS

JOINTS MAY BE MECHANICAL JOINTS WITH  
 RESTRAINED FOLLOER GLAND, PUSH-ON JOINT WITH  
 FIELD LOCK OR FAST GRIP GASKET, OR STAB-FIT  
 DESIGN REQUIRING ONE STAINLESS STEEL FASTENER.

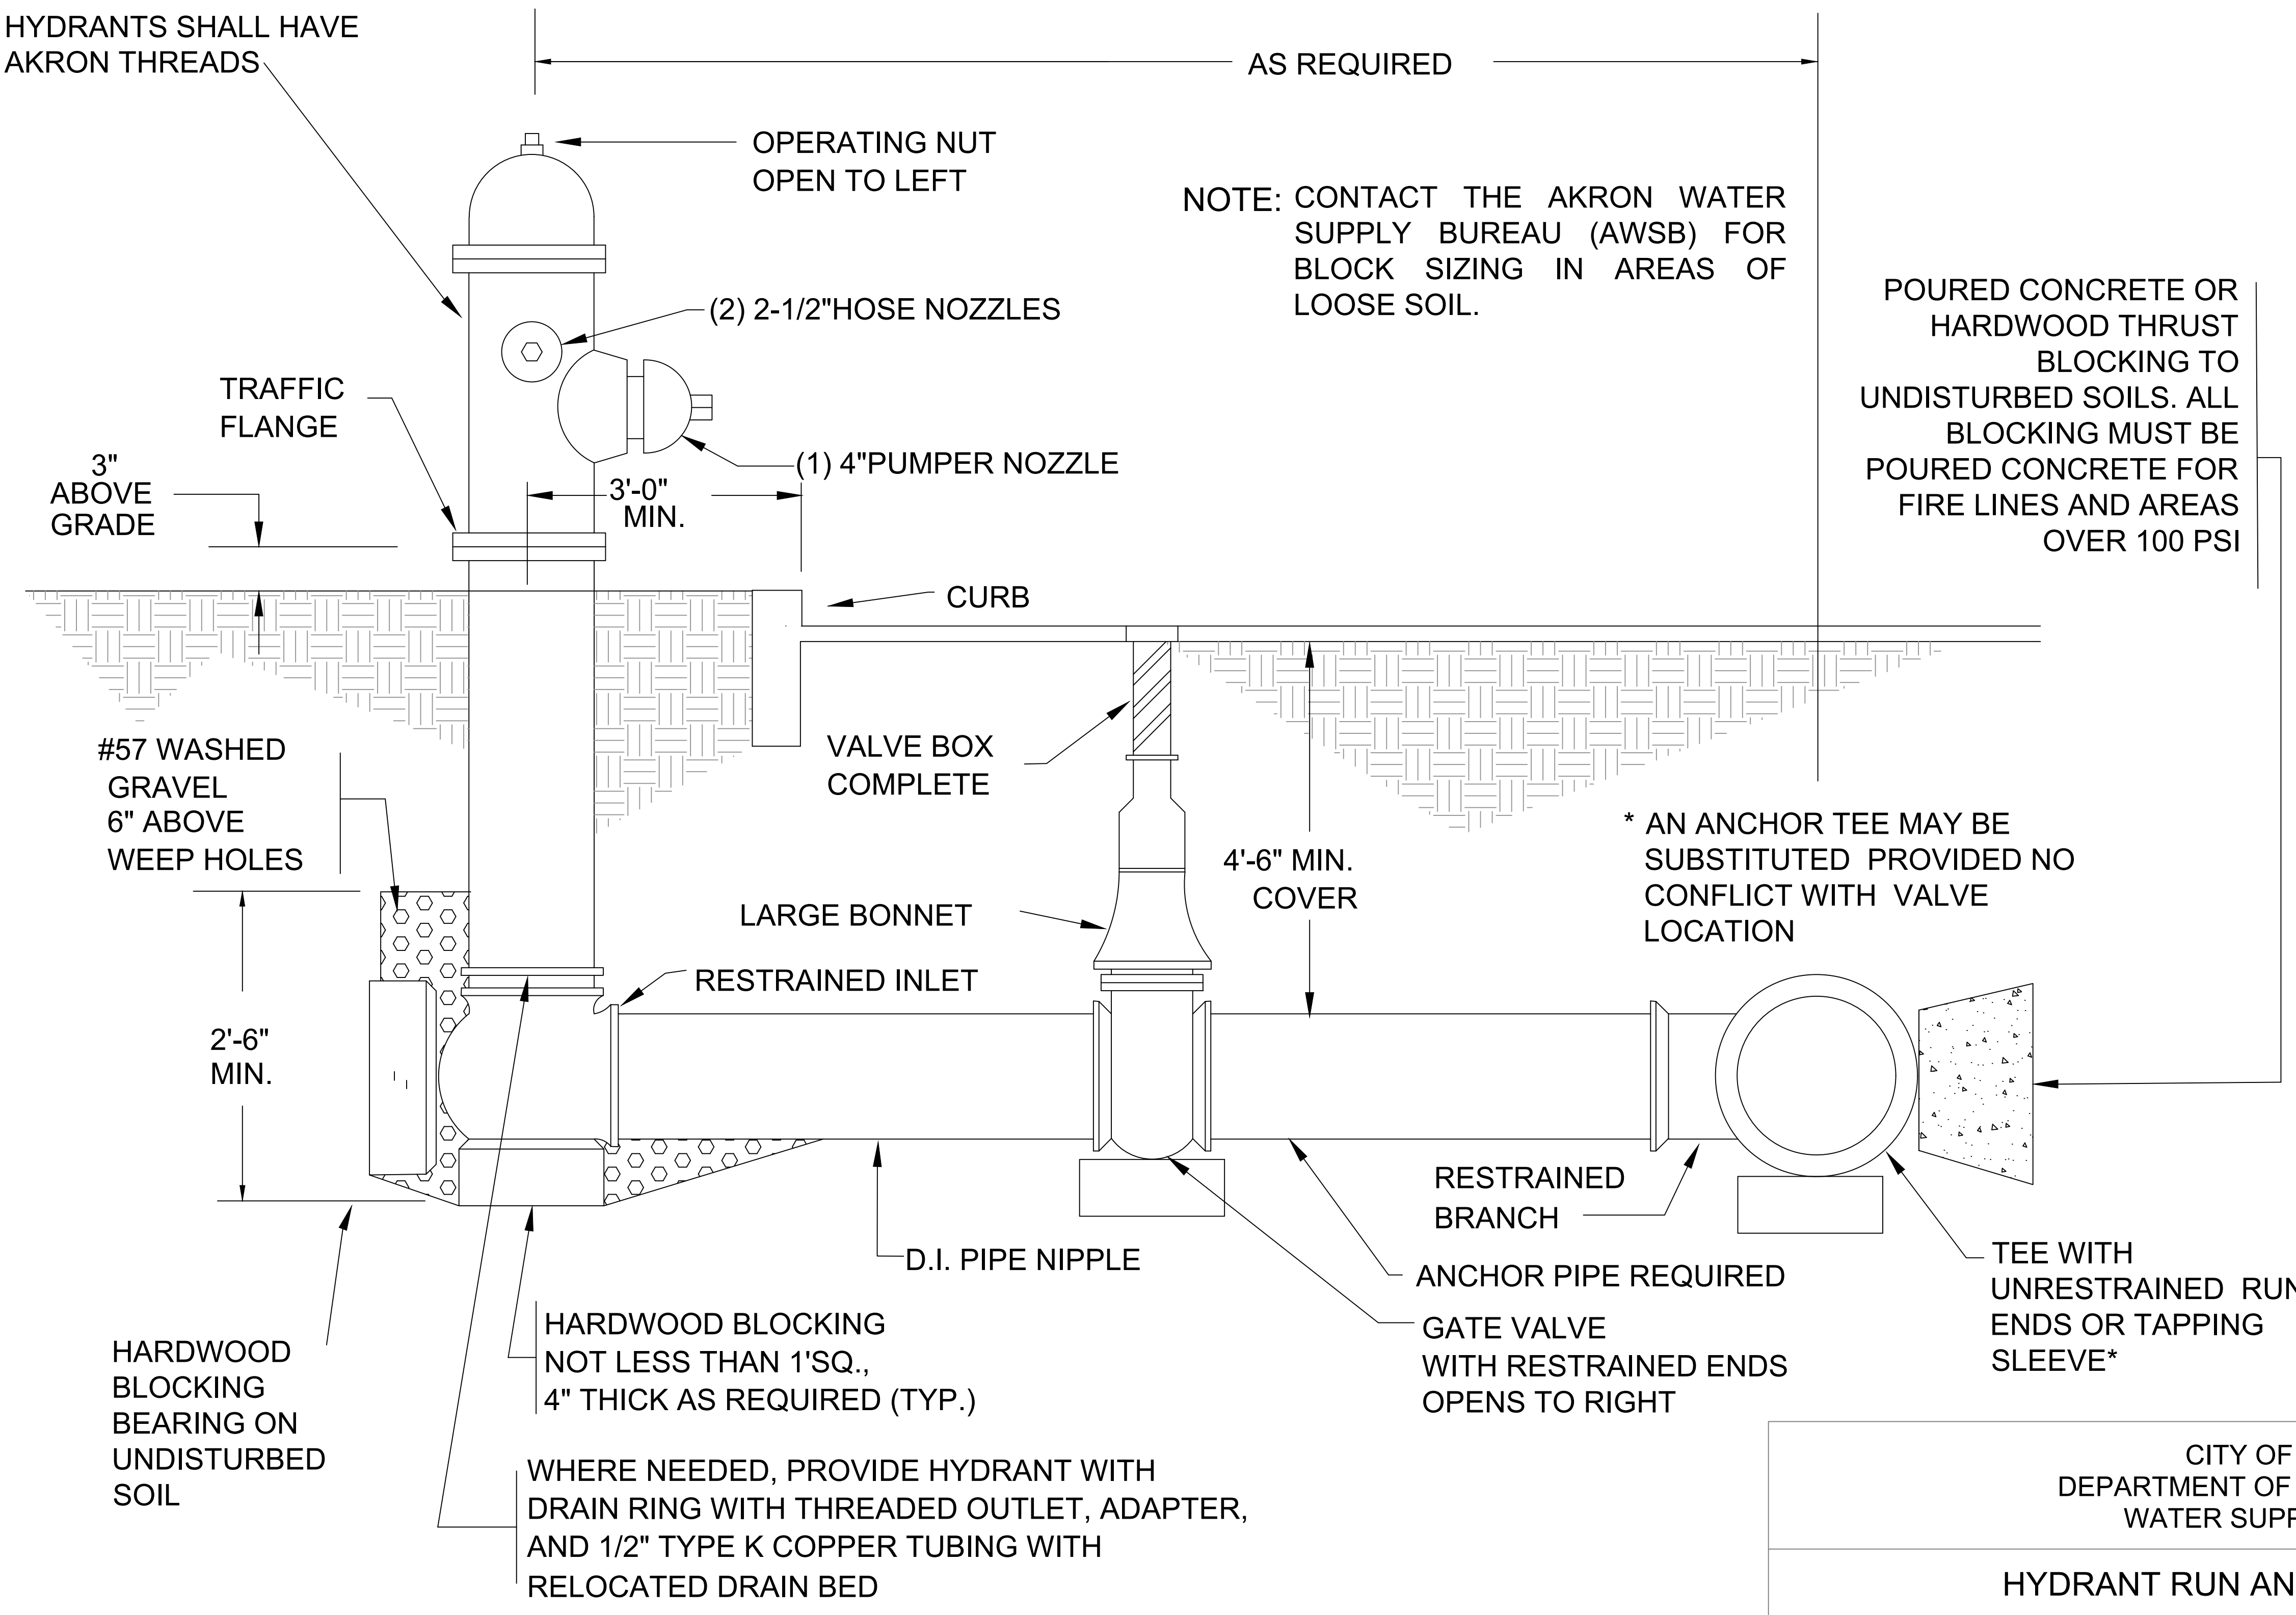

POURED CONCRETE OR  
 HARDWOOD THRUST  
 BLOCKING TO  
 UNDISTURBED SOILS. ALL  
 BLOCKING MUST BE  
 POURED CONCRETE FOR  
 FIRE LINES AND AREAS  
 OVER 100 PSI

\* AN ANCHOR TEE MAY BE  
 SUBSTITUTED PROVIDED NO  
 CONFLICT WITH VALVE  
 LOCATION

DO NOT SCALE - USE DIMENSIONS ONLY

CITY OF AKRON  
 DEPARTMENT OF PUBLIC SERVICE  
 WATER SUPPLY BUREAU

HYDRANT RUN AND INSTALLATION

REV. DECEMBER 13, 2023

AKRON WATER SUPPLY BUREAU STANDARD DRAWINGS FOUND ONLINE AT  
<http://www.akronohio.gov/water>

*RAJL*  
 UTILITIES ENGINEER

STANDARD CONSTRUCTION  
 DRAWING NO.

W-7.0