McNees Wallace & Nurick LLC
100 Pine Street
P.O. Box 1166
Harrisburg, PA 17108-1166

Jeffrey Esch McCombie
Direct Dial: 717.237.5310
Direct Fax: 717.260.1788
jmccombie@mcneeslaw.com

December 15, 2025

VIA FEDERAL EXPRESS AND E-MAIL

Borough Council
Borough of Archbald
400 Church Street
Archbald, PA 18403

RE: Archbald I LLC
Conditional Use Application
Our File No. 87970-0002

Dear Council Members:

We represent Archbald I LLC ("Applicant"), the equitable owner of approximately 400.76 acres of land ("Property") located between Scranton Carbondale Highway (Business Route 6, SR 6006) and Eynon Jermyn Road (SR 1023) in Archbald Borough ("Borough"), Lackawanna County ("County"), Pennsylvania. Applicant intends to redevelop the Property, so as to establish a data center campus, a unified integrated development comprising of 18 data center buildings, along with essential accessory and supporting uses and equipment ("Facility").

As you may recall, at the meeting on November 24, 2025, the Borough Council adopted Ordinance No. 04-2025, which amended the Borough's Zoning Ordinance ("Zoning Ordinance") by creating the Data Center Overlay Zoning District ("DC District"), applying it to certain land, including the Property, and defining and permitting data centers and related uses by conditional use approval, subject to certain standards. Therefore, pursuant to Sections 206, 301, 303, 401 and 402 of the Zoning Ordinance, this Application requests that the Borough Council grant conditional use approval to permit the Facility as a data center campus on the Property in the DC District.

Enclosed in support of this Application are eighteen (18) copies of the following documents:

1. Conditional Use Hearing Application form;
2. Landowners' information;
3. Authorization letters from the landowner(s), permitting Applicant to file this Application;
4. List of potential state, federal and other permits necessary to develop and operate a data center development;
5. Conditional use site plan, prepared by HYLAND Engineering, consisting of five (5) sheets;
6. Conceptual building elevation exhibit, prepared by Ci Design Inc., consisting of five (5) sheets;

7. Conceptual data center campus security plan;

8. Initial noise monitoring study, prepared by ATCS, Inc. of PA;

9. Traffic letter, prepared by Traffic Planning & Design, Inc.; and

10. Narrative demonstrating compliance with applicable requirements of the Zoning Ordinance and entitlement to such conditional use approval.

Also enclosed is a check in the amount of $1,000.00 made payable to the Borough as payment of the filing fee for this request.

We request that a hearing be scheduled on the Application by the Board Council at its earliest convenience. Please advise the undersigned of the date and time of the hearing once it has been scheduled. Also, please confirm if the Borough Planning Commission will be reviewing this Application. It is our understanding that the Borough will provide appropriate public notice and post the Property as required under the Pennsylvania Municipalities Planning Code. We would also request that the Borough arrange to have a stenographer present at the hearing.

Lastly, please send all correspondence related to the Application to the undersigned rather than to Applicant.

We look forward to presenting this request to the Borough Council.

Sincerely,

Jeffery Esch McCombie
MCNEES WALLACE & NURICK LLC

Enclosures

Archbald Borough

400 Church Street, Archbald PA 18403
P: (570) 876-1800 www.archbaldboroughpa.gov

Conditional Use Hearing Application

Application is NOT complete if information is missing. Please provide ALL information.

1. Location/Address of Project: See attached landowner information.
Pin Number: See attached landowner information.

2. Name of Property Owner: See attached landowner information.
Address: See attached landowner information.
Phone: See attached landowner information. Fax: N/A
Email: See attached landowner information.

3. Name of Applicant: Archbald I LLC
Address: Archbald I LLC - 108 Lakeland Avenue, Dover, DE 19901;
McNees Wallace & Nurick LLC - 100 Pine Street, Harrisburg, PA 17101
Phone: (717) 237-5310 Fax: (717) 260-1788
Email: jmccombie@mcneeslaw.com

4. Legal Counsel (if applicable): Jeffrey Esch McCombie, Esq.
Address: McNees Wallace & Nurick LLC, 100 Pine Street, PO Box 1166, Harrisburg, PA 17108-1166
Phone: (717) 237-5310 Fax: (717) 260-1788
Email: jmccombie@mcneeslaw.com

5. Project Description: Data center campus, comprised of 18 data center buildings and accessory and supporting uses and equipment on the Property in the Data Center Overlay. (Ss. 206, 301, 303, 401 and 403) See attached site plan and narrative.

6. Present Land Use: See attached landowner information and narrative. Proposed Land Use: See 5. Project Description above, and attached site plan and narrative.

7. Zoning District: Data Center Overlay. See attached landowner information for base zoning districts.

8. Total Land Area: approx. 17,457,105.6 (sq. ft.) approx. 400.76 (Acres)

9. Are any additional, state, federal or other permits required to operate the proposed use or construct the structure? If yes, please provide the list of permits (and their status) required to operate the proposed use or structure.

See attached list of potential state, federal and other permits necessary to develop and operate a data center development.

The undersigned Applicant hereby requests for a Conditional Use on the basis of the information contained within this application and the attached supporting documents. The Application herby certifies that all information and attachments are true and correct. The Applicant is responsible for all applicable fees.

Applicant Signature Print: J. Esch McCombie Date: 12/15/25
Attorney for Applicant

Please reference Article 14 of the Archbald Borough Zoning Ordinance for the procedure.

X Provide 2 papers copies and one digital copy
X Payment of application fee by check or money order

OFFICIAL USE:

Hearing #_____
Application Received: _____/_____/_____ Fee: $ 1,000.00 Check Number: _____
Hearing Scheduled: _____/_____/_____
Advertisement One: _____/_____/_____ Location: _____
Advertisement Two: _____/_____/_____ Location: _____
Property posted: _____/_____/_____
Hearing Date: _____/_____/_____ **@**_____

LANDOWNER INFORMATION
ARCHBALD I LLC
SCRANTON CARBONDALE HIGHWAY / EYNON JERMYN ROAD

	Parcel ID No.	Address	Owner Name	Mailing Address	Contact Info. (Phone & Email)	General Land Use	Zoning District(s)
1	0840101000103	1001 Eynon Jermyn Road	Domiano Anthony Jr & Domiano Family Tr	1 Domiano Dr, Archbald, PA 18403-1002	(570) 510-5501 tonyjr@tonydomiano.com	Wooded / Open Space	C/LI – majority C-2 – along Scranton Carbondale Highway frontage
2	0840101000102	1 Domiano Drive	Domiano Family Trust	2 Domiano Dr, Archbald, PA 18403-1002	(570) 510-5501 tonyjr@tonydomiano.com	Wooded / Open Space	R-2
3	0840101000106	2 Domiano Drive	Domiano Anthony R Jr & Karen E	2 Domiano Dr, Eynon, PA 18403-1002	(570) 510-5501 tonyjr@tonydomiano.com	Residential	R-2
4	0840101000104	1 Domiano Drive	Domiano Family Trust	2 Domiano Dr, Eynon, PA 18403-1002	(570) 510-5501 tonyjr@tonydomiano.com	Residential	R-2
5	0840101000107	3 Domiano Drive	Campolieto Carla D & Joseph	3 Domiano Dr, Eynon, PA 18403-1002	(570) 876-6900 jcamp@4palaw.com	Residential	R-2
6	0730301000202	Domiano Drive Off Route 6	Nieto Marie Domiano & Gregory	4 Nieto Dr, Eynon, PA 18403-1005	(570) 510-6761 gnieto@nndrilling.com	Wooded / Open Space	C/LI
7	08401020001	Off Route 6	Nieto Marie Domiano & Gregory	4 Nieto Dr, Eynon, PA 18403-1005	570) 510-6761 gnieto@nndrilling.com	Residential	C/LI
8	0730301000204	Off Route 6	Nieto Gregory & Marie Domiano	4 Nieto Dr, Archbald, PA 18403-1005	570) 510-6761 gnieto@nndrilling.com	Wooded / Open Space	C/LI
9	0730301000210	Scranton Carbondale Highway L4	New Venture Realty Inc	3 Export Ln, Archbald, PA 18403-1957	Dave Stafursky (570) 313-0201 dstafursky@stafurskypaving.com	Wooded / Open Space	C/LI
10	0730301000209	Eynon Jermyn Road, Lot 5	New Venture Realty Co	3 Export Ln, Archbald, PA 18403-1957	Dave Stafursky (570) 313-0201 dstafursky@stafurskypaving.com	Wooded / Open Space	C/LI I-2 – majority, along Eynon Jermyn Road
11	0730301000208	Eynon Jermyn Road	New Venture Realty Inc	3 Export Ln, Archbald, PA 18403-1957	Dave Stafursky (570) 313-0201 dstafursky@stafurskypaving.com	Wooded / Open Space	C/LI – majority I-2 – along Eynon Jermyn Road frontage
12	08404010001	State Highway Route 648	New Venture Realty Inc	3 Export Ln, Archbald, PA 18403-1957	Dave Stafursky (570) 313-0201 dstafursky@stafurskypaving.com	Wooded / Open Space	I-2
13	0840401000101	State Highway Route 648	New Venture Realty Inc	3 Export Ln, Archbald, PA 18403-1957	Dave Stafursky (570) 313-0201 dstafursky@stafurskypaving.com	Wooded / Open Space	I-2
14	08404030002	Eynon Jermyn Road	Shnipes John J Jr & Jamie Lynn	115 Simpson St, Eynon, PA 18403-1217	(570) 677-8450 jshnipes@comcast.net	Wooded / Open Space	I-2

Archbald I LLC
c/o Esch McCombie, Esq.
McNees Wallace & Nurick LLC
100 Pine Street
Harrisburg, PA 17101

Dear Mr. McCombie:

Archbald I LLC is hereby authorized to file any necessary zoning, land development and permit applications with Archbald Borough for any approvals required for the development and construction of a data center campus on the property identified as Parcel Identification No. 0840101000103 and located at 1001 Eynon Jermyn Road, Archbald, Pennsylvania.

Sincerely,

By: _____
Name: Anthony Domiano, Jr.

DAMIANO FAMILY TRUST

By: _____
Name: Anthony Domiano
Title: trustee

Archbald I LLC
c/o Esch McCombie, Esq.
McNees Wallace & Nurick LLC
100 Pine Street
Harrisburg, PA 17101

Dear Mr. McCombie:

Archbald I LLC is hereby authorized to file any necessary zoning, land development and permit applications with Archbald Borough for any approvals required for the development and construction of a data center campus on the property identified as Parcel Identification Nos. 0840101000102 and 0840101000104 and located at 1 Domiano Drive, Archbald, Pennsylvania.

Sincerely,

DAMIANO FAMILY TRUST

By: _____
Name: Anthony Domiano
Title: trustee

Archbald I LLC
c/o Esch McCombie, Esq.
McNees Wallace & Nurick LLC
100 Pine Street
Harrisburg, PA 17101

Dear Mr. McCombie:

Archbald I LLC is hereby authorized to file any necessary zoning, land development and permit applications with Archbald Borough for any approvals required for the development and construction of a data center campus on the property identified as Parcel Identification No. 0840101000106 and located at 2 Domiano Drive, Archbald, Pennsylvania.

Sincerely,

By: _____
Name: Anthony R. Domiano, Jr.

By: Karen E. Domiano
Name: Karen E. Domiano

Archbald I LLC
c/o Esch McCombie, Esq.
McNees Wallace & Nurick LLC
100 Pine Street
Harrisburg, PA 17101

Dear Mr. McCombie:

Archbald I LLC is hereby authorized to file any necessary zoning, land development and permit applications with Archbald Borough for any approvals required for the development and construction of a data center campus on the property identified as Parcel Identification No. 0840101000107 and located at 3 Domiano Drive, Archbald, Pennsylvania.

Sincerely,

By: _____
Name: Carla D. Campolieto

By: _____
Name: Joseph Campolieto

Archbald I LLC
c/o Esch McCombie, Esq.
McNees Wallace & Nurick LLC
100 Pine Street
Harrisburg, PA 17101

Dear Mr. McCombie:

Archbald I LLC is hereby authorized to file any necessary zoning, land development and permit applications with Archbald Borough for any approvals required for the development and construction of a data center campus on the property identified as Parcel Identification Nos.: (i) 0730301000202; (ii) 08401020001; and (iii) 0730301000204 and located at Domiano Drive Off Route 6, Archbald, Pennsylvania.

Sincerely,

By: _____
Name: Marie Domiano Nieto

By: _____
Name: Gregory Nieto

Archbald I LLC
c/o Esch McCombie, Esq.
McNees Wallace & Nurick LLC
100 Pine Street
Harrisburg, PA 17101

Dear Mr. McCombie:

Archbald I LLC is hereby authorized to file any necessary zoning, land development and permit applications with Archbald Borough for any approvals required for the development and construction of a data center campus on the property identified as: (i) Parcel Identification No. 0730301000210 and located at Scranton Carbondale Highway L4, Archbald, Pennsylvania; (ii) Parcel Identification No. 0730301000208 and located at Eynon Jermyn Road, Archbald, Pennsylvania; and (iii) Parcel Identification Nos. 08404010001 and 0840401000101 and located at State Highway Route 648, Archbald, Pennsylvania.

Sincerely,

NEW VENTURE REALTY, INC.

By: _____
Name: David Stratton
Title: President

Archbald I LLC
c/o Esch McCombie, Esq.
McNees Wallace & Nurick LLC
100 Pine Street
Harrisburg, PA 17101

Dear Mr. McCombie:

Archbald I LLC is hereby authorized to file any necessary zoning, land development and permit applications with Archbald Borough for any approvals required for the development and construction of a data center campus on the property identified as Parcel Identification No. 0730301000209 and located at Eynon Jermyn Road, Lot 5, Archbald, Pennsylvania.

Sincerely,

NEW VENTURE REALTY, INC.[1]

By: _____
Name:
Title:

[1] The deeded owner of the property is New Venture Realty, Inc. The Lackawanna County Tax Assessor's Office lists the owner New Venture Realty, Co., which is incorrect.

Archbald I LLC
c/o Esch McCombie, Esq.
McNees Wallace & Nurick LLC
100 Pine Street
Harrisburg, PA 17101

Dear Mr. McCombie:

Archbald I LLC is hereby authorized to file any necessary zoning, land development and permit applications with Archbald Borough for any approvals required for the development and construction of a data center campus on the property identified as Parcel Identification No. 08404030002 and located at Eynon Jermyn Road, Archbald, Pennsylvania.

Sincerely,

By: _____
Name: John J. Shnipes, Jr.

By: _____
Name: Jamie Lynn Shnipes

LIST OF POTENTIAL STATE, FEDERAL AND OTHER PERMITS TO DEVELOP AND OPERATE A DATA CENTER[1]
ARCHBALD I LLC
SCRANTON CARBONDALE HIGHWAY / EYNON JERMYN ROAD

- **Conditional Use Approval:**
    - Review: Requires review and recommendation at a public meeting of the Borough Planning Commission
    - Action: Requires action by the Borough Council at a public meeting
- **Traffic Impact Study Approval**:
    - Review and Action: Requires administrative review and approval by PennDOT
- **Preliminary/Final Land Development Plan Approval**:
    - Review: Requires review and recommendation at a public meeting of the Borough Planning Commission
    - Action: Requires action by the Borough Council at a public meeting
- **General or Individual NPDES Construction Permit Approval**:
    - Review and Action: Requires administrative review and approval by the County Conservation District / PADEP
- **General or Individual NPDES Industrial Stormwater Permit Approval or No Exposure Certification (if applicable)**:
    - Review and Action: Requires administrative review and approval by PADEP.
- **Water Obstruction and Encroachment Permit / Joint 404 Permit Approval**:
    - Review and Action: Requires administrative review and approval by PADEP (Chapter 105 water obstruction and encroachment) and U.S. Army Corps of Engineers (Section 404 permit)
- **Sewage Facilities Planning Module Approval or Waiver**:
    - Review and Action: Requires administrative review and approval by the Borough and PADEP (module approval) or PADEP (waiver)
- **Air Quality Plan / Operating Permit Approval:**
    - Review and Action: Requires administrative review and approval by PADEP
- **Highway Occupancy Permit Approval**:
    - Review and Action: Requires administrative review and approval by PennDOT
- **Traffic Signal Modification Permit Approval (if required)**:

[1] See Item #9 of Conditional Use Hearing Application form

- Review and Action: Requires administrative review and approval by PennDOT

- **Utility System Design Approvals**:
  - Review and Action: Requires administrative review and approval by various utility companies:
    - Electric
    - Sewer
    - Water
    - Gas (if applicable)

- **Zoning Permit Approval**:
  - Review and Action: Requires administrative review and approval by the Borough Zoning Officer

- **Building Permit Approval**:
  - Review and Action: Requires administrative review and approval by the Borough Building Code Officer

- **Occupancy Permit Approval**:
  - Review and Action: Requires administrative review and approval by the Borough Building Code Officer

EXISTING CONDITIONS PLAN LEGEND

- PROPERTY LINE
- EXISTING EASEMENT
- (4) PARCEL IDENTIFIER

EXISTING CONDITIONS PLAN NOTES

1. THE PENNDOT FACILITY IS NOT INCLUDED AS PART OF THE PROPOSED DEVELOPMENT.

GRAPHIC SCALE
250 125 0 250
SCALE IN FEET

HYLAND Engineering
212 South Front Street
Wormleysburg, PA 17043
(717) 723-3326

CONDITIONAL USE APPLICATION PLAN

ARCHBALD DATA CENTERS
SCRANTON CARBONDALE HIGHWAY, ARCHBALD, PA 18403
ARCHBALD BOROUGH, LACKAWANNA COUNTY

REVISIONS
No. Date Description / Reason

Designer	C.J.S.
Drafter	C.J.S.
Reviewer	A.J.D.
Scale	1"=250'
Project No.	220626
Date	12/8/2025

CAD File: SP220626_P01-CU

Sheet Title
EXISTING CONDITIONS PLAN

Sheet Number
1

I:\SP\220626 - KYLE FELTY, C:\USERS\KYLEFELTY.YODA\ACDOCS\HYLAND ENGINEERING INC-220626 - ARCHBALD DC\PROJECT FILES\CONCEPTUAL\SP220626_P01-CU.DWG 8.5X11

ZONING INFORMATION

LOCATION: ARCHBALD BOROUGH, LACKAWANNA COUNTY

ZONE: R-2 (MEDIUM DENSITY RESIDENTIAL); C/ LI (COMMERCIAL/LIGHT INDUSTRIAL); I-2 (GENERAL INDUSTRIAL); C-2 (GENERAL COMMERCIAL); DC (DATA CENTER OVERLAY)

USE: DATA CENTER CAMPUS (CONDITIONAL USE)

ITEM #	ITEM	REQUIREMENTS	PROPOSED	ORDINANCE SECTION	VARIANCE
1	MINIMUM LOT AREA	120 ACRES	400.76 ACRES	507.1	NO
2	MINIMUM LOT WIDTH (AT BUILDING SETBACK LINE)	300 FEET	> 300 FEET	507.2	NO
3	MINIMUM FRONT, SIDE, REAR BUILDING SETBACK	200 FEET OR THE HEIGHT OF THE BUILDING, WHICHEVER IS GREATER; 300 FEET ABUTTING ANY PROPERTY IN R-1, R-2, OR R-3 ZONING DISTRICT, EXCEPT LOTS IN DC OVERLAY AND/OR OWNED BY DATA CENTER OPERATOR	200 FEET 300 FEET ABUTTING R-1. R-2, R-3 ZONING DISTRICTS	507.4.a	NO
3	MINIMUM ACCESSORY BUILDING SETBACK	50 FEET OR THE HEIGHT OF THE BUILDING, WHICHEVER IS GREATER; EXCEPT 1-STORY SECURITY SHEDS OR STRUCTURES MAY BE SETBACK 25 FEET	50 FEET	507.4.b	NO
4	MAXIMUM BUILDING HEIGHT	90 FEET 50 FEET FOR ACCESSORY STRUCTURE*	90 FEET 50 FEET FOR ACCESSORY STRUCTURE*	507.3	NO
5	MAXIMUM BUILDING COVERAGE	50 PERCENT	< 25 PERCENT	507.5	NO
6	MAXIMUM IMPERVIOUS COVERAGE	75 PERCENT	< 40 PERCENT	507.6	NO
7	MINIMUM LANDSCAPE COVERAGE	10 PERCENT	>10 PERCENT	1304.A	NO
8	MINIMUM BUFFER YARD	50 FEET (NO BASINS)	50 FEET (NO BASINS)	507.8	NO

* DATA CENTER ACCESSORY USES SUCH AS WATER AND COOLING TOWERS MAY BE HIGHER THAN 90 FEET UPON PROOF THAT SUCH ADDITIONAL HEIGHT IS REQUIRED FOR REQUIRED WATER PRESSURE AND FIRE SUPPRESSION SYSTEMS.

PARKING INFORMATION

ITEM #	ITEM	REQUIREMENTS	PROPOSED	ORDINANCE SECTION	VARIANCE
1	PARKING REQUIRED	DATA CENTER: 1 SPACE PER EVERY 8,000 S.F. OF FLOOR AREA TO BE ACCESSED REGULARLY BY EMPLOYEES OR 1 SPACE PER EMPLOYEE ON THE LARGEST SHIFT; WHICHEVER IS LESSER 7,850 S.F FOR FLOOR AREA REGULARLY ACCESSED BY EMPLOYEES = 2 PARKING SPACES REQUIRED PER BUILDING TOTAL REQUIRED: 36 TOTAL SPACES	40 PARKING SPACES PER BUILDING 720 TOTAL PARKING SPACES	507.4(62)-13	NO
2	MINIMUM ADA PARKING SPACES REQUIRED	26-50 PARKING SPACES = 2 ADA SPACES PER BUILDING 36 TOTAL ADA SPACES	2 ADA SPACES PER BUILDING 36 TOTAL ADA PARKING SPACES	1103.G(1)	NO
3	MINIMUM PARKING DIMENSIONS	9 FEET X 18 FEET	9 FEET X 18 FEET	1103.B(1)	NO
4	MINIMUM DRIVE AISLE WIDTH	24 FEET – 2-WAY 20 FEET – 1-WAY	25 FEET, 26 FEET, 30 FEET – 2-WAY	1103.C	NO
5	MINIMUM PARKING SETBACK	BUFFER YARD (50 FEET)	BUFFER YARD (50 FEET)	507.8(A)	NO
6	DRIVEWAY WIDTH	MINIMUM – 20 FEET MAXIMUM – 28 FEET*	VARIABLE, < 20 FEET	1103.D	NO
7	OFF-STREET LOADING REQUIREMENT	1 LOADING SPACE PER BUILDING	2 LOADING SPACES PER BUILDING 36 TOTAL LOADING SPACES	602.62(14)	NO
8	MINIMUM PARKING LOT LANDSCAPING	ONE SHADE TREE PER 10 PARKING SPACES = 4 TREES PER PARKING LOT	4 SHADE TREES PER BUILDING 72 TOTAL SHADE TREES	1304.B	NO

* THIS STANDARD MAY BE REVISED WHERE WHERE PENNDOT REQUIRES A DIFFERENT STANDARD FOR AN ENTRANCE TO A STATE ROAD, OR WHERE THE APPLICANT DEMONSTRATES TO THE ZONING OFFICER THAT A WIDER WIDTH IS NEEDED FOR TRUCK ACCESS.

SITE PLAN LEGEND

- PROPERTY LINE
- EXISTING EASEMENT
- BUILDING SETBACK LINE
- BUFFER YARD SETBACK LINE
- PROPOSED FENCE
- APPROXIMATE ZONING DISTRICT BOUNDARY LINE
- STANDARD DUTY BITUMINOUS ASPHALT PAVEMENT

SITE PLAN NOTES

1. THE PROPOSED SWITCH STATION WILL BE OWNED AND OPERATED BY THE ELECTRIC PROVIDER.
2. THE PENNDOT FACILITY IS NOT INCLUDED AS PART OF THE PROPOSED DEVELOPMENT.

GRAPHIC SCALE
250 125 0 250
SCALE IN FEET

HYLAND Engineering
212 South Front Street
Wormleysburg, PA 17043
(717) 723-3326

CONDITIONAL USE APPLICATION PLAN

ARCHBALD DATA CENTERS
SCRANTON CARBONDALE HIGHWAY, ARCHBALD, PA 18403
ARCHBALD BOROUGH, LACKAWANNA COUNTY

REVISIONS

No.	Date	Description / Reason

Designer	C.J.S.
Drafter	C.J.S.
Reviewer	A.J.D.
Scale	1"=250'
Project No.	220626
Date	12/8/2025
CAD File:	SP220626_P01-CU

Sheet Title

CONCEPT PLAN

Sheet Number

2

I:\P\220626_ARCHBALD\P_C:\USERS\KYLEFELTY\DOCACODOCS\KYLEFELTY\DOCACODOCS\KYLFELTY.PLANS ENGINEERING INC-220626 - ARCHBALD DC\PROJECT FILES\CONCEPT PLAN\SP220626_P01-CU.DWG, 8.5in x

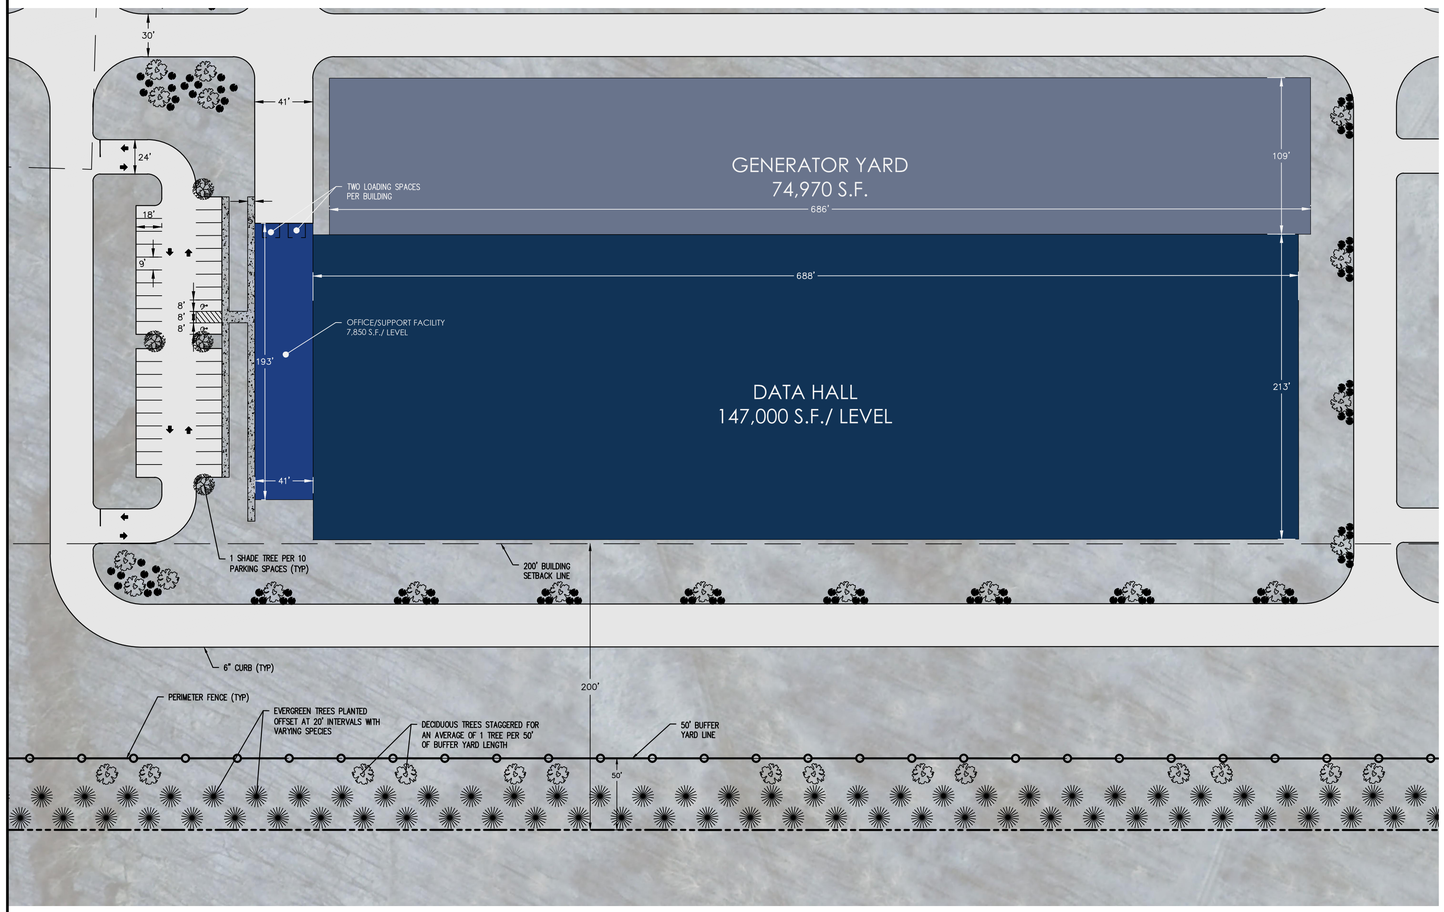

TYPICAL BUILDING AND BUFFER YARD PLANTINGS

GRAPHIC SCALE
50 25 0 50
SCALE IN FEET

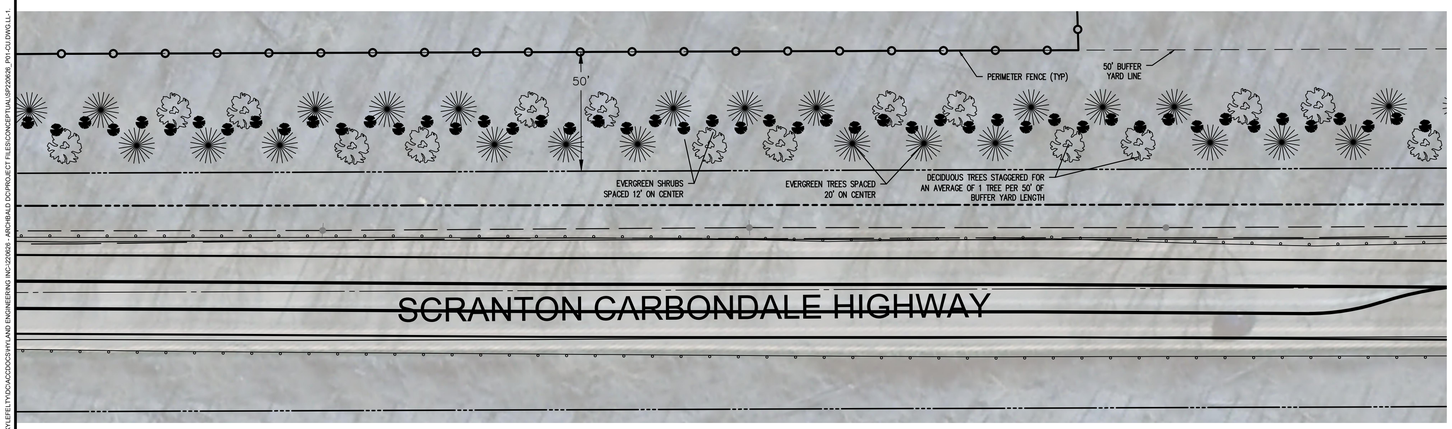

ROADWAY BERM AND BUFFER YARD PLANTINGS

GRAPHIC SCALE
30 25 0 30
SCALE IN FEET

LANDSCAPING INFORMATION

ITEM #	ITEM	REQUIREMENTS	PROPOSED	ORDINANCE SECTION	VARIANCE
1	BUFFER YARD	50 FOOT BUFFER YARD DEPTH ALONG ALL PROPERTY LINES	50 FOOT BUFFER YARD DEPTH ALONG ALL PROPERTY LINES	507.8.A&B	NO
2	LANDSCAPE BERMS	REQUIRED FOR LANDS ADJACENT TO R-1, R-2 AND R-3 ZONING, ALONG ARTERIAL OR COLLECTOR ROADWAYS WHERE DATA CENTERS EXCEED 50 FEET IN HEIGHT, AND WHERE DATA CENTER EQUIPMENT WILL BE VISIBLE FROM PUBLIC RIGHT-OF-WAYS – BERMS SHALL BE 6 FEET IN HEIGHT	REFER TO CROSS-SECTION AND TYPICAL PLANTING DETAIL	507.9.A(1-3)	NO
3	BERM PLANTINGS	BERMS SHALL HAVE A BASE MINIMUM WIDTH OF 12 FEET. TREES SHALL BE PLANTED AT 20 FEET ON CENTER. SHRUBS SHALL BE PLANTED AT 12 FEET ON CENTER.	REFER TO CROSS-SECTION AND TYPICAL PLANTING DETAIL	507.9.B-D	NO

SITE PLAN LEGEND

PROPERTY LINE

BUFFER YARD SETBACK LINE

PROPOSED EVERGREEN TREE

PROPOSED DECIDUOUS TREE

LANDSCAPE PLAN NOTES

1. EVERGREEN TREES FOR SCREENING SHALL BE A MIXTURE OF EASTERN REDCEDAR (JUNIPERUS VIRNIANA), BLUE SPRUCE (PICEA PUNGENS) AND EASTERN HEMLOCK (PINUS STROBUS).
2. DECIDUOUS SHADE TREES SHALL BE A MIXTURE OF HEDGE MAPLE (ACER CAMPESTRE), PURPLEBLOW MAPLE (ACER TRUNCATUM) AND RED OAK (QUERCUS RUBRA).
3. STREET TREES ARE INCLUDED AS PART OF THE BUFFER YARD PLANTING REQUIREMENTS.
4. LANDSCAPING BERMS SHALL NOT BE PROPOSED WHERE EXISTING VEGETATION AND TOPOGRAPHY CREATES A NATURAL SCREENING PER SECTION 507.9.A & 507.9.L(1)



TYPICAL BERM PLANTING DETAIL

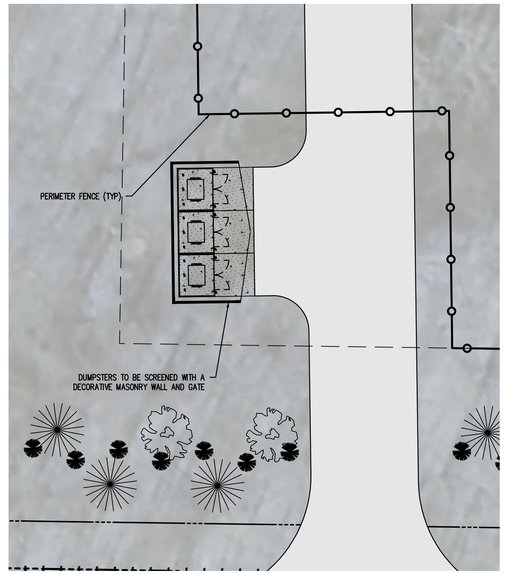

TYPICAL DUMPSTER LOCATION

GRAPHIC SCALE
20 10 0 20
SCALE IN FEET

HYLAND Engineering
212 South Front Street
Wormleysburg, PA 17043
(717) 723-3326

CONDITIONAL USE APPLICATION PLAN

ARCHBALD DATA CENTERS
SCRANTON CARBONDALE HIGHWAY, ARCHBALD, PA 18403
ARCHBALD BOROUGH, LACKAWANNA COUNTY

REVISIONS

No.	Date	Description / Reason

Designer	C.J.S.
Drafter	C.J.S.
Reviewer	A.J.D.
Scale	AS NOTED
Project No.	220626
Date	12/8/2025
CAD File:	SP220626_P01-CU

Sheet Title

SITE & LANDSCAPING PLAN

Sheet Number

3

10/17/2025, KYLEFELTY, C:\USERS\KYLEFELTY\DOCUMENTS\HYLAND\CONSULTING\ARCHBALD DC\PROJECT FILES\CONSTRUCTION\DWG\SP220626_P01-CU.DWG, LL-1

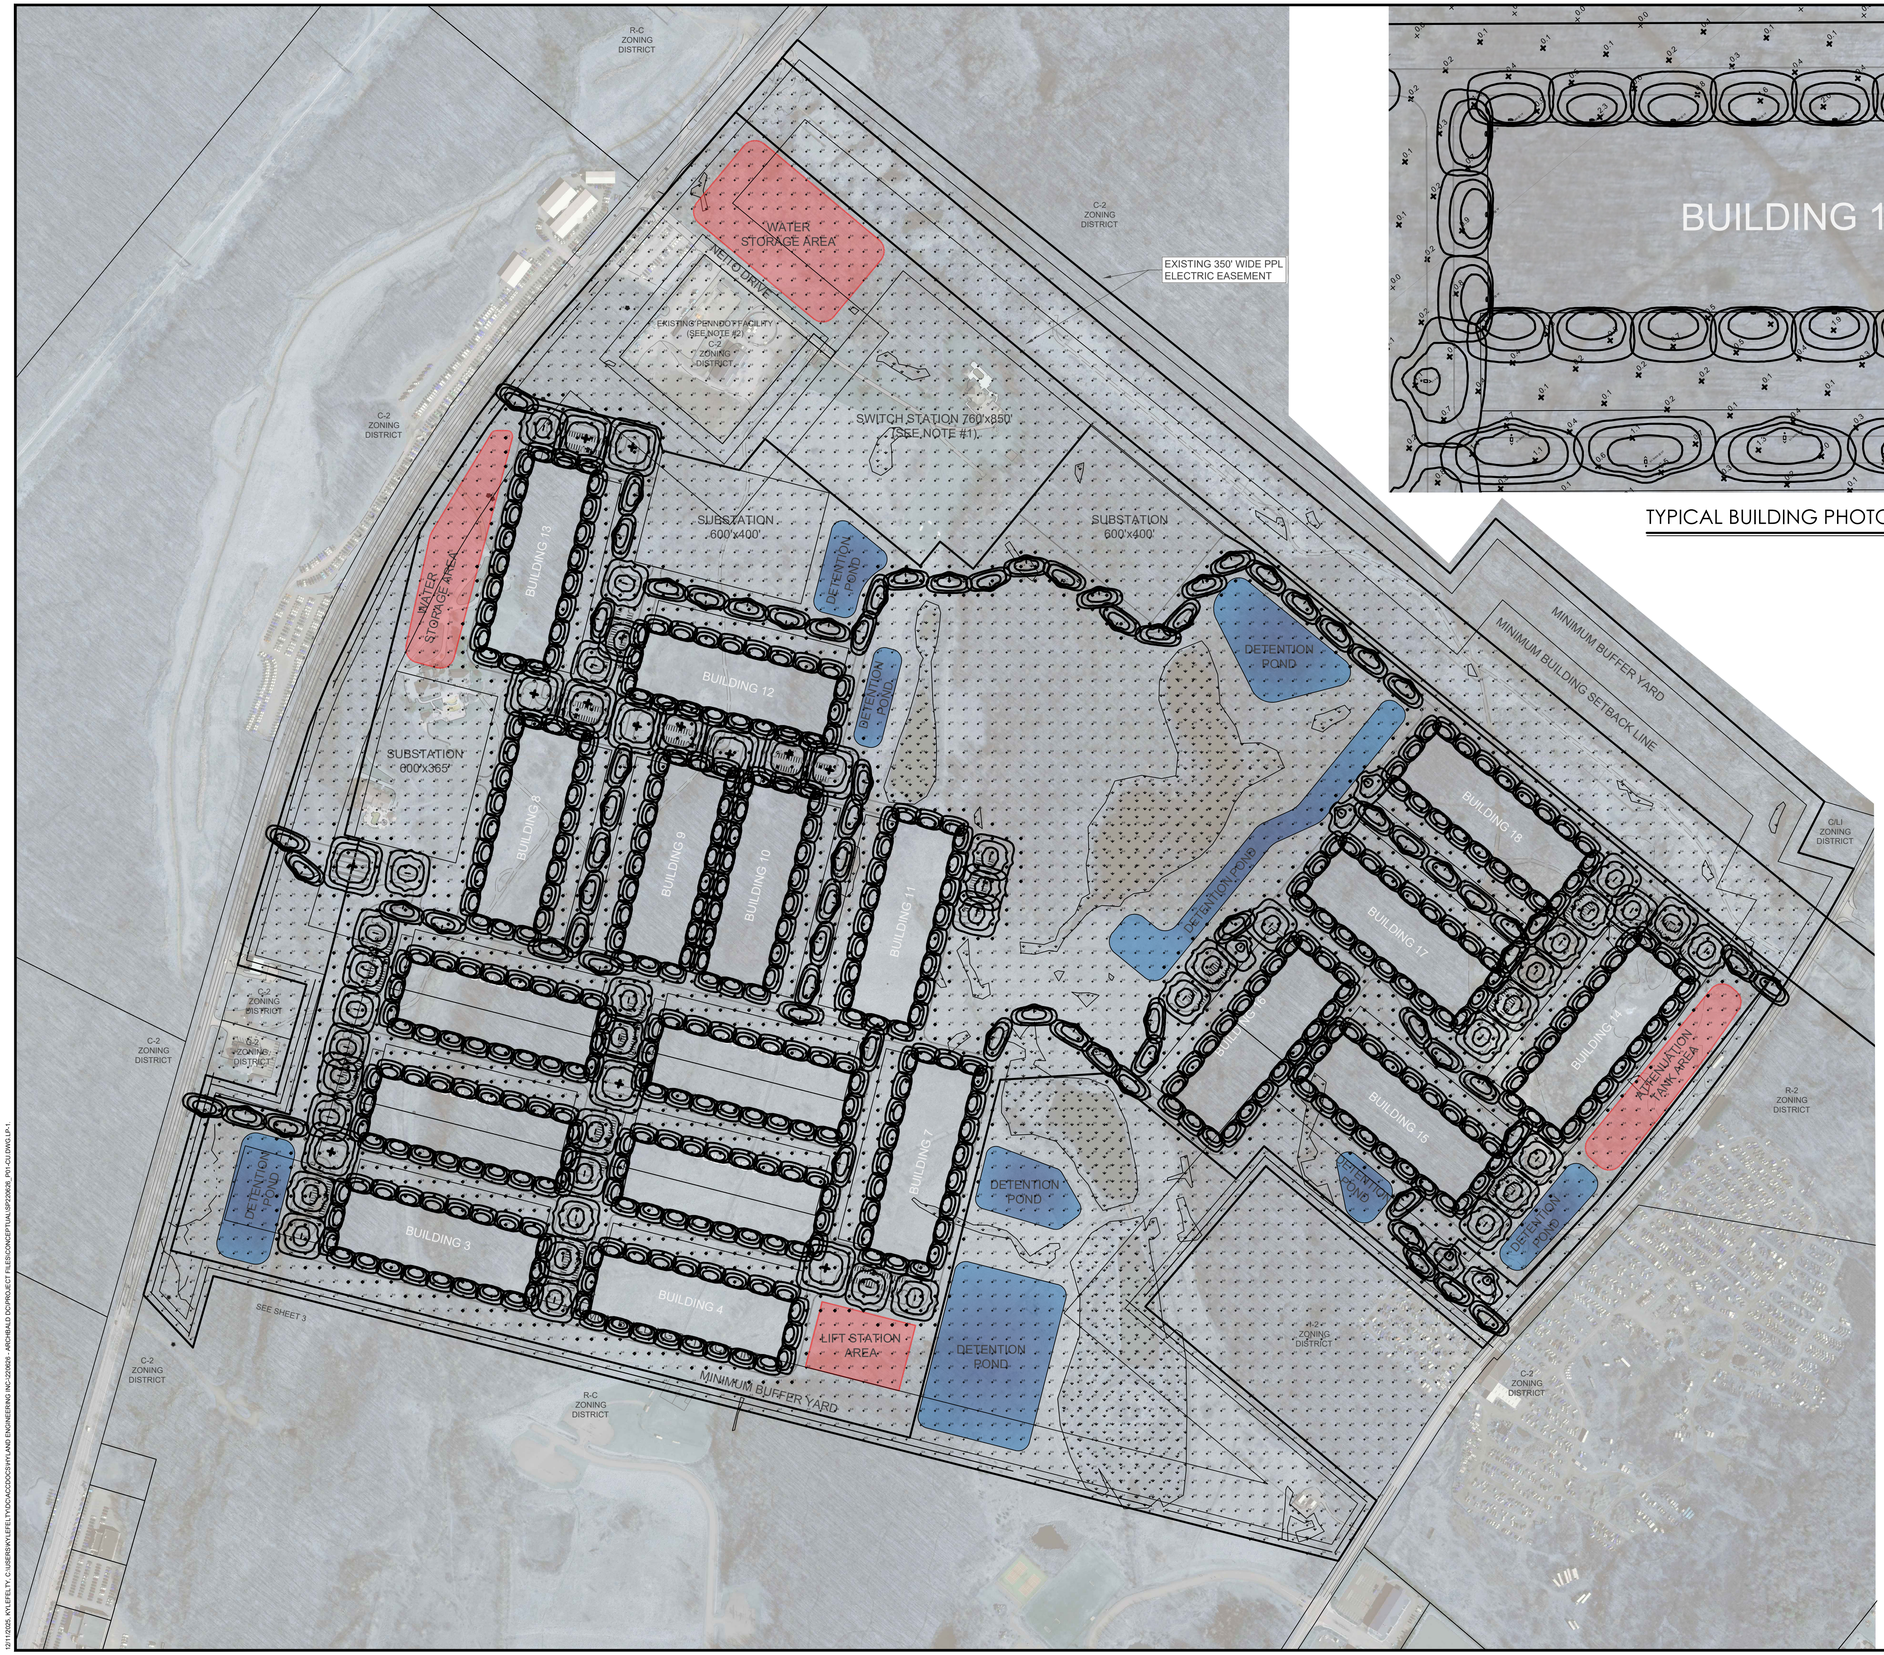

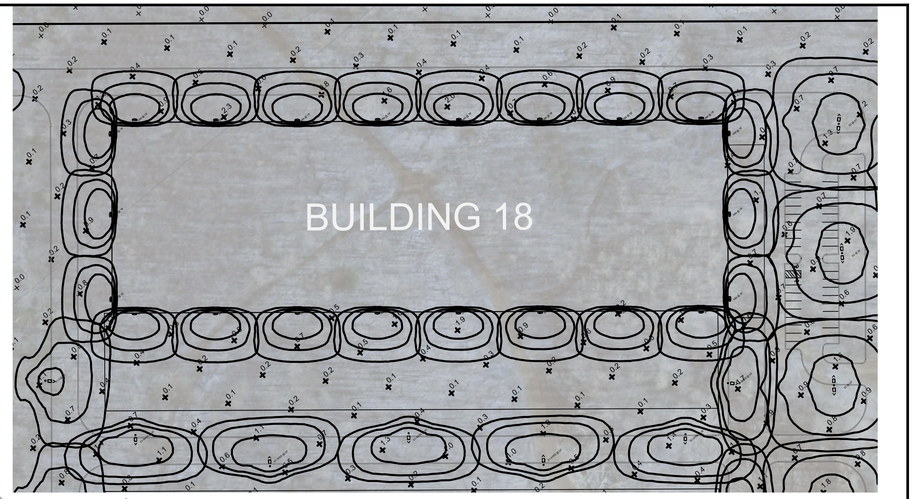

TYPICAL BUILDING PHOTOMETRICS

GRAPHIC SCALE
250 125 0 250
SCALE IN FEET

HYLAND Engineering
212 South Front Street
Wormleysburg, PA 17043
(717) 723-3326

CONDITIONAL USE APPLICATION PLAN

ARCHBALD DATA CENTERS
SCRANTON CARBONDALE HIGHWAY, ARCHBALD, PA 18403
ARCHBALD BOROUGH, LACKAWANNA COUNTY

REVISIONS

No.	Date	Description / Reason

Designer	C.J.S.
Drafter	C.J.S.
Reviewer	A.J.D.
Scale	1"=250'
Project No.	220626
Date	12/8/2025
CAD File:	SP220626_P01-CU

Sheet Title

LIGHTING PLAN

Sheet Number

4

C:\1\220626 - KYLE\REALTY\CAD\CADDS\SHYLAND ENGINEERING INC\220626 - ARCHBALD DC\PROJECT FILES\CONCEPTUAL\SP220626_P01-CU(1WC).DP-1

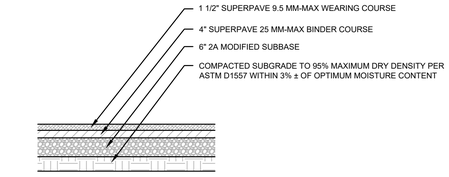

NOTES:

1. ALL PAVING MATERIALS AND INSTALLATION PROCEDURES SHALL CONFORM TO PENNDOT STANDARDS, PUB. 408.

STANDARD DUTY BITUMINOUS PAVING DETAIL

N.T.S

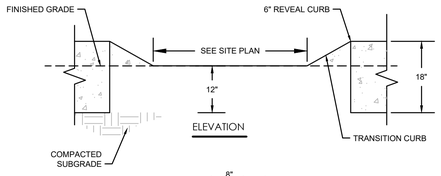



6" REVEAL / DEPRESSED CONCRETE CURB

N.T.S

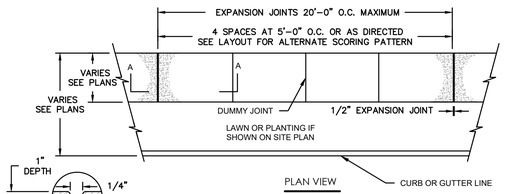

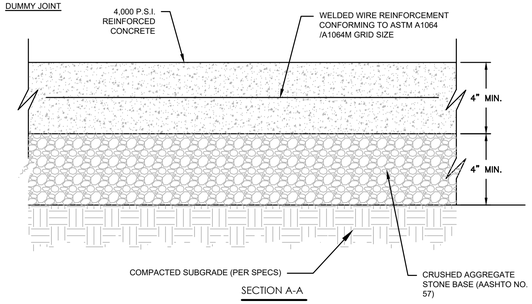

NOTES:

1. 1/4" WIDE x 1" DEEP DUMMY JOINTS SCORED AT 5'-0" INTERVALS.
2. CONSTRUCTION EXPANSION JOINTS SPACED EVERY 20' AND BETWEEN CURB AND SIDEWALK WHERE ADJACENT
3. SIDEWALK TO BE BROOM FINISHED
4. COLOR TO BE SELECTED BY OWNER

SIDEWALK DETAIL

N.T.S

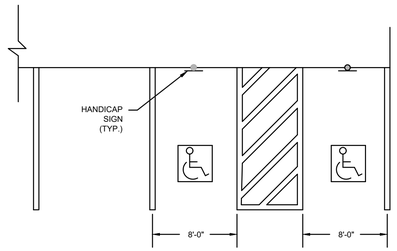



NOTES:

1. PROVIDE TWO COATS OF PAINT ON ALL SURFACES.
2. SEE PLAN FOR ACTUAL SPACE LOCATION AND DIMENSIONS.

PARKING STALL DETAIL

N.T.S

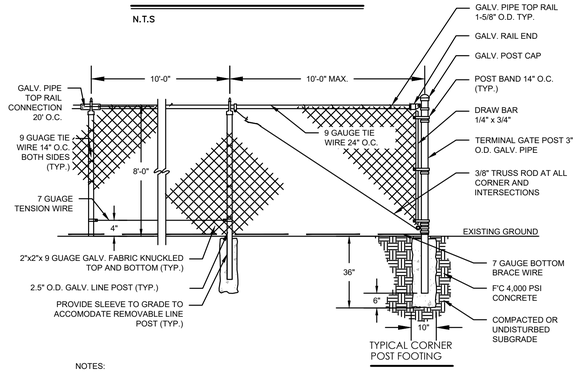

NOTES:

1. FOOTING DESIGN TO BE CHECKED BY AN ENGINEER FOR WIND LOADS IF SLATS ARE USED.
2. STRAIGHT RUNS BETWEEN BRACED POSTS SHALL NOT EXCEED 500 FT.
3. FENCE DETAILS ARE INTENDED AS A GUIDE ONLY. ALL FENCE MATERIALS AND CONSTRUCTION METHODS SHALL BE APPROVED BY THE ENGINEER AND FENCE MANUFACTURER.
4. ALL POSTS, RAILS, AND FABRIC HARDWARE TO BE GALV. 2.0 OZ. PER SQ. FT.

8' HIGH CHAIN LINK FENCE

N.T.S

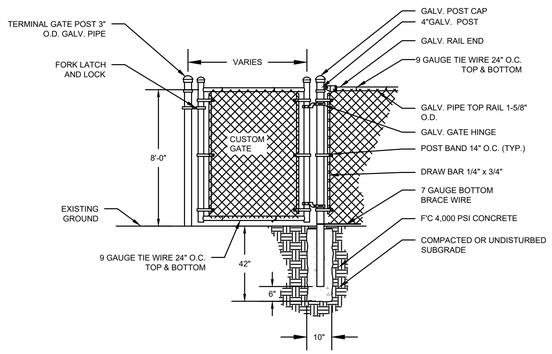

8' HIGH CHAIN LINK GATE

N.T.S

(D1) 2025, KYLE FELTY, C:\USERS\KYLEFELTY\DOCS\DOCSWYLAND ENGINEERING INC-220626 - ARCHBALD DO\PROJECT FILES\CONCEPTUAL\SP220626_P01-CU.DWG 1:1

Autobahn Series ATB0
Roadway Lighting

Consistent with LEED® goals & Green Globes™ criteria for light pollution reduction

PRODUCT OVERVIEW

Applications:

- Roadways
- Off ramps
- Residential streets
- Parking lots

DIMENSIONS



Effective Projected Area (EPA): The EPA for the ATB0 is 0.76 sq. ft. Approx. Wt. = 14 lbs.

STANDARDS

DesignLights Consortium® (DLC) Premium qualified product. Not all versions of this product may be DLC Premium qualified. Please check the DLC Qualified Products List at www.designlights.org/QPL to confirm which versions are qualified.

Color temperatures of ≤ 3000K must be specified for International Dark-Sky Association certification.

Rated for -40°C to 40°C ambient
CSA Certified to U.S. and Canadian standards
Complies with ANSI: C136.2, C136.10, C136.14, C136.31, C136.15, C136.37

GOVERNMENT PROCUREMENT — BAA – Buy America(n) Act: Product with the BAA option qualifies as a domestic end product under the Buy American Act as implemented in the FAR and DFARS. Product with the BAA option also qualifies as manufactured in the United States under DOT Buy America regulations.

BABA – Build America Buy America: Product with the BAA option also qualifies as produced in the United States under the definitions of the Build America, Buy America Act.

Please refer to www.acuitybrands.com/buy-american for additional information.

Note: Actual performance may differ as a result of end-user environment and application. Specifications subject to change without notice.

© 2014-2024 Acuity Brands Lighting, Inc. ATB0 Rev. 08/16/24

Features:

OPTICAL

The Autobahn's new molded silicone optics provide exceptional performance. Silicone optics are superior to other polymeric materials in the areas of; optical efficiency, thermal performance, and reduction in dirt accumulation, all of which can lead to long term lumen degradation and a shift in optical distribution. Also, because silicone allows for the molding of fine details as well as thick sections, it produces the most crisp, clean and well-defined lighting distributions available. Silicone optics paired with modern LED's allow the Autobahn to take full advantage of both technologies.

Same Light: Performance is comparable to 100 - 400W HP'S roadway luminaires.

White Light: Correlated color temperature - 4000K, or optional 2700K, 3000K or 5000K, all 70 CRI minimum.

Unique IP66 rated LED light engines provided 0% uplight and restrict backlight to within sidewalk depth, providing optimal application coverage and optimal pole spacing. Available in Type II, III, IV, and V roadway distributions.

ELECTRICAL

Expected Life: LED light engines are rated >100,000 hours at 25°C, L70. Electronic driver has an expected life of 100,000 hours at a 25°C ambient.

Lower Energy: Saves an expected of 40-60% over comparable HID luminaires.

Robust Surge Protection: Two different surge protection options provide a minimum of ANSI C136.2 10kV/5kA protection. 20kV/10kA protection is also available.

Luminaire ships with a 0-10v dimmable driver. Luminaire is continuous and step dimming capable via A0 option or controls installed on P7 photocontrol receptacle option.

MECHANICAL

Includes standard AEL lineman-friendly features such as tool-less entry, 3 station terminal block and quick disconnects. Bubble level located inside the electrical compartment for easily leveling at installation.

Rugged die-cast aluminum housing and door are polyester powder-coated for durability and corrosion resistance. Rigorous five-stage pre-treating and painting process yields a finish that achieves a scribe creepage rating of 7 (per ASTM D1654) after over 5000 hours exposure to salt fog chamber (operated per ASTM B117).

Mast arm mount is adjustable for arms from 1-1/4" to 2" (1-5/8" to 2-3/8" O.D.) diameter. Provides a 3G vibration rating per ANSI C136.31

Wildlife shield is cast into the housing (not a separate piece).

CONTROLS

NEMA 3 pin photocontrol receptacle is standard, with the Acuity designed ANSI standard 7 pin receptacle optionally available.

Premium solid state locking style photocontrol - PCSS (10 year rated life) Extreme long life solid state locking style photocontrol - PCLL (20 year rated life).

Optional onboard Adjustable Output module allows the light output and input wattage to be modified to meet site specific requirements, and also can allow a single fixture to be flexibly applied in many different applications.

Assembly Drawing

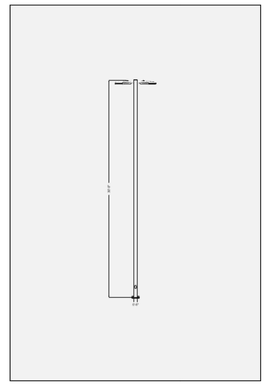

Windload

Passed Wind Speed: 90 mph

Windload Result: 44%

Evaluated per: Non-AASHTO

Pole Loading EPA: 2.12 sq ft

Pole Loading Weight: 44.84 lbs

Dimensional Data



Pole Top Style	Description	Orientation
D01	Drilling for 1 Unit	C
D02	2 Units @ 180	B,D
D03	3 Units @ 90	B,C,D
D04	4 Units @ 90	A,B,C,D
D05	2 Units @ 90	B,C

Bolt Circle Dia.	Min Base Size 'D'	Base Thk 'T'	Bolt Projection
12.5	12.25	0.63	3.50 - 4.00

Description	Height/Width
Assembly Overall Height	30'-0"
Luminaire Mounting Height	30'-0"
Pole Height	30'-0"
Pole Base Width	0'-6"

Ordering Information

Qty	Catalog Number
98	ATB0 P203 MVOLT R4 BK P7 PCLL
49	SSA 30 66J D02 AD2 BK
49	AB-27-4
1	TMP-48
98	ATB0DECOS BK





Customer Approval Signature: Date:

HYLAND Engineering
212 South Front Street
Wormleysburg, PA 17043
(717) 723-3326

CONDITIONAL USE APPLICATION PLAN
ARCHBALD DATA CENTERS
SCRANTON CARBONDALE HIGHWAY, ARCHBALD, PA 18403
ARCHBALD BOROUGH, LACKAWANNA COUNTY

REVISIONS

No.	Date	Description / Reason

Designer	C.J.S.
Drafter	C.J.S.
Reviewer	A.J.D.
Scale	N.T.S.
Project No.	220626
Date	12/8/2025
CAD File:	SP220626_P01-CU

Sheet Title

DETAILS

Sheet Number

5

Elevations

Architectural Render: Front elevation

Architectural Render: Left side elevation

Architectural Render: Back side elevation

Architectural Render: Right side elevation

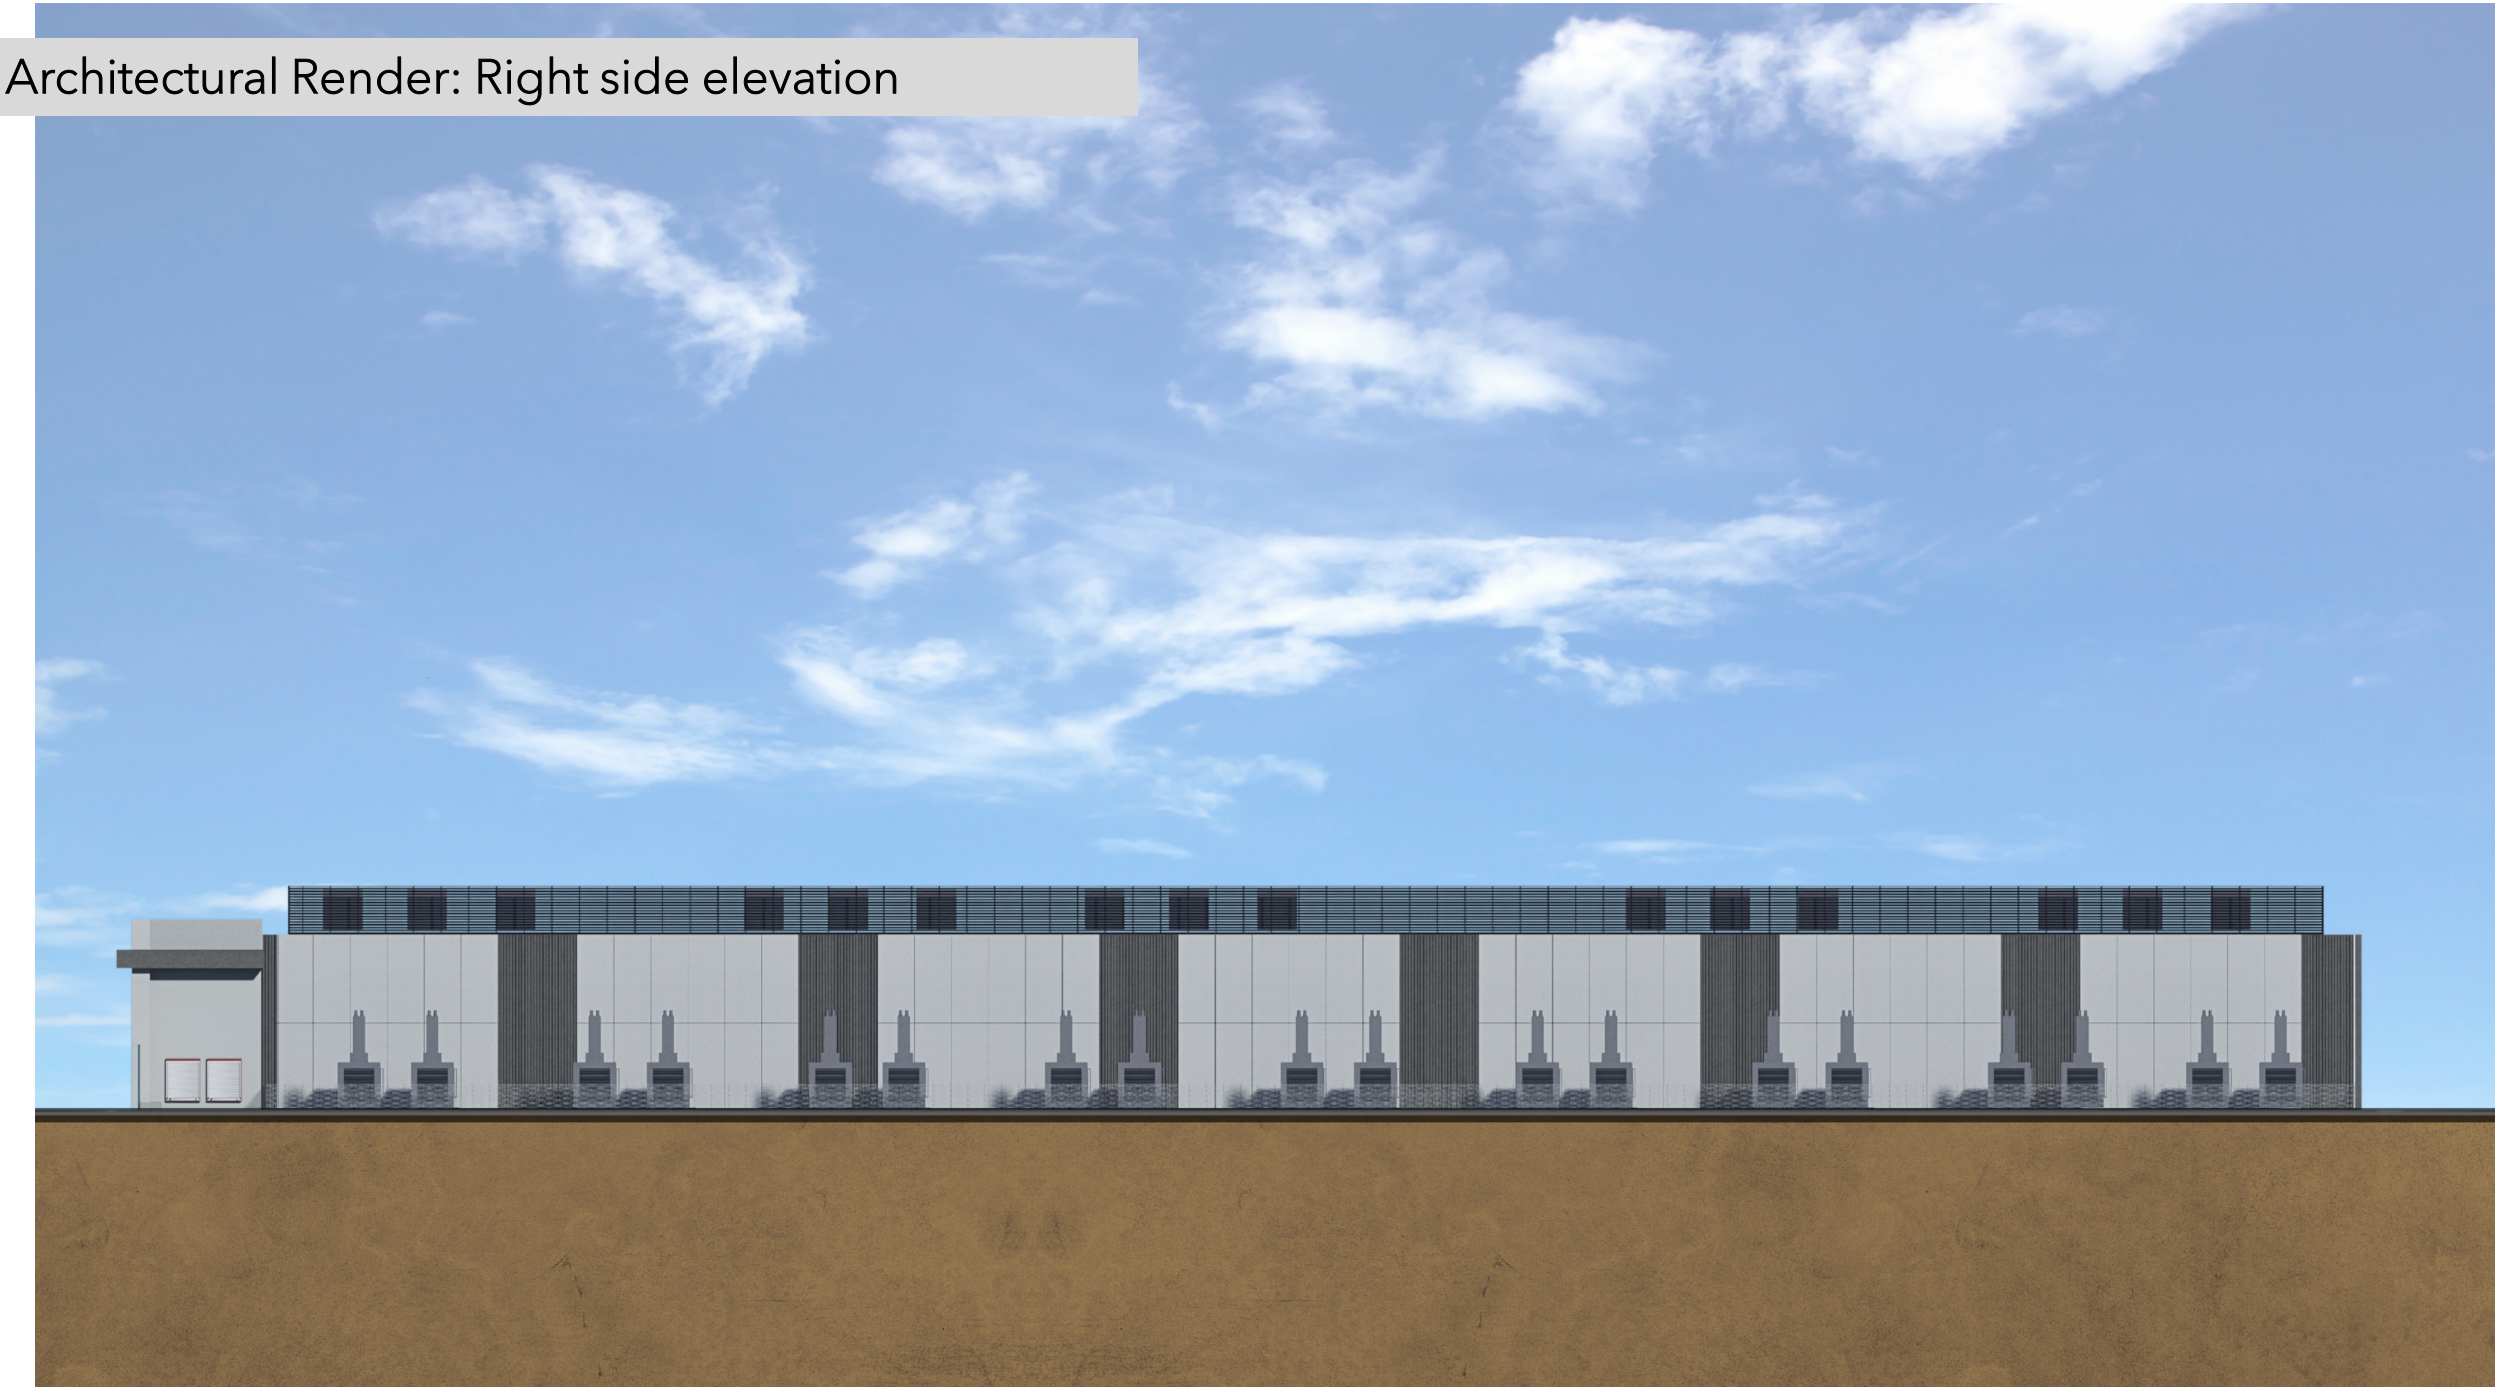

CONCEPTUAL DATA CENTER CAMPUS SECURITY PLAN
ARCHBALD I LLC
SCRANTON CARBONDALE HIGHWAY / EYNON JERMYN ROAD

Security for the Archbald Data Center campus will be designed with a layered, defense-in-depth approach consistent with hyperscale data center standards. The perimeter will be fully secured with anti-climb fencing (minimum height of 8 feet), controlled vehicular gates, and a 24/7 staffed guard station at primary entry points. All ingress and egress will be strictly monitored, with screening protocols in place to verify the authorization of personnel, contractors, and deliveries.

The campus will be supported by a robust electronic surveillance system. This includes continuous live-feed on-site coverage through high-definition security cameras, and may be supplemented with perimeter intrusion detection systems to provide immediate alerts to any breach attempts. Coverage will extend across the perimeter, entrances, equipment yards, and other critical outdoor areas. Redundant power sources will ensure the uninterrupted operation of all security systems during outages.

Within each facility, building access will be limited through electronic badge systems tied to role-based access controls. Entry to sensitive areas such as server halls and mechanical/electrical rooms will require additional authorization. Security logs will be actively monitored to track and audit access. While biometric screening and mantraps are not currently assumed, these measures may be incorporated depending on the future end user’s operational requirements.

Beyond physical access, the campus design will incorporate protective measures against vehicular threats. Controlled-access gates will be designed to meet vehicle impact standards, and opportunities for passive vehicle barriers (such as setbacks, bollards, or reinforced landscaping) will be reviewed during detailed design. Coordination with local law enforcement and emergency responders will also be built into the operating framework to ensure incident response plans are well-integrated with community resources.

As this is a preliminary framework, specific security management systems (central monitoring platforms, remote access protocols, security patrols, etc.) will be defined during the end user’s land development and operational planning stages. The intent at this stage is to demonstrate a robust baseline that balances physical security, electronic monitoring, and operational readiness, while retaining flexibility to adapt to the specific needs of the end user.

ATCS®

NOISE MONITORING TECHNICAL RESULTS

Archbald DC Ambient Noise Measurements

Archbald I LLC

Scranton Carbondale Highway / Eynon Jermyn Road,

Archbald Borough,

Lackawanna County, Pennsylvania

November 2025

CLIENT ▪ EMPLOYEE ▪ COMPANY ▪ COMMUNITY

Table of Contents

1.0 Noise Monitoring 1

Tables

Table 1 – Monitored Sound Levels 2

Figures

Figure 1 – Project Vicinity Map

Appendices

Appendix A – Monitored Noise Level Data

1.0 Noise Monitoring

ATCS Inc of PA (ATCS) was contracted to conduct noise monitoring efforts for the Archbald DC parcel in Archbald Borough, Lackawanna County, Pennsylvania. The purpose of the noise monitoring data collection was to identify current ambient conditions of the Archbald DC parcel. Prior to conducting noise measurements, ATCS coordinated all monitoring locations with the project team. Measurement locations were selected to ensure sufficient representation where the bounding parcel (Archbald DC) was within 2,500 feet of any residential land use per the Borough of Archbald Ordinance. Additionally, all noise meters used were ANSI certified and noise measurements/methodologies used to collect data adhered to the ASA/ANSI S12.9-1992/Part 2 guidance.

Noise monitoring was conducted on September 10th and 11th, for 4 long-term monitoring sites, using one minute interval data collection speeds to provide sufficient representation of the existing noise levels associated with each site at the property boundary. Noise measurements were then post processed to generate an average sound level for the overall measurement duration, as well as an average rolling hour assessment. The rolling hourly average of noise levels depicts a more accurate assessment of long-term measurements as the process smooths out short-term fluctuations and transient spikes, providing a more stable representation of overall ambient noise conditions which was the premise for using this methodology as the foundation of this analysis. Unlike fixed hourly averages, it continuously updates over time, preventing bias from arbitrary time boundaries and ensuring that no significant noise events are missed. This approach better reflects actual environmental and human exposure to sustained noise, making it more reliable for identifying long-term patterns and trends in noise levels.

A rolling 24-hour average was generated per measurement location. These averages were then combined logarithmically to delineate the overall average ambient condition of the Archbald DC parcel. The raw monitoring data can be found in ***Appendix A***.

Site M-01

Noise readings were recorded on the northeastern edge of the property boundary (***Figure 1***), along Eynon Jermyn Road. The minimum, maximum, average, L90 (90th percentile Leq) and L10 (10th percentile Leq) sound levels were recorded over the 24-hour monitoring session. Throughout the monitoring session, site M-01 experienced an average rolling 24-hour sound level of 50.8 db(A). The dominant noise source for this location was Eynon Jermyn Road. The levels associated with M-01 can be referenced in ***Table 1***.

Site M-02

Noise readings were recorded on the northeastern edge of the property boundary (***Figure 1***), along Eynon Jermyn Road. The minimum, maximum, average, L90 (90th percentile Leq) and L10 (10th percentile Leq) sound levels were recorded over the 24-hour monitoring session. Throughout the monitoring session, site M-02 experienced an average rolling 24-hour sound level of 65.4 db(A). The dominant noise source for this location was Eynon Jermyn Road and nearby construction noise. The levels associated with M-02 can be referenced in ***Table 1***.

Site M-03

Noise readings were recorded on the southeastern edge of the property boundary (***Figure 1***), along Eynon Jermyn Road near Ed Staback Memorial Park. The minimum, maximum, average, L90 (90th percentile Leq) and L10 (10th percentile Leq) sound levels were recorded over the 24-hour monitoring session. Throughout the monitoring session, site M-03

experienced an average rolling 24-hour sound level of 60.4 db(A). The dominant noise source for this location was Eynon Jermyn Road. The levels associated with M-03 can be referenced in ***Table 1***.

Site M-04

Noise readings were recorded on the southwestern edge of the property boundary (***Figure 1***), along Scranton Carbondale Highway near Archbald Pothole State Park. The minimum, maximum, average, L90 (90th percentile Leq) and L10 (10th percentile Leq) sound levels were recorded over the 24-hour monitoring session. Throughout the monitoring session, site M-04 experienced an average rolling 24-hour sound level of 55.3 db(A). The dominant noise source for this location was Scranton Carbondale Highway. The levels associated with M-04 can be referenced in ***Table 1***.

Table 1: Monitored Sound Levels

Monitoring Site	Sound Levels	
	Average Leq (24 Hour)	Rolling Hour Average Leq
M-01	50.5	50.8
M-02	65.3	65.4
M-03	60.4	60.4
M-04	55.2	55.3
Overall Ambient Condition		***61.0***

Conclusion

In summary, data collection took place between September 10th and 11th for 4 long-term monitoring sites, using 1-minute interval data collection speeds to provide sufficient representation of the existing noise levels associated with each site. The measurement data was post processed into both a comprehensive 24 hour and rolling hour methodology to provide baseline data for the property's current ambient noise condition. These rolling hour averages per measurement location were then added logarithmically to populate an overall ambient condition of 61.0 db(A) for the Archbald DC parcel as shown in ***Table 1***. Pending locality acceptance of this report, per the Borough of Archbald ordinance (Section IV, (62)2d/2e); this parcel shall not exceed five (5) decibels above the determined ambient noise level (61.0 db(A)) at any lot line of the property where residential uses exist within 2,500 feet, or at the site of any other residential land uses within 2,500 feet.

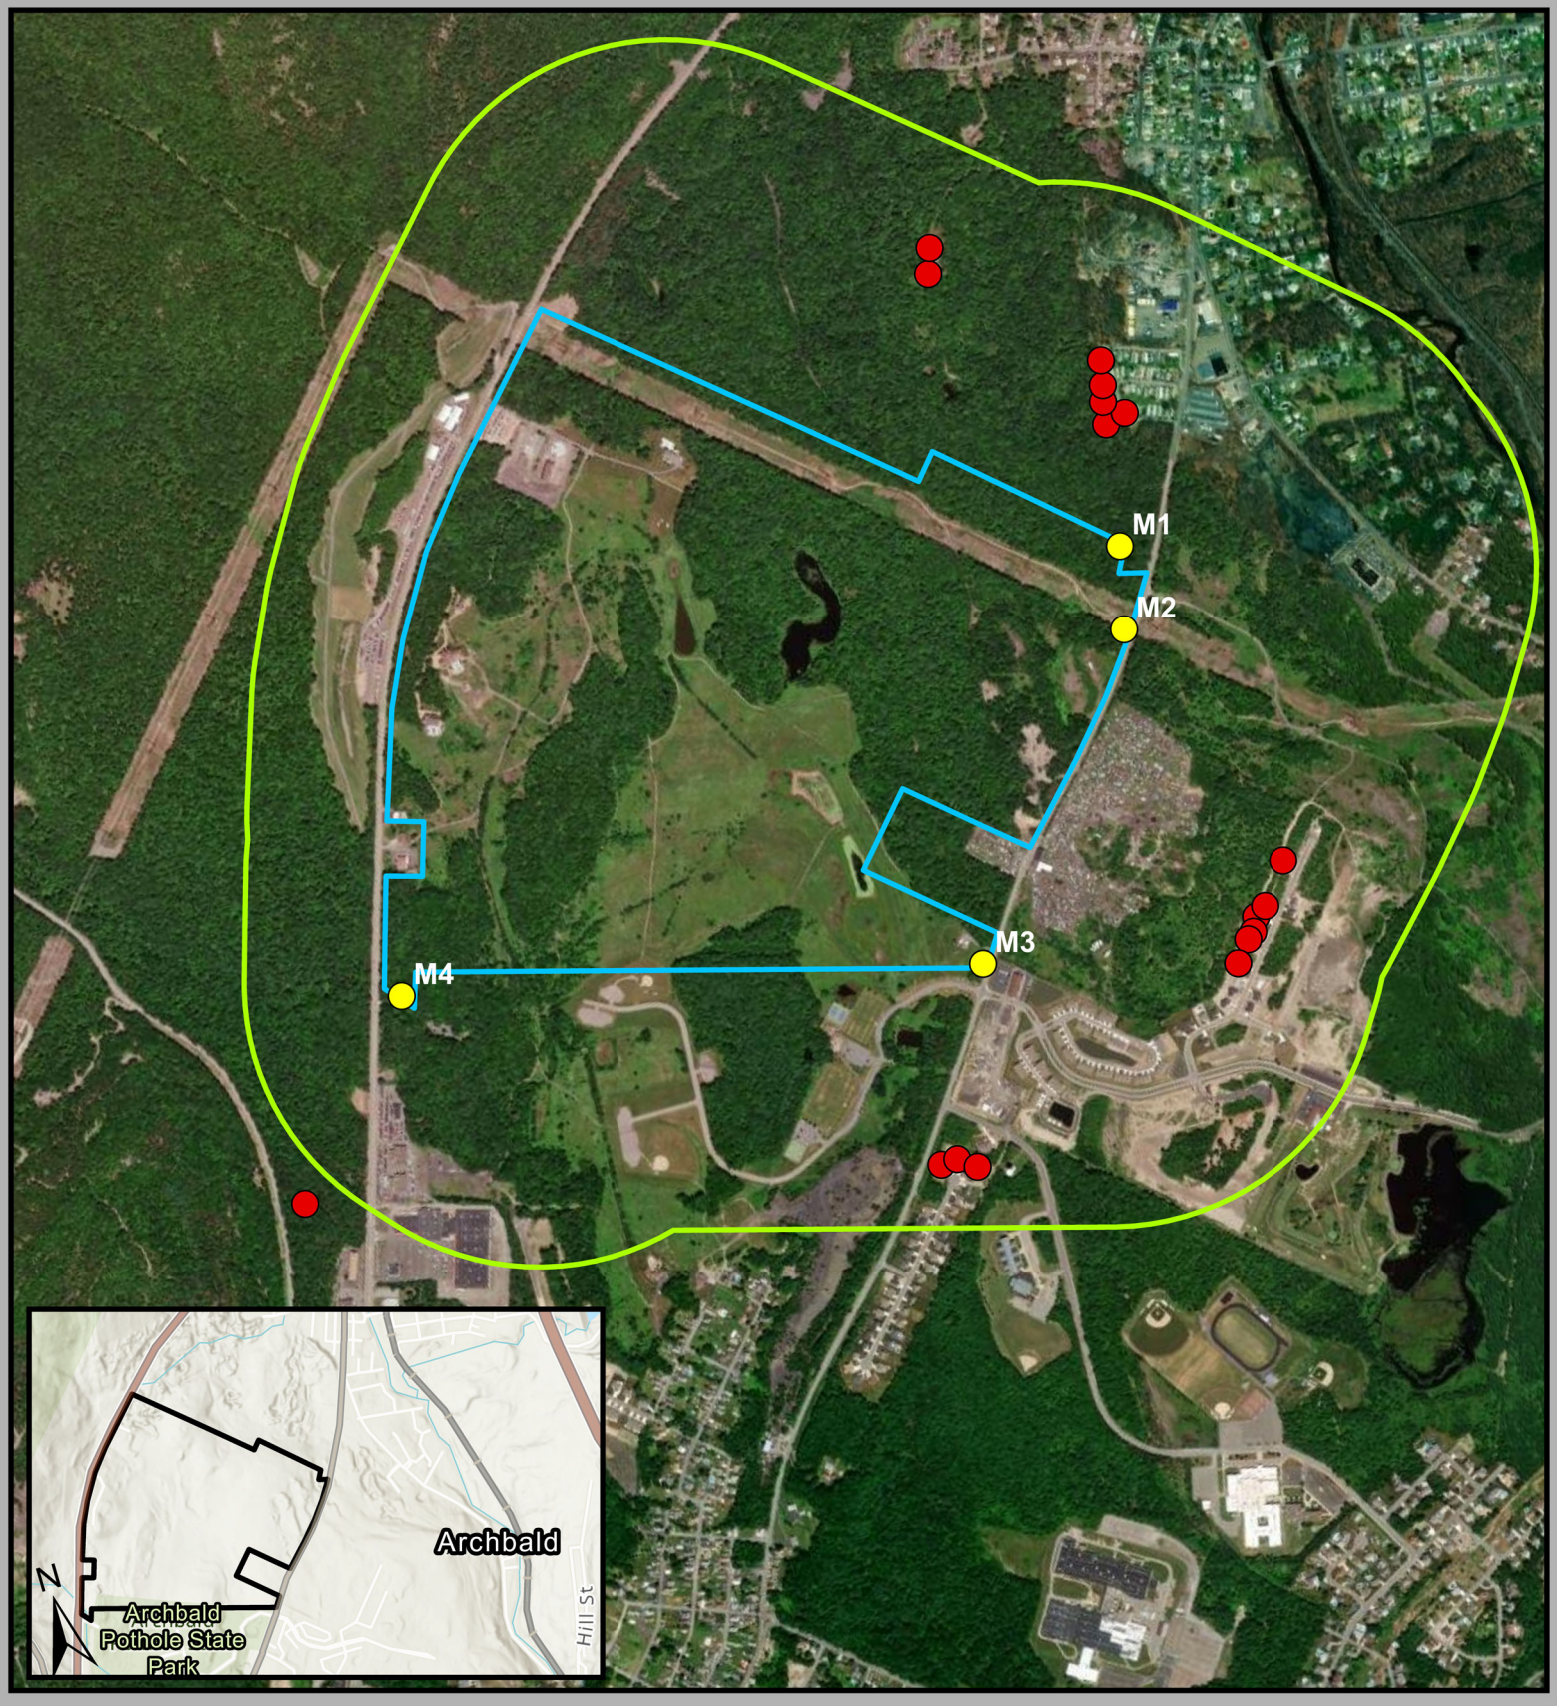

Archbald DC Ambient Noise Measurements

Scranton Carbondale Highway / Eynon Jermyn Road
Archbald Borough, Lackawanna County PA

- Monitoring Locations
- Nearest Residential Land Use
- 2500 Feet From Property Boundary
- Property Boundary

Figure 1 Project Vicinity Map

Map Created: 11/21/2025

LACKAWANNA COUNTY PENNSYLVANIA

ATCS

Appendix A

Site M1

Site M2

Site M3

Site M4

Address	Start Time	Measurement Time		Leq	LE	LMAX	LMIN	Ly	LN1	LN2	LN3	LN4	LN5	Over	Under	Inverse Log	Overall Leq	Rolling 24 Hour	Rolling Hour Avg
M-01																			
1	9/10/2025	8:20:12	00d 01:00.0	55.3	73.1	58.9	50.3	-:-	58.6	58	54.5	52	50.7	----	-----	338844.2	50.5	53.0	50.8
2	9/10/2025	8:21:12	00d 01:00.0	63.3	81.1	72.1	50.9	-:-	71.6	68.7	57.8	52.5	51.9	----	-----	2137962.1		53.0	Hourly
3	9/10/2025	8:22:12	00d 01:00.0	53.8	71.6	59.3	47.4	-:-	58.5	56.8	52.8	48.5	47.8	----	-----	239883.3		52.2	
4	9/10/2025	8:23:12	00d 01:00.0	52.1	69.9	56.5	48.1	-:-	56.1	55	51.5	48.8	48.5	----	-----	162181.0		52.2	
5	9/10/2025	8:24:12	00d 01:00.0	54.6	72.4	62	45	-:-	61	60	48.2	45.8	45.5	----	-----	288403.2		52.1	
6	9/10/2025	8:25:12	00d 01:00.0	51.2	69	55.9	45	-:-	55.5	54.4	50.6	46.1	45.3	----	-----	131825.7		52.1	
7	9/10/2025	8:26:12	00d 01:00.0	56.3	74.1	64.8	45.4	-:-	63.1	59.4	55.2	46.1	45.9	----	-----	426579.5		52.1	
8	9/10/2025	8:27:12	00d 01:00.0	58.2	76	65.2	44.5	-:-	61.3	61	57.2	48.7	45.4	----	-----	660693.4		51.9	
9	9/10/2025	8:28:12	00d 01:00.0	53.9	71.7	59.3	44.2	-:-	59.2	58.1	51.8	46.2	44.5	----	-----	245470.9		51.6	
10	9/10/2025	8:29:12	00d 01:00.0	46.2	64	51.9	40.9	-:-	51	49.8	44.6	41.2	41.1	----	-----	41686.9		51.5	
11	9/10/2025	8:30:12	00d 01:00.0	50.1	67.9	58.1	40.7	-:-	57.3	54.5	47	41.5	41	----	-----	102329.3		51.6	
12	9/10/2025	8:31:12	00d 01:00.0	51.4	69.2	54.7	42.7	-:-	54.6	54.1	51.1	46.4	45.9	----	-----	138038.4		51.8	
13	9/10/2025	8:32:12	00d 01:00.0	50.4	68.2	55.8	41.7	-:-	55.4	53.9	49.3	42.5	42	----	-----	109647.8		51.8	
14	9/10/2025	8:33:12	00d 01:00.0	53.9	71.7	59.3	48.5	-:-	58.3	56.1	53.2	49.4	48.6	----	-----	245470.9		51.8	
15	9/10/2025	8:34:12	00d 01:00.0	52.4	70.2	57.4	46.3	-:-	56.5	55	51.4	48.8	47.3	----	-----	173780.1		52.0	
16	9/10/2025	8:35:12	00d 01:00.0	46.3	64.1	52.5	41.2	-:-	51.6	49.4	44.4	41.5	41.3	----	-----	42658.0		52.0	
17	9/10/2025	8:36:12	00d 01:00.0	44	61.8	49.3	40.4	-:-	49.1	47.7	42.3	40.5	40.4	----	-----	25118.9		52.0	
18	9/10/2025	8:37:12	00d 01:00.0	51.5	69.3	56.6	44.8	-:-	56.1	54.7	50.5	46.2	45.3	----	-----	141253.8		52.1	
19	9/10/2025	8:38:12	00d 01:00.0	53	70.8	58.8	43.6	-:-	57	56.6	51.8	44.6	44.2	----	-----	199526.2		52.1	
20	9/10/2025	8:39:12	00d 01:00.0	49.8	67.6	55.7	42.2	-:-	54.8	53.6	48.4	42.6	42.5	----	-----	95499.3		52.1	
21	9/10/2025	8:40:12	00d 01:00.0	50.8	68.6	56	46.2	-:-	55.5	53.9	50.1	47.1	46.6	----	-----	120226.4		52.1	
22	9/10/2025	8:41:12	00d 01:00.0	51.1	68.9	57.8	45.3	-:-	55.9	54	49.7	45.8	45.7	----	-----	128825.0		52.1	
23	9/10/2025	8:42:12	00d 01:00.0	43.2	61	47.3	41.3	-:-	46.6	45.2	42.6	41.7	41.6	----	-----	20893.0		52.1	
24	9/10/2025	8:43:12	00d 01:00.0	51	68.8	54.9	44.8	-:-	54.7	54.4	49.8	46.3	45.3	----	-----	125892.5		52.1	
25	9/10/2025	8:44:12	00d 01:00.0	50.6	68.4	55	41.6	-:-	55	54.3	49.4	42	41.9	----	-----	114815.4		52.1	
26	9/10/2025	8:45:12	00d 01:00.0	59.4	77.2	70.2	40.6	-:-	68	64.8	48.2	41.1	40.8	----	-----	870963.6		52.1	
27	9/10/2025	8:46:12	00d 01:00.0	50.1	67.9	54	43	-:-	53.9	53.1	49.3	44.3	43.4	----	-----	102329.3		51.8	
28	9/10/2025	8:47:12	00d 01:00.0	58.5	76.3	68.5	43.2	-:-	67.1	63.8	49.1	43.6	43.4	----	-----	707945.8		51.9	
29	9/10/2025	8:48:12	00d 01:00.0	52.5	70.3	57.5	47.1	-:-	57.2	55.7	51.2	48.5	48.2	----	-----	177827.9		51.6	
30	9/10/2025	8:49:12	00d 01:00.0	50.3	68.1	55	41.8	-:-	54.6	53.8	49.5	42.6	42.2	----	-----	107151.9		51.6	
31	9/10/2025	8:50:12	00d 01:00.0	51.4	69.2	56.9	45	-:-	56.6	54.8	50.2	47.4	46.8	----	-----	138038.4		51.6	
32	9/10/2025	8:51:12	00d 01:00.0	50.6	68.4	57.8	41.7	-:-	57.6	55.6	48.5	42.2	41.8	----	-----	114815.4		51.7	
33	9/10/2025	8:52:12	00d 01:00.0	46.5	64.3	52.3	41.8	-:-	52.2	49.5	44.9	42.2	41.9	----	-----	44668.4		51.7	
34	9/10/2025	8:53:12	00d 01:00.0	47.1	64.9	51.7	41.2	-:-	51.7	50.8	45.6	41.9	41.4	----	-----	51286.1		51.8	
35	9/10/2025	8:54:12	00d 01:00.0	52.6	70.4	57.5	43.5	-:-	56.4	55.1	52.4	45.4	43.8	----	-----	181970.1		51.8	
36	9/10/2025	8:55:12	00d 01:00.0	45.1	62.9	53.6	39.6	-:-	50.9	49.5	42.3	40.2	40	----	-----	32359.4		51.9	
37	9/10/2025	8:56:12	00d 01:00.0	41.5	59.3	43.2	39.8	-:-	43.1	42.5	41.4	40.2	40	----	-----	14125.4		51.9	
38	9/10/2025	8:57:12	00d 01:00.0	47.3	65.1	53.4	41	-:-	53	51	45.5	42.2	41.8	----	-----	53703.2		51.9	
39	9/10/2025	8:58:12	00d 01:00.0	50.9	68.7	55.5	42.9	-:-	55.4	54.6	49.2	44.2	43.5	----	-----	123026.9		51.9	
40	9/10/2025	8:59:12	00d 01:00.0	57.4	75.2	67.9	39.8	-:-	66	64.1	48.8	40.7	40	----	-----	549540.9		52.0	
41	9/10/2025	9:00:12	00d 01:00.0	49.5	67.3	55.4	39.8	-:-	55	53.1	46.8	40.2	40	----	-----	89125.1		51.8	
42	9/10/2025	9:01:12	00d 01:00.0	41.8	59.6	49.2	39.3	-:-	48.5	42.8	40.1	39.4	39.3	----	-----	15135.6		51.8	
43	9/10/2025	9:02:12	00d 01:00.0	50	67.8	55.7	39	-:-	55.4	53.9	49.8	39.3	39.2	----	-----	100000.0		51.9	
44	9/10/2025	9:03:12	00d 01:00.0	52.3	70.1	61.2	39.7	-:-	58.3	56.1	49.6	40.7	40.1	----	-----	169824.4		52.0	
45	9/10/2025	9:04:12	00d 01:00.0	45.8	63.6	50.4	40	-:-	50.3	50.1	43.7	40.5	40.1	----	-----	38018.9		52.0	
46	9/10/2025	9:05:12	00d 01:00.0	50	67.8	55.7	41.6	-:-	55.3	52.8	49.3	43.9	42.7	----	-----	100000.0		52.0	
47	9/10/2025	9:06:12	00d 01:00.0	52.7	70.5	60.6	38	-:-	60.3	58.7	44.2	38.6	38.4	----	-----	186208.7		52.0	
48	9/10/2025	9:07:12	00d 01:00.0	46.1	63.9	51.5	37.4	-:-	51.5	51.1	42.6	38	37.8	----	-----	40738.0		51.9	
49	9/10/2025	9:08:12	00d 01:00.0	47.6	65.4	53.9	39.1	-:-	53.2	51.4	45.5	40.3	39.5	----	-----	57544.0		52.4	
50	9/10/2025	9:09:12	00d 01:00.0	50.7	68.5	56.8	38.1	-:-	56.4	54.7	49.7	39	38.4	----	-----	117489.8		52.4	
51	9/10/2025	9:10:12	00d 01:00.0	52.4	70.2	56.2	40.2	-:-	55.5	55.2	52.4	44.7	43.2	----	-----	173780.1		52.4	
52	9/10/2025	9:11:12	00d 01:00.0	47.7	65.5	55.4	38.6	-:-	55.4	52.4	44.3	39	38.8	----	-----	58884.4		52.4	
53	9/10/2025	9:12:12	00d 01:00.0	43.5	61.3	55.3	37.5	-:-	51.3	46.8	39	37.8	37.7	----	-----	22387.2		52.4	
54	9/10/2025	9:13:12	00d 01:00.0	50.3	68.1	60.6	37.9	-:-	59	55.3	40.1	38.4	38.2	----	-----	107151.9		52.4	
55	9/10/2025	9:14:12	00d 01:00.0	54.1	71.9	61.1	42.4	-:-	60.2	58.6	52.2	43.5	42.8	----	-----	257039.6		52.4	
56	9/10/2025	9:15:12	00d 01:00.0	53.6	71.4	65.1	43.6	-:-	58.1	56	50.2	44.4	44	----	-----	229086.8		52.3	
57	9/10/2025	9:16:12	00d 01:00.0	52.8	70.6	65.2	39.1	-:-	61.1	55.9	45.7	39.4	39.4	----	-----	190546.1		52.3	
58	9/10/2025	9:17:12	00d 01:00.0	47.2	65	52.2	42.1	-:-	51.7	50.8	45.8	42.7	42.4	----	-----	52480.7		52.2	
59	9/10/2025	9:18:12	00d 01:00.0	50.6	68.4	55	44.7	-:-	54.7	53.8	49.3	45.6	45.3	----	-----	114815.4		52.4	
60	9/10/2025	9:19:12	00d 01:00.0	54.1	71.9	60.9	46	-:-	59.5	57.7	52	48.1	47	----	-----	257039.6		52.3	
61	9/10/2025	9:20:12	00d 01:00.0	44.9	62.7	52	38.1	-:-	51.5	50.7	41	38.9	38.5	----	-----	30903.0		52.2	
62	9/10/2025	9:21:12	00d 01:00.0	55.5	73.3	66	42.3	-:-	64.8	58.9	50.2	43.4	43.2	----	-----	354813.4		52.3	
63	9/10/2025	9:22:12	00d 01:00.0	52.9	70.7	61.3	38.9	-:-	59.5	58	48.8	40.4	39.4	----	-----	194984.5		52.1	
64	9/10/2025	9:23:12	00d 01:00.0	47.4	65.2	51.6	40.2	-:-	51.6	51.4	45.3	41.2	40.4	----	-----	54954.1		52.1	
65	9/10/2025	9:24:12	00d 01:00.0	51	68.8	55.8	42	-:-	55.5	55.1	49	43.1	42.2	----	-----	125892.5		52.1	
66	9/10/2025	9:25:12	00d 01:00.0	49.5	67.3	57.7	39.8	-:-	57	55	43.2	40.3	39.9	----	-----	89125.1		52.1	
67	9/10/2025	9:26:12	00d 01:00.0	52.4	70.2	59.4	42.3	-:-	58.3	57.5	49.2	43.9	43	----	-----	173780.1		52.1	
68	9/10/2025	9:27:12	00d 01:00.0	49.7	67.5	56.1	39.9	-:-	55.5	54.7	47.4	40.4	39.8	----	-----	93325.4		52.1	
69	9/10/2025	9:28:12	00d 01:00.0	46.8	64.6	52.5	39.7	-:-	51.9	50.6	45.8	40.3	40.2	----	-----	47863.0		52.1	
70	9/10/2025	9:29:12	00d 01:00.0	47.6	65.4	53.9	39.4	-:-	53.4	52.9	43.1	40	39.9	----	-----	57544.0		52.1	
71	9/10/2025	9:30:12	00d 01:00.0	48.8	66.6	55	40.4	-:-	55	53.8	45.5	40.9	40.7	----	-----	75857.8		52.1	
72	9/10/2025	9:31:12	00d 01:00.0	57.2	75	66.2	41.4	-:-	65.7	63.9	48.4	41.7	41.7	----	-----	524807.5		52.2	
73	9/10/2025	9:32:12	00d 01:00.0	54.6	72.4	60.8	41.6	-:-	60.6	58.8	50.6	44.5	42	----	-----	288403.2		52.0	
74	9/10/2025	9:33:12	00d 01:00.0	51	68.8	55.8	43.8	-:-	55.5	54.2	49.9	45.7	44.9	----	-----	125892.5		51.9	
75	9/10/2025	9:34:12	00d 01:00.0	57.5	75.3	67.9	43.3	-:-	65.3	63.3	52.3	44.3	44	----	-----	562341.3		51.9	
76	9/10/2025	9:35:12	00d 01:00.0	54.4	72.2	63.3	42.7	-:-	62.3	57.4	51.3	43.7	43.1	----	-----	275422.9		51.9	
77	9/10/2025	9:36:12	00d 01:00.0	48.9	66.7	55.6	42.3	-:-	54.6	52.6	45.3	42.6	42.5	----	-----	77624.7		51.8	
78	9/10/2025	9:37:12	00d 01:00.0	51.9	69.7	59.4	43.2	-:-	59.2	56.5	49.5	44.7	43.7	----	-----	154881.7		51.7	
79	9/10/2025	9:38:12	00d 01:00.0	51.8	69.6	58.1	41.2	-:-	57.8	56.9	48.9	42.2	41.9	----	-----	151356.1		51.8	
80	9/10/2025	9:39:12	00d 01:00.0	54.6	72.4	64.1	41.7	-:-	63.8	59.4	47.5	42.4	42.2	----	-----	288403.2		51.7	
81	9/10/2025	9:40:12	00d 01:00.0	47.2	65	54.8	40.3	-:-	54.3	51.1	43.2	41.3	40.9	----	-----	52480.7		51.6	
82	9/10/2025	9:41:12	00d 01:00.0	47.3	65.1	53.6	41.1	-:-	53	51.1	44.8	41.9	41.5	----	-----	53703.2		51.6	
83	9/10/2025	9:42:12	00d 01:00.0	48.8	66.6	56.5	41.8	-:-	56.3	51.5	46	43.2	42.4	----	-----	75857.8		51.6	
84	9/10/2025	9:43:12	00d 01:00.0	52.1	69.9	57.2	44.9	-:-	56.6	54.8	51.2	46.7	45.4	----	-----	162181.0		51.7	
85	9/10/2025	9:44:12	00d 01:00.0	48.8	66.6	55.9	41.5	-:-	55.6	52.7	46.5	41.8	41.6	----	-----	75857.8		51.6	
86	9/10/2025	9:45:12	00d 01:00.0	47.4	65.2	53.2	41.4	-:-	53.1	52.4	44	41.7	41.6	----	-----	54954.1		51.7	
87	9/10/2025	9:46:12	00d 01:00.0	54.8	72.6	65.8	41.6	-:-	65.1	56.4	48.6	42.5	41.9	----	-----	301995.2		51.6	
88	9/10/2025	9:47:12	00d 01:00.0	54.4	72.2	65.8	43.7	-:-	62.4	58.6	50.2	44.2	43.6	----	-----	275422.9		51.6	
89	9/10/2025	9:48:12	00d 01:00.0	49.2	67	57.1	38.9	-:-	56.3	55	44.8	39.4	39.1	----	-----	83176.4		51.5	
90	9/10/2025	9:49:12	00d 01:00.0	49.8	67.6	54.7	40.6	-:-	54.6	54.4	47.9	41	40.9	----	-----	95499.3		51.6	
91	9/10/2025	9:50:12	00d 01:00.0	54.1	71.9	60.9	42.6	-:-	60.4	57.5	52.3	44.3	43	----	-----	257039.6		51.6	
92	9/10/2025	9:51:12	00d 01:00.0	51.8	69.6	57	44.9	-:-	56.8	55.8	51.2	46.1	45.1	----	-----	151356.1		51.6	
93	9/10/2025	9:52:12	00d 01:00.0	54.1	71.9	60.2	47.6	-:-	59.5	57.2	52.8	47.9	47.8	----	-----	257039.6		51.5	
94	9/10/2025	9:53:12	00d 01:00.0	50.5	68.3	56.3	44	-:-	55.5	54	48.4	44.4	44.3	----	-----	112201.8		51.4	
95	9/10/2025	9:54:12	00d 01:00.0	47.6	65.4	54.4	41.7	-:-	53.8	52.1	44.1	42.5	42.4	----	-----	57544.0		51.4	
96	9/10/2025	9:55:12	00d 01:00.0	55.8	73.6	65.4	43.2	-:-	65.2	60.3	47.6	44	43.6	----	-----	380189.4		51.4	
97	9/10/2025	9:56:12	00d 01:00.0	51.6	69.4	57.2	42.1	-:-	56.6	55.1	50	44	43	----	-----	144544.0		51.3	
98	9/10/2025	9:57:12	00d 01:00.0	47.2	65	54.5	41.3	-:-	53.7	51	45.2	42	41.5	----	-----	52480.7		51.2	
99	9/10/2025	9:58:12	00d 01:00.0	49.9	67.7	55.7	43	-:-	55.6	53.4	48.3	43.4	43.3	----	-----	97723.7		51.2	
100	9/10/2025	9:59:12	00d 01:00.0	54.5	72.3	62.4	43.3	-:-	60.9	58.7	51.4	46.3	45.7	----	-----	281838.3		51.2	
101	9/10/2025	10:00:12	00d 01:00.0	46	63.8	49.8	41	-:-	49.9	49.4	45.2	41.4	41.2	----	-----	39810.7		51.1	
102	9/10/2025	10:01:12	00d 01:00.0	51	68.8	56.9	42.8	-:-	56.4	55.3	49.5	43.7	43.3	----	-----	125892.5		51.2	
103	9/10/2025	10:02:12	00d 01:00.0	53.1	70.9	60.7	46.3	-:-	59.6	56.2	50.8	47.6	47.4	----	-----	204173.8		51.1	
104	9/10/2025	10:03:12	00d 01:00.0	55	72.8	58.8	46.3	-:-	58.5	57.9	54.8	47.8	46.7	----	-----	316227.8		51.2	
105	9/10/2025	10:04:12	00d 01:00.0	50.4	68.2	55.8	42.7	-:-	55.1	54.3	48.5	44.6	43.6	----	-----	109647.8		51.0	
106	9/10/2025	10:05:12	00d 01:00.0	48.4	66.2	55.7	40.3	-:-	53.9	52	46.4	40.8	40.5	----	-----	69183.1		51.0	
107	9/10/2025	10:06:12	00d 01:00.0	51.1	68.9	58.2	40.3	-:-	57.6	56.1	44.2	42.2	41.9	----	-----	128825.0		51.0	
108	9/10/2025	10:07:12	00d 01:00.0	50	67.8	59.5	41.7	-:-	58.6	55.5	43.7	42.3	41.8	----	-----	100000.0		51.0	

109	9/10/2025	10:08:12	00d	01:00.0	60.8	78.6	71.5	47.7	-:-	68.9	66.4	54.6	49.5	49	----	-----	1202264.4	51.0
110	9/10/2025	10:09:12	00d	01:00.0	45.3	63.1	50.7	41.6	-:-	50.7	49	43.6	42.4	42	----	-----	33884.4	50.4
111	9/10/2025	10:10:12	00d	01:00.0	46.2	64	51	41.7	-:-	50.7	50.1	44.5	42.6	42.3	----	-----	41686.9	50.4
112	9/10/2025	10:11:12	00d	01:00.0	47.2	65	53.5	41.6	-:-	53	51.5	43.6	42.2	41.8	----	-----	52480.7	50.4
113	9/10/2025	10:12:12	00d	01:00.0	48.4	66.2	52	42.7	-:-	51.9	51.3	47.7	43.7	43.4	----	-----	69183.1	50.4
114	9/10/2025	10:13:12	00d	01:00.0	51.2	69	55.8	43.6	-:-	55.5	54.6	50.1	46.7	45.2	----	-----	131825.7	50.4
115	9/10/2025	10:14:12	00d	01:00.0	48.6	66.4	57.7	40.5	-:-	57.5	53.5	43.3	40.8	40.6	----	-----	72443.6	50.3
116	9/10/2025	10:15:12	00d	01:00.0	49.6	67.4	55.8	42.3	-:-	55	53.8	45.8	42.8	42.6	----	-----	91201.1	50.3
117	9/10/2025	10:16:12	00d	01:00.0	48.4	66.2	54.4	41.8	-:-	54.2	52.8	45.9	42.2	42	----	-----	69183.1	50.3
118	9/10/2025	10:17:12	00d	01:00.0	49.7	67.5	57.3	41.3	-:-	56.8	55.2	43.1	41.5	41.4	----	-----	93325.4	50.4
119	9/10/2025	10:18:12	00d	01:00.0	55.9	73.7	66	42.8	-:-	65.2	60.3	44.9	43	42.9	----	-----	389045.1	50.4
120	9/10/2025	10:19:12	00d	01:00.0	45.6	63.4	52.5	41.4	-:-	52	49	43.2	42.1	41.9	----	-----	36307.8	50.1
121	9/10/2025	10:20:12	00d	01:00.0	47.6	65.4	52.7	42.3	-:-	52.8	52	45.4	43.4	42.6	----	-----	57544.0	50.2
122	9/10/2025	10:21:12	00d	01:00.0	48.3	66.1	54.9	41.4	-:-	53.8	52.2	45.8	41.8	41.7	----	-----	67608.3	50.3
123	9/10/2025	10:22:12	00d	01:00.0	46.4	64.2	54	41.3	-:-	53.5	49.9	42.5	41.7	41.6	----	-----	43651.6	50.3
124	9/10/2025	10:23:12	00d	01:00.0	51.2	69	57	42.3	-:-	56.3	55.6	48.5	44	43.4	----	-----	131825.7	50.4
125	9/10/2025	10:24:12	00d	01:00.0	48.9	66.7	54.8	40	-:-	54.7	53.9	45.2	40.7	40.3	----	-----	77624.7	50.4
126	9/10/2025	10:25:12	00d	01:00.0	50.7	68.5	56.5	39.6	-:-	56.2	54.4	49.6	41.7	40.4	----	-----	117489.8	50.3
127	9/10/2025	10:26:12	00d	01:00.0	48	65.8	55.4	38.9	-:-	54	53.7	42.6	39.4	39.3	----	-----	63095.7	50.3
128	9/10/2025	10:27:12	00d	01:00.0	51.2	69	59.1	38.3	-:-	57.9	55.1	48.2	38.7	38.5	----	-----	131825.7	50.4
129	9/10/2025	10:28:12	00d	01:00.0	49.7	67.5	57.4	41.3	-:-	55.6	54.5	43.7	41.8	41.6	----	-----	93325.4	50.3
130	9/10/2025	10:29:12	00d	01:00.0	50.2	68	57.1	41.3	-:-	56.6	54.3	47.7	42.6	42.2	----	-----	104712.9	50.3
131	9/10/2025	10:30:12	00d	01:00.0	49.7	67.5	54.2	41.8	-:-	54.2	53.9	47.6	42.9	42.4	----	-----	93325.4	50.4
132	9/10/2025	10:31:12	00d	01:00.0	54.5	72.3	63.4	41.9	-:-	63	60	45.5	42.4	42.2	----	-----	281838.3	50.4
133	9/10/2025	10:32:12	00d	01:00.0	48.5	66.3	57.2	43	-:-	52.5	52.3	46.8	44.2	43.5	----	-----	70794.6	50.2
134	9/10/2025	10:33:12	00d	01:00.0	49.6	67.4	57.1	41.2	-:-	56.6	54.2	45.5	41.6	41.1	----	-----	91201.1	50.2
135	9/10/2025	10:34:12	00d	01:00.0	47	64.8	53.5	38	-:-	53.2	51.4	43.6	38.8	38.4	----	-----	50118.7	50.2
136	9/10/2025	10:35:12	00d	01:00.0	57.5	75.3	67.1	43.4	-:-	65.1	62.5	51.8	44.6	44.1	----	-----	562341.3	50.4
137	9/10/2025	10:36:12	00d	01:00.0	45.8	63.6	51.2	40.7	-:-	50.3	49.6	43.3	41.3	40.8	----	-----	38018.9	50.1
138	9/10/2025	10:37:12	00d	01:00.0	46.8	64.6	52.9	41.2	-:-	51.4	51.1	44.4	41.7	41.5	----	-----	47863.0	50.2
139	9/10/2025	10:38:12	00d	01:00.0	52.7	70.5	61.7	43.9	-:-	57.3	55.8	51.4	44.4	44.1	----	-----	186208.7	50.2
140	9/10/2025	10:39:12	00d	01:00.0	50	67.8	56.3	42.9	-:-	55.5	52.6	49.3	43.4	43.2	----	-----	100000.0	50.1
141	9/10/2025	10:40:12	00d	01:00.0	49.9	67.7	56.2	42.7	-:-	55.7	53.9	48.7	43.2	42.9	----	-----	97723.7	50.1
142	9/10/2025	10:41:12	00d	01:00.0	46.6	64.4	53.2	40.1	-:-	52.6	49.9	43.6	40.9	40.2	----	-----	45708.8	50.1
143	9/10/2025	10:42:12	00d	01:00.0	45.2	63	53.1	39.4	-:-	50.7	50.1	41.5	40.3	40	----	-----	33113.1	50.1
144	9/10/2025	10:43:12	00d	01:00.0	52	69.8	56.9	46.2	-:-	56.3	54.9	51	47.5	46.9	----	-----	158489.3	50.1
145	9/10/2025	10:44:12	00d	01:00.0	49.2	67	54.8	41.9	-:-	54.5	53.5	46.7	42.5	42.4	----	-----	83176.4	50.1
146	9/10/2025	10:45:12	00d	01:00.0	50.8	68.6	55.2	45.9	-:-	54.3	54	49.6	46.7	46.4	----	-----	120226.4	50.2
147	9/10/2025	10:46:12	00d	01:00.0	44.9	62.7	51.2	40.6	-:-	49.5	48.3	43.2	41.2	40.8	----	-----	30903.0	50.2
148	9/10/2025	10:47:12	00d	01:00.0	54.4	72.2	62.2	45.5	-:-	61.4	58.9	51.7	49	47.9	----	-----	275422.9	50.3
149	9/10/2025	10:48:12	00d	01:00.0	46.2	64	52.8	39.4	-:-	51.8	49.8	42.8	40.2	39.9	----	-----	41686.9	50.2
150	9/10/2025	10:49:12	00d	01:00.0	52.8	70.6	59.6	41.4	-:-	57.9	56.9	51.4	43.2	42.2	----	-----	190546.1	50.2
151	9/10/2025	10:50:12	00d	01:00.0	53.1	70.9	61.9	44	-:-	60.7	58.4	48.6	45.1	44.7	----	-----	204173.8	50.4
152	9/10/2025	10:51:12	00d	01:00.0	50.8	68.6	55.7	44.3	-:-	55.3	54.2	49.7	46.8	45.9	----	-----	120226.4	50.5
153	9/10/2025	10:52:12	00d	01:00.0	50.2	68	55.1	44	-:-	54.9	53.9	48.9	45.7	44.4	----	-----	104712.9	50.5
154	9/10/2025	10:53:12	00d	01:00.0	49.1	66.9	53.9	43.3	-:-	53.7	52	47.9	44.7	43.9	----	-----	81283.1	50.5
155	9/10/2025	10:54:12	00d	01:00.0	48.9	66.7	54.7	38.7	-:-	54.3	53.2	46.8	39.9	39.1	----	-----	77624.7	50.4
156	9/10/2025	10:55:12	00d	01:00.0	50.3	68.1	55.4	40.7	-:-	54.9	53.7	48.3	42.2	41.4	----	-----	107151.9	50.5
157	9/10/2025	10:56:12	00d	01:00.0	45	62.8	49.2	39	-:-	48.9	48.2	44	40.1	39.6	----	-----	31622.8	50.4
158	9/10/2025	10:57:12	00d	01:00.0	40.3	58.1	44.5	37.5	-:-	42.6	41.5	40.4	38.2	38	----	-----	10715.2	50.5
159	9/10/2025	10:58:12	00d	01:00.0	49.2	67	54.2	38.8	-:-	53.2	52.4	48.3	43.3	42.8	----	-----	83176.4	50.5
160	9/10/2025	10:59:12	00d	01:00.0	48.2	66	55.1	41.9	-:-	54	51.5	45.9	42.6	42.2	----	-----	66069.3	50.6
161	9/10/2025	11:00:12	00d	01:00.0	50.9	68.7	54.3	44.6	-:-	53.7	53.5	50.1	46.4	44.8	----	-----	123026.9	50.6
162	9/10/2025	11:01:12	00d	01:00.0	51.3	69.1	57.1	46.3	-:-	56.3	55.5	49.4	46.8	46.5	----	-----	134896.3	50.5
163	9/10/2025	11:02:12	00d	01:00.0	48.2	66	52.9	42.4	-:-	52.8	51.9	47.1	42.9	42.8	----	-----	66069.3	50.5
164	9/10/2025	11:03:12	00d	01:00.0	54.1	71.9	63.5	45.1	-:-	61.2	57.7	49	45.8	45.6	----	-----	257039.6	50.5
165	9/10/2025	11:04:12	00d	01:00.0	49.3	67.1	54.7	44.1	-:-	53.6	51.8	48.8	45.6	44.6	----	-----	85113.8	50.4
166	9/10/2025	11:05:12	00d	01:00.0	46.8	64.6	54.1	42.9	-:-	53.1	50.7	44.4	43.2	43.1	----	-----	47863.0	50.4
167	9/10/2025	11:06:12	00d	01:00.0	46.8	64.6	53	41.6	-:-	52.7	51.9	42.9	41.9	41.9	----	-----	47863.0	50.4
168	9/10/2025	11:07:12	00d	01:00.0	51.5	69.3	58.7	41.8	-:-	57.8	55.9	46	42.4	42.3	----	-----	141253.8	50.5
169	9/10/2025	11:08:12	00d	01:00.0	48	65.8	53.1	42.7	-:-	52.7	52.2	46.1	43.9	43.5	----	-----	63095.7	50.7
170	9/10/2025	11:09:12	00d	01:00.0	54.1	71.9	62	45.7	-:-	61.4	59.1	50.6	46.7	46.1	----	-----	257039.6	50.7
171	9/10/2025	11:10:12	00d	01:00.0	45.7	63.5	52.3	38.8	-:-	52	49.5	43.6	39.2	38.9	----	-----	37153.5	50.6
172	9/10/2025	11:11:12	00d	01:00.0	42.1	59.9	48.5	38.5	-:-	46.7	45.1	40.9	39	38.6	----	-----	16218.1	50.7
173	9/10/2025	11:12:12	00d	01:00.0	47.3	65.1	52.7	42	-:-	51.6	50.7	45	42.1	42	----	-----	53703.2	50.7
174	9/10/2025	11:13:12	00d	01:00.0	44.6	62.4	52.6	40.4	-:-	50.4	48.7	41.6	41.1	40.7	----	-----	28840.3	50.8
175	9/10/2025	11:14:12	00d	01:00.0	46.3	64.1	53.5	40.8	-:-	53.2	50.9	42.8	41.7	41.5	----	-----	42658.0	51.4
176	9/10/2025	11:15:12	00d	01:00.0	48.7	66.5	56	41.7	-:-	55.2	52.9	45.1	42.2	42	----	-----	74131.0	51.5
177	9/10/2025	11:16:12	00d	01:00.0	49.9	67.7	54.2	42.7	-:-	53.8	52.4	49.4	43.3	42.8	----	-----	97723.7	51.5
178	9/10/2025	11:17:12	00d	01:00.0	52	69.8	57.6	42.8	-:-	57.4	54.8	51.4	45.3	43.9	----	-----	158489.3	51.6
179	9/10/2025	11:18:12	00d	01:00.0	50.9	68.7	57.5	41.3	-:-	56.3	53.4	50.5	41.6	41.4	----	-----	123026.9	51.6
180	9/10/2025	11:19:12	00d	01:00.0	42.6	60.4	48.1	40	-:-	46.1	44.3	42.1	40.8	40.7	----	-----	18197.0	51.6
181	9/10/2025	11:20:12	00d	01:00.0	49	66.8	54.3	41.9	-:-	54.1	53.7	46.2	42.3	42.1	----	-----	79432.8	51.6
182	9/10/2025	11:21:12	00d	01:00.0	55.1	72.9	66	43.5	-:-	59.2	58.8	50.6	43.8	43.7	----	-----	323593.7	51.7
183	9/10/2025	11:22:12	00d	01:00.0	48.6	66.4	54.7	42.9	-:-	53.9	51.8	47.3	44.1	43.7	----	-----	72443.6	51.6
184	9/10/2025	11:23:12	00d	01:00.0	48.9	66.7	54	44.1	-:-	53.8	52.2	47.6	44.7	44.3	----	-----	77624.7	51.8
185	9/10/2025	11:24:12	00d	01:00.0	50.5	68.3	56.1	41.6	-:-	55.7	54.9	47.7	42	41.7	----	-----	112201.8	51.8
186	9/10/2025	11:25:12	00d	01:00.0	47.2	65	53.9	40.5	-:-	53.6	52.8	43.6	41	40.7	----	-----	52480.7	51.8
187	9/10/2025	11:26:12	00d	01:00.0	51	68.8	56.8	45.6	-:-	56	55.7	48.9	46	45.6	----	-----	125892.5	51.8
188	9/10/2025	11:27:12	00d	01:00.0	49.5	67.3	55.3	42.6	-:-	55.1	54.6	47.2	43.5	42.9	----	-----	89125.1	51.8
189	9/10/2025	11:28:12	00d	01:00.0	48.4	66.2	54.6	42	-:-	54.3	51.6	46	42.5	42.3	----	-----	69183.1	51.8
190	9/10/2025	11:29:12	00d	01:00.0	50.1	67.9	56	42	-:-	55.4	55.1	44.6	42.5	42.2	----	-----	102329.3	51.8
191	9/10/2025	11:30:12	00d	01:00.0	53.1	70.9	56.4	44.3	-:-	56.3	55.5	53.2	47.7	45.5	----	-----	204173.8	51.8
192	9/10/2025	11:31:12	00d	01:00.0	50.9	68.7	57.3	40.6	-:-	56.5	55.6	48.9	41.4	41	----	-----	123026.9	51.7
193	9/10/2025	11:32:12	00d	01:00.0	45.2	63	50.1	38.4	-:-	49.8	49	43.5	38.7	38.5	----	-----	33113.1	51.8
194	9/10/2025	11:33:12	00d	01:00.0	48.6	66.4	53.7	38.6	-:-	53.4	52.4	47.6	40.8	39.2	----	-----	72443.6	51.8
195	9/10/2025	11:34:12	00d	01:00.0	49.5	67.3	56.1	41.4	-:-	55.2	53.1	47.1	42.5	41.9	----	-----	89125.1	52.0
196	9/10/2025	11:35:12	00d	01:00.0	54.9	72.7	64	40.6	-:-	62.1	58.5	51.9	41.2	40.8	----	-----	309029.5	52.0
197	9/10/2025	11:36:12	00d	01:00.0	49.7	67.5	55.5	42	-:-	55.2	54.1	47.9	43.6	42.4	----	-----	93325.4	51.9
198	9/10/2025	11:37:12	00d	01:00.0	52	69.8	58.4	41.8	-:-	57.3	55.8	50.7	45.6	42.9	----	-----	158489.3	51.9
199	9/10/2025	11:38:12	00d	01:00.0	46.9	64.7	52.8	40.6	-:-	52.2	51.6	44.1	41.2	40.8	----	-----	48977.9	51.9
200	9/10/2025	11:39:12	00d	01:00.0	49.5	67.3	56.2	40.6	-:-	55.6	54.4	46.1	41.6	41.3	----	-----	89125.1	51.9
201	9/10/2025	11:40:12	00d	01:00.0	47.9	65.7	55.3	40.6	-:-	54.5	52.4	45.3	41.8	41	----	-----	61659.5	51.9
202	9/10/2025	11:41:12	00d	01:00.0	50.1	67.9	57.8	39.7	-:-	57.5	54.6	46.6	40.9	40.7	----	-----	102329.3	51.9
203	9/10/2025	11:42:12	00d	01:00.0	48.2	66	55.1	40.3	-:-	53.9	52.5	45.2	40.8	40.4	----	-----	66069.3	51.9
204	9/10/2025	11:43:12	00d	01:00.0	48.7	66.5	52.9	40.9	-:-	52.7	52.3	47.6	41.2	41	----	-----	74131.0	51.8
205	9/10/2025	11:44:12	00d	01:00.0	49.7	67.5	56.8	40.8	-:-	56.8	54.5	45.7	41.1	40.8	----	-----	93325.4	51.8
206	9/10/2025	11:45:12	00d	01:00.0	53	70.8	60.4	40.8	-:-	59.2	57.1	50.2	41.5	41.2	----	-----	199526.2	51.9
207	9/10/2025	11:46:12	00d	01:00.0	51.9	69.7	57.2	45	-:-	56.9	55.1	50.6	46.3	45.6	----	-----	154881.7	51.8
208	9/10/2025	11:47:12	00d	01:00.0	52.7	70.5	59.9	42.6	-:-	59.1	56.7	49.1	43.3	43	----	-----	186208.7	51.8
209	9/10/2025	11:48:12	00d	01:00.0	49.6	67.4	54	41	-:-	53.8	53.3	48.3	42	41.2	----	-----	91201.1	51.7
210	9/10/2025	11:49:12	00d	01:00.0	48.1	65.9	53.3	40.7	-:-	53	52.3	47.5	40.9	40.7	----	-----	64565.4	51.7
211	9/10/2025	11:50:12	00d	01:00.0	56.7	74.5	67.1	40.6	-:-	64.7	63.2	50.4	42.5	41.4	----	-----	467735.1	51.7
212	9/10/2025	11:51:12	00d	01:00.0	55.3	73.1	63	40.7	-:-	61.3	60.5	53	42.4	41.1	----	-----	338844.2	51.5
213	9/10/2025	11:52:12	00d	01:00.0	51	68.8	57.2	41.1	-:-	56.6	54.3	49.8	43.2	41.6	----	-----	125892.5	51.4
214	9/10/2025	11:53:12	00d	01:00.0	50.6	68.4	59.6	40.5	-:-	58.3	55.3	45.4	40.7	40.5	----	-----	114815.4	51.3
215	9/10/2025	11:54:12	00d	01:00.0	46.5	64.3	53.1	38.5	-:-	52.7	51.2	44.1	39.1	38.8	----	-----	44668.4	51.3
216	9/10/2025	11:55:12	00d	01:00.0	49.7	67.5	55.3	39.3	-:-	54.8	53.2	48	41	39.7	----	-----	93325.4	51.4
217	9/10/2025	11:56:12	00d	01:00.0	49.1	66.9	54.2	40.7	-:-	53.8	53	47.6	42.6	41.3	----	-----	81283.1	51.3
218	9/10/2025	11:57:12	00d	01:00.0	49.1	66.9	58.1	38.2	-:-	57.4	54.1	42.6	39.1	38.6	----	-----	81283.1	51.3
219	9/10/2025	11:58:12	00d	01:00.0	47.7	65.5	54.5	39.5	-:-	53.8	52.9	43.9	40	39.8	----	-----	58884.4	51.4

220	9/10/2025	11:59:12	00d	01:00.0	52.3	70.1	60.3	39.2	-:-	59.6	57.4	48.2	39.9	39.7	----	-----	169824.4	51.5
221	9/10/2025	12:00:12	00d	01:00.0	48	65.8	53.5	40.2	-:-	52.7	51.1	47.7	41.3	40.6	----	-----	63095.7	51.5
222	9/10/2025	12:01:12	00d	01:00.0	48.9	66.7	55.8	41.2	-:-	55.2	53.4	46.4	42.1	41.7	----	-----	77624.7	51.5
223	9/10/2025	12:02:12	00d	01:00.0	51.7	69.5	54.7	45.9	-:-	54.6	54.1	51.2	48.6	47.2	----	-----	147910.8	51.5
224	9/10/2025	12:03:12	00d	01:00.0	48.8	66.6	55.3	41	-:-	54.8	53.5	45.8	41.6	41.2	----	-----	75857.8	51.5
225	9/10/2025	12:04:12	00d	01:00.0	48.6	66.4	51.8	43.3	-:-	51.6	51.5	48	43.7	43.2	----	-----	72443.6	51.5
226	9/10/2025	12:05:12	00d	01:00.0	49.3	67.1	54.7	42.6	-:-	54	52.9	47.4	43.9	42.9	----	-----	85113.8	51.5
227	9/10/2025	12:06:12	00d	01:00.0	46.5	64.3	53	39.8	-:-	51.8	50.8	42.8	40.2	39.9	----	-----	44668.4	51.5
228	9/10/2025	12:07:12	00d	01:00.0	50.9	68.7	57.6	43.2	-:-	57.2	55.9	47.4	43.8	43.3	----	-----	123026.9	51.5
229	9/10/2025	12:08:12	00d	01:00.0	57.4	75.2	64	44.9	-:-	63.2	62.2	54	48.3	47	----	-----	549540.9	51.5
230	9/10/2025	12:09:12	00d	01:00.0	49.9	67.7	53.7	43.9	-:-	53.4	52.9	48.8	45.1	44.7	----	-----	97723.7	51.3
231	9/10/2025	12:10:12	00d	01:00.0	47.6	65.4	54.8	42.8	-:-	54.4	51.5	45	43.7	43.5	----	-----	57544.0	51.9
232	9/10/2025	12:11:12	00d	01:00.0	50.6	68.4	54.4	43.8	-:-	54.4	53.1	50.4	46	45.4	----	-----	114815.4	51.9
233	9/10/2025	12:12:12	00d	01:00.0	51.3	69.1	56.9	43.6	-:-	56.1	54.7	50.2	44.9	44	----	-----	134896.3	51.9
234	9/10/2025	12:13:12	00d	01:00.0	52.5	70.3	59.3	46.9	-:-	56.7	55.7	51	48.1	47.2	----	-----	177827.9	51.9
235	9/10/2025	12:14:12	00d	01:00.0	60.5	78.3	70.9	42.5	-:-	69.5	66.4	48.3	43.3	43.1	----	-----	1122018.5	51.8
236	9/10/2025	12:15:12	00d	01:00.0	51.4	69.2	60.9	42.7	-:-	58.5	55.4	48.2	43.8	43.4	----	-----	138038.4	51.3
237	9/10/2025	12:16:12	00d	01:00.0	50.6	68.4	55.6	41.6	-:-	55.3	53.9	49.2	42.9	41.8	----	-----	114815.4	51.6
238	9/10/2025	12:17:12	00d	01:00.0	55.2	73	64.5	42.7	-:-	63.6	61.1	48.3	43.1	42.9	----	-----	331131.1	51.6
239	9/10/2025	12:18:12	00d	01:00.0	50.6	68.4	56.4	42	-:-	56.2	55.2	48.7	42.8	42.3	----	-----	114815.4	51.4
240	9/10/2025	12:19:12	00d	01:00.0	51.8	69.6	59.1	43.3	-:-	58.8	55.7	49.6	44.8	44.3	----	-----	151356.1	51.4
241	9/10/2025	12:20:12	00d	01:00.0	51	68.8	56.5	42.5	-:-	56.4	55.6	48.6	44.3	43.4	----	-----	125892.5	51.4
242	9/10/2025	12:21:12	00d	01:00.0	51.8	69.6	58.6	39.9	-:-	58.3	56	50.4	40.8	40.4	----	-----	151356.1	51.4
243	9/10/2025	12:22:12	00d	01:00.0	50.2	68	54.3	40.1	-:-	54.1	53.4	49.5	42.5	41	----	-----	104712.9	51.4
244	9/10/2025	12:23:12	00d	01:00.0	57.4	75.2	67.4	46.5	-:-	65.8	60.6	53	47.7	46.8	----	-----	549540.9	51.4
245	9/10/2025	12:24:12	00d	01:00.0	47.6	65.4	53.5	38.9	-:-	52.7	52.1	45.8	39.5	39.1	----	-----	57544.0	51.1
246	9/10/2025	12:25:12	00d	01:00.0	52.5	70.3	59.3	40.4	-:-	58.3	56.9	49	43.5	41.7	----	-----	177827.9	51.2
247	9/10/2025	12:26:12	00d	01:00.0	48.1	65.9	54.7	38	-:-	52.3	51.7	47.1	38.9	38.2	----	-----	64565.4	51.1
248	9/10/2025	12:27:12	00d	01:00.0	48	65.8	56	38.1	-:-	55	54.3	44.1	38.8	38.7	----	-----	63095.7	51.1
249	9/10/2025	12:28:12	00d	01:00.0	46.4	64.2	52.8	38.1	-:-	52.4	51	41.8	39	38.6	----	-----	43651.6	51.2
250	9/10/2025	12:29:12	00d	01:00.0	46	63.8	52.2	39.1	-:-	52	50	43.6	40	39.4	----	-----	39810.7	51.4
251	9/10/2025	12:30:12	00d	01:00.0	48.1	65.9	59.9	38.3	-:-	52.7	51.5	42.7	38.9	38.5	----	-----	64565.4	51.4
252	9/10/2025	12:31:12	00d	01:00.0	52.6	70.4	57.6	47.2	-:-	57.4	55.5	51.5	47.8	47.5	----	-----	181970.1	51.6
253	9/10/2025	12:32:12	00d	01:00.0	52.9	70.7	60.9	41.7	-:-	60.5	57.8	48.3	43.2	41.9	----	-----	194984.5	51.6
254	9/10/2025	12:33:12	00d	01:00.0	49.8	67.6	55.5	43.2	-:-	54.6	53.8	48.1	43.8	43.7	----	-----	95499.3	51.5
255	9/10/2025	12:34:12	00d	01:00.0	57.4	75.2	68.4	43.8	-:-	65.3	62.5	50.7	44.6	44.1	----	-----	549540.9	51.5
256	9/10/2025	12:35:12	00d	01:00.0	50.5	68.3	56.3	42.2	-:-	55.9	55.1	48.1	42.7	42.5	----	-----	112201.8	51.3
257	9/10/2025	12:36:12	00d	01:00.0	50.2	68	59.3	43.4	-:-	57.4	52.7	46.8	44.3	44	----	-----	104712.9	51.3
258	9/10/2025	12:37:12	00d	01:00.0	47.5	65.3	59.4	39.4	-:-	56.4	50.9	41.8	39.9	39.6	----	-----	56234.1	51.4
259	9/10/2025	12:38:12	00d	01:00.0	45.3	63.1	51	39.2	-:-	50.9	48.9	43.6	39.8	39.7	----	-----	33884.4	51.4
260	9/10/2025	12:39:12	00d	01:00.0	51	68.8	55.9	42.3	-:-	55.8	54.8	51	42.9	42.6	----	-----	125892.5	51.8
261	9/10/2025	12:40:12	00d	01:00.0	49.7	67.5	57.9	37.9	-:-	57.3	53.7	40	38.4	38.2	----	-----	93325.4	51.8
262	9/10/2025	12:41:12	00d	01:00.0	46.1	63.9	51.9	38.5	-:-	51.8	49.3	45.1	38.8	38.6	----	-----	40738.0	51.8
263	9/10/2025	12:42:12	00d	01:00.0	42	59.8	49.2	38.8	-:-	47.1	43.6	40.8	39	38.9	----	-----	15848.9	51.8
264	9/10/2025	12:43:12	00d	01:00.0	46.7	64.5	50.1	41.3	-:-	50	49.7	46.1	41.6	41.4	----	-----	46773.5	51.9
265	9/10/2025	12:44:12	00d	01:00.0	48.7	66.5	53.6	39.7	-:-	53.3	53	46.9	41.2	40.5	----	-----	74131.0	51.9
266	9/10/2025	12:45:12	00d	01:00.0	50.4	68.2	54.2	46.2	-:-	53.6	53.3	49.4	46.4	46.3	----	-----	109647.8	51.9
267	9/10/2025	12:46:12	00d	01:00.0	50.4	68.2	55.1	44	-:-	55.2	55	48.3	44.6	44.2	----	-----	109647.8	51.9
268	9/10/2025	12:47:12	00d	01:00.0	47.9	65.7	52.8	42.8	-:-	52.3	50.9	46.9	44.1	43.4	----	-----	61659.5	51.9
269	9/10/2025	12:48:12	00d	01:00.0	47.3	65.1	53.2	39.2	-:-	52.5	50.1	46.4	39.9	39.6	----	-----	53703.2	52.0
270	9/10/2025	12:49:12	00d	01:00.0	45.8	63.6	52.2	40	-:-	51	49.3	44.7	40.7	40.2	----	-----	38018.9	52.0
271	9/10/2025	12:50:12	00d	01:00.0	49.3	67.1	54.9	41.7	-:-	54.4	52.8	48.1	43	42.1	----	-----	85113.8	52.1
272	9/10/2025	12:51:12	00d	01:00.0	47.7	65.5	54.5	38.4	-:-	53.8	51.6	46.1	39.4	39.1	----	-----	58884.4	52.2
273	9/10/2025	12:52:12	00d	01:00.0	49.6	67.4	56.9	40.2	-:-	56.6	53.7	46.8	41.8	40.7	----	-----	91201.1	52.2
274	9/10/2025	12:53:12	00d	01:00.0	50	67.8	54.8	45	-:-	54.1	53	49.3	46.4	45.8	----	-----	100000.0	52.2
275	9/10/2025	12:54:12	00d	01:00.0	49.9	67.7	54.7	43.9	-:-	54	52.4	49.3	44.8	44.2	----	-----	97723.7	52.2
276	9/10/2025	12:55:12	00d	01:00.0	49.2	67	58	38.4	-:-	56.9	53.1	43.1	39.2	38.7	----	-----	83176.4	52.2
277	9/10/2025	12:56:12	00d	01:00.0	49.1	66.9	57	37.8	-:-	56.4	53.9	41	38.7	38.1	----	-----	81283.1	52.3
278	9/10/2025	12:57:12	00d	01:00.0	48.7	66.5	52.8	41.6	-:-	52.5	52.5	47.9	42.7	42.1	----	-----	74131.0	52.3
279	9/10/2025	12:58:12	00d	01:00.0	49.5	67.3	54.2	40.5	-:-	53.8	53.4	48.8	42.1	40.8	----	-----	89125.1	52.3
280	9/10/2025	12:59:12	00d	01:00.0	55.2	73	64.2	40.6	-:-	62.8	59.4	51.2	45.3	43.6	----	-----	331131.1	52.3
281	9/10/2025	13:00:12	00d	01:00.0	53.4	71.2	60.5	43.3	-:-	59.8	57.5	50.9	45.1	43.9	----	-----	218776.2	52.2
282	9/10/2025	13:01:12	00d	01:00.0	49.8	67.6	54.8	41.2	-:-	54.8	54	47.7	42	41.4	----	-----	95499.3	52.4
283	9/10/2025	13:02:12	00d	01:00.0	47.6	65.4	55.6	40.2	-:-	53.9	52.6	43.3	40.7	40.4	----	-----	57544.0	52.4
284	9/10/2025	13:03:12	00d	01:00.0	48.1	65.9	52.7	43	-:-	52.5	51.5	47.1	44.6	43.7	----	-----	64565.4	52.4
285	9/10/2025	13:04:12	00d	01:00.0	51.1	68.9	57.1	41.3	-:-	56.1	54.6	49.7	44.5	42.1	----	-----	128825.0	52.4
286	9/10/2025	13:05:12	00d	01:00.0	48.1	65.9	55	39.5	-:-	54.7	51.9	45.4	40.7	40.1	----	-----	64565.4	52.5
287	9/10/2025	13:06:12	00d	01:00.0	44.5	62.3	51.4	38.1	-:-	50.6	48.8	40.4	38.6	38.3	----	-----	28183.8	52.5
288	9/10/2025	13:07:12	00d	01:00.0	52.1	69.9	58.2	44.6	-:-	56.5	55.4	50.9	46.3	45.1	----	-----	162181.0	52.5
289	9/10/2025	13:08:12	00d	01:00.0	52	69.8	56.7	43.9	-:-	56.5	55.2	51.6	45	44.3	----	-----	158489.3	52.6
290	9/10/2025	13:09:12	00d	01:00.0	50.9	68.7	58.2	40.6	-:-	56.8	54.3	48.6	41.5	40.9	----	-----	123026.9	52.6
291	9/10/2025	13:10:12	00d	01:00.0	61.3	79.1	71.4	45.7	-:-	68.5	67.9	52.6	46.9	46.5	----	-----	1348962.9	52.6
292	9/10/2025	13:11:12	00d	01:00.0	45.2	63	52	40.5	-:-	49.2	48.6	43.4	42.4	41.1	----	-----	33113.1	52.1
293	9/10/2025	13:12:12	00d	01:00.0	46.7	64.5	53.8	41	-:-	52.8	50.2	44.3	41.5	41.1	----	-----	46773.5	52.1
294	9/10/2025	13:13:12	00d	01:00.0	46.2	64	53.4	39.9	-:-	52.4	50.3	42.7	40.4	40.1	----	-----	41686.9	52.2
295	9/10/2025	13:14:12	00d	01:00.0	50.2	68	56.7	42.5	-:-	55.7	53.9	48.7	43	42.9	----	-----	104712.9	52.3
296	9/10/2025	13:15:12	00d	01:00.0	50.6	68.4	54.8	44.2	-:-	54.5	53.1	50.1	45.3	44.6	----	-----	114815.4	52.3
297	9/10/2025	13:16:12	00d	01:00.0	58.1	75.9	67.4	42.5	-:-	66.5	62.8	52.1	42.8	42.7	----	-----	645654.2	52.3
298	9/10/2025	13:17:12	00d	01:00.0	49.8	67.6	57	40.5	-:-	54.3	53.9	48.7	41	40.8	----	-----	95499.3	52.1
299	9/10/2025	13:18:12	00d	01:00.0	46.2	64	50.5	41.1	-:-	50.2	49.9	44.6	41.4	41.2	----	-----	41686.9	52.3
300	9/10/2025	13:19:12	00d	01:00.0	46	63.8	52.6	38.7	-:-	50.8	49.6	44.9	39	38.9	----	-----	39810.7	52.3
301	9/10/2025	13:20:12	00d	01:00.0	53	70.8	60.3	39.2	-:-	59.2	56.8	50.5	39.7	39.4	----	-----	199526.2	52.3
302	9/10/2025	13:21:12	00d	01:00.0	52.1	69.9	58.8	39.1	-:-	58.6	56.6	47.8	40.6	40.2	----	-----	162181.0	52.6
303	9/10/2025	13:22:12	00d	01:00.0	51	68.8	55.3	44.9	-:-	54.9	53.5	50.6	46.4	45.3	----	-----	125892.5	52.5
304	9/10/2025	13:23:12	00d	01:00.0	48.7	66.5	54.5	40.3	-:-	53.7	52.2	47.4	43.8	41.3	----	-----	74131.0	52.5
305	9/10/2025	13:24:12	00d	01:00.0	47.5	65.3	54.5	39.5	-:-	54	52.3	44	40.2	39.6	----	-----	56234.1	52.5
306	9/10/2025	13:25:12	00d	01:00.0	50.3	68.1	55.6	41.8	-:-	55.1	54.1	49	43.3	42.9	----	-----	107151.9	52.5
307	9/10/2025	13:26:12	00d	01:00.0	46.4	64.2	51.5	39.8	-:-	51.1	50.3	45.3	40.4	40	----	-----	43651.6	52.5
308	9/10/2025	13:27:12	00d	01:00.0	51	68.8	57.8	40.8	-:-	56.9	55.6	47.5	41.9	41.7	----	-----	125892.5	52.5
309	9/10/2025	13:28:12	00d	01:00.0	53.9	71.7	61.1	46.2	-:-	59.8	57.1	52.3	46.6	46.4	----	-----	245470.9	52.5
310	9/10/2025	13:29:12	00d	01:00.0	55.9	73.7	66	43.7	-:-	65.1	59.9	48.8	45.3	44.1	----	-----	389045.1	52.5
311	9/10/2025	13:30:12	00d	01:00.0	48.4	66.2	55.9	38.6	-:-	55.1	53.4	44.4	39.1	38.8	----	-----	69183.1	52.4
312	9/10/2025	13:31:12	00d	01:00.0	55.7	73.5	68.1	42.6	-:-	60.6	57.8	52.4	43.8	43.3	----	-----	371535.2	52.4
313	9/10/2025	13:32:12	00d	01:00.0	53	70.8	63.4	42.8	-:-	58.1	57.4	50.2	45.6	44.2	----	-----	199526.2	52.3
314	9/10/2025	13:33:12	00d	01:00.0	49.2	67	58.6	40.3	-:-	55.6	53.1	47.4	41.4	40.5	----	-----	83176.4	52.4
315	9/10/2025	13:34:12	00d	01:00.0	49.7	67.5	54	40.8	-:-	53.6	53	49	43.7	41.8	----	-----	93325.4	52.5
316	9/10/2025	13:35:12	00d	01:00.0	51.1	68.9	55.4	39.6	-:-	54.9	54.6	50.2	40.3	39.9	----	-----	128825.0	52.5
317	9/10/2025	13:36:12	00d	01:00.0	50.9	68.7	57.3	38.5	-:-	57	54.7	47.6	39.1	38.9	----	-----	123026.9	52.4
318	9/10/2025	13:37:12	00d	01:00.0	54.3	72.1	63.4	38.2	-:-	62.1	60.3	46.9	39.2	38.7	----	-----	269153.5	52.4
319	9/10/2025	13:38:12	00d	01:00.0	48.5	66.3	52.9	40.5	-:-	52.6	52	48	41.2	40.7	----	-----	70794.6	52.5
320	9/10/2025	13:39:12	00d	01:00.0	59.3	77.1	69.1	46.6	-:-	67	62.6	54	47.5	46.8	----	-----	851138.0	52.5
321	9/10/2025	13:40:12	00d	01:00.0	51.5	69.3	61	40.1	-:-	59.2	54.8	47.1	41.7	40.3	----	-----	141253.8	52.2
322	9/10/2025	13:41:12	00d	01:00.0	50.2	68	58.5	39.4	-:-	57.2	54.3	47.2	41.1	39.7	----	-----	104712.9	52.3
323	9/10/2025	13:42:12	00d	01:00.0	48	65.8	52.3	41.2	-:-	52.1	51	47.6	42.7	41.8	----	-----	63095.7	52.3
324	9/10/2025	13:43:12	00d	01:00.0	50.8	68.6	55.5	44.2	-:-	54.9	53.5	50	46.6	45	----	-----	120226.4	52.3
325	9/10/2025	13:44:12	00d	01:00.0	48.9	66.7	53.9	41.5	-:-	53.3	52.7	47.4	43.5	42.7	----	-----	77624.7	52.3
326	9/10/2025	13:45:12	00d	01:00.0	45.2	63	52	38.4	-:-	51.5	49.7	41.8	39	38.9	----	-----	33113.1	52.3
327	9/10/2025	13:46:12	00d	01:00.0	51.7	69.5	59.3	41.2	-:-	58.8	55.2	50.1	42.7	41.5	----	-----	147910.8	52.3
328	9/10/2025	13:47:12	00d	01:00.0	49.3	67.1	56.4	39.4	-:-	55.4	53.5	46.5	40	39.7	----	-----	85113.8	52.3
329	9/10/2025	13:48:12	00d	01:00.0	53.6	71.4	62.4	40.4	-:-	61.9	59.5	48.2	41.4	41	----	-----	229086.8	53.5
330	9/10/2025	13:49:12	00d	01:00.0	52.1	69.9	56.4	42.5	-:-	56.1	55.6	51.6	43.6	43.2	----	-----	162181.0	53.4

331	9/10/2025	13:50:12	00d	01:00.0	51.9	69.7	56	46.6	-:-	55.7	55.4	50.6	47.6	47.3	----	-----	154881.7	53.5
332	9/10/2025	13:51:12	00d	01:00.0	54.9	72.7	62.9	46.7	-:-	61.5	59.1	52.8	47	46.8	----	-----	309029.5	53.6
333	9/10/2025	13:52:12	00d	01:00.0	51.9	69.7	58.2	45.1	-:-	55.2	54.6	51.9	47.1	45.8	----	-----	154881.7	53.5
334	9/10/2025	13:53:12	00d	01:00.0	48.8	66.6	54.7	39.8	-:-	54.6	54	42.4	40.1	39.9	----	-----	75857.8	53.5
335	9/10/2025	13:54:12	00d	01:00.0	51.8	69.6	57.5	45.6	-:-	57.2	55.4	49.9	46.1	45.6	----	-----	151356.1	53.5
336	9/10/2025	13:55:12	00d	01:00.0	51.3	69.1	58.7	42.7	-:-	57.7	54.9	49.6	43.3	43	----	-----	134896.3	53.4
337	9/10/2025	13:56:12	00d	01:00.0	53.9	71.7	63.6	38	-:-	62.2	58.6	47.8	38.6	38.2	----	-----	245470.9	53.4
338	9/10/2025	13:57:12	00d	01:00.0	48.8	66.6	55.1	37.9	-:-	54.5	52.7	46.6	39.1	38.2	----	-----	75857.8	53.4
339	9/10/2025	13:58:12	00d	01:00.0	50.3	68.1	55.5	40	-:-	55.3	54.3	48.9	40.6	40.4	----	-----	107151.9	53.5
340	9/10/2025	13:59:12	00d	01:00.0	49.7	67.5	55	42	-:-	54.2	53.5	47.9	43	42.2	----	-----	93325.4	53.5
341	9/10/2025	14:00:12	00d	01:00.0	47.7	65.5	53.7	38.8	-:-	53.5	52.2	45	40.1	39.6	----	-----	58884.4	53.5
342	9/10/2025	14:01:12	00d	01:00.0	58.3	76.1	68.9	40.4	-:-	67.3	63.7	53.5	42.6	42.4	----	-----	676083.0	53.5
343	9/10/2025	14:02:12	00d	01:00.0	52.2	70	56.4	45.6	-:-	56.1	55.4	51.6	46.1	45.8	----	-----	165958.7	53.3
344	9/10/2025	14:03:12	00d	01:00.0	49.9	67.7	56.1	39.9	-:-	55.7	54.9	45.3	40.3	40.2	----	-----	97723.7	53.4
345	9/10/2025	14:04:12	00d	01:00.0	48.3	66.1	55.2	37.9	-:-	53.8	53.3	45.3	38.4	38.2	----	-----	67608.3	53.4
346	9/10/2025	14:05:12	00d	01:00.0	52.8	70.6	57.4	44.8	-:-	56.6	55.9	52	46.4	46	----	-----	190546.1	53.5
347	9/10/2025	14:06:12	00d	01:00.0	52.1	69.9	58.6	42.9	-:-	57.4	55.4	50	43.9	43.7	----	-----	162181.0	53.4
348	9/10/2025	14:07:12	00d	01:00.0	51.4	69.2	58.8	41	-:-	58.1	55.7	49.3	43	42	----	-----	138038.4	53.6
349	9/10/2025	14:08:12	00d	01:00.0	53.8	71.6	57.5	44.6	-:-	56.9	56.5	53.6	46.1	45.7	----	-----	239883.3	53.6
350	9/10/2025	14:09:12	00d	01:00.0	51.9	69.7	57.1	39.3	-:-	55.4	55.2	52	40	39.5	----	-----	154881.7	53.5
351	9/10/2025	14:10:12	00d	01:00.0	50.6	68.4	57.6	41	-:-	55.7	54.3	48.9	42.3	41.8	----	-----	114815.4	53.5
352	9/10/2025	14:11:12	00d	01:00.0	50.2	68	59	40.7	-:-	55.6	53.3	47.5	41.5	41	----	-----	104712.9	53.5
353	9/10/2025	14:12:12	00d	01:00.0	49.9	67.7	54.6	43.3	-:-	54.6	53.2	48.4	43.9	43.7	----	-----	97723.7	53.5
354	9/10/2025	14:13:12	00d	01:00.0	53.8	71.6	62.1	40.5	-:-	60.9	59.3	48.2	41.7	40.8	----	-----	239883.3	53.5
355	9/10/2025	14:14:12	00d	01:00.0	55	72.8	62.6	43.9	-:-	61.7	59.9	51	46.5	44.7	----	-----	316227.8	53.4
356	9/10/2025	14:15:12	00d	01:00.0	52.5	70.3	60.5	42.8	-:-	59.9	57.7	48.8	43.8	43.3	----	-----	177827.9	53.4
357	9/10/2025	14:16:12	00d	01:00.0	49.3	67.1	54.2	43.1	-:-	53.9	53.1	48.1	43.6	43.3	----	-----	85113.8	53.4
358	9/10/2025	14:17:12	00d	01:00.0	50.2	68	55.3	44.9	-:-	55	53.3	49.4	46.2	45.7	----	-----	104712.9	53.4
359	9/10/2025	14:18:12	00d	01:00.0	57.7	75.5	66.9	44.8	-:-	65.1	61	53.8	49	47.7	----	-----	588843.7	53.4
360	9/10/2025	14:19:12	00d	01:00.0	48.3	66.1	54.9	40.7	-:-	54.4	53.7	44.3	41.2	40.9	----	-----	67608.3	53.3
361	9/10/2025	14:20:12	00d	01:00.0	48.1	65.9	56.8	39.2	-:-	56.3	52.4	43.1	39.5	39.5	----	-----	64565.4	53.3
362	9/10/2025	14:21:12	00d	01:00.0	59.2	77	69.4	40.4	-:-	68.2	64	47	40.7	40.6	----	-----	831763.8	53.3
363	9/10/2025	14:22:12	00d	01:00.0	51.2	69	58.8	38.9	-:-	56.5	56	46	39.1	39	----	-----	131825.7	53.0
364	9/10/2025	14:23:12	00d	01:00.0	48.7	66.5	54.4	38.9	-:-	53.8	53.6	46.7	39.1	39.1	----	-----	74131.0	53.0
365	9/10/2025	14:24:12	00d	01:00.0	47.8	65.6	54.2	39.5	-:-	53.3	51.8	44.6	39.9	39.7	----	-----	60256.0	53.1
366	9/10/2025	14:25:12	00d	01:00.0	49.2	67	53.5	40.2	-:-	53.5	53.1	48.1	44	41.8	----	-----	83176.4	53.1
367	9/10/2025	14:26:12	00d	01:00.0	50	67.8	56	38	-:-	55.4	54.5	47.8	39	38.3	----	-----	100000.0	53.1
368	9/10/2025	14:27:12	00d	01:00.0	47.3	65.1	52.4	38	-:-	52.4	51.3	45.2	39	38.4	----	-----	53703.2	53.1
369	9/10/2025	14:28:12	00d	01:00.0	48.7	66.5	54.5	40	-:-	53.8	53.2	47.1	40.4	40.2	----	-----	74131.0	53.2
370	9/10/2025	14:29:12	00d	01:00.0	53.7	71.5	62.4	41.6	-:-	61.3	58.2	50.1	43.9	42.1	----	-----	234422.9	53.4
371	9/10/2025	14:30:12	00d	01:00.0	51.5	69.3	57.8	39.6	-:-	57.8	57.2	48.8	42.7	40.4	----	-----	141253.8	53.3
372	9/10/2025	14:31:12	00d	01:00.0	44.1	61.9	50.6	38.5	-:-	49.8	48.4	40.5	39	38.9	----	-----	25704.0	53.3
373	9/10/2025	14:32:12	00d	01:00.0	53.1	70.9	64.7	39.2	-:-	62	53.3	46	39.6	39.3	----	-----	204173.8	53.4
374	9/10/2025	14:33:12	00d	01:00.0	56.8	74.6	65.8	41.7	-:-	65	61.7	48.5	42.9	42.3	----	-----	478630.1	53.4
375	9/10/2025	14:34:12	00d	01:00.0	51.2	69	55.5	44.3	-:-	54.8	54.6	50.8	45.3	44.9	----	-----	131825.7	53.2
376	9/10/2025	14:35:12	00d	01:00.0	50	67.8	57	40.9	-:-	56.1	52.8	47.7	41.5	41.2	----	-----	100000.0	53.3
377	9/10/2025	14:36:12	00d	01:00.0	49.6	67.4	54.6	44.5	-:-	54	53.5	48.4	44.7	44.5	----	-----	91201.1	53.3
378	9/10/2025	14:37:12	00d	01:00.0	47.3	65.1	53.2	39.4	-:-	52.5	51.6	44.7	39.7	39.6	----	-----	53703.2	53.3
379	9/10/2025	14:38:12	00d	01:00.0	56	73.8	64.4	39.9	-:-	63.1	61.5	52	40.6	40.3	----	-----	398107.2	53.4
380	9/10/2025	14:39:12	00d	01:00.0	52.6	70.4	57.4	48	-:-	57.1	56.4	51.2	48.8	48.6	----	-----	181970.1	53.3
381	9/10/2025	14:40:12	00d	01:00.0	49.4	67.2	56.2	41.8	-:-	52.6	52.3	48.6	42.6	41.5	----	-----	87096.4	53.4
382	9/10/2025	14:41:12	00d	01:00.0	55.3	73.1	64.9	40.5	-:-	63.9	60.4	45.3	41	40.8	----	-----	338844.2	53.4
383	9/10/2025	14:42:12	00d	01:00.0	48.4	66.2	52.4	40.8	-:-	52.1	51.9	47.4	41.7	41.1	----	-----	69183.1	53.3
384	9/10/2025	14:43:12	00d	01:00.0	47.2	65	52.9	40	-:-	52	51.1	45.1	40.4	40.2	----	-----	52480.7	53.4
385	9/10/2025	14:44:12	00d	01:00.0	52.7	70.5	63.2	41.6	-:-	61.3	55.1	48.8	42.3	42	----	-----	186208.7	53.4
386	9/10/2025	14:45:12	00d	01:00.0	49.7	67.5	56.8	41.6	-:-	56.7	54.3	47.1	42.1	42	----	-----	93325.4	53.4
387	9/10/2025	14:46:12	00d	01:00.0	51.4	69.2	55.8	45.8	-:-	54.8	54.2	50.7	47	46.4	----	-----	138038.4	53.4
388	9/10/2025	14:47:12	00d	01:00.0	47.5	65.3	53.4	41.7	-:-	52.5	50.1	46	43.6	43.1	----	-----	56234.1	53.5
389	9/10/2025	14:48:12	00d	01:00.0	65.2	83	79.3	41.1	-:-	73.8	66.2	48.8	42.6	41.1	----	-----	3311311.2	53.6
390	9/10/2025	14:49:12	00d	01:00.0	50.6	68.4	56.5	39.9	-:-	55.8	55.1	46.5	40.6	40.1	----	-----	114815.4	52.5
391	9/10/2025	14:50:12	00d	01:00.0	56.3	74.1	65.4	41.2	-:-	63.6	60.6	53.9	42.2	41.4	----	-----	426579.5	52.6
392	9/10/2025	14:51:12	00d	01:00.0	53.6	71.4	58.3	47.2	-:-	57.5	56.4	52.9	49.3	49	----	-----	229086.8	52.5
393	9/10/2025	14:52:12	00d	01:00.0	48.4	66.2	54.2	42.7	-:-	53.7	53	46.3	43.5	43.4	----	-----	69183.1	52.5
394	9/10/2025	14:53:12	00d	01:00.0	50.2	68	54.8	40	-:-	54.5	54.2	48.9	40.6	40.3	----	-----	104712.9	52.5
395	9/10/2025	14:54:12	00d	01:00.0	47.9	65.7	52.7	39.8	-:-	52.5	52.1	46.7	40.6	40.2	----	-----	61659.5	52.5
396	9/10/2025	14:55:12	00d	01:00.0	48.6	66.4	54	38.4	-:-	53.5	53.3	44.5	39	38.6	----	-----	72443.6	52.6
397	9/10/2025	14:56:12	00d	01:00.0	47.4	65.2	54.3	38.7	-:-	53.4	51.7	43.5	39.6	39.2	----	-----	54954.1	52.7
398	9/10/2025	14:57:12	00d	01:00.0	55.6	73.4	65.6	44.7	-:-	63.2	59.8	50.5	46.9	46.7	----	-----	363078.1	52.7
399	9/10/2025	14:58:12	00d	01:00.0	51.6	69.4	57.2	43.2	-:-	56.6	55.7	49.9	45	44.4	----	-----	144544.0	52.6
400	9/10/2025	14:59:12	00d	01:00.0	53	70.8	61.6	40.1	-:-	60	56.4	49.7	42.3	41.1	----	-----	199526.2	52.7
401	9/10/2025	15:00:12	00d	01:00.0	52.2	70	59	40	-:-	58.2	56.6	49.6	42.7	40.2	----	-----	165958.7	52.7
402	9/10/2025	15:01:12	00d	01:00.0	49	66.8	54.9	38	-:-	54.3	53.7	45	38.3	38.1	----	-----	79432.8	52.7
403	9/10/2025	15:02:12	00d	01:00.0	48.6	66.4	54.2	41.4	-:-	54	52.5	46.4	42.5	42	----	-----	72443.6	52.8
404	9/10/2025	15:03:12	00d	01:00.0	54.5	72.3	60	45.8	-:-	58.7	57.5	54.1	48.7	46.4	----	-----	281838.3	52.8
405	9/10/2025	15:04:12	00d	01:00.0	52.8	70.6	57.8	43.5	-:-	57.3	56.4	51	44.4	43.9	----	-----	190546.1	52.8
406	9/10/2025	15:05:12	00d	01:00.0	55.1	72.9	63.6	45.6	-:-	62.6	58.4	52.1	46.8	46.5	----	-----	323593.7	52.8
407	9/10/2025	15:06:12	00d	01:00.0	49.5	67.3	61	39.3	-:-	54.9	54.7	46.4	39.7	39.5	----	-----	89125.1	52.8
408	9/10/2025	15:07:12	00d	01:00.0	57.1	74.9	65.9	47.9	-:-	64.8	61.6	52.5	48.6	48.6	----	-----	512861.4	52.9
409	9/10/2025	15:08:12	00d	01:00.0	53.3	71.1	57.3	47.6	-:-	56.6	55.7	52.7	49.2	48.5	----	-----	213796.2	52.7
410	9/10/2025	15:09:12	00d	01:00.0	49.3	67.1	52.4	43.2	-:-	52.1	51.9	49.1	44.4	43.4	----	-----	85113.8	52.7
411	9/10/2025	15:10:12	00d	01:00.0	49	66.8	55.2	38.5	-:-	54.6	52.8	46.1	38.9	38.7	----	-----	79432.8	52.8
412	9/10/2025	15:11:12	00d	01:00.0	49.7	67.5	56.7	38.8	-:-	56.1	53.6	47.3	40.1	39.2	----	-----	93325.4	52.8
413	9/10/2025	15:12:12	00d	01:00.0	49.8	67.6	54.9	40.7	-:-	54.8	54	46.9	41.8	41.1	----	-----	95499.3	52.8
414	9/10/2025	15:13:12	00d	01:00.0	50.4	68.2	55.7	40.6	-:-	54.9	53.9	48.7	43.3	42	----	-----	109647.8	52.9
415	9/10/2025	15:14:12	00d	01:00.0	48.4	66.2	55.8	39.8	-:-	55.8	53.6	44	40.1	40	----	-----	69183.1	52.9
416	9/10/2025	15:15:12	00d	01:00.0	54.8	72.6	59.3	44.7	-:-	59.2	58	54.3	49.8	47.5	----	-----	301995.2	53.0
417	9/10/2025	15:16:12	00d	01:00.0	47.6	65.4	52.9	40.2	-:-	52.7	51.3	44.1	40.7	40.4	----	-----	57544.0	52.9
418	9/10/2025	15:17:12	00d	01:00.0	52	69.8	56.8	44.2	-:-	56.1	55.6	50.7	45.7	45.3	----	-----	158489.3	52.9
419	9/10/2025	15:18:12	00d	01:00.0	50.6	68.4	56.1	42	-:-	55.7	53.6	49.5	43.8	42.8	----	-----	114815.4	52.9
420	9/10/2025	15:19:12	00d	01:00.0	49	66.8	52.6	42.4	-:-	52.2	51.8	48.6	43.7	42.9	----	-----	79432.8	52.9
421	9/10/2025	15:20:12	00d	01:00.0	45.7	63.5	49.7	41.1	-:-	49.5	49.4	43.6	41.7	41.4	----	-----	37153.5	53.0
422	9/10/2025	15:21:12	00d	01:00.0	50.4	68.2	55.3	41.6	-:-	55.1	54.2	49.1	42.3	41.8	----	-----	109647.8	53.0
423	9/10/2025	15:22:12	00d	01:00.0	50.5	68.3	54.9	40.6	-:-	54.5	54	49.9	40.8	40.8	----	-----	112201.8	53.2
424	9/10/2025	15:23:12	00d	01:00.0	52.9	70.7	57.5	45	-:-	57	56.5	52.1	45.8	45.2	----	-----	194984.5	53.3
425	9/10/2025	15:24:12	00d	01:00.0	55.7	73.5	64.7	40.2	-:-	64.7	59.7	51.8	41.7	40.9	----	-----	371535.2	53.3
426	9/10/2025	15:25:12	00d	01:00.0	45.3	63.1	50.8	39.3	-:-	50.3	48.4	43.7	39.9	39.6	----	-----	33884.4	53.2
427	9/10/2025	15:26:12	00d	01:00.0	50.2	68	56	39.7	-:-	54.9	54.2	48.8	41.7	40.4	----	-----	104712.9	53.3
428	9/10/2025	15:27:12	00d	01:00.0	49	66.8	53.5	39.7	-:-	53.5	53.1	47.2	40.1	39.8	----	-----	79432.8	53.3
429	9/10/2025	15:28:12	00d	01:00.0	54.8	72.6	63	44	-:-	60.8	59	52.1	45.2	44.3	----	-----	301995.2	53.4
430	9/10/2025	15:29:12	00d	01:00.0	57	74.8	66.1	41.7	-:-	64.4	61.4	53.4	43.8	42.3	----	-----	501187.2	53.4
431	9/10/2025	15:30:12	00d	01:00.0	51.1	68.9	54.9	43.1	-:-	54.7	54.1	50.3	44.6	43.8	----	-----	128825.0	53.3
432	9/10/2025	15:31:12	00d	01:00.0	50.9	68.7	55.3	45.7	-:-	54.8	54.1	50.3	46.1	46	----	-----	123026.9	53.3
433	9/10/2025	15:32:12	00d	01:00.0	50.3	68.1	55.2	43.2	-:-	55	54.3	48	44.6	43.9	----	-----	107151.9	53.3
434	9/10/2025	15:33:12	00d	01:00.0	53.1	70.9	59.3	43.8	-:-	58.9	57.7	51	45	44.5	----	-----	204173.8	53.3
435	9/10/2025	15:34:12	00d	01:00.0	51.6	69.4	55.8	43.3	-:-	55.7	55.2	50.7	44.7	43.6	----	-----	144544.0	53.3
436	9/10/2025	15:35:12	00d	01:00.0	52.9	70.7	56.5	47.5	-:-	55.7	55.5	52.8	48.5	48.3	----	-----	194984.5	53.3
437	9/10/2025	15:36:12	00d	01:00.0	54.4	72.2	62.6	44.8	-:-	61.4	58.7	51.2	46	45.1	----	-----	275422.9	53.3
438	9/10/2025	15:37:12	00d	01:00.0	48.4	66.2	52.8	44.2	-:-	52.7	50.9	47.5	44.7	44.1	----	-----	69183.1	53.3
439	9/10/2025	15:38:12	00d	01:00.0	53.5	71.3	60.9	44.9	-:-	59.4	58	51	46.7	46	----	-----	223872.1	53.4
440	9/10/2025	15:39:12	00d	01:00.0	53.3	71.1	57.8	48.5	-:-	56.8	56.4	52.2	49.2	48.6	----	-----	213796.2	53.4
441	9/10/2025	15:40:12	00d	01:00.0	55.6	73.4	63	47.8	-:-	62.7	59.7	52.3	48.8	48.1	----	-----	363078.1	53.4

442	9/10/2025	15:41:12	00d	01:00.0	50.3	68.1	54	45.7	-:-	53.8	53	49.9	47.2	46.3	----	-----	107151.9	53.4
443	9/10/2025	15:42:12	00d	01:00.0	52	69.8	56.3	44.8	-:-	56	55.8	50.9	45.9	45.5	----	-----	158489.3	53.4
444	9/10/2025	15:43:12	00d	01:00.0	53.3	71.1	57.2	45.7	-:-	56.8	55.8	53.5	47.3	46.7	----	-----	213796.2	53.4
445	9/10/2025	15:44:12	00d	01:00.0	53.1	70.9	59.7	44.8	-:-	59.7	56.6	51.3	45.7	45.2	----	-----	204173.8	53.4
446	9/10/2025	15:45:12	00d	01:00.0	50.2	68	54.6	40.7	-:-	54.6	54.3	48.6	43.3	40.8	----	-----	104712.9	53.5
447	9/10/2025	15:46:12	00d	01:00.0	53.4	71.2	58.9	45.2	-:-	58.9	57.5	51.8	46.6	45.8	----	-----	218776.2	53.5
448	9/10/2025	15:47:12	00d	01:00.0	55.7	73.5	60.3	50.8	-:-	60.1	59.4	54.5	52	51.3	----	-----	371535.2	53.5
449	9/10/2025	15:48:12	00d	01:00.0	55.1	72.9	60	45.2	-:-	59.5	58.2	54.6	46.5	46.1	----	-----	323593.7	53.4
450	9/10/2025	15:49:12	00d	01:00.0	54.7	72.5	61.3	46.1	-:-	61.1	60.2	52	46.2	46.2	----	-----	295120.9	53.4
451	9/10/2025	15:50:12	00d	01:00.0	54	71.8	58.2	47.3	-:-	58	56.4	53.4	49.5	48.5	----	-----	251188.6	53.4
452	9/10/2025	15:51:12	00d	01:00.0	53.1	70.9	56.4	49	-:-	55.9	55.2	52.5	50.4	49.4	----	-----	204173.8	53.3
453	9/10/2025	15:52:12	00d	01:00.0	52	69.8	56.3	45.9	-:-	55.9	55.5	51.4	46.8	46.6	----	-----	158489.3	53.3
454	9/10/2025	15:53:12	00d	01:00.0	52.5	70.3	58.3	47.4	-:-	58	56	50.4	48.3	47.7	----	-----	177827.9	53.3
455	9/10/2025	15:54:12	00d	01:00.0	53.1	70.9	58.1	46.9	-:-	57.9	57	51.4	48.3	47.4	----	-----	204173.8	53.3
456	9/10/2025	15:55:12	00d	01:00.0	54.8	72.6	61.2	47.3	-:-	60.8	58.2	53.3	48.1	47.5	----	-----	301995.2	53.2
457	9/10/2025	15:56:12	00d	01:00.0	51.4	69.2	54.8	46.2	-:-	54.3	54.1	51.2	47.2	46.8	----	-----	138038.4	53.2
458	9/10/2025	15:57:12	00d	01:00.0	53	70.8	59.2	45.4	-:-	59.1	57.2	50.6	46.4	46.2	----	-----	199526.2	53.2
459	9/10/2025	15:58:12	00d	01:00.0	51	68.8	57	45.6	-:-	56.2	54.7	48.3	46.2	45.9	----	-----	125892.5	53.2
460	9/10/2025	15:59:12	00d	01:00.0	54.4	72.2	62.1	47	-:-	60.2	57.4	51.1	48	47.5	----	-----	275422.9	53.2
461	9/10/2025	16:00:12	00d	01:00.0	52.2	70	59	45.4	-:-	58.9	55.8	49.7	46.2	45.8	----	-----	165958.7	53.2
462	9/10/2025	16:01:12	00d	01:00.0	54.4	72.2	61.9	46.1	-:-	61.3	59.5	51.7	47.2	46.6	----	-----	275422.9	53.3
463	9/10/2025	16:02:12	00d	01:00.0	54.4	72.2	62.3	47	-:-	60.7	57.4	51.2	48.7	48.3	----	-----	275422.9	53.4
464	9/10/2025	16:03:12	00d	01:00.0	53.7	71.5	58.6	45.3	-:-	58	57.8	50.8	46.5	45.9	----	-----	234422.9	53.3
465	9/10/2025	16:04:12	00d	01:00.0	53	70.8	58.5	45	-:-	57.7	57.3	51.9	46.3	45.8	----	-----	199526.2	53.3
466	9/10/2025	16:05:12	00d	01:00.0	52	69.8	56.4	45.1	-:-	56.4	56	51.1	46.2	45.8	----	-----	158489.3	53.3
467	9/10/2025	16:06:12	00d	01:00.0	55	72.8	59.8	49.1	-:-	59.6	58.3	53.9	49.7	49.2	----	-----	316227.8	53.4
468	9/10/2025	16:07:12	00d	01:00.0	53.9	71.7	59.7	45.5	-:-	58.9	58.7	51.8	46.4	46	----	-----	245470.9	53.3
469	9/10/2025	16:08:12	00d	01:00.0	53.5	71.3	58.3	48.3	-:-	55.2	55	53.6	50.7	50.2	----	-----	223872.1	53.4
470	9/10/2025	16:09:12	00d	01:00.0	53.1	70.9	56.9	47.7	-:-	56.7	56.1	52.3	48	47.6	----	-----	204173.8	53.3
471	9/10/2025	16:10:12	00d	01:00.0	52.2	70	58.4	45.7	-:-	57.5	55.1	51.1	46.4	46.1	----	-----	165958.7	53.4
472	9/10/2025	16:11:12	00d	01:00.0	53.8	71.6	57.6	45.8	-:-	57.4	56.9	53.8	46.8	46.5	----	-----	239883.3	53.4
473	9/10/2025	16:12:12	00d	01:00.0	50	67.8	56	42.6	-:-	55.1	52.4	49.1	43.1	42.9	----	-----	100000.0	53.3
474	9/10/2025	16:13:12	00d	01:00.0	53.3	71.1	58.3	45.8	-:-	57.9	56.8	52.3	46.6	46.3	----	-----	213796.2	53.4
475	9/10/2025	16:14:12	00d	01:00.0	50	67.8	56.8	44.9	-:-	56.6	54.2	47.6	45.9	45.1	----	-----	100000.0	53.4
476	9/10/2025	16:15:12	00d	01:00.0	54.5	72.3	59.5	46.8	-:-	59.2	57.6	53.7	48.8	47.4	----	-----	281838.3	53.4
477	9/10/2025	16:16:12	00d	01:00.0	48.9	66.7	55.1	42.4	-:-	53.5	52	47.6	43.4	42.5	----	-----	77624.7	53.4
478	9/10/2025	16:17:12	00d	01:00.0	53.8	71.6	58.3	44.7	-:-	58	57	53.5	46.3	45.6	----	-----	239883.3	53.4
479	9/10/2025	16:18:12	00d	01:00.0	51.1	68.9	54.5	45.1	-:-	53.9	53.8	50.9	46.5	45.9	----	-----	128825.0	53.4
480	9/10/2025	16:19:12	00d	01:00.0	51.2	69	56.2	43.4	-:-	56.2	55.4	48.2	44.4	44	----	-----	131825.7	53.4
481	9/10/2025	16:20:12	00d	01:00.0	53.3	71.1	60.1	47.5	-:-	59.2	57.5	50.8	48.3	47.9	----	-----	213796.2	53.5
482	9/10/2025	16:21:12	00d	01:00.0	53.2	71	56.6	45.9	-:-	56.3	56.1	52.4	48.6	47.4	----	-----	208929.6	53.5
483	9/10/2025	16:22:12	00d	01:00.0	58.4	76.2	68.8	45.9	-:-	65.9	62	54.1	49	46.8	----	-----	691831.0	53.5
484	9/10/2025	16:23:12	00d	01:00.0	53.2	71	56.3	46.7	-:-	56.1	55.6	52.9	48.7	47.4	----	-----	208929.6	53.4
485	9/10/2025	16:24:12	00d	01:00.0	54.7	72.5	59.3	48.6	-:-	59	57.5	54.3	50.2	49	----	-----	295120.9	53.3
486	9/10/2025	16:25:12	00d	01:00.0	52.7	70.5	56.6	48	-:-	56.1	55.9	51.4	48.6	48.3	----	-----	186208.7	53.3
487	9/10/2025	16:26:12	00d	01:00.0	52.6	70.4	58.4	43.3	-:-	58.3	57	48.5	43.6	43.4	----	-----	181970.1	53.3
488	9/10/2025	16:27:12	00d	01:00.0	52.6	70.4	58.6	46.4	-:-	57.9	55.2	51.7	47.3	46.8	----	-----	181970.1	53.3
489	9/10/2025	16:28:12	00d	01:00.0	54.3	72.1	60.2	46.7	-:-	59.3	57.3	52.9	49.8	49.5	----	-----	269153.5	53.3
490	9/10/2025	16:29:12	00d	01:00.0	54.2	72	57.2	49	-:-	57.1	56.6	53.7	50.3	49.4	----	-----	263026.8	53.3
491	9/10/2025	16:30:12	00d	01:00.0	51.7	69.5	56.5	44.3	-:-	55.2	55	50.9	44.8	44.7	----	-----	147910.8	53.3
492	9/10/2025	16:31:12	00d	01:00.0	51.8	69.6	56.3	46.3	-:-	55.9	54.8	50.4	47.4	46.9	----	-----	151356.1	53.3
493	9/10/2025	16:32:12	00d	01:00.0	52.4	70.2	56.2	47.5	-:-	55.9	54.8	51.9	49.5	48.6	----	-----	173780.1	53.3
494	9/10/2025	16:33:12	00d	01:00.0	52.9	70.7	57.6	45.4	-:-	57.2	56.5	50.8	46.9	46	----	-----	194984.5	53.3
495	9/10/2025	16:34:12	00d	01:00.0	52.9	70.7	57.7	47.2	-:-	57.4	57.1	51.4	48.2	47.5	----	-----	194984.5	53.3
496	9/10/2025	16:35:12	00d	01:00.0	51.7	69.5	56.2	46.4	-:-	56	55	51.3	47.3	46.7	----	-----	147910.8	53.3
497	9/10/2025	16:36:12	00d	01:00.0	49.6	67.4	54.5	44.3	-:-	54.4	53	48.1	45.3	44.8	----	-----	91201.1	53.3
498	9/10/2025	16:37:12	00d	01:00.0	55.3	73.1	58.9	43	-:-	58.6	58.3	55.9	45.1	43.7	----	-----	338844.2	53.4
499	9/10/2025	16:38:12	00d	01:00.0	53.9	71.7	57.3	49	-:-	57	56.4	53.9	49.7	49.2	----	-----	245470.9	53.4
500	9/10/2025	16:39:12	00d	01:00.0	55.6	73.4	62	46.3	-:-	61.2	59.2	53.9	49.5	47	----	-----	363078.1	53.3
501	9/10/2025	16:40:12	00d	01:00.0	52.8	70.6	57.7	46.2	-:-	56.8	56	52.2	48.5	47	----	-----	190546.1	53.3
502	9/10/2025	16:41:12	00d	01:00.0	55.7	73.5	60.3	50.2	-:-	59.9	58.1	54.8	51.5	50.5	----	-----	371535.2	53.3
503	9/10/2025	16:42:12	00d	01:00.0	53.3	71.1	57.3	43.8	-:-	56.8	55.3	53.5	45.1	44.1	----	-----	213796.2	53.2
504	9/10/2025	16:43:12	00d	01:00.0	51.9	69.7	55.3	43.8	-:-	55.1	54.8	51.7	47.3	46.6	----	-----	154881.7	53.2
505	9/10/2025	16:44:12	00d	01:00.0	54.3	72.1	61.7	48.4	-:-	60.9	56.7	52.8	49	48.3	----	-----	269153.5	53.4
506	9/10/2025	16:45:12	00d	01:00.0	53.7	71.5	57.7	47.1	-:-	57.3	56.6	53.2	48.3	47.5	----	-----	234422.9	53.3
507	9/10/2025	16:46:12	00d	01:00.0	52.5	70.3	56.6	47.2	-:-	55.2	54.8	52	48.5	47.4	----	-----	177827.9	53.3
508	9/10/2025	16:47:12	00d	01:00.0	53.1	70.9	57.2	46.2	-:-	56.8	56.3	52.9	46.7	46.6	----	-----	204173.8	53.3
509	9/10/2025	16:48:12	00d	01:00.0	53.4	71.2	58.6	48	-:-	57.5	56.1	52.3	49	48.4	----	-----	218776.2	53.3
510	9/10/2025	16:49:12	00d	01:00.0	54	71.8	59.7	49.3	-:-	58.1	56.8	52.9	49.7	49.4	----	-----	251188.6	53.3
511	9/10/2025	16:50:12	00d	01:00.0	52.4	70.2	59.6	46.2	-:-	56.4	56	50.9	46.9	46.6	----	-----	173780.1	53.3
512	9/10/2025	16:51:12	00d	01:00.0	51.3	69.1	56.6	44.3	-:-	56.1	54	50.4	45.5	45	----	-----	134896.3	53.3
513	9/10/2025	16:52:12	00d	01:00.0	52.4	70.2	60.7	44.6	-:-	59.7	56.4	48.8	45.4	45	----	-----	173780.1	53.4
514	9/10/2025	16:53:12	00d	01:00.0	47.2	65	50.9	43.7	-:-	50.9	50.6	45.7	44.4	44.1	----	-----	52480.7	53.4
515	9/10/2025	16:54:12	00d	01:00.0	51.2	69	58.2	45.3	-:-	56.2	53.9	49.8	46	45.8	----	-----	131825.7	53.7
516	9/10/2025	16:55:12	00d	01:00.0	49.6	67.4	53.4	44.7	-:-	53	52.7	48.7	45.6	45.4	----	-----	91201.1	53.6
517	9/10/2025	16:56:12	00d	01:00.0	50.6	68.4	56.4	44.6	-:-	56.2	55.8	47.7	45.2	45	----	-----	114815.4	53.7
518	9/10/2025	16:57:12	00d	01:00.0	52.5	70.3	56	46.4	-:-	55.8	55.7	52	47.5	47.2	----	-----	177827.9	53.7
519	9/10/2025	16:58:12	00d	01:00.0	53.9	71.7	59.3	46.5	-:-	59.3	57.7	52.2	48.4	48.1	----	-----	245470.9	53.7
520	9/10/2025	16:59:12	00d	01:00.0	53.8	71.6	57.2	48.9	-:-	56.9	56.7	53.3	49.7	49.2	----	-----	239883.3	53.7
521	9/10/2025	17:00:12	00d	01:00.0	53.7	71.5	57.3	44.9	-:-	56.8	56.1	53.8	46.4	45.3	----	-----	234422.9	53.6
522	9/10/2025	17:01:12	00d	01:00.0	56.1	73.9	63.5	44.8	-:-	62.9	60.5	53.9	48.8	46.6	----	-----	407380.3	53.6
523	9/10/2025	17:02:12	00d	01:00.0	56.9	74.7	64.2	47.1	-:-	63.5	60.8	54.5	49.5	47.7	----	-----	489778.8	53.5
524	9/10/2025	17:03:12	00d	01:00.0	50.2	68	55.2	46.5	-:-	54.8	52.7	49.4	46.7	46.6	----	-----	104712.9	53.4
525	9/10/2025	17:04:12	00d	01:00.0	53.1	70.9	56.4	49.7	-:-	56.3	56	51.7	50.4	50.2	----	-----	204173.8	53.5
526	9/10/2025	17:05:12	00d	01:00.0	52	69.8	55.8	47.4	-:-	55.2	54.1	51.9	48.1	47.6	----	-----	158489.3	53.5
527	9/10/2025	17:06:12	00d	01:00.0	56.4	74.2	62.1	46.5	-:-	61.3	59.8	54.5	47.1	46.8	----	-----	436515.8	53.5
528	9/10/2025	17:07:12	00d	01:00.0	52.6	70.4	57.4	47.6	-:-	57.3	55.5	51.5	48.9	48.8	----	-----	181970.1	53.5
529	9/10/2025	17:08:12	00d	01:00.0	54.7	72.5	59.9	46.2	-:-	59.6	57.8	54	48.2	46.6	----	-----	295120.9	53.4
530	9/10/2025	17:09:12	00d	01:00.0	52.3	70.1	57	45.5	-:-	56.2	55.5	51.1	46.3	46.2	----	-----	169824.4	53.4
531	9/10/2025	17:10:12	00d	01:00.0	55.5	73.3	61	50.1	-:-	60.1	58	54.3	51.1	50.5	----	-----	354813.4	53.4
532	9/10/2025	17:11:12	00d	01:00.0	52.6	70.4	56.8	46	-:-	56.7	56	51.7	47.4	46.4	----	-----	181970.1	53.3
533	9/10/2025	17:12:12	00d	01:00.0	49.4	67.2	55.5	45.3	-:-	54.1	53.1	47	46	45.7	----	-----	87096.4	53.3
534	9/10/2025	17:13:12	00d	01:00.0	53.2	71	56.9	46.5	-:-	56.9	56.4	52.2	47.6	47.1	----	-----	208929.6	53.3
535	9/10/2025	17:14:12	00d	01:00.0	52.7	70.5	57.3	47.7	-:-	56.7	56	51.8	48	47.9	----	-----	186208.7	53.3
536	9/10/2025	17:15:12	00d	01:00.0	53.3	71.1	58.2	49.5	-:-	57.8	55.9	52.3	49.8	49.7	----	-----	213796.2	53.3
537	9/10/2025	17:16:12	00d	01:00.0	51.7	69.5	56.3	47.3	-:-	56.1	54.3	50.2	48.7	48.1	----	-----	147910.8	53.3
538	9/10/2025	17:17:12	00d	01:00.0	52.3	70.1	58.4	47.5	-:-	58	55.6	51	48.2	47.9	----	-----	169824.4	53.3
539	9/10/2025	17:18:12	00d	01:00.0	52.7	70.5	57.2	47.6	-:-	56.9	56.2	51.2	48.8	48.1	----	-----	186208.7	53.3
540	9/10/2025	17:19:12	00d	01:00.0	52.1	69.9	55.5	47.2	-:-	55.2	54.7	51.8	48.4	47.9	----	-----	162181.0	53.3
541	9/10/2025	17:20:12	00d	01:00.0	56.2	74	64.5	48.1	-:-	63.5	60.3	53.7	48.8	48.3	----	-----	416869.4	53.3
542	9/10/2025	17:21:12	00d	01:00.0	56.6	74.4	63.1	51	-:-	61.8	58.9	55.9	51.2	51	----	-----	457088.2	53.3
543	9/10/2025	17:22:12	00d	01:00.0	52.6	70.4	55.8	48.8	-:-	55.3	54.6	52.2	49.8	49.3	----	-----	181970.1	53.2
544	9/10/2025	17:23:12	00d	01:00.0	51.4	69.2	54.9	47.8	-:-	54.4	54.1	50.4	48.7	48.2	----	-----	138038.4	53.2
545	9/10/2025	17:24:12	00d	01:00.0	50.3	68.1	55.4	46.9	-:-	55.1	53.4	48.2	47.3	47.1	----	-----	107151.9	53.2
546	9/10/2025	17:25:12	00d	01:00.0	53.4	71.2	58.8	47	-:-	58.7	56.2	52.4	49.7	48.2	----	-----	218776.2	53.2
547	9/10/2025	17:26:12	00d	01:00.0	53.4	71.2	58.8	47.1	-:-	58.4	56.8	52.2	47.5	47.3	----	-----	218776.2	53.3
548	9/10/2025	17:27:12	00d	01:00.0	53	70.8	58.9	47	-:-	56.4	55.9	52	47.9	47.6	----	-----	199526.2	53.3
549	9/10/2025	17:28:12	00d	01:00.0	53.7	71.5	60	45.5	-:-	59.3	58.2	49.2	46.9	46.3	----	-----	234422.9	53.3
550	9/10/2025	17:29:12	00d	01:00.0	51.3	69.1	55.6	47	-:-	55.1	54.6	50.3	47.6	47.2	----	-----	134896.3	53.3
551	9/10/2025	17:30:12	00d	01:00.0	53.1	70.9	57.9	47.5	-:-	57.7	56.2	51.9	47.9	47.7	----	-----	204173.8	53.3
552	9/10/2025	17:31:12	00d	01:00.0	53.2	71	56.5	47.9	-:-	56.3	56.2	52.6	48.5	48.2	----	-----	208929.6	53.3

553	9/10/2025	17:32:12	00d	01:00.0	52.8	70.6	56	48.1	-:-	55.6	55.5	52.6	48.6	48.5	----	-----	190546.1	53.2
554	9/10/2025	17:33:12	00d	01:00.0	53.8	71.6	57.5	50	-:-	57	56.7	52.8	50.7	50.5	----	-----	239883.3	53.2
555	9/10/2025	17:34:12	00d	01:00.0	53.4	71.2	56.7	50.3	-:-	56.3	55.9	52.6	51.2	51.1	----	-----	218776.2	53.2
556	9/10/2025	17:35:12	00d	01:00.0	51.6	69.4	56.5	47.8	-:-	55.5	53.9	50.8	48.6	48.1	----	-----	144544.0	53.2
557	9/10/2025	17:36:12	00d	01:00.0	50.4	68.2	56	45.6	-:-	55.8	53.8	49.1	45.9	45.9	----	-----	109647.8	53.2
558	9/10/2025	17:37:12	00d	01:00.0	56.9	74.7	65.2	46.8	-:-	64.3	60.9	53.5	47.9	47.5	----	-----	489778.8	53.2
559	9/10/2025	17:38:12	00d	01:00.0	52.9	70.7	58.3	45.7	-:-	58.2	57.6	50.9	46.1	45.9	----	-----	194984.5	53.1
560	9/10/2025	17:39:12	00d	01:00.0	49.5	67.3	54	45.7	-:-	53.7	51.5	48.9	46.6	46.1	----	-----	89125.1	53.1
561	9/10/2025	17:40:12	00d	01:00.0	52.2	70	57.1	45.4	-:-	56.4	55.6	51.3	46.3	45.7	----	-----	165958.7	53.1
562	9/10/2025	17:41:12	00d	01:00.0	51.7	69.5	57.1	44.3	-:-	56	55.2	50.4	44.7	44.4	----	-----	147910.8	53.1
563	9/10/2025	17:42:12	00d	01:00.0	53.7	71.5	58.6	49.5	-:-	57.2	57	52.3	50.1	49.7	----	-----	234422.9	53.1
564	9/10/2025	17:43:12	00d	01:00.0	52.6	70.4	58.8	45.1	-:-	57.9	56.5	51.7	45.9	45.4	----	-----	181970.1	53.0
565	9/10/2025	17:44:12	00d	01:00.0	57.8	75.6	63.5	49.5	-:-	62.8	61.8	56.7	50.8	49.9	----	-----	602559.6	53.0
566	9/10/2025	17:45:12	00d	01:00.0	53.2	71	61.6	46.4	-:-	57.5	56.7	52.1	46.9	46.6	----	-----	208929.6	52.8
567	9/10/2025	17:46:12	00d	01:00.0	52.8	70.6	57.2	47.5	-:-	57	56.7	51.6	48.5	47.7	----	-----	190546.1	52.8
568	9/10/2025	17:47:12	00d	01:00.0	51.4	69.2	55.2	44.7	-:-	54.9	54.5	51.2	45.4	44.9	----	-----	138038.4	52.8
569	9/10/2025	17:48:12	00d	01:00.0	47.9	65.7	53	45	-:-	52.9	50.5	46.8	45.7	45.6	----	-----	61659.5	52.8
570	9/10/2025	17:49:12	00d	01:00.0	54.8	72.6	59.8	46.8	-:-	59.9	59.2	53	47.9	47.4	----	-----	301995.2	52.8
571	9/10/2025	17:50:12	00d	01:00.0	55	72.8	61.5	47.2	-:-	61.2	59.1	51.1	47.6	47.4	----	-----	316227.8	52.8
572	9/10/2025	17:51:12	00d	01:00.0	51.2	69	55.1	47.5	-:-	54.9	52.6	50.7	48.9	48.5	----	-----	131825.7	52.7
573	9/10/2025	17:52:12	00d	01:00.0	54.9	72.7	61	48.8	-:-	60.8	58.1	53.5	49.5	49.2	----	-----	309029.5	52.7
574	9/10/2025	17:53:12	00d	01:00.0	55.2	73	62.2	49.4	-:-	58.4	56.6	54.8	51.8	50.3	----	-----	331131.1	52.6
575	9/10/2025	17:54:12	00d	01:00.0	59.4	77.2	70.3	44	-:-	67.7	65.4	51.1	45.9	44.4	----	-----	870963.6	52.5
576	9/10/2025	17:55:12	00d	01:00.0	46.5	64.3	50.4	44.3	-:-	50.5	48.8	45.2	44.4	44.4	----	-----	44668.4	52.2
577	9/10/2025	17:56:12	00d	01:00.0	52	69.8	57.2	46.5	-:-	56.7	55.4	51.3	47	46.6	----	-----	158489.3	52.3
578	9/10/2025	17:57:12	00d	01:00.0	53.5	71.3	57.7	45.5	-:-	57.5	56.6	52.8	46.4	45.8	----	-----	223872.1	52.2
579	9/10/2025	17:58:12	00d	01:00.0	53.3	71.1	57.7	47.9	-:-	57.2	55.9	52.5	48.7	48.4	----	-----	213796.2	52.2
580	9/10/2025	17:59:12	00d	01:00.0	51.3	69.1	55.3	47.4	-:-	55.2	54.9	49.3	47.7	47.5	----	-----	134896.3	52.1
581	9/10/2025	18:00:12	00d	01:00.0	52.4	70.2	56.1	47.5	-:-	55.7	55.3	51.5	48.5	48	----	-----	173780.1	52.1
582	9/10/2025	18:01:12	00d	01:00.0	52.4	70.2	55.6	47.2	-:-	55.1	54.8	51.8	49	48.4	----	-----	173780.1	52.1
583	9/10/2025	18:02:12	00d	01:00.0	50.8	68.6	55.1	46	-:-	55	53.3	50.4	46.6	46.3	----	-----	120226.4	52.1
584	9/10/2025	18:03:12	00d	01:00.0	52	69.8	55.5	47.5	-:-	55.2	55.1	51.5	48.3	47.6	----	-----	158489.3	52.1
585	9/10/2025	18:04:12	00d	01:00.0	53.7	71.5	58.9	47.2	-:-	58.2	56.6	53.2	48.6	47.9	----	-----	234422.9	52.1
586	9/10/2025	18:05:12	00d	01:00.0	54.6	72.4	59.1	47.3	-:-	58.7	57.9	53.6	48.3	47.7	----	-----	288403.2	52.0
587	9/10/2025	18:06:12	00d	01:00.0	54.4	72.2	62.4	46.3	-:-	61.9	58.8	50.6	46.7	46.5	----	-----	275422.9	51.9
588	9/10/2025	18:07:12	00d	01:00.0	53.5	71.3	56.6	45.9	-:-	56.6	56.5	53.4	46.9	46.4	----	-----	223872.1	51.9
589	9/10/2025	18:08:12	00d	01:00.0	50	67.8	57.1	44.8	-:-	56.5	55.2	46.5	45.3	45	----	-----	100000.0	51.8
590	9/10/2025	18:09:12	00d	01:00.0	51.2	69	54.7	45.6	-:-	54.5	54	50.7	47.3	47	----	-----	131825.7	51.8
591	9/10/2025	18:10:12	00d	01:00.0	49.7	67.5	54.9	46	-:-	54.1	53	48.1	46.5	46.4	----	-----	93325.4	51.8
592	9/10/2025	18:11:12	00d	01:00.0	52.4	70.2	57.8	46.5	-:-	57.6	56	50.8	46.9	46.6	----	-----	173780.1	51.8
593	9/10/2025	18:12:12	00d	01:00.0	51.9	69.7	56.2	46.7	-:-	56	54.7	51.1	47.2	46.9	----	-----	154881.7	51.9
594	9/10/2025	18:13:12	00d	01:00.0	51.7	69.5	57.5	45.5	-:-	57.4	56.9	48.9	46.4	45.7	----	-----	147910.8	51.8
595	9/10/2025	18:14:12	00d	01:00.0	51.2	69	56.6	46.9	-:-	56	54.5	49.7	47.3	47	----	-----	131825.7	51.8
596	9/10/2025	18:15:12	00d	01:00.0	48.1	65.9	53.6	44.8	-:-	52.4	51.1	46.5	45.4	45.2	----	-----	64565.4	51.8
597	9/10/2025	18:16:12	00d	01:00.0	54.4	72.2	59	46.2	-:-	58.5	58.1	54.4	47.6	47	----	-----	275422.9	51.8
598	9/10/2025	18:17:12	00d	01:00.0	53.5	71.3	57.1	48.1	-:-	56.5	56.1	53	48.6	48.3	----	-----	223872.1	51.7
599	9/10/2025	18:18:12	00d	01:00.0	52.9	70.7	59.1	45.9	-:-	58.9	57.5	48.4	46.4	46.3	----	-----	194984.5	51.7
600	9/10/2025	18:19:12	00d	01:00.0	53.6	71.4	58.9	48.9	-:-	56.5	56.2	53.6	50	49.8	----	-----	229086.8	51.7
601	9/10/2025	18:20:12	00d	01:00.0	52.8	70.6	59.2	46.5	-:-	58.9	56.7	50.8	47.2	46.7	----	-----	190546.1	51.6
602	9/10/2025	18:21:12	00d	01:00.0	52.7	70.5	56.5	47.7	-:-	56	55.5	51.9	48.2	47.9	----	-----	186208.7	51.6
603	9/10/2025	18:22:12	00d	01:00.0	53.1	70.9	57.8	45.9	-:-	57.3	56.8	52.6	46.6	46.3	----	-----	204173.8	51.5
604	9/10/2025	18:23:12	00d	01:00.0	52.1	69.9	55.2	47.7	-:-	55.2	54.8	51.6	48.2	48	----	-----	162181.0	51.5
605	9/10/2025	18:24:12	00d	01:00.0	53.3	71.1	57.5	48.6	-:-	56.6	55.4	52.9	49.8	49.4	----	-----	213796.2	51.4
606	9/10/2025	18:25:12	00d	01:00.0	53.5	71.3	61.8	46.5	-:-	60.1	57.5	50.3	47.2	46.6	----	-----	223872.1	51.4
607	9/10/2025	18:26:12	00d	01:00.0	54.7	72.5	59.2	49.3	-:-	58.8	57.6	54.1	51.7	50.4	----	-----	295120.9	51.3
608	9/10/2025	18:27:12	00d	01:00.0	57	74.8	63.3	47.3	-:-	62.7	62.2	53.9	47.6	47.5	----	-----	501187.2	51.3
609	9/10/2025	18:28:12	00d	01:00.0	49.8	67.6	55.4	45	-:-	55.2	54	46.6	45.3	45.2	----	-----	95499.3	51.1
610	9/10/2025	18:29:12	00d	01:00.0	51.5	69.3	56.1	45.3	-:-	55.5	54	51.2	46.9	46	----	-----	141253.8	51.1
611	9/10/2025	18:30:12	00d	01:00.0	52.5	70.3	56.1	46.3	-:-	55.9	55.6	51.9	46.5	46.4	----	-----	177827.9	51.1
612	9/10/2025	18:31:12	00d	01:00.0	49.7	67.5	55	45.5	-:-	54.1	52.8	48.6	45.8	45.6	----	-----	93325.4	51.1
613	9/10/2025	18:32:12	00d	01:00.0	51.2	69	55.6	45.8	-:-	55.3	55.1	49.5	46.2	46	----	-----	131825.7	51.1
614	9/10/2025	18:33:12	00d	01:00.0	53.6	71.4	59.4	44.9	-:-	58.9	58.8	51.6	45.5	45.3	----	-----	229086.8	51.1
615	9/10/2025	18:34:12	00d	01:00.0	47.1	64.9	57.8	44.3	-:-	52	49.9	45.8	45	44.6	----	-----	51286.1	51.0
616	9/10/2025	18:35:12	00d	01:00.0	52.7	70.5	60.1	45.5	-:-	59.7	57.8	47.8	45.7	45.6	----	-----	186208.7	51.0
617	9/10/2025	18:36:12	00d	01:00.0	52.8	70.6	56.5	48.3	-:-	56.1	55.8	52.6	48.9	48.5	----	-----	190546.1	51.0
618	9/10/2025	18:37:12	00d	01:00.0	50.9	68.7	54.5	47.2	-:-	54.5	53.8	50.6	47.6	47.6	----	-----	123026.9	51.0
619	9/10/2025	18:38:12	00d	01:00.0	52.8	70.6	56.9	47.5	-:-	56.4	55.7	52.6	48.2	47.7	----	-----	190546.1	51.0
620	9/10/2025	18:39:12	00d	01:00.0	50.7	68.5	57.1	45.5	-:-	57	54.5	47	45.8	45.7	----	-----	117489.8	51.0
621	9/10/2025	18:40:12	00d	01:00.0	53.8	71.6	61.7	45.4	-:-	60.4	59.2	47	46.1	45.8	----	-----	239883.3	51.0
622	9/10/2025	18:41:12	00d	01:00.0	51.1	68.9	57	46.5	-:-	56.6	54.4	49	46.7	46.7	----	-----	128825.0	50.9
623	9/10/2025	18:42:12	00d	01:00.0	48.9	66.7	55	45.2	-:-	54.8	52.3	46.5	45.6	45.4	----	-----	77624.7	50.9
624	9/10/2025	18:43:12	00d	01:00.0	48.5	66.3	54.1	45	-:-	53.8	52.3	46.1	45.4	45.3	----	-----	70794.6	51.0
625	9/10/2025	18:44:12	00d	01:00.0	51.2	69	56.3	44.9	-:-	55.8	55.2	49.6	45.6	45.1	----	-----	131825.7	51.0
626	9/10/2025	18:45:12	00d	01:00.0	49.7	67.5	55.7	45.1	-:-	54.9	53.6	46.7	45.5	45.3	----	-----	93325.4	51.1
627	9/10/2025	18:46:12	00d	01:00.0	51.3	69.1	57.1	44.9	-:-	57	56.7	47.7	46.1	45.5	----	-----	134896.3	51.1
628	9/10/2025	18:47:12	00d	01:00.0	50.6	68.4	54.4	46.7	-:-	54.2	53.2	50.3	47.9	47.5	----	-----	114815.4	51.1
629	9/10/2025	18:48:12	00d	01:00.0	54.4	72.2	58.5	46.1	-:-	58.2	58	53.4	47.1	46.5	----	-----	275422.9	51.2
630	9/10/2025	18:49:12	00d	01:00.0	50	67.8	53.8	46.2	-:-	53.6	52.9	49.2	46.7	46.5	----	-----	100000.0	51.1
631	9/10/2025	18:50:12	00d	01:00.0	53.1	70.9	58.3	46.1	-:-	58.1	56.4	52.1	47.3	47.1	----	-----	204173.8	51.1
632	9/10/2025	18:51:12	00d	01:00.0	49.5	67.3	53.8	45.6	-:-	53.7	53.5	47.6	46.2	45.9	----	-----	89125.1	51.1
633	9/10/2025	18:52:12	00d	01:00.0	50.1	67.9	53.4	46.1	-:-	53.2	52.8	49.6	46.5	46.2	----	-----	102329.3	51.1
634	9/10/2025	18:53:12	00d	01:00.0	49.7	67.5	55.4	45.7	-:-	54.6	53.7	47.7	46.3	45.8	----	-----	93325.4	51.1
635	9/10/2025	18:54:12	00d	01:00.0	49.4	67.2	55.4	44.9	-:-	55.1	52.9	46.9	45.3	45.2	----	-----	87096.4	51.1
636	9/10/2025	18:55:12	00d	01:00.0	50.7	68.5	57.8	45.8	-:-	56.5	54.4	48.6	46.8	46.6	----	-----	117489.8	51.1
637	9/10/2025	18:56:12	00d	01:00.0	52.6	70.4	59	46.6	-:-	58.8	56.9	50.7	47.4	47.4	----	-----	181970.1	51.1
638	9/10/2025	18:57:12	00d	01:00.0	50.2	68	53	46.8	-:-	52.8	52	50.4	47.9	47.4	----	-----	104712.9	51.1
639	9/10/2025	18:58:12	00d	01:00.0	50.1	67.9	55.8	46	-:-	55.3	53.5	48.4	46.3	46.2	----	-----	102329.3	51.1
640	9/10/2025	18:59:12	00d	01:00.0	48.3	66.1	52.5	45.5	-:-	51.5	51.3	47.3	45.9	45.7	----	-----	67608.3	51.1
641	9/10/2025	19:00:12	00d	01:00.0	51.9	69.7	56	45.1	-:-	55.5	55.3	51	46	45.3	----	-----	154881.7	51.2
642	9/10/2025	19:01:12	00d	01:00.0	50	67.8	53.6	45.6	-:-	53.3	52.9	49.3	46.3	46.1	----	-----	100000.0	51.2
643	9/10/2025	19:02:12	00d	01:00.0	52.5	70.3	55.9	46.9	-:-	55.9	55.6	51.5	48.2	47.6	----	-----	177827.9	51.3
644	9/10/2025	19:03:12	00d	01:00.0	51.7	69.5	55.3	46.7	-:-	54.6	54	51.7	47.7	47.1	----	-----	147910.8	51.2
645	9/10/2025	19:04:12	00d	01:00.0	47.5	65.3	52.6	43.4	-:-	50.8	50.3	45.8	44.3	43.6	----	-----	56234.1	51.2
646	9/10/2025	19:05:12	00d	01:00.0	50.3	68.1	56.9	43.6	-:-	56.4	54.4	48.1	44.5	44.1	----	-----	107151.9	51.3
647	9/10/2025	19:06:12	00d	01:00.0	51.3	69.1	57.1	45.2	-:-	56.6	54.2	49.9	45.7	45.5	----	-----	134896.3	51.3
648	9/10/2025	19:07:12	00d	01:00.0	51.4	69.2	56.9	45.7	-:-	56.1	55.8	48.5	46.1	46	----	-----	138038.4	51.4
649	9/10/2025	19:08:12	00d	01:00.0	50.4	68.2	55.1	44.6	-:-	55	54.3	46.9	44.9	44.7	----	-----	109647.8	51.5
650	9/10/2025	19:09:12	00d	01:00.0	51.8	69.6	55.4	46	-:-	55.4	55.3	52.2	46.2	46.1	----	-----	151356.1	51.5
651	9/10/2025	19:10:12	00d	01:00.0	49.2	67	55.8	45.1	-:-	54.2	53.5	47	45.3	45.3	----	-----	83176.4	51.5
652	9/10/2025	19:11:12	00d	01:00.0	51.6	69.4	56.9	45.6	-:-	55.6	54.3	50.6	46.3	46.2	----	-----	144544.0	51.5
653	9/10/2025	19:12:12	00d	01:00.0	53.5	71.3	56.5	49.1	-:-	56.4	55.9	53	50	49.6	----	-----	223872.1	51.5
654	9/10/2025	19:13:12	00d	01:00.0	48.1	65.9	53.6	45.4	-:-	53.2	51.4	46.3	45.6	45.4	----	-----	64565.4	51.4
655	9/10/2025	19:14:12	00d	01:00.0	51.1	68.9	56.2	45.6	-:-	56	55.5	48.3	46	45.9	----	-----	128825.0	51.5
656	9/10/2025	19:15:12	00d	01:00.0	50.6	68.4	54.5	44.7	-:-	54.3	53.4	49.9	46.1	45.6	----	-----	114815.4	51.4
657	9/10/2025	19:16:12	00d	01:00.0	50.2	68	55.1	45.4	-:-	54.7	52.9	48.9	46.2	45.4	----	-----	104712.9	51.4
658	9/10/2025	19:17:12	00d	01:00.0	49.6	67.4	54.9	45.5	-:-	54	53	47.3	46.3	46	----	-----	91201.1	51.4
659	9/10/2025	19:18:12	00d	01:00.0	52.7	70.5	60.4	45.8	-:-	58.5	55.6	50	46.8	46.3	----	-----	186208.7	51.4
660	9/10/2025	19:19:12	00d	01:00.0	50.1	67.9	55.7	45.4	-:-	54.2	53.1	48.8	46	45.7	----	-----	102329.3	51.4
661	9/10/2025	19:20:12	00d	01:00.0	49	66.8	52.9	45.4	-:-	52.3	51.9	47.9	45.9	45.7	----	-----	79432.8	51.4
662	9/10/2025	19:21:12	00d	01:00.0	50.8	68.6	53.6	46.2	-:-	53.5	53.4	50.3	48.2	47.5	----	-----	120226.4	51.5
663	9/10/2025	19:22:12	00d	01:00.0	50.7	68.5	56.3	45	-:-	55.9	54.3	48.4	46	45.8	----	-----	117489.8	51.5

664	9/10/2025	19:23:12	00d	01:00.0	49.1	66.9	54.6	46.1	-:-	53.7	51.7	47.5	46.5	46.4	----	-----	81283.1	51.5
665	9/10/2025	19:24:12	00d	01:00.0	49.4	67.2	55.1	44.1	-:-	54.3	52.7	47	45.1	44.7	----	-----	87096.4	51.6
666	9/10/2025	19:25:12	00d	01:00.0	47.8	65.6	52.3	44.4	-:-	51.6	50.7	46.3	45	44.7	----	-----	60256.0	51.6
667	9/10/2025	19:26:12	00d	01:00.0	52.5	70.3	57.3	47.7	-:-	56.1	54.9	51.7	48.1	47.9	----	-----	177827.9	51.7
668	9/10/2025	19:27:12	00d	01:00.0	53.2	71	58.1	47.5	-:-	58.1	56.3	52.7	48.1	48	----	-----	208929.6	51.7
669	9/10/2025	19:28:12	00d	01:00.0	52.8	70.6	58.2	47.1	-:-	57.7	57	50.5	48	47.5	----	-----	190546.1	51.7
670	9/10/2025	19:29:12	00d	01:00.0	51.6	69.4	56.3	46.1	-:-	55.8	54.9	51	46.6	46.4	----	-----	144544.0	51.6
671	9/10/2025	19:30:12	00d	01:00.0	49.7	67.5	56.1	46.7	-:-	52.7	51.8	49.1	47.1	46.7	----	-----	93325.4	51.6
672	9/10/2025	19:31:12	00d	01:00.0	47.9	65.7	53	45	-:-	52.9	50.7	46.5	45.3	45.1	----	-----	61659.5	51.7
673	9/10/2025	19:32:12	00d	01:00.0	51.4	69.2	56.5	45.6	-:-	56.1	55.3	50.6	46.1	46.1	----	-----	138038.4	51.7
674	9/10/2025	19:33:12	00d	01:00.0	52.1	69.9	56.2	46.2	-:-	55.8	55.4	51.4	46.6	46.5	----	-----	162181.0	51.7
675	9/10/2025	19:34:12	00d	01:00.0	48.2	66	52.8	45.9	-:-	52.6	51.1	47	46.3	46.1	----	-----	66069.3	51.9
676	9/10/2025	19:35:12	00d	01:00.0	49.1	66.9	53.7	45.3	-:-	53.2	52.1	47.4	45.7	45.6	----	-----	81283.1	52.0
677	9/10/2025	19:36:12	00d	01:00.0	50.3	68.1	55.6	46.3	-:-	55.2	53.5	48.9	47.1	46.7	----	-----	107151.9	52.0
678	9/10/2025	19:37:12	00d	01:00.0	52	69.8	57.4	46.4	-:-	57.1	56	50.4	47.3	47	----	-----	158489.3	52.0
679	9/10/2025	19:38:12	00d	01:00.0	53.5	71.3	60.3	46.9	-:-	60	59.3	49.2	47.5	47	----	-----	223872.1	52.0
680	9/10/2025	19:39:12	00d	01:00.0	51.1	68.9	60	48.1	-:-	54.2	53.8	50.1	48.4	48.3	----	-----	128825.0	51.9
681	9/10/2025	19:40:12	00d	01:00.0	50.1	67.9	52.9	47	-:-	52.6	52.3	49.8	47.6	47.3	----	-----	102329.3	51.9
682	9/10/2025	19:41:12	00d	01:00.0	50.8	68.6	55.5	47.6	-:-	55.2	53.1	50.1	48	47.7	----	-----	120226.4	51.9
683	9/10/2025	19:42:12	00d	01:00.0	51.3	69.1	56.1	47.6	-:-	55.9	54.3	50	48	47.7	----	-----	134896.3	51.9
684	9/10/2025	19:43:12	00d	01:00.0	52.6	70.4	55.2	48.2	-:-	55.2	54.9	52.8	48.7	48.5	----	-----	181970.1	51.9
685	9/10/2025	19:44:12	00d	01:00.0	53.1	70.9	57.9	47.7	-:-	57	56.6	52.7	48.2	47.9	----	-----	204173.8	51.9
686	9/10/2025	19:45:12	00d	01:00.0	52.7	70.5	56	48.7	-:-	55.8	55.4	52.3	49.7	49	----	-----	186208.7	51.8
687	9/10/2025	19:46:12	00d	01:00.0	51	68.8	54.4	47.3	-:-	54.2	53.6	49.9	48.2	47.9	----	-----	125892.5	51.8
688	9/10/2025	19:47:12	00d	01:00.0	51.5	69.3	55.9	48.2	-:-	55.2	54.8	49.6	48.6	48.5	----	-----	141253.8	51.7
689	9/10/2025	19:48:12	00d	01:00.0	53.7	71.5	60	48.7	-:-	59.2	58.4	51.2	49.1	48.9	----	-----	234422.9	51.7
690	9/10/2025	19:49:12	00d	01:00.0	52.4	70.2	59.6	47.5	-:-	57.4	56	49.6	48.1	47.8	----	-----	173780.1	51.7
691	9/10/2025	19:50:12	00d	01:00.0	50.9	68.7	55.1	47.6	-:-	54.7	53.8	49.8	48.1	48	----	-----	123026.9	51.6
692	9/10/2025	19:51:12	00d	01:00.0	51.1	68.9	56.7	48	-:-	54.1	53.9	49.9	48.5	48.3	----	-----	128825.0	51.6
693	9/10/2025	19:52:12	00d	01:00.0	50.3	68.1	57.3	47.8	-:-	53	51.9	49.4	48.5	48.2	----	-----	107151.9	51.6
694	9/10/2025	19:53:12	00d	01:00.0	50.3	68.1	54.9	48.6	-:-	54.7	53.3	49.4	48.8	48.6	----	-----	107151.9	51.6
695	9/10/2025	19:54:12	00d	01:00.0	51.5	69.3	57.5	48.2	-:-	57.3	54.7	49.6	48.8	48.4	----	-----	141253.8	51.7
696	9/10/2025	19:55:12	00d	01:00.0	49.9	67.7	53.2	48.1	-:-	52.7	52	49.6	48.9	48.7	----	-----	97723.7	51.6
697	9/10/2025	19:56:12	00d	01:00.0	49.7	67.5	52.2	48	-:-	51.5	51.4	49.4	48.6	48.4	----	-----	93325.4	51.6
698	9/10/2025	19:57:12	00d	01:00.0	52.9	70.7	55.9	48.8	-:-	55.7	54.9	52.8	49.1	48.8	----	-----	194984.5	51.6
699	9/10/2025	19:58:12	00d	01:00.0	49.9	67.7	53.8	48.2	-:-	52.9	51.7	49.2	48.7	48.3	----	-----	97723.7	51.5
700	9/10/2025	19:59:12	00d	01:00.0	52.3	70.1	55.5	48.9	-:-	55.5	55	51.5	49.2	49.1	----	-----	169824.4	51.5
701	9/10/2025	20:00:12	00d	01:00.0	51.7	69.5	56.5	48.4	-:-	56.2	55.8	49.7	48.8	48.7	----	-----	147910.8	51.5
702	9/10/2025	20:01:12	00d	01:00.0	52.6	70.4	56.2	50	-:-	56.2	55.2	51.6	50.3	50.1	----	-----	181970.1	51.4
703	9/10/2025	20:02:12	00d	01:00.0	52.7	70.5	59	49	-:-	58.4	56.1	50.3	49.4	49.3	----	-----	186208.7	51.4
704	9/10/2025	20:03:12	00d	01:00.0	50.6	68.4	52.8	49.3	-:-	52.7	52.2	50.2	49.6	49.5	----	-----	114815.4	51.3
705	9/10/2025	20:04:12	00d	01:00.0	52.5	70.3	56.7	49.2	-:-	56.6	55.8	50.5	49.5	49.4	----	-----	177827.9	51.3
706	9/10/2025	20:05:12	00d	01:00.0	52.6	70.4	56.7	49	-:-	55.7	55.3	51.9	49.4	49.3	----	-----	181970.1	51.3
707	9/10/2025	20:06:12	00d	01:00.0	50.7	68.5	53.8	49.3	-:-	53.4	53	50.2	49.6	49.5	----	-----	117489.8	51.2
708	9/10/2025	20:07:12	00d	01:00.0	54.5	72.3	58.4	50	-:-	58.2	57.7	53.7	50.4	50.4	----	-----	281838.3	51.2
709	9/10/2025	20:08:12	00d	01:00.0	54.3	72.1	61.9	49.7	-:-	61.2	58.7	51.5	50.1	50	----	-----	269153.5	51.1
710	9/10/2025	20:09:12	00d	01:00.0	51.9	69.7	55.3	49.7	-:-	55	54.3	51.3	50	49.9	----	-----	154881.7	50.9
711	9/10/2025	20:10:12	00d	01:00.0	51.3	69.1	54	49.5	-:-	53.8	53.3	50.6	49.7	49.4	----	-----	134896.3	50.9
712	9/10/2025	20:11:12	00d	01:00.0	51.3	69.1	54.4	49.2	-:-	54.2	53.4	50.5	49.4	49.3	----	-----	134896.3	50.8
713	9/10/2025	20:12:12	00d	01:00.0	49.8	67.6	51.9	48.8	-:-	51.6	51.3	49.5	49	49	----	-----	95499.3	50.8
714	9/10/2025	20:13:12	00d	01:00.0	50.3	68.1	53.8	48.8	-:-	52.7	52.1	49.7	48.9	48.9	----	-----	107151.9	50.8
715	9/10/2025	20:14:12	00d	01:00.0	51.8	69.6	55	49	-:-	54.8	53.9	51.2	49.5	49.2	----	-----	151356.1	50.8
716	9/10/2025	20:15:12	00d	01:00.0	49.6	67.4	52.5	48.7	-:-	50.5	50.4	49.5	49	49	----	-----	91201.1	50.8
717	9/10/2025	20:16:12	00d	01:00.0	50.8	68.6	56.1	48.4	-:-	55.9	53.4	49.6	48.8	48.5	----	-----	120226.4	50.8
718	9/10/2025	20:17:12	00d	01:00.0	50.6	68.4	54.3	48.2	-:-	54.1	53.5	49.6	48.5	48.5	----	-----	114815.4	50.7
719	9/10/2025	20:18:12	00d	01:00.0	50.4	68.2	53.5	48.4	-:-	53.2	52.5	49.8	49	48.8	----	-----	109647.8	50.7
720	9/10/2025	20:19:12	00d	01:00.0	51.9	69.7	56.1	48.1	-:-	55.6	54.5	50.6	48.4	48.3	----	-----	154881.7	50.7
721	9/10/2025	20:20:12	00d	01:00.0	50.1	67.9	54.3	47.9	-:-	53.9	52.5	49.1	48.2	48.1	----	-----	102329.3	50.6
722	9/10/2025	20:21:12	00d	01:00.0	51.2	69	53.6	48.2	-:-	53.5	53.1	50.9	48.8	48.7	----	-----	131825.7	50.6
723	9/10/2025	20:22:12	00d	01:00.0	52.8	70.6	55.9	48.6	-:-	55.5	55.2	52.5	49.5	49.2	----	-----	190546.1	50.6
724	9/10/2025	20:23:12	00d	01:00.0	51	68.8	56.8	47.2	-:-	56.5	54.5	48.3	47.5	47.3	----	-----	125892.5	50.6
725	9/10/2025	20:24:12	00d	01:00.0	54.5	72.3	60.9	47.5	-:-	60.3	58.5	51.6	48.1	48	----	-----	281838.3	50.5
726	9/10/2025	20:25:12	00d	01:00.0	51.5	69.3	55.9	47.5	-:-	55.5	53.9	50.7	48.4	47.7	----	-----	141253.8	50.4
727	9/10/2025	20:26:12	00d	01:00.0	53.8	71.6	58.7	47.8	-:-	58.4	57.2	53.1	48.6	48	----	-----	239883.3	50.3
728	9/10/2025	20:27:12	00d	01:00.0	50.9	68.7	53.9	47.6	-:-	53.7	53.3	50.8	47.8	47.7	----	-----	123026.9	50.2
729	9/10/2025	20:28:12	00d	01:00.0	53.1	70.9	57.6	49.5	-:-	57	56.3	51.5	50	49.7	----	-----	204173.8	50.1
730	9/10/2025	20:29:12	00d	01:00.0	50.2	68	57.6	47.4	-:-	57.4	52.8	48.1	47.7	47.6	----	-----	104712.9	50.0
731	9/10/2025	20:30:12	00d	01:00.0	50.5	68.3	53.4	47.8	-:-	53.2	52.8	50.1	48.2	47.9	----	-----	112201.8	50.0
732	9/10/2025	20:31:12	00d	01:00.0	53	70.8	58.4	47.4	-:-	58.2	56.7	50.7	47.9	47.7	----	-----	199526.2	50.0
733	9/10/2025	20:32:12	00d	01:00.0	51.6	69.4	56.8	47.7	-:-	56.3	54.4	50.1	48.1	48	----	-----	144544.0	49.9
734	9/10/2025	20:33:12	00d	01:00.0	52.7	70.5	57.4	48	-:-	57.1	55.8	51.6	48.7	48.5	----	-----	186208.7	49.8
735	9/10/2025	20:34:12	00d	01:00.0	57.6	75.4	72.4	47.5	-:-	55.6	53.4	49.9	48	47.7	----	-----	575439.9	49.7
736	9/10/2025	20:35:12	00d	01:00.0	51.8	69.6	56	48	-:-	55.8	54.9	50.4	48.6	48.4	----	-----	151356.1	49.3
737	9/10/2025	20:36:12	00d	01:00.0	52.4	70.2	57.6	47.9	-:-	57	55.4	51	48.4	48.1	----	-----	173780.1	49.3
738	9/10/2025	20:37:12	00d	01:00.0	49.5	67.3	53.6	47.2	-:-	52.7	52.1	48.5	47.5	47.4	----	-----	89125.1	49.2
739	9/10/2025	20:38:12	00d	01:00.0	49.2	67	53.8	47.5	-:-	53	51.4	48.4	47.7	47.6	----	-----	83176.4	49.1
740	9/10/2025	20:39:12	00d	01:00.0	52.2	70	59.5	48	-:-	59	57	48.8	48.4	48	----	-----	165958.7	49.1
741	9/10/2025	20:40:12	00d	01:00.0	50.9	68.7	54.2	48.4	-:-	53.7	53	50.4	48.8	48.7	----	-----	123026.9	49.0
742	9/10/2025	20:41:12	00d	01:00.0	50.1	67.9	54.9	47.4	-:-	53.3	52.6	49.5	48	47.7	----	-----	102329.3	49.0
743	9/10/2025	20:42:12	00d	01:00.0	47.7	65.5	48.2	46.8	-:-	48.2	48.1	47.7	47.3	47.3	----	-----	58884.4	48.9
744	9/10/2025	20:43:12	00d	01:00.0	48.1	65.9	49.3	47.3	-:-	49.2	48.7	48.1	47.5	47.4	----	-----	64565.4	48.9
745	9/10/2025	20:44:12	00d	01:00.0	51.6	69.4	59.4	47.3	-:-	58.4	56.4	48.3	47.5	47.4	----	-----	144544.0	48.9
746	9/10/2025	20:45:12	00d	01:00.0	49.1	66.9	53.7	47.4	-:-	53.5	51.2	48.1	47.7	47.6	----	-----	81283.1	48.9
747	9/10/2025	20:46:12	00d	01:00.0	49.4	67.2	55.1	47.1	-:-	55	51.8	48.2	47.5	47.1	----	-----	87096.4	48.9
748	9/10/2025	20:47:12	00d	01:00.0	49.4	67.2	53.1	47.7	-:-	52.6	51.3	48.7	47.9	47.8	----	-----	87096.4	48.9
749	9/10/2025	20:48:12	00d	01:00.0	49.7	67.5	53.6	47.3	-:-	53.5	53	48.7	47.5	47.3	----	-----	93325.4	48.9
750	9/10/2025	20:49:12	00d	01:00.0	50.2	68	56	47.1	-:-	54.9	53.1	48.1	47.4	47.3	----	-----	104712.9	48.9
751	9/10/2025	20:50:12	00d	01:00.0	47.7	65.5	51.6	46.6	-:-	49.5	48.7	47.5	47	46.9	----	-----	58884.4	48.8
752	9/10/2025	20:51:12	00d	01:00.0	50.4	68.2	55.4	46.8	-:-	55.1	54.2	48.2	47.1	47	----	-----	109647.8	48.8
753	9/10/2025	20:52:12	00d	01:00.0	51.8	69.6	57.6	47.4	-:-	57.5	54.9	49.7	47.9	47.6	----	-----	151356.1	48.8
754	9/10/2025	20:53:12	00d	01:00.0	51.2	69	56.1	47.6	-:-	55.3	54.3	49.8	48.4	48.1	----	-----	131825.7	48.7
755	9/10/2025	20:54:12	00d	01:00.0	52.4	70.2	56.1	47.6	-:-	55.7	55.3	51.4	48.4	48	----	-----	173780.1	48.6
756	9/10/2025	20:55:12	00d	01:00.0	48.2	66	55.5	46.3	-:-	52.1	48.8	47.4	46.8	46.6	----	-----	66069.3	48.5
757	9/10/2025	20:56:12	00d	01:00.0	49.3	67.1	55.4	46.9	-:-	54.8	52.5	47.8	47.1	47	----	-----	85113.8	48.5
758	9/10/2025	20:57:12	00d	01:00.0	49.1	66.9	53.4	46.9	-:-	53.1	52	47.6	47.1	47	----	-----	81283.1	48.5
759	9/10/2025	20:58:12	00d	01:00.0	47.1	64.9	49.2	46.3	-:-	48	47.7	47	46.6	46.5	----	-----	51286.1	48.5
760	9/10/2025	20:59:12	00d	01:00.0	46.9	64.7	47.6	46.1	-:-	47.5	47.4	46.9	46.4	46.3	----	-----	48977.9	48.5
761	9/10/2025	21:00:12	00d	01:00.0	50.4	68.2	55.8	46.5	-:-	55.5	53.5	49	46.8	46.7	----	-----	109647.8	48.5
762	9/10/2025	21:01:12	00d	01:00.0	47.4	65.2	51.4	46.2	-:-	50.1	48.5	47	46.6	46.5	----	-----	54954.1	48.4
763	9/10/2025	21:02:12	00d	01:00.0	48.8	66.6	55.9	46.2	-:-	54.6	52	46.8	46.3	46.1	----	-----	75857.8	48.4
764	9/10/2025	21:03:12	00d	01:00.0	48.7	66.5	54.9	46.1	-:-	53.9	51.5	46.9	46.4	46.3	----	-----	74131.0	48.4
765	9/10/2025	21:04:12	00d	01:00.0	47	64.8	48.5	46.1	-:-	48.3	47.8	46.8	46.3	46.2	----	-----	50118.7	48.4
766	9/10/2025	21:05:12	00d	01:00.0	51.4	69.2	55.3	46.8	-:-	54.7	54.2	50.9	47.8	47.4	----	-----	138038.4	48.3
767	9/10/2025	21:06:12	00d	01:00.0	49.3	67.1	53.4	46.5	-:-	52.9	51.7	48.5	46.9	46.7	----	-----	85113.8	48.2
768	9/10/2025	21:07:12	00d	01:00.0	46.7	64.5	47.5	45.9	-:-	47.3	47.2	46.7	46.3	46.1	----	-----	46773.5	48.2
769	9/10/2025	21:08:12	00d	01:00.0	48.1	65.9	52.7	46.2	-:-	52.4	50.6	47.1	46.5	46.3	----	-----	64565.4	48.2
770	9/10/2025	21:09:12	00d	01:00.0	46.7	64.5	49.8	46	-:-	47.1	47	46.6	46.2	46.1	----	-----	46773.5	48.2
771	9/10/2025	21:10:12	00d	01:00.0	48	65.8	52.7	46.3	-:-	52.5	50.7	46.9	46.4	46.4	----	-----	63095.7	48.2
772	9/10/2025	21:11:12	00d	01:00.0	46.9	64.7	51.9	45.7	-:-	50.3	47.9	46.4	45.9	45.8	----	-----	48977.9	48.5
773	9/10/2025	21:12:12	00d	01:00.0	51.3	69.1	55.3	48.4	-:-	55.1	53.5	50.4	48.8	48.6	----	-----	134896.3	48.5
774	9/10/2025	21:13:12	00d	01:00.0	46.7	64.5	48.6	46.1	-:-	47.8	47.2	46.7	46.3	46.2	----	-----	46773.5	48.4

775	9/10/2025	21:14:12	00d	01:00.0	50.2	68	54.9	46.3	-:-	54.5	53.3	48.8	46.7	46.5	----	-----	104712.9	48.4
776	9/10/2025	21:15:12	00d	01:00.0	49.7	67.5	54.2	46.3	-:-	53.9	53.1	48.3	46.7	46.6	----	-----	93325.4	48.4
777	9/10/2025	21:16:12	00d	01:00.0	49.7	67.5	54	46.3	-:-	53.5	52.7	49.1	46.6	46.5	----	-----	93325.4	48.3
778	9/10/2025	21:17:12	00d	01:00.0	49	66.8	53.8	46.1	-:-	53.7	53.1	47.2	46.4	46.3	----	-----	79432.8	48.2
779	9/10/2025	21:18:12	00d	01:00.0	49.2	67	55.4	45.4	-:-	55.1	53.3	46.8	45.9	45.7	----	-----	83176.4	48.2
780	9/10/2025	21:19:12	00d	01:00.0	48.4	66.2	52.4	45.9	-:-	52.1	51.6	47.1	46.3	46.2	----	-----	69183.1	48.2
781	9/10/2025	21:20:12	00d	01:00.0	48.1	65.9	53.8	45.8	-:-	53.5	51	46.5	46.1	46	----	-----	64565.4	48.1
782	9/10/2025	21:21:12	00d	01:00.0	48.4	66.2	54.2	45.8	-:-	53.9	51.5	46.5	46.1	46	----	-----	69183.1	48.1
783	9/10/2025	21:22:12	00d	01:00.0	51.3	69.1	59.6	45.4	-:-	58.5	56.9	46.6	46.1	45.8	----	-----	134896.3	48.1
784	9/10/2025	21:23:12	00d	01:00.0	50.5	68.3	59.3	45.7	-:-	55.4	54.2	48.6	45.9	45.9	----	-----	112201.8	48.0
785	9/10/2025	21:24:12	00d	01:00.0	48.1	65.9	53.5	45.2	-:-	53.2	52.2	46.5	45.8	45.6	----	-----	64565.4	48.0
786	9/10/2025	21:25:12	00d	01:00.0	46.2	64	47	45.4	-:-	46.7	46.6	46.2	45.7	45.6	----	-----	41686.9	47.9
787	9/10/2025	21:26:12	00d	01:00.0	45.8	63.6	46.3	45.3	-:-	46.2	46.2	45.8	45.5	45.4	----	-----	38018.9	48.0
788	9/10/2025	21:27:12	00d	01:00.0	47.5	65.3	53.8	44.8	-:-	53.1	50.7	45.3	44.9	44.9	----	-----	56234.1	48.0
789	9/10/2025	21:28:12	00d	01:00.0	47.2	65	52.5	44.9	-:-	52.3	50.2	45.9	45.3	45.1	----	-----	52480.7	48.1
790	9/10/2025	21:29:12	00d	01:00.0	46.3	64.1	52.3	44.7	-:-	51	47.8	45.3	44.9	44.9	----	-----	42658.0	48.1
791	9/10/2025	21:30:12	00d	01:00.0	49	66.8	52.5	45.4	-:-	52	51.4	48.5	45.9	45.7	----	-----	79432.8	48.1
792	9/10/2025	21:31:12	00d	01:00.0	50.2	68	52.9	45.2	-:-	53	52.9	50	45.8	45.6	----	-----	104712.9	48.0
793	9/10/2025	21:32:12	00d	01:00.0	46.8	64.6	50.8	44.6	-:-	50.6	49.8	45.9	45.1	45	----	-----	47863.0	48.0
794	9/10/2025	21:33:12	00d	01:00.0	48.5	66.3	53.8	45.5	-:-	53.4	50.8	47.1	46	45.8	----	-----	70794.6	48.0
795	9/10/2025	21:34:12	00d	01:00.0	47.4	65.2	50.3	45.8	-:-	50.2	48.9	47.3	46	45.9	----	-----	54954.1	47.9
796	9/10/2025	21:35:12	00d	01:00.0	46.2	64	47.6	45.1	-:-	47.5	47	46.1	45.5	45.3	----	-----	41686.9	47.9
797	9/10/2025	21:36:12	00d	01:00.0	51.3	69.1	58.4	46.1	-:-	57.6	56	48.2	46.3	46.2	----	-----	134896.3	48.0
798	9/10/2025	21:37:12	00d	01:00.0	46.2	64	46.8	45.3	-:-	46.8	46.7	46.2	45.8	45.4	----	-----	41686.9	47.9
799	9/10/2025	21:38:12	00d	01:00.0	46.4	64.2	47.2	45.7	-:-	47.2	47	46.3	45.9	45.8	----	-----	43651.6	47.9
800	9/10/2025	21:39:12	00d	01:00.0	46.7	64.5	48.8	45.8	-:-	47.6	47.5	46.6	46	46	----	-----	46773.5	47.9
801	9/10/2025	21:40:12	00d	01:00.0	48.4	66.2	51.4	46	-:-	51.2	50.7	47.9	46.5	46.4	----	-----	69183.1	47.9
802	9/10/2025	21:41:12	00d	01:00.0	48.4	66.2	53.8	46	-:-	53.6	50.8	46.9	46.4	46.3	----	-----	69183.1	47.8
803	9/10/2025	21:42:12	00d	01:00.0	46.3	64.1	47.1	45.2	-:-	47.1	46.7	46.3	45.6	45.4	----	-----	42658.0	47.8
804	9/10/2025	21:43:12	00d	01:00.0	45.6	63.4	46.4	44.7	-:-	46.2	46.2	45.7	45	44.8	----	-----	36307.8	47.8
805	9/10/2025	21:44:12	00d	01:00.0	49.1	66.9	54.1	45.6	-:-	53.7	52.6	47.3	46.4	46.3	----	-----	81283.1	47.8
806	9/10/2025	21:45:12	00d	01:00.0	50.3	68.1	57.5	46.1	-:-	57.1	55.2	46.9	46.3	46.2	----	-----	107151.9	47.8
807	9/10/2025	21:46:12	00d	01:00.0	47	64.8	50.6	45.7	-:-	50.3	48.4	46.5	46	45.9	----	-----	50118.7	47.7
808	9/10/2025	21:47:12	00d	01:00.0	50.5	68.3	55.9	46.2	-:-	55.8	54.1	48.7	46.4	46.3	----	-----	112201.8	47.7
809	9/10/2025	21:48:12	00d	01:00.0	50.3	68.1	54.8	45.7	-:-	54.4	53.7	49.7	46.1	46	----	-----	107151.9	47.6
810	9/10/2025	21:49:12	00d	01:00.0	46.6	64.4	50.6	45.4	-:-	48.5	47.8	46.3	45.8	45.6	----	-----	45708.8	47.6
811	9/10/2025	21:50:12	00d	01:00.0	47.1	64.9	51.5	45.1	-:-	51.4	49.7	46.2	45.4	45.3	----	-----	51286.1	47.6
812	9/10/2025	21:51:12	00d	01:00.0	48.7	66.5	54.4	45.6	-:-	54.1	52.9	46.5	45.9	45.7	----	-----	74131.0	47.6
813	9/10/2025	21:52:12	00d	01:00.0	46	63.8	49.6	44.3	-:-	47.3	46.8	45.9	45	45	----	-----	39810.7	47.5
814	9/10/2025	21:53:12	00d	01:00.0	49.8	67.6	57.9	45.3	-:-	57.3	53.9	46.5	45.8	45.5	----	-----	95499.3	47.5
815	9/10/2025	21:54:12	00d	01:00.0	48.6	66.4	55.9	44.6	-:-	55.7	52.4	46.2	45.5	45	----	-----	72443.6	47.4
816	9/10/2025	21:55:12	00d	01:00.0	48.6	66.4	55.2	44.5	-:-	53.1	52.4	45.9	44.8	44.7	----	-----	72443.6	47.4
817	9/10/2025	21:56:12	00d	01:00.0	47.6	65.4	54.3	44.8	-:-	53.6	51.3	45.8	45.1	45	----	-----	57544.0	47.4
818	9/10/2025	21:57:12	00d	01:00.0	48.7	66.5	55.1	44.7	-:-	54.6	53	46	45	44.8	----	-----	74131.0	47.4
819	9/10/2025	21:58:12	00d	01:00.0	48	65.8	54.7	44.4	-:-	54.2	51.6	45.5	45	44.6	----	-----	63095.7	47.3
820	9/10/2025	21:59:12	00d	01:00.0	45.4	63.2	46.4	44.6	-:-	46.1	46	45.5	44.9	44.9	----	-----	34673.7	47.3
821	9/10/2025	22:00:12	00d	01:00.0	45	62.8	45.6	44.3	-:-	45.5	45.5	45	44.6	44.4	----	-----	31622.8	47.3
822	9/10/2025	22:01:12	00d	01:00.0	46.8	64.6	52.5	43.8	-:-	52	49.8	45.1	44.4	44.3	----	-----	47863.0	47.3
823	9/10/2025	22:02:12	00d	01:00.0	46.4	64.2	51	44.8	-:-	50.8	49.2	45.5	44.9	44.9	----	-----	43651.6	47.3
824	9/10/2025	22:03:12	00d	01:00.0	45	62.8	45.6	44	-:-	45.5	45.4	44.9	44.4	44.4	----	-----	31622.8	47.2
825	9/10/2025	22:04:12	00d	01:00.0	48.5	66.3	56.2	44.5	-:-	54.8	52.3	45.5	44.6	44.6	----	-----	70794.6	47.2
826	9/10/2025	22:05:12	00d	01:00.0	45.1	62.9	45.7	44.3	-:-	45.6	45.5	45.2	44.8	44.7	----	-----	32359.4	47.2
827	9/10/2025	22:06:12	00d	01:00.0	46.9	64.7	51.4	44.8	-:-	51.2	49.9	45.6	45.1	45	----	-----	48977.9	47.2
828	9/10/2025	22:07:12	00d	01:00.0	45.5	63.3	47.3	44.8	-:-	46.8	46.3	45.3	45	44.9	----	-----	35481.3	47.1
829	9/10/2025	22:08:12	00d	01:00.0	47.8	65.6	54.6	44.3	-:-	54.2	51.5	45.6	44.9	44.6	----	-----	60256.0	47.1
830	9/10/2025	22:09:12	00d	01:00.0	46.7	64.5	54.5	45.4	-:-	50	48	46	45.6	45.6	----	-----	46773.5	47.1
831	9/10/2025	22:10:12	00d	01:00.0	50.1	67.9	57.1	45.2	-:-	56.6	53	48.7	45.5	45.4	----	-----	102329.3	47.0
832	9/10/2025	22:11:12	00d	01:00.0	54.9	72.7	64	45.4	-:-	63.9	60.7	46.9	46	45.8	----	-----	309029.5	47.0
833	9/10/2025	22:12:12	00d	01:00.0	46.5	64.3	48.7	45.3	-:-	48.5	47.8	46.1	45.5	45.5	----	-----	44668.4	46.6
834	9/10/2025	22:13:12	00d	01:00.0	47.2	65	52	45	-:-	51.3	49.2	46.4	45.2	45.1	----	-----	52480.7	46.6
835	9/10/2025	22:14:12	00d	01:00.0	48.4	66.2	53.6	45.4	-:-	53.1	51.6	46.6	45.6	45.5	----	-----	69183.1	46.6
836	9/10/2025	22:15:12	00d	01:00.0	45.3	63.1	46.2	44.6	-:-	45.7	45.6	45.3	44.9	44.8	----	-----	33884.4	46.6
837	9/10/2025	22:16:12	00d	01:00.0	44.9	62.7	45.5	44.4	-:-	45.3	45.2	45	44.6	44.5	----	-----	30903.0	46.6
838	9/10/2025	22:17:12	00d	01:00.0	44.8	62.6	45.3	44	-:-	45.2	45.2	44.8	44.5	44.2	----	-----	30199.5	46.6
839	9/10/2025	22:18:12	00d	01:00.0	45.2	63	49.4	43.7	-:-	48	46	44.8	44.4	44.2	----	-----	33113.1	46.5
840	9/10/2025	22:19:12	00d	01:00.0	48.4	66.2	53.8	44.6	-:-	53.7	52.1	46.2	44.9	44.8	----	-----	69183.1	46.5
841	9/10/2025	22:20:12	00d	01:00.0	45.1	62.9	46	44.6	-:-	45.8	45.6	45.1	44.8	44.7	----	-----	32359.4	46.4
842	9/10/2025	22:21:12	00d	01:00.0	44.9	62.7	45.4	44.3	-:-	45.3	45.2	44.9	44.5	44.5	----	-----	30903.0	46.4
843	9/10/2025	22:22:12	00d	01:00.0	47.2	65	52.9	44.8	-:-	52.6	49.9	45.9	44.9	44.9	----	-----	52480.7	46.4
844	9/10/2025	22:23:12	00d	01:00.0	50.7	68.5	56.1	44.7	-:-	55.4	54.2	48.3	45.4	45.1	----	-----	117489.8	46.4
845	9/10/2025	22:24:12	00d	01:00.0	47.8	65.6	53.4	44.5	-:-	53.1	52	45.4	44.8	44.7	----	-----	60256.0	46.2
846	9/10/2025	22:25:12	00d	01:00.0	44.9	62.7	45.6	44.3	-:-	45.5	45.3	45	44.6	44.4	----	-----	30903.0	46.2
847	9/10/2025	22:26:12	00d	01:00.0	48.3	66.1	55.5	44	-:-	54.7	52.4	44.8	44.2	44.1	----	-----	67608.3	46.1
848	9/10/2025	22:27:12	00d	01:00.0	44.7	62.5	45.5	43.4	-:-	45.5	45.3	44.8	43.9	43.7	----	-----	29512.1	46.0
849	9/10/2025	22:28:12	00d	01:00.0	51.4	69.2	58.7	44.1	-:-	58.1	57.5	45.4	44.5	44.3	----	-----	138038.4	46.0
850	9/10/2025	22:29:12	00d	01:00.0	49.2	67	53.7	45.2	-:-	53.4	52.3	47.9	45.6	45.6	----	-----	83176.4	45.9
851	9/10/2025	22:30:12	00d	01:00.0	46.6	64.4	51.3	44.5	-:-	51.1	49.4	45.4	44.7	44.6	----	-----	45708.8	45.8
852	9/10/2025	22:31:12	00d	01:00.0	44.5	62.3	45.2	43.6	-:-	45.2	45	44.5	43.9	43.9	----	-----	28183.8	45.8
853	9/10/2025	22:32:12	00d	01:00.0	47.7	65.5	54.5	43.2	-:-	54	52	44.6	43.8	43.5	----	-----	58884.4	45.8
854	9/10/2025	22:33:12	00d	01:00.0	44.6	62.4	45.7	43.4	-:-	45.3	45.2	44.6	44	43.6	----	-----	28840.3	45.7
855	9/10/2025	22:34:12	00d	01:00.0	44.8	62.6	45.9	43.8	-:-	45.7	45.5	44.7	44.2	44.1	----	-----	30199.5	45.8
856	9/10/2025	22:35:12	00d	01:00.0	47.5	65.3	53.9	44.1	-:-	53.6	51.2	45.3	44.5	44.4	----	-----	56234.1	45.8
857	9/10/2025	22:36:12	00d	01:00.0	48.3	66.1	52.4	44.6	-:-	52.2	51.9	47.3	45	44.8	----	-----	67608.3	45.8
858	9/10/2025	22:37:12	00d	01:00.0	48.6	66.4	55.6	44.4	-:-	55.1	53.1	45.7	44.8	44.6	----	-----	72443.6	45.7
859	9/10/2025	22:38:12	00d	01:00.0	47.3	65.1	54.4	44.3	-:-	53.9	50.7	45	44.5	44.3	----	-----	53703.2	45.6
860	9/10/2025	22:39:12	00d	01:00.0	44.8	62.6	45.4	44	-:-	45.4	45.4	44.7	44.3	44.1	----	-----	30199.5	45.6
861	9/10/2025	22:40:12	00d	01:00.0	45.2	63	46	44.2	-:-	45.9	45.8	45.2	44.6	44.4	----	-----	33113.1	45.6
862	9/10/2025	22:41:12	00d	01:00.0	44.8	62.6	45.6	43.8	-:-	45.7	45.5	44.8	44.2	44.2	----	-----	30199.5	45.6
863	9/10/2025	22:42:12	00d	01:00.0	44.8	62.6	45.3	44.1	-:-	45.3	45.3	44.9	44.3	44.2	----	-----	30199.5	45.5
864	9/10/2025	22:43:12	00d	01:00.0	48.4	66.2	56.1	44.3	-:-	55.9	52.7	45.1	44.4	44.3	----	-----	69183.1	45.6
865	9/10/2025	22:44:12	00d	01:00.0	48.8	66.6	53.8	44.5	-:-	53.7	52.4	46.8	45	44.9	----	-----	75857.8	45.5
866	9/10/2025	22:45:12	00d	01:00.0	47.5	65.3	54	44	-:-	53	50.9	45	44.2	44.1	----	-----	56234.1	45.4
867	9/10/2025	22:46:12	00d	01:00.0	46.3	64.1	53.3	43.6	-:-	53.2	49	44.5	44.2	43.8	----	-----	42658.0	45.4
868	9/10/2025	22:47:12	00d	01:00.0	45.7	63.5	53.3	44.5	-:-	48.5	46.7	45.2	44.7	44.6	----	-----	37153.5	45.4
869	9/10/2025	22:48:12	00d	01:00.0	44.5	62.3	45.4	44.1	-:-	45.1	44.8	44.5	44.2	44.2	----	-----	28183.8	45.4
870	9/10/2025	22:49:12	00d	01:00.0	46.9	64.7	52.8	44.1	-:-	52.3	50.7	44.8	44.3	44.2	----	-----	48977.9	45.4
871	9/10/2025	22:50:12	00d	01:00.0	46.6	64.4	52.2	44	-:-	52	49.9	44.8	44.2	44.2	----	-----	45708.8	45.3
872	9/10/2025	22:51:12	00d	01:00.0	47.2	65	52.9	43	-:-	52.8	52.6	44.4	43.5	43.3	----	-----	52480.7	45.3
873	9/10/2025	22:52:12	00d	01:00.0	45.1	62.9	53	43	-:-	49.7	46.8	43.8	43.3	43.2	----	-----	32359.4	45.3
874	9/10/2025	22:53:12	00d	01:00.0	43.8	61.6	45	42.8	-:-	45	44.5	43.6	43.2	43	----	-----	23988.3	45.3
875	9/10/2025	22:54:12	00d	01:00.0	44.9	62.7	50.9	42.8	-:-	49.5	46.9	44	43.3	43	----	-----	30903.0	45.3
876	9/10/2025	22:55:12	00d	01:00.0	46.8	64.6	52	43.6	-:-	51.6	50.1	45.7	44.3	44	----	-----	47863.0	45.2
877	9/10/2025	22:56:12	00d	01:00.0	50.1	67.9	56	43.1	-:-	55.7	53.6	48.2	43.3	43.2	----	-----	102329.3	45.2
878	9/10/2025	22:57:12	00d	01:00.0	44.1	61.9	46.2	43	-:-	45.6	44.9	44	43.4	43.2	----	-----	25704.0	45.0
879	9/10/2025	22:58:12	00d	01:00.0	44.2	62	45.4	43.5	-:-	45	44.8	44.1	43.7	43.5	----	-----	26302.7	45.0
880	9/10/2025	22:59:12	00d	01:00.0	48.7	66.5	55.2	43.2	-:-	54.5	52	47.1	43.7	43.3	----	-----	74131.0	45.0
881	9/10/2025	23:00:12	00d	01:00.0	43.8	61.6	44.5	43.2	-:-	44.2	44.2	43.8	43.4	43.3	----	-----	23988.3	44.8
882	9/10/2025	23:01:12	00d	01:00.0	43.8	61.6	44.5	43	-:-	44.4	44.2	43.8	43.4	43.3	----	-----	23988.3	44.8
883	9/10/2025	23:02:12	00d	01:00.0	44.3	62.1	45.4	43.5	-:-	45.1	44.9	44.2	43.7	43.7	----	-----	26915.3	44.8
884	9/10/2025	23:03:12	00d	01:00.0	44	61.8	44.8	43.2	-:-	44.7	44.5	44	43.5	43.3	----	-----	25118.9	44.8
885	9/10/2025	23:04:12	00d	01:00.0	43.5	61.3	44.3	42.8	-:-	44.1	44	43.6	43	43	----	-----	22387.2	44.8

886	9/10/2025	23:05:12	00d	01:00.0	44	61.8	46.8	43.2	-:-	45.2	44.8	43.7	43.3	43.3	----	-----	25118.9	44.8
887	9/10/2025	23:06:12	00d	01:00.0	45.8	63.6	51.6	43.1	-:-	51.1	48.9	44.1	43.4	43.2	----	-----	38018.9	44.8
888	9/10/2025	23:07:12	00d	01:00.0	44	61.8	45.4	43.3	-:-	45.2	44.8	43.9	43.5	43.4	----	-----	25118.9	44.9
889	9/10/2025	23:08:12	00d	01:00.0	43.5	61.3	44.4	42.9	-:-	44.1	44	43.5	43.1	42.9	----	-----	22387.2	45.0
890	9/10/2025	23:09:12	00d	01:00.0	43.8	61.6	46.9	42.7	-:-	46.4	45.2	43.4	42.9	42.9	----	-----	23988.3	45.1
891	9/10/2025	23:10:12	00d	01:00.0	43.3	61.1	44	42.6	-:-	43.9	43.7	43.3	42.9	42.8	----	-----	21379.6	45.0
892	9/10/2025	23:11:12	00d	01:00.0	47.3	65.1	54.5	42.8	-:-	54.4	51.5	44.1	43.2	43.1	----	-----	53703.2	45.1
893	9/10/2025	23:12:12	00d	01:00.0	46.9	64.7	54.4	43.5	-:-	53.5	51.3	44.1	43.7	43.6	----	-----	48977.9	45.0
894	9/10/2025	23:13:12	00d	01:00.0	48.6	66.4	56.5	43.4	-:-	55.8	52.9	45.1	43.9	43.6	----	-----	72443.6	44.9
895	9/10/2025	23:14:12	00d	01:00.0	46.2	64	52.4	42.8	-:-	52.2	50	43.8	43	42.9	----	-----	41686.9	44.8
896	9/10/2025	23:15:12	00d	01:00.0	46.3	64.1	52.6	43.1	-:-	52.2	49.8	44.4	43.3	43.2	----	-----	42658.0	44.7
897	9/10/2025	23:16:12	00d	01:00.0	44.4	62.2	46	43.5	-:-	45.7	45.3	44.3	43.9	43.8	----	-----	27542.3	44.7
898	9/10/2025	23:17:12	00d	01:00.0	44.8	62.6	52.3	43.4	-:-	47.1	44.9	44.1	43.6	43.5	----	-----	30199.5	44.7
899	9/10/2025	23:18:12	00d	01:00.0	43.6	61.4	44.4	42.8	-:-	44.2	44	43.6	43.3	43.1	----	-----	22908.7	44.7
900	9/10/2025	23:19:12	00d	01:00.0	43.3	61.1	43.8	42.8	-:-	43.8	43.7	43.3	43	43	----	-----	21379.6	44.6
901	9/10/2025	23:20:12	00d	01:00.0	43.2	61	45	42.7	-:-	43.9	43.7	43.2	42.9	42.7	----	-----	20893.0	44.6
902	9/10/2025	23:21:12	00d	01:00.0	45.4	63.2	50.7	42.5	-:-	50.5	48.7	43.7	42.9	42.8	----	-----	34673.7	44.6
903	9/10/2025	23:22:12	00d	01:00.0	42.9	60.7	43.9	42	-:-	43.6	43.4	42.9	42.4	42.3	----	-----	19498.4	44.6
904	9/10/2025	23:23:12	00d	01:00.0	44.4	62.2	47.6	42.6	-:-	47.5	46.7	43.7	42.9	42.7	----	-----	27542.3	44.6
905	9/10/2025	23:24:12	00d	01:00.0	42.9	60.7	44.4	41.7	-:-	43.7	43.6	43	41.8	41.8	----	-----	19498.4	44.5
906	9/10/2025	23:25:12	00d	01:00.0	42.6	60.4	43.3	41.9	-:-	43.2	43	42.7	42.3	42.1	----	-----	18197.0	44.5
907	9/10/2025	23:26:12	00d	01:00.0	42.9	60.7	43.5	42	-:-	43.4	43.4	43	42.6	42.4	----	-----	19498.4	44.5
908	9/10/2025	23:27:12	00d	01:00.0	43.1	60.9	43.7	42.4	-:-	43.6	43.5	43.1	42.8	42.6	----	-----	20417.4	44.5
909	9/10/2025	23:28:12	00d	01:00.0	42.9	60.7	43.5	42.3	-:-	43.5	43.4	43	42.5	42.4	----	-----	19498.4	44.4
910	9/10/2025	23:29:12	00d	01:00.0	47.8	65.6	56	42.5	-:-	55.4	51.8	43.7	42.8	42.8	----	-----	60256.0	44.4
911	9/10/2025	23:30:12	00d	01:00.0	46.9	64.7	54.3	42.6	-:-	53.6	51	43.7	43	42.9	----	-----	48977.9	44.3
912	9/10/2025	23:31:12	00d	01:00.0	45.9	63.7	52.7	42.3	-:-	51.9	49.6	43.4	42.7	42.4	----	-----	38904.5	44.2
913	9/10/2025	23:32:12	00d	01:00.0	42.7	60.5	43.8	41.9	-:-	43.5	43.3	42.7	42.2	41.9	----	-----	18620.9	44.1
914	9/10/2025	23:33:12	00d	01:00.0	45.2	63	51.1	42.2	-:-	51	48.9	43.1	42.5	42.4	----	-----	33113.1	44.1
915	9/10/2025	23:34:12	00d	01:00.0	45.1	62.9	50.6	42.2	-:-	50.3	48.5	43.7	42.9	42.6	----	-----	32359.4	44.0
916	9/10/2025	23:35:12	00d	01:00.0	48.5	66.3	56.7	42.7	-:-	56.4	53.4	43.7	42.9	42.7	----	-----	70794.6	44.1
917	9/10/2025	23:36:12	00d	01:00.0	43.2	61	44.2	42.4	-:-	44.1	43.9	43.1	42.6	42.6	----	-----	20893.0	43.9
918	9/10/2025	23:37:12	00d	01:00.0	42.9	60.7	44.2	41.9	-:-	43.8	43.8	43	42.2	42	----	-----	19498.4	43.9
919	9/10/2025	23:38:12	00d	01:00.0	47	64.8	55.3	42.7	-:-	54	50.5	43.5	43	42.8	----	-----	50118.7	43.9
920	9/10/2025	23:39:12	00d	01:00.0	43.5	61.3	47.7	42.2	-:-	46.3	44.6	43.1	42.5	42.4	----	-----	22387.2	43.8
921	9/10/2025	23:40:12	00d	01:00.0	46	63.8	53.2	42.8	-:-	52.9	50	43.3	42.9	42.9	----	-----	39810.7	43.7
922	9/10/2025	23:41:12	00d	01:00.0	43.2	61	45.4	42.3	-:-	44.3	43.9	43.2	42.6	42.4	----	-----	20893.0	43.7
923	9/10/2025	23:42:12	00d	01:00.0	43.1	60.9	45.2	41.7	-:-	44.1	44.1	43	42.2	41.9	----	-----	20417.4	43.7
924	9/10/2025	23:43:12	00d	01:00.0	48.8	66.6	55.1	42.2	-:-	53.3	52.2	48.2	42.5	42.4	----	-----	75857.8	43.7
925	9/10/2025	23:44:12	00d	01:00.0	42.9	60.7	43.8	42.4	-:-	43.5	43.4	42.9	42.5	42.4	----	-----	19498.4	43.5
926	9/10/2025	23:45:12	00d	01:00.0	43.9	61.7	47	42.5	-:-	46.1	45	43.5	43.1	42.8	----	-----	24547.1	43.5
927	9/10/2025	23:46:12	00d	01:00.0	42.6	60.4	43.4	41.9	-:-	43.3	43.1	42.6	42.2	42.2	----	-----	18197.0	43.4
928	9/10/2025	23:47:12	00d	01:00.0	47.7	65.5	55.6	42.2	-:-	54.6	52.9	43.5	42.6	42.5	----	-----	58884.4	43.6
929	9/10/2025	23:48:12	00d	01:00.0	43.1	60.9	43.8	42.3	-:-	43.9	43.8	43.1	42.7	42.6	----	-----	20417.4	43.5
930	9/10/2025	23:49:12	00d	01:00.0	46.8	64.6	54.5	41.6	-:-	54.4	51.3	43.1	42.3	42.1	----	-----	47863.0	43.4
931	9/10/2025	23:50:12	00d	01:00.0	43.1	60.9	47.2	42.1	-:-	44.2	44	43.1	42.4	42.2	----	-----	20417.4	43.6
932	9/10/2025	23:51:12	00d	01:00.0	43.9	61.7	45	42.6	-:-	45.1	44.8	43.8	43.1	42.9	----	-----	24547.1	43.5
933	9/10/2025	23:52:12	00d	01:00.0	47.8	65.6	56.7	42.1	-:-	55.1	51.8	43.3	42.5	42.4	----	-----	60256.0	43.5
934	9/10/2025	23:53:12	00d	01:00.0	43	60.8	43.9	42.2	-:-	43.9	43.7	42.8	42.5	42.4	----	-----	19952.6	43.3
935	9/10/2025	23:54:12	00d	01:00.0	42.7	60.5	43.7	41.7	-:-	43.7	43.6	42.6	42.2	41.9	----	-----	18620.9	43.3
936	9/10/2025	23:55:12	00d	01:00.0	42.9	60.7	44	41.8	-:-	44	43.5	42.9	42.2	42	----	-----	19498.4	43.3
937	9/10/2025	23:56:12	00d	01:00.0	42.9	60.7	43.9	41.9	-:-	43.9	43.7	42.9	42.4	42.2	----	-----	19498.4	43.3
938	9/10/2025	23:57:12	00d	01:00.0	42.3	60.1	43.3	41.2	-:-	43.4	43.3	42.3	41.7	41.6	----	-----	16982.4	43.2
939	9/10/2025	23:58:12	00d	01:00.0	42.7	60.5	44	41.5	-:-	43.8	43.6	42.7	42	41.7	----	-----	18620.9	43.4
940	9/10/2025	23:59:12	00d	01:00.0	42.6	60.4	44	41.8	-:-	43.7	43.1	42.6	42.1	42	----	-----	18197.0	43.4
941	9/11/2025	0:00:12	00d	01:00.0	42	59.8	42.9	40.8	-:-	42.8	42.7	42	41.2	40.9	----	-----	15848.9	43.7
942	9/11/2025	0:01:12	00d	01:00.0	42	59.8	42.9	41.4	-:-	43	42.5	42	41.6	41.5	----	-----	15848.9	43.7
943	9/11/2025	0:02:12	00d	01:00.0	42.4	60.2	43.2	41.4	-:-	43.3	43.1	42.3	41.7	41.6	----	-----	17378.0	43.7
944	9/11/2025	0:03:12	00d	01:00.0	44.7	62.5	49.9	40.5	-:-	49.8	48.4	43.1	41	40.9	----	-----	29512.1	43.8
945	9/11/2025	0:04:12	00d	01:00.0	41.7	59.5	44.3	40.5	-:-	43.7	42.6	41.6	40.9	40.7	----	-----	14791.1	43.7
946	9/11/2025	0:05:12	00d	01:00.0	43.8	61.6	48.4	41	-:-	48.3	47	42.3	41.2	41.1	----	-----	23988.3	43.7
947	9/11/2025	0:06:12	00d	01:00.0	41.9	59.7	44	40.7	-:-	43	42.7	41.8	41	40.8	----	-----	15488.2	43.7
948	9/11/2025	0:07:12	00d	01:00.0	50.1	67.9	61.3	41.7	-:-	59.1	52.2	43	42.1	42.1	----	-----	102329.3	43.8
949	9/11/2025	0:08:12	00d	01:00.0	48.7	66.5	61.1	41	-:-	55.8	54.1	43.2	41.6	41.3	----	-----	74131.0	43.5
950	9/11/2025	0:09:12	00d	01:00.0	45.7	63.5	56	42	-:-	52	47.8	43.8	42.3	42.2	----	-----	37153.5	43.3
951	9/11/2025	0:10:12	00d	01:00.0	42.7	60.5	43.5	41.8	-:-	43.5	43.3	42.6	42.2	42.1	----	-----	18620.9	43.2
952	9/11/2025	0:11:12	00d	01:00.0	46.4	64.2	51.7	41.7	-:-	51.1	49.3	44.8	42.1	41.9	----	-----	43651.6	43.2
953	9/11/2025	0:12:12	00d	01:00.0	41.9	59.7	42.7	41.3	-:-	42.7	42.4	41.9	41.5	41.4	----	-----	15488.2	43.1
954	9/11/2025	0:13:12	00d	01:00.0	41.7	59.5	42.9	40.8	-:-	42.6	42.4	41.6	41	40.8	----	-----	14791.1	43.1
955	9/11/2025	0:14:12	00d	01:00.0	41.9	59.7	42.9	40.9	-:-	42.9	42.7	41.9	41.3	41.1	----	-----	15488.2	43.1
956	9/11/2025	0:15:12	00d	01:00.0	41.8	59.6	43.1	40.8	-:-	42.9	42.5	41.9	41.1	41	----	-----	15135.6	43.1
957	9/11/2025	0:16:12	00d	01:00.0	41.9	59.7	42.9	41.1	-:-	42.7	42.5	41.9	41.4	41.3	----	-----	15488.2	43.1
958	9/11/2025	0:17:12	00d	01:00.0	45.6	63.4	53.5	41.1	-:-	53	49.9	42.2	41.7	41.5	----	-----	36307.8	43.1
959	9/11/2025	0:18:12	00d	01:00.0	42	59.8	48.5	41	-:-	45.2	43.1	41.6	41.1	41.1	----	-----	15848.9	43.0
960	9/11/2025	0:19:12	00d	01:00.0	42.2	60	46.3	40.7	-:-	45.1	44.8	41.5	40.9	40.9	----	-----	16595.9	43.1
961	9/11/2025	0:20:12	00d	01:00.0	40.7	58.5	41.5	39.8	-:-	41.5	41.3	40.7	40.1	40	----	-----	11749.0	43.1
962	9/11/2025	0:21:12	00d	01:00.0	43.1	60.9	47.6	40.2	-:-	47.4	47	41.6	40.4	40.3	----	-----	20417.4	43.2
963	9/11/2025	0:22:12	00d	01:00.0	40.8	58.6	41.9	40	-:-	41.6	41.4	40.7	40.2	40.1	----	-----	12022.6	43.2
964	9/11/2025	0:23:12	00d	01:00.0	42.6	60.4	44.8	41.2	-:-	44.2	43.6	42.4	41.8	41.6	----	-----	18197.0	43.2
965	9/11/2025	0:24:12	00d	01:00.0	41.4	59.2	43.6	40	-:-	43.4	42.9	41.1	40.4	40.3	----	-----	13803.8	43.2
966	9/11/2025	0:25:12	00d	01:00.0	40.8	58.6	41.7	40	-:-	41.7	41.3	40.8	40.4	40.3	----	-----	12022.6	43.1
967	9/11/2025	0:26:12	00d	01:00.0	40.7	58.5	41.7	39.9	-:-	41.6	41.3	40.6	40.2	40.1	----	-----	11749.0	43.2
968	9/11/2025	0:27:12	00d	01:00.0	40.7	58.5	41.8	39.6	-:-	41.9	41.8	40.6	39.9	39.8	----	-----	11749.0	43.2
969	9/11/2025	0:28:12	00d	01:00.0	40.2	58	41.9	38.9	-:-	41.4	41.2	40.2	39.2	39	----	-----	10471.3	43.2
970	9/11/2025	0:29:12	00d	01:00.0	40.4	58.2	41.8	39.1	-:-	41.9	41.6	40.3	39.5	39.2	----	-----	10964.8	43.2
971	9/11/2025	0:30:12	00d	01:00.0	41.7	59.5	48.9	38.4	-:-	47.7	44.1	40	39.1	38.5	----	-----	14791.1	43.2
972	9/11/2025	0:31:12	00d	01:00.0	40.1	57.9	41.4	39	-:-	41.6	41.3	39.9	39.4	39.1	----	-----	10232.9	43.2
973	9/11/2025	0:32:12	00d	01:00.0	40.3	58.1	41.8	39.2	-:-	41.9	41.7	40.1	39.3	39.3	----	-----	10715.2	43.2
974	9/11/2025	0:33:12	00d	01:00.0	40.5	58.3	41.9	39.7	-:-	41.8	41.4	40.4	39.8	39.8	----	-----	11220.2	43.2
975	9/11/2025	0:34:12	00d	01:00.0	41	58.8	42.5	39.8	-:-	42.2	41.8	40.9	40.4	40.3	----	-----	12589.3	43.2
976	9/11/2025	0:35:12	00d	01:00.0	47.2	65	52.6	39.9	-:-	52	51.9	44.8	40.6	40.4	----	-----	52480.7	43.2
977	9/11/2025	0:36:12	00d	01:00.0	41.1	58.9	43.2	40	-:-	42.3	41.9	41	40.3	40.2	----	-----	12882.5	43.0
978	9/11/2025	0:37:12	00d	01:00.0	40.3	58.1	41.6	39.4	-:-	41.4	41.2	40	39.7	39.6	----	-----	10715.2	43.0
979	9/11/2025	0:38:12	00d	01:00.0	40.9	58.7	42.2	40	-:-	42.1	42	40.6	40.2	40.1	----	-----	12302.7	43.0
980	9/11/2025	0:39:12	00d	01:00.0	40.3	58.1	41.7	39.4	-:-	41.8	41.5	40.2	39.6	39.4	----	-----	10715.2	43.0
981	9/11/2025	0:40:12	00d	01:00.0	41.2	59	42.9	39.6	-:-	42.8	42.1	41	40.3	40.1	----	-----	13182.6	43.1
982	9/11/2025	0:41:12	00d	01:00.0	41.1	58.9	42.6	40	-:-	42.3	42.1	41	40.4	40.2	----	-----	12882.5	43.2
983	9/11/2025	0:42:12	00d	01:00.0	45.3	63.1	52.5	40	-:-	52.2	50.3	41.8	40.6	40.3	----	-----	33884.4	43.2
984	9/11/2025	0:43:12	00d	01:00.0	40.8	58.6	42.2	39.7	-:-	42.2	42	40.6	40	39.9	----	-----	12022.6	43.1
985	9/11/2025	0:44:12	00d	01:00.0	40.9	58.7	42.1	39.9	-:-	42.1	41.6	40.8	40.2	40.2	----	-----	12302.7	43.1
986	9/11/2025	0:45:12	00d	01:00.0	41.8	59.6	43.9	40	-:-	43.4	43.1	41.6	40.5	40.4	----	-----	15135.6	43.1
987	9/11/2025	0:46:12	00d	01:00.0	41.2	59	46.2	39.6	-:-	43.2	42.2	40.9	39.8	39.6	----	-----	13182.6	43.0
988	9/11/2025	0:47:12	00d	01:00.0	49.1	66.9	59.1	40.1	-:-	57.3	54	41.3	40.3	40.2	----	-----	81283.1	43.0
989	9/11/2025	0:48:12	00d	01:00.0	40.3	58.1	42	39	-:-	41.6	41.4	40.3	39.2	39.1	----	-----	10715.2	42.8
990	9/11/2025	0:49:12	00d	01:00.0	40.9	58.7	42.1	39.8	-:-	42	41.7	40.8	40.2	40.2	----	-----	12302.7	42.8
991	9/11/2025	0:50:12	00d	01:00.0	49.4	67.2	54.6	40.8	-:-	53.8	53	48	41.3	41	----	-----	87096.4	42.8
992	9/11/2025	0:51:12	00d	01:00.0	40.7	58.5	44.6	39.5	-:-	42.6	42	40.3	39.9	39.8	----	-----	11749.0	42.5
993	9/11/2025	0:52:12	00d	01:00.0	40.4	58.2	42.7	39.5	-:-	41.9	41.3	40.3	39.8	39.8	----	-----	10964.8	42.5
994	9/11/2025	0:53:12	00d	01:00.0	40.9	58.7	42.2	39.8	-:-	42.2	41.7	40.9	40.2	40	----	-----	12302.7	42.6
995	9/11/2025	0:54:12	00d	01:00.0	40.5	58.3	44.2	39.3	-:-	42	41.2	40.3	39.6	39.5	----	-----	11220.2	42.7
996	9/11/2025	0:55:12	00d	01:00.0	40.2	58	41.7	39.3	-:-	41.6	41.1	40.1	39.5	39.4	----	-----	10471.3	42.7

997	9/11/2025	0:56:12	00d	01:00.0	40.5	58.3	41.8	39.4	-:-	41.8	41.3	40.4	39.7	39.5	----	-----	11220.2	42.7
998	9/11/2025	0:57:12	00d	01:00.0	41.6	59.4	42.9	40.5	-:-	42.7	42.5	41.5	40.8	40.7	----	-----	14454.4	42.6
999	9/11/2025	0:58:12	00d	01:00.0	48.8	66.6	58	39.8	-:-	57.2	53.8	42.8	40.3	40.2	----	-----	75857.8	42.7
1000	9/11/2025	0:59:12	00d	01:00.0	41.5	59.3	47.6	39.6	-:-	43.6	42.8	40.6	39.9	39.7	----	-----	14125.4	42.5
1001	9/11/2025	1:00:12	00d	01:00.0	50.5	68.3	59.6	39.7	-:-	58.6	56.4	40.8	40.1	39.8	----	-----	112201.8	42.5
1002	9/11/2025	1:01:12	00d	01:00.0	40.2	58	41.9	39.5	-:-	41.5	41.1	40.2	39.6	39.6	----	-----	10471.3	42.0
1003	9/11/2025	1:02:12	00d	01:00.0	45.1	62.9	52.2	39.6	-:-	52	50	41	40.1	39.9	----	-----	32359.4	42.0
1004	9/11/2025	1:03:12	00d	01:00.0	43.4	61.2	48.9	40.4	-:-	48.7	47.4	41.8	40.6	40.5	----	-----	21877.6	41.9
1005	9/11/2025	1:04:12	00d	01:00.0	40.2	58	41.7	39.1	-:-	41.5	41	40.1	39.5	39.4	----	-----	10471.3	41.8
1006	9/11/2025	1:05:12	00d	01:00.0	40.8	58.6	42	39.5	-:-	41.8	41.6	40.8	39.9	39.6	----	-----	12022.6	41.8
1007	9/11/2025	1:06:12	00d	01:00.0	45.9	63.7	55.5	39.9	-:-	54.5	49.5	41.3	40.7	40.4	----	-----	38904.5	42.0
1008	9/11/2025	1:07:12	00d	01:00.0	43.9	61.7	55.5	41	-:-	49.8	45.9	41.8	41.2	41.1	----	-----	24547.1	41.9
1009	9/11/2025	1:08:12	00d	01:00.0	41.5	59.3	42.7	40.5	-:-	42.6	42.3	41.4	40.8	40.8	----	-----	14125.4	41.8
1010	9/11/2025	1:09:12	00d	01:00.0	41.8	59.6	43.2	40.3	-:-	43.1	42.8	41.9	40.5	40.4	----	-----	15135.6	42.0
1011	9/11/2025	1:10:12	00d	01:00.0	40.8	58.6	42.2	39.5	-:-	42.2	41.7	40.8	39.9	39.8	----	-----	12022.6	41.9
1012	9/11/2025	1:11:12	00d	01:00.0	41.5	59.3	43.2	39.8	-:-	42.8	42.6	41.4	40.4	40.2	----	-----	14125.4	41.9
1013	9/11/2025	1:12:12	00d	01:00.0	39.9	57.7	42.5	38.6	-:-	41.2	41	39.9	39.1	38.9	----	-----	9772.4	41.9
1014	9/11/2025	1:13:12	00d	01:00.0	40.5	58.3	43	39.1	-:-	42.1	41.5	40.2	39.5	39.4	----	-----	11220.2	42.1
1015	9/11/2025	1:14:12	00d	01:00.0	43.1	60.9	48.5	39.7	-:-	48.3	47.3	41	40.1	39.9	----	-----	20417.4	42.1
1016	9/11/2025	1:15:12	00d	01:00.0	40.7	58.5	44.2	39.1	-:-	42.3	41.7	40.4	39.5	39.3	----	-----	11749.0	42.0
1017	9/11/2025	1:16:12	00d	01:00.0	42.2	60	44.3	41.2	-:-	43.5	43.1	42	41.4	41.3	----	-----	16595.9	42.0
1018	9/11/2025	1:17:12	00d	01:00.0	41	58.8	42	39.6	-:-	41.9	41.8	41.1	39.9	39.7	----	-----	12589.3	42.0
1019	9/11/2025	1:18:12	00d	01:00.0	40.2	58	42.2	39.2	-:-	41.4	41	40.1	39.6	39.3	----	-----	10471.3	42.0
1020	9/11/2025	1:19:12	00d	01:00.0	46.8	64.6	56.2	39.5	-:-	55.3	51.2	41	40.1	39.8	----	-----	47863.0	42.0
1021	9/11/2025	1:20:12	00d	01:00.0	41.1	58.9	45.2	39.7	-:-	44.3	43.4	40.6	39.9	39.8	----	-----	12882.5	41.8
1022	9/11/2025	1:21:12	00d	01:00.0	46.6	64.4	54.4	41.1	-:-	53.6	50.9	43.1	41.3	41.2	----	-----	45708.8	41.8
1023	9/11/2025	1:22:12	00d	01:00.0	40.7	58.5	42.1	39.4	-:-	42.1	41.7	40.7	40	39.8	----	-----	11749.0	41.6
1024	9/11/2025	1:23:12	00d	01:00.0	40.7	58.5	42.8	39.9	-:-	42.2	41.3	40.6	40.2	40.1	----	-----	11749.0	41.6
1025	9/11/2025	1:24:12	00d	01:00.0	41.2	59	42.3	40.1	-:-	42.1	42	41.1	40.4	40.3	----	-----	13182.6	41.5
1026	9/11/2025	1:25:12	00d	01:00.0	41	58.8	42.3	39.9	-:-	42.4	42.1	40.8	40.2	40	----	-----	12589.3	41.5
1027	9/11/2025	1:26:12	00d	01:00.0	41.5	59.3	42.9	39.8	-:-	42.9	42.3	41.6	40.5	40.3	----	-----	14125.4	41.4
1028	9/11/2025	1:27:12	00d	01:00.0	45.4	63.2	52.2	40.7	-:-	52.1	49.8	42.9	41.4	41.1	----	-----	34673.7	41.4
1029	9/11/2025	1:28:12	00d	01:00.0	40.5	58.3	43.2	39.1	-:-	42.4	42.1	40.1	39.5	39.3	----	-----	11220.2	41.2
1030	9/11/2025	1:29:12	00d	01:00.0	39.6	57.4	42.7	38.2	-:-	42	40.4	39.5	38.5	38.4	----	-----	9120.1	41.2
1031	9/11/2025	1:30:12	00d	01:00.0	38.9	56.7	40.4	37.1	-:-	40.1	39.9	39	37.8	37.6	----	-----	7762.5	41.6
1032	9/11/2025	1:31:12	00d	01:00.0	39.9	57.7	41.3	38.3	-:-	40.9	40.7	40	38.9	38.8	----	-----	9772.4	41.6
1033	9/11/2025	1:32:12	00d	01:00.0	39.7	57.5	41	38.2	-:-	40.6	40.4	39.9	39	38.8	----	-----	9332.5	41.6
1034	9/11/2025	1:33:12	00d	01:00.0	39.3	57.1	39.9	38.4	-:-	39.8	39.7	39.4	38.9	38.6	----	-----	8511.4	41.6
1035	9/11/2025	1:34:12	00d	01:00.0	39.7	57.5	41.3	38.6	-:-	41.2	40.9	39.4	39.1	38.9	----	-----	9332.5	41.6
1036	9/11/2025	1:35:12	00d	01:00.0	39.6	57.4	41.1	38.1	-:-	40.5	40.3	39.7	38.7	38.4	----	-----	9120.1	41.6
1037	9/11/2025	1:36:12	00d	01:00.0	39.8	57.6	41.2	38.7	-:-	40.5	40.3	39.9	39	39	----	-----	9549.9	41.5
1038	9/11/2025	1:37:12	00d	01:00.0	39.3	57.1	40.1	38.2	-:-	40	39.8	39.4	38.7	38.5	----	-----	8511.4	41.5
1039	9/11/2025	1:38:12	00d	01:00.0	39.5	57.3	40.1	38.1	-:-	40.1	40	39.6	38.9	38.6	----	-----	8912.5	41.5
1040	9/11/2025	1:39:12	00d	01:00.0	39.6	57.4	41.4	37.3	-:-	41.1	40.8	39.7	37.9	37.6	----	-----	9120.1	41.5
1041	9/11/2025	1:40:12	00d	01:00.0	46.6	64.4	54.6	38.6	-:-	54.2	52.1	40.6	39.3	39	----	-----	45708.8	41.5
1042	9/11/2025	1:41:12	00d	01:00.0	46.3	64.1	55	39	-:-	53.9	51.3	40.4	39.2	39.1	----	-----	42658.0	41.3
1043	9/11/2025	1:42:12	00d	01:00.0	38.8	56.6	39.8	37.9	-:-	39.4	39.3	38.9	38.3	38	----	-----	7585.8	41.1
1044	9/11/2025	1:43:12	00d	01:00.0	38.8	56.6	39.7	37.4	-:-	39.4	39.3	38.9	38.1	37.7	----	-----	7585.8	41.1
1045	9/11/2025	1:44:12	00d	01:00.0	39.2	57	39.8	38.5	-:-	39.8	39.7	39.2	38.8	38.5	----	-----	8317.6	41.1
1046	9/11/2025	1:45:12	00d	01:00.0	39.1	56.9	40.5	38.2	-:-	39.9	39.7	39	38.5	38.4	----	-----	8128.3	41.1
1047	9/11/2025	1:46:12	00d	01:00.0	39.1	56.9	39.9	38.1	-:-	39.9	39.7	39.2	38.4	38.3	----	-----	8128.3	41.1
1048	9/11/2025	1:47:12	00d	01:00.0	38.1	55.9	39.3	37.1	-:-	39.2	39	38.1	37.4	37.3	----	-----	6456.5	41.1
1049	9/11/2025	1:48:12	00d	01:00.0	38.2	56	41.4	37	-:-	39.8	38.7	38	37.5	37.3	----	-----	6606.9	41.2
1050	9/11/2025	1:49:12	00d	01:00.0	44.5	62.3	52.9	36.1	-:-	52.7	49.6	38.5	36.4	36.3	----	-----	28183.8	41.2
1051	9/11/2025	1:50:12	00d	01:00.0	37.6	55.4	38.7	36.4	-:-	38.6	38.4	37.6	36.8	36.7	----	-----	5754.4	41.0
1052	9/11/2025	1:51:12	00d	01:00.0	37.6	55.4	38.4	36.3	-:-	38.3	38.3	37.9	36.7	36.6	----	-----	5754.4	41.0
1053	9/11/2025	1:52:12	00d	01:00.0	38.5	56.3	40.4	37.8	-:-	39.3	38.8	38.4	38.1	38	----	-----	7079.5	41.0
1054	9/11/2025	1:53:12	00d	01:00.0	46.9	64.7	55	37.8	-:-	54.6	53.1	40.5	38.1	38	----	-----	48977.9	41.0
1055	9/11/2025	1:54:12	00d	01:00.0	45.6	63.4	54.6	37.1	-:-	54.3	50.7	38.3	37.7	37.6	----	-----	36307.8	40.9
1056	9/11/2025	1:55:12	00d	01:00.0	38.4	56.2	47.6	36.4	-:-	42.5	39.1	37.7	36.9	36.7	----	-----	6918.3	40.7
1057	9/11/2025	1:56:12	00d	01:00.0	37.2	55	38.1	35.7	-:-	37.9	37.7	37.3	36.7	36.5	----	-----	5248.1	40.7
1058	9/11/2025	1:57:12	00d	01:00.0	37.1	54.9	37.9	36	-:-	37.7	37.6	37.2	36.6	36.4	----	-----	5128.6	40.7
1059	9/11/2025	1:58:12	00d	01:00.0	46.1	63.9	54	37.5	-:-	53.4	50.2	41.1	38.3	37.9	----	-----	40738.0	40.7
1060	9/11/2025	1:59:12	00d	01:00.0	40.3	58.1	49.3	36.4	-:-	47.1	43.3	37.5	36.6	36.5	----	-----	10715.2	40.6
1061	9/11/2025	2:00:12	00d	01:00.0	37.4	55.2	38.3	36.6	-:-	38.3	38.1	37.3	36.9	36.9	----	-----	5495.4	40.9
1062	9/11/2025	2:01:12	00d	01:00.0	37.5	55.3	38.1	36.8	-:-	38	37.9	37.5	37.1	37	----	-----	5623.4	40.9
1063	9/11/2025	2:02:12	00d	01:00.0	37	54.8	37.9	35.6	-:-	37.9	37.7	37.2	35.9	35.7	----	-----	5011.9	40.9
1064	9/11/2025	2:03:12	00d	01:00.0	39.6	57.4	41.1	36.9	-:-	41.1	40.4	39.8	38.2	38.1	----	-----	9120.1	40.9
1065	9/11/2025	2:04:12	00d	01:00.0	39.9	57.7	41	37.7	-:-	40.7	40.6	40	38.6	38.1	----	-----	9772.4	40.8
1066	9/11/2025	2:05:12	00d	01:00.0	39.5	57.3	40.3	38	-:-	40.2	40.1	39.7	38.7	38.5	----	-----	8912.5	40.8
1067	9/11/2025	2:06:12	00d	01:00.0	47.9	65.7	57.2	38.9	-:-	56	53.5	40.2	39.6	39.5	----	-----	61659.5	40.8
1068	9/11/2025	2:07:12	00d	01:00.0	40.5	58.3	47.1	37.3	-:-	43.8	42.2	40.2	38.7	38.1	----	-----	11220.2	40.4
1069	9/11/2025	2:08:12	00d	01:00.0	40.2	58	41	38.6	-:-	41.1	41	40.3	39.3	39.1	----	-----	10471.3	40.4
1070	9/11/2025	2:09:12	00d	01:00.0	46	63.8	54.3	38.9	-:-	53.6	50.9	41.3	39.6	39.5	----	-----	39810.7	40.3
1071	9/11/2025	2:10:12	00d	01:00.0	40.3	58.1	42	38.6	-:-	41.5	41.1	40.4	39.4	38.8	----	-----	10715.2	40.1
1072	9/11/2025	2:11:12	00d	01:00.0	40.9	58.7	41.8	39.1	-:-	41.8	41.6	41	39.9	39.6	----	-----	12302.7	40.1
1073	9/11/2025	2:12:12	00d	01:00.0	40.7	58.5	42.1	38.1	-:-	42	41.9	40.6	39.6	39.2	----	-----	11749.0	40.0
1074	9/11/2025	2:13:12	00d	01:00.0	45.7	63.5	53.8	40.1	-:-	53.7	50.6	41	40.4	40.2	----	-----	37153.5	40.0
1075	9/11/2025	2:14:12	00d	01:00.0	41	58.8	48.5	39.2	-:-	43.6	41.8	40.9	40	39.5	----	-----	12589.3	39.8
1076	9/11/2025	2:15:12	00d	01:00.0	40.5	58.3	41.7	39	-:-	41.5	41.2	40.6	39.3	39.1	----	-----	11220.2	39.8
1077	9/11/2025	2:16:12	00d	01:00.0	39.7	57.5	41.3	38.4	-:-	41.2	41	39.6	38.5	38.5	----	-----	9332.5	39.7
1078	9/11/2025	2:17:12	00d	01:00.0	39.8	57.6	40.9	37.1	-:-	40.8	40.8	40	38.5	38.1	----	-----	9549.9	39.7
1079	9/11/2025	2:18:12	00d	01:00.0	44.4	62.2	51.6	38.7	-:-	51.1	48.6	41.1	39.7	39	----	-----	27542.3	39.7
1080	9/11/2025	2:19:12	00d	01:00.0	38	55.8	40.2	35.4	-:-	39	39	38.1	36.4	35.7	----	-----	6309.6	39.5
1081	9/11/2025	2:20:12	00d	01:00.0	37.7	55.5	38.9	36.2	-:-	38.6	38.5	37.7	36.9	36.7	----	-----	5888.4	39.6
1082	9/11/2025	2:21:12	00d	01:00.0	37.5	55.3	38.9	35.9	-:-	38.8	38.6	37.1	36.3	36	----	-----	5623.4	39.6
1083	9/11/2025	2:22:12	00d	01:00.0	36.2	54	37.5	34.9	-:-	37.4	37.2	36.1	35.1	35.1	----	-----	4168.7	39.6
1084	9/11/2025	2:23:12	00d	01:00.0	37.1	54.9	37.7	35.3	-:-	37.7	37.6	37.2	35.8	35.6	----	-----	5128.6	39.6
1085	9/11/2025	2:24:12	00d	01:00.0	36.7	54.5	37.4	35.3	-:-	37.3	37.2	36.8	36.1	36.1	----	-----	4677.4	39.6
1086	9/11/2025	2:25:12	00d	01:00.0	36.4	54.2	38.9	35.1	-:-	38.1	37.4	36	35.3	35.2	----	-----	4365.2	39.7
1087	9/11/2025	2:26:12	00d	01:00.0	35.5	53.3	37	33.9	-:-	36.9	36.8	35.3	34.4	34.1	----	-----	3548.1	40.1
1088	9/11/2025	2:27:12	00d	01:00.0	37.5	55.3	40	36.3	-:-	39.1	38.4	37.3	36.6	36.4	----	-----	5623.4	40.2
1089	9/11/2025	2:28:12	00d	01:00.0	35.6	53.4	37.4	34.3	-:-	37.1	36.9	35.6	34.6	34.5	----	-----	3630.8	40.6
1090	9/11/2025	2:29:12	00d	01:00.0	37.5	55.3	44.5	34.8	-:-	40.8	39.3	36.3	35.4	35.2	----	-----	5623.4	40.6
1091	9/11/2025	2:30:12	00d	01:00.0	49.4	67.2	58.2	35.6	-:-	57.8	55.5	37.7	35.8	35.8	----	-----	87096.4	40.6
1092	9/11/2025	2:31:12	00d	01:00.0	37.2	55	38.8	36.1	-:-	38	37.8	37.2	36.6	36.4	----	-----	5248.1	40.2
1093	9/11/2025	2:32:12	00d	01:00.0	37.3	55.1	40	35.8	-:-	39.9	38.6	37	36.3	36	----	-----	5370.3	40.2
1094	9/11/2025	2:33:12	00d	01:00.0	40.3	58.1	45.3	37.6	-:-	44.4	42.4	39.7	37.9	37.9	----	-----	10715.2	40.2
1095	9/11/2025	2:34:12	00d	01:00.0	38.1	55.9	38.7	36.5	-:-	38.7	38.6	38.2	37.5	37.2	----	-----	6456.5	40.2
1096	9/11/2025	2:35:12	00d	01:00.0	38	55.8	39.4	37.3	-:-	39.2	38.8	37.8	37.5	37.5	----	-----	6309.6	40.2
1097	9/11/2025	2:36:12	00d	01:00.0	39.1	56.9	39.7	38.3	-:-	39.6	39.5	39.2	38.7	38.6	----	-----	8128.3	40.2
1098	9/11/2025	2:37:12	00d	01:00.0	39.8	57.6	42.2	37	-:-	41.9	41.1	39.8	37.5	37.4	----	-----	9549.9	40.2
1099	9/11/2025	2:38:12	00d	01:00.0	37.9	55.7	38.9	36.7	-:-	38.7	38.5	38.1	37.1	37	----	-----	6166.0	40.2
1100	9/11/2025	2:39:12	00d	01:00.0	38.3	56.1	39	37.6	-:-	38.9	38.8	38.4	37.7	37.6	----	-----	6760.8	40.3
1101	9/11/2025	2:40:12	00d	01:00.0	38.8	56.6	39.9	37.4	-:-	39.8	39.8	38.9	37.8	37.6	----	-----	7585.8	40.3
1102	9/11/2025	2:41:12	00d	01:00.0	37.8	55.6	38.6	36.9	-:-	38.5	38.2	37.9	37.2	37	----	-----	6025.6	40.4
1103	9/11/2025	2:42:12	00d	01:00.0	37.6	55.4	39.5	36.7	-:-	38.5	38.3	37.5	36.9	36.8	----	-----	5754.4	40.5
1104	9/11/2025	2:43:12	00d	01:00.0	37.4	55.2	38.1	36.3	-:-	37.9	37.8	37.5	36.9	36.8	----	-----	5495.4	40.5
1105	9/11/2025	2:44:12	00d	01:00.0	37.4	55.2	38.5	36.2	-:-	38.3	38.2	37.5	36.6	36.4	----	-----	5495.4	40.5
1106	9/11/2025	2:45:12	00d	01:00.0	37.6	55.4	38.8	36.2	-:-	38.5	38.4	37.5	36.7	36.5	----	-----	5754.4	40.5
1107	9/11/2025	2:46:12	00d	01:00.0	38.2	56	38.9	37.2	-:-	38.9	38.7	38.2	37.8	37.6	----	-----	6606.9	40.7

1108	9/11/2025	2:47:12	00d	01:00.0	38.2	56	39.1	37.4	-:-	39	38.9	38.2	37.9	37.6	----	-----	6606.9	40.7
1109	9/11/2025	2:48:12	00d	01:00.0	44.2	62	51.9	37.1	-:-	51.6	49.8	39.3	37.4	37.2	----	-----	26302.7	40.7
1110	9/11/2025	2:49:12	00d	01:00.0	37.1	54.9	39.9	35.9	-:-	38.2	38.1	37.1	36.3	36.2	----	-----	5128.6	40.6
1111	9/11/2025	2:50:12	00d	01:00.0	37.4	55.2	38.6	35.7	-:-	38.5	38.4	37.6	36.1	35.9	----	-----	5495.4	40.6
1112	9/11/2025	2:51:12	00d	01:00.0	37.6	55.4	39	36.6	-:-	38.8	38.3	37.5	37.1	36.9	----	-----	5754.4	40.6
1113	9/11/2025	2:52:12	00d	01:00.0	37.3	55.1	38.5	35.8	-:-	38.3	38.2	37.3	36.5	36.1	----	-----	5370.3	41.1
1114	9/11/2025	2:53:12	00d	01:00.0	37.6	55.4	38.7	35.9	-:-	38.7	38.6	37.6	36.5	36.3	----	-----	5754.4	41.1
1115	9/11/2025	2:54:12	00d	01:00.0	43.6	61.4	51.2	35.6	-:-	51.1	48.6	39	35.9	35.7	----	-----	22908.7	41.1
1116	9/11/2025	2:55:12	00d	01:00.0	37.4	55.2	38.4	35.7	-:-	38.4	38.2	37.3	36.9	36.6	----	-----	5495.4	41.0
1117	9/11/2025	2:56:12	00d	01:00.0	38.2	56	39.7	37.1	-:-	39.2	39.1	38.2	37.5	37.4	----	-----	6606.9	41.0
1118	9/11/2025	2:57:12	00d	01:00.0	38.6	56.4	39.7	37.1	-:-	39.5	39.4	38.7	38	37.8	----	-----	7244.4	41.0
1119	9/11/2025	2:58:12	00d	01:00.0	38.4	56.2	41.1	36.7	-:-	40.8	39.9	38.1	37.2	36.6	----	-----	6918.3	41.0
1120	9/11/2025	2:59:12	00d	01:00.0	43	60.8	47.9	37.1	-:-	47.1	46.5	42.3	37.5	37.4	----	-----	19952.6	41.0
1121	9/11/2025	3:00:12	00d	01:00.0	47.4	65.2	52.6	37.8	-:-	52	51.5	46.1	38.7	38.4	----	-----	54954.1	41.2
1122	9/11/2025	3:01:12	00d	01:00.0	37.4	55.2	40.1	35.8	-:-	39.4	38.6	37.3	36.4	36.3	----	-----	5495.4	40.9
1123	9/11/2025	3:02:12	00d	01:00.0	37.3	55.1	39.4	35.7	-:-	38.5	38.3	37.4	36.1	35.9	----	-----	5370.3	40.9
1124	9/11/2025	3:03:12	00d	01:00.0	37.6	55.4	38.6	36.4	-:-	38.4	38.2	37.7	36.7	36.5	----	-----	5754.4	40.9
1125	9/11/2025	3:04:12	00d	01:00.0	36.5	54.3	37.5	35.5	-:-	37.5	37.3	36.4	35.7	35.7	----	-----	4466.8	40.9
1126	9/11/2025	3:05:12	00d	01:00.0	36.2	54	38.2	34.1	-:-	38	37	36	35.3	35	----	-----	4168.7	41.1
1127	9/11/2025	3:06:12	00d	01:00.0	36.3	54.1	37.4	34.9	-:-	37.3	37.1	36.5	35.3	35.1	----	-----	4265.8	41.2
1128	9/11/2025	3:07:12	00d	01:00.0	36.3	54.1	37.4	34.3	-:-	37.4	37.2	36.3	35.7	35.2	----	-----	4265.8	41.2
1129	9/11/2025	3:08:12	00d	01:00.0	36.6	54.4	38.3	34.9	-:-	37.6	37.3	36.5	36.2	35.7	----	-----	4570.9	41.2
1130	9/11/2025	3:09:12	00d	01:00.0	37.2	55	39.3	35.5	-:-	39.1	38.4	37	36.3	36	----	-----	5248.1	41.2
1131	9/11/2025	3:10:12	00d	01:00.0	35.9	53.7	37.2	34.9	-:-	36.9	36.7	35.8	35.5	35.3	----	-----	3890.5	41.4
1132	9/11/2025	3:11:12	00d	01:00.0	38.6	56.4	45.8	34.9	-:-	44.1	41.9	37.1	35.6	35.6	----	-----	7244.4	41.4
1133	9/11/2025	3:12:12	00d	01:00.0	39.6	57.4	46.5	35.5	-:-	45.4	44.1	37	35.8	35.7	----	-----	9120.1	41.4
1134	9/11/2025	3:13:12	00d	01:00.0	36	53.8	37.3	33.6	-:-	37	36.8	36.2	34.5	33.9	----	-----	3981.1	41.7
1135	9/11/2025	3:14:12	00d	01:00.0	41.7	59.5	49	36.4	-:-	48.5	47.3	37.8	36.9	36.8	----	-----	14791.1	41.8
1136	9/11/2025	3:15:12	00d	01:00.0	38.1	55.9	46.9	34.9	-:-	43	42.3	36.7	35.7	35.3	----	-----	6456.5	41.9
1137	9/11/2025	3:16:12	00d	01:00.0	36.3	54.1	37.1	34.4	-:-	37	36.9	36.4	35.6	35.3	----	-----	4265.8	42.0
1138	9/11/2025	3:17:12	00d	01:00.0	36.5	54.3	37.8	34.2	-:-	37.5	37.3	36.5	35.6	35.2	----	-----	4466.8	42.0
1139	9/11/2025	3:18:12	00d	01:00.0	37.4	55.2	39	35.6	-:-	38.8	38.7	37.1	36	35.9	----	-----	5495.4	42.0
1140	9/11/2025	3:19:12	00d	01:00.0	37.5	55.3	44.7	35.4	-:-	39.5	38.1	36.9	35.7	35.5	----	-----	5623.4	42.0
1141	9/11/2025	3:20:12	00d	01:00.0	43.9	61.7	52.5	36.1	-:-	52	49.1	38	36.5	36.4	----	-----	24547.1	42.2
1142	9/11/2025	3:21:12	00d	01:00.0	36.5	54.3	40.6	34.6	-:-	37.8	37.5	36.5	35.2	34.8	----	-----	4466.8	42.1
1143	9/11/2025	3:22:12	00d	01:00.0	36	53.8	37.4	34.3	-:-	37.2	36.7	36.1	34.8	34.6	----	-----	3981.1	42.1
1144	9/11/2025	3:23:12	00d	01:00.0	38.5	56.3	40.4	36.3	-:-	40.1	39.5	38.5	36.9	36.7	----	-----	7079.5	42.4
1145	9/11/2025	3:24:12	00d	01:00.0	37.5	55.3	39.9	35.4	-:-	39.4	38.8	37.3	36.5	35.6	----	-----	5623.4	42.4
1146	9/11/2025	3:25:12	00d	01:00.0	42.6	60.4	53.3	35.1	-:-	51	47.3	37	36	35.5	----	-----	18197.0	42.6
1147	9/11/2025	3:26:12	00d	01:00.0	47.3	65.1	57.7	35	-:-	57.1	52.2	38	36.5	35.7	----	-----	53703.2	42.5
1148	9/11/2025	3:27:12	00d	01:00.0	43.1	60.9	50.5	36.8	-:-	50.1	48.8	38.2	37.2	37.1	----	-----	20417.4	42.4
1149	9/11/2025	3:28:12	00d	01:00.0	48.4	66.2	57.8	33.9	-:-	57.5	53.9	36.6	34.6	34.1	----	-----	69183.1	42.3
1150	9/11/2025	3:29:12	00d	01:00.0	38.4	56.2	48.2	35.3	-:-	43.3	40.4	36.4	35.5	35.4	----	-----	6918.3	42.1
1151	9/11/2025	3:30:12	00d	01:00.0	36.8	54.6	38.6	33.4	-:-	38.2	38.1	36.8	35.4	35.1	----	-----	4786.3	42.2
1152	9/11/2025	3:31:12	00d	01:00.0	43.7	61.5	51.5	37	-:-	51.1	48.6	39.3	37.5	37.2	----	-----	23442.3	42.3
1153	9/11/2025	3:32:12	00d	01:00.0	36.6	54.4	37.8	35.4	-:-	37.5	37.2	36.7	35.9	35.7	----	-----	4570.9	42.2
1154	9/11/2025	3:33:12	00d	01:00.0	37.8	55.6	39.3	36.2	-:-	38.9	38.7	38	36.6	36.5	----	-----	6025.6	42.4
1155	9/11/2025	3:34:12	00d	01:00.0	38.7	56.5	40	36.7	-:-	39.9	39.9	38.7	37.4	37.2	----	-----	7413.1	42.7
1156	9/11/2025	3:35:12	00d	01:00.0	38.2	56	39.4	36.7	-:-	39.2	39	38.2	37.5	37.4	----	-----	6606.9	42.9
1157	9/11/2025	3:36:12	00d	01:00.0	37.8	55.6	38.6	37.1	-:-	38.4	38.2	37.8	37.4	37.1	----	-----	6025.6	42.9
1158	9/11/2025	3:37:12	00d	01:00.0	39	56.8	41.6	36	-:-	41.3	40.6	38.9	37.2	36.3	----	-----	7943.3	42.9
1159	9/11/2025	3:38:12	00d	01:00.0	39.8	57.6	44.6	35.9	-:-	43.7	41.4	39.2	37.1	36.8	----	-----	9549.9	42.9
1160	9/11/2025	3:39:12	00d	01:00.0	41.5	59.3	48	37.7	-:-	47.9	46.5	38.7	38	37.9	----	-----	14125.4	43.0
1161	9/11/2025	3:40:12	00d	01:00.0	38.6	56.4	40.5	37.1	-:-	40	39.5	38.5	37.7	37.5	----	-----	7244.4	43.0
1162	9/11/2025	3:41:12	00d	01:00.0	44.9	62.7	53.5	37.9	-:-	52.9	49.9	39.4	38.2	38.1	----	-----	30903.0	43.1
1163	9/11/2025	3:42:12	00d	01:00.0	42.2	60	47.5	37.1	-:-	47.4	46.1	40.3	38.1	37.9	----	-----	16595.9	43.0
1164	9/11/2025	3:43:12	00d	01:00.0	40	57.8	43.6	38	-:-	42.7	42.2	39	38.2	38	----	-----	10000.0	43.0
1165	9/11/2025	3:44:12	00d	01:00.0	38.8	56.6	41.2	36.8	-:-	40.9	40.3	38.7	37	36.9	----	-----	7585.8	43.0
1166	9/11/2025	3:45:12	00d	01:00.0	38.6	56.4	40.7	36.8	-:-	40.3	39.8	38.4	37.6	37.5	----	-----	7244.4	43.1
1167	9/11/2025	3:46:12	00d	01:00.0	45.6	63.4	53.8	37.7	-:-	53.6	50	39.8	38.1	37.8	----	-----	36307.8	43.1
1168	9/11/2025	3:47:12	00d	01:00.0	38.3	56.1	42.8	35.8	-:-	41.6	39.3	37.9	37	36.3	----	-----	6760.8	43.0
1169	9/11/2025	3:48:12	00d	01:00.0	37.7	55.5	39.3	36.1	-:-	39.1	38.3	37.7	36.9	36.6	----	-----	5888.4	43.2
1170	9/11/2025	3:49:12	00d	01:00.0	38	55.8	42.1	35.3	-:-	41.5	40.6	36.8	35.7	35.6	----	-----	6309.6	43.3
1171	9/11/2025	3:50:12	00d	01:00.0	37.5	55.3	42.1	34.8	-:-	39	38.9	37.6	35.6	35.5	----	-----	5623.4	43.6
1172	9/11/2025	3:51:12	00d	01:00.0	39.9	57.7	50.4	35.3	-:-	46.4	40.8	36.8	35.6	35.3	----	-----	9772.4	43.8
1173	9/11/2025	3:52:12	00d	01:00.0	49.6	67.4	56.8	36.7	-:-	56.8	55.7	44.2	37.5	37.2	----	-----	91201.1	43.8
1174	9/11/2025	3:53:12	00d	01:00.0	36.7	54.5	38.9	35.4	-:-	38.3	37.9	36.6	35.7	35.5	----	-----	4677.4	43.6
1175	9/11/2025	3:54:12	00d	01:00.0	35.9	53.7	37.3	34.4	-:-	37	36.8	35.9	34.8	34.6	----	-----	3890.5	43.6
1176	9/11/2025	3:55:12	00d	01:00.0	36.8	54.6	39	34.6	-:-	38.4	38	36.7	35.5	35.2	----	-----	4786.3	43.6
1177	9/11/2025	3:56:12	00d	01:00.0	36.2	54	38.6	33.9	-:-	38	37.7	35.7	34.5	34	----	-----	4168.7	43.6
1178	9/11/2025	3:57:12	00d	01:00.0	41	58.8	47.5	35.3	-:-	47.2	46.2	38.1	35.9	35.8	----	-----	12589.3	43.8
1179	9/11/2025	3:58:12	00d	01:00.0	38	55.8	41.3	35.2	-:-	40.8	40.1	37.5	35.8	35.8	----	-----	6309.6	44.0
1180	9/11/2025	3:59:12	00d	01:00.0	38.2	56	41.5	36.1	-:-	40.7	39.8	37.8	37.2	36.9	----	-----	6606.9	44.0
1181	9/11/2025	4:00:12	00d	01:00.0	46.6	64.4	53.2	38.2	-:-	53	50.7	44.3	40	38.7	----	-----	45708.8	44.1
1182	9/11/2025	4:01:12	00d	01:00.0	38	55.8	41.1	36.4	-:-	39.9	39.3	37.8	36.8	36.7	----	-----	6309.6	44.0
1183	9/11/2025	4:02:12	00d	01:00.0	38.7	56.5	40.4	37.2	-:-	40.4	40	38.5	37.5	37.4	----	-----	7413.1	44.2
1184	9/11/2025	4:03:12	00d	01:00.0	40.7	58.5	45.9	37.3	-:-	45.3	44.1	39.2	37.6	37.5	----	-----	11749.0	44.3
1185	9/11/2025	4:04:12	00d	01:00.0	37.4	55.2	40.1	34.5	-:-	39.8	39.4	36.8	35.2	35	----	-----	5495.4	44.4
1186	9/11/2025	4:05:12	00d	01:00.0	46	63.8	55.6	35.4	-:-	55.1	50.7	38.9	36	35.6	----	-----	39810.7	44.4
1187	9/11/2025	4:06:12	00d	01:00.0	42.3	60.1	49.6	34	-:-	49.5	47.4	38.5	34.4	34.2	----	-----	16982.4	44.3
1188	9/11/2025	4:07:12	00d	01:00.0	34.2	52	35.9	32.6	-:-	35.8	35.3	34.2	33	32.8	----	-----	2630.3	44.3
1189	9/11/2025	4:08:12	00d	01:00.0	34.3	52.1	36.2	32.9	-:-	35.8	35.5	34.2	33.5	33.3	----	-----	2691.5	44.3
1190	9/11/2025	4:09:12	00d	01:00.0	37	54.8	39.7	33.8	-:-	39.5	39.1	36.8	34.3	34	----	-----	5011.9	44.6
1191	9/11/2025	4:10:12	00d	01:00.0	47.1	64.9	54.1	37.4	-:-	53	51.3	43.9	38.1	37.8	----	-----	51286.1	45.4
1192	9/11/2025	4:11:12	00d	01:00.0	36.7	54.5	38.9	33.3	-:-	38.8	38.3	36.5	34.9	34.3	----	-----	4677.4	45.3
1193	9/11/2025	4:12:12	00d	01:00.0	36.5	54.3	39	33.2	-:-	38.9	38.4	36.4	34	33.6	----	-----	4466.8	45.6
1194	9/11/2025	4:13:12	00d	01:00.0	48.5	66.3	59.4	36.6	-:-	57.7	52.2	40.5	37.3	36.9	----	-----	70794.6	45.6
1195	9/11/2025	4:14:12	00d	01:00.0	39.4	57.2	44.2	36.6	-:-	43.3	42.9	37.9	37	36.8	----	-----	8709.6	45.5
1196	9/11/2025	4:15:12	00d	01:00.0	47.3	65.1	56.7	37.3	-:-	55.9	51.6	42	37.5	37.4	----	-----	53703.2	45.6
1197	9/11/2025	4:16:12	00d	01:00.0	43.3	61.1	51.8	35.1	-:-	51.6	49.1	37.8	35.9	35.7	----	-----	21379.6	45.7
1198	9/11/2025	4:17:12	00d	01:00.0	38.9	56.7	43	37.4	-:-	40.4	39.8	38.5	37.7	37.7	----	-----	7762.5	45.7
1199	9/11/2025	4:18:12	00d	01:00.0	38.9	56.7	43.2	34.6	-:-	42.9	41.8	37.3	35.6	35.3	----	-----	7762.5	45.8
1200	9/11/2025	4:19:12	00d	01:00.0	38.6	56.4	42.6	36.7	-:-	41.3	40	38.1	37.2	37.2	----	-----	7244.4	46.0
1201	9/11/2025	4:20:12	00d	01:00.0	46.8	64.6	55.5	37.4	-:-	54.8	52.1	40.2	37.9	37.7	----	-----	47863.0	46.3
1202	9/11/2025	4:21:12	00d	01:00.0	36.4	54.2	38.5	34.8	-:-	38	37.4	36.3	35.2	35	----	-----	4365.2	46.3
1203	9/11/2025	4:22:12	00d	01:00.0	36.2	54	37.7	34.8	-:-	37.5	37.3	36.3	35.2	35.1	----	-----	4168.7	46.3
1204	9/11/2025	4:23:12	00d	01:00.0	47.6	65.4	55.2	35.5	-:-	54.5	52.2	39.7	36.3	36	----	-----	57544.0	46.3
1205	9/11/2025	4:24:12	00d	01:00.0	39.2	57	48.5	35.3	-:-	45.6	42.7	37.3	36.2	35.7	----	-----	8317.6	46.3
1206	9/11/2025	4:25:12	00d	01:00.0	47.7	65.5	58.2	35.3	-:-	56.1	53.1	37.6	36.1	35.7	----	-----	58884.4	46.5
1207	9/11/2025	4:26:12	00d	01:00.0	39.5	57.3	49.1	34.1	-:-	46.9	42.9	36.2	34.9	34.4	----	-----	8912.5	46.5
1208	9/11/2025	4:27:12	00d	01:00.0	41.8	59.6	50.6	36.6	-:-	50.5	45.8	37.5	36.9	36.9	----	-----	15135.6	46.5
1209	9/11/2025	4:28:12	00d	01:00.0	36.1	53.9	37.8	34.8	-:-	37.3	37.1	36.2	35.1	34.8	----	-----	4073.8	46.6
1210	9/11/2025	4:29:12	00d	01:00.0	43.6	61.4	51.8	36.2	-:-	51.6	48.9	37.6	36.7	36.3	----	-----	22908.7	46.8
1211	9/11/2025	4:30:12	00d	01:00.0	43.2	61	50.8	36.5	-:-	50.5	48.1	38.5	37.5	37.1	----	-----	20893.0	46.8
1212	9/11/2025	4:31:12	00d	01:00.0	45.2	63	53	38.6	-:-	52.5	50.2	42.1	39.5	38.9	----	-----	33113.1	46.8
1213	9/11/2025	4:32:12	00d	01:00.0	39.2	57	43.7	36.2	-:-	42.2	41.6	38.2	36.6	36.4	----	-----	8317.6	46.8
1214	9/11/2025	4:33:12	00d	01:00.0	47.3	65.1	54.1	38.2	-:-	53.6	51.4	45.2	38.6	38.3	----	-----	53703.2	46.9
1215	9/11/2025	4:34:12	00d	01:00.0	48.5	66.3	57.5	35.4	-:-	57	54.2	42.3	36.3	35.7	----	-----	70794.6	46.9
1216	9/11/2025	4:35:12	00d	01:00.0	47.7	65.5	57.1	36.8	-:-	55.9	52.6	40.9	38.3	37.5	----	-----	58884.4	47.0
1217	9/11/2025	4:36:12	00d	01:00.0	37.1	54.9	39.9	35.5	-:-	39.3	38.5	36.9	35.7	35.7	----	-----	5128.6	46.9
1218	9/11/2025	4:37:12	00d	01:00.0	39.6	57.4	49.9	33.9	-:-	47.5	43.2	35.1	34.2	34	----	-----	9120.1	47.1

1219	9/11/2025	4:38:12	00d	01:00.0	40.4	58.2	50.3	33.5	-:-	48.6	44.8	35.5	33.9	33.9	----	-----	10964.8	47.2
1220	9/11/2025	4:39:12	00d	01:00.0	44	61.8	52.2	33.8	-:-	51.7	49.9	37.9	34.6	34.2	----	-----	25118.9	47.3
1221	9/11/2025	4:40:12	00d	01:00.0	44.2	62	52.1	36.3	-:-	51.8	49.2	39.6	37	36.6	----	-----	26302.7	47.3
1222	9/11/2025	4:41:12	00d	01:00.0	45.1	62.9	52.9	38	-:-	52.5	50.8	41.2	38.2	38	----	-----	32359.4	47.6
1223	9/11/2025	4:42:12	00d	01:00.0	37.3	55.1	46.9	35	-:-	42.6	40.1	35.9	35.3	35.2	----	-----	5370.3	47.7
1224	9/11/2025	4:43:12	00d	01:00.0	42.9	60.7	52.6	34.7	-:-	51.7	47.8	37.4	35.3	34.8	----	-----	19498.4	49.1
1225	9/11/2025	4:44:12	00d	01:00.0	40.1	57.9	51.9	35.4	-:-	46.4	43.4	37.9	35.8	35.7	----	-----	10232.9	49.2
1226	9/11/2025	4:45:12	00d	01:00.0	43.4	61.2	51.1	36.6	-:-	50.6	48.6	39.4	37.7	37.3	----	-----	21877.6	49.3
1227	9/11/2025	4:46:12	00d	01:00.0	41.5	59.3	47.6	36.3	-:-	47.5	46	38.6	36.6	36.4	----	-----	14125.4	49.3
1228	9/11/2025	4:47:12	00d	01:00.0	37.3	55.1	39.2	35.8	-:-	38.9	38.5	37.2	36.1	36	----	-----	5370.3	49.3
1229	9/11/2025	4:48:12	00d	01:00.0	48.8	66.6	56.6	38.6	-:-	56.4	54	42.3	39.2	39.1	----	-----	75857.8	49.4
1230	9/11/2025	4:49:12	00d	01:00.0	41	58.8	44.7	36	-:-	44.4	43.5	40.8	36.7	36.3	----	-----	12589.3	49.3
1231	9/11/2025	4:50:12	00d	01:00.0	51	68.8	61.3	36.6	-:-	60.2	56.3	38.5	37.3	37.1	----	-----	125892.5	49.3
1232	9/11/2025	4:51:12	00d	01:00.0	48.4	66.2	53	37.8	-:-	53	52.3	46.4	40.9	39.4	----	-----	69183.1	49.2
1233	9/11/2025	4:52:12	00d	01:00.0	38	55.8	40.2	36.9	-:-	39.6	39.2	37.7	37	36.9	----	-----	6309.6	49.2
1234	9/11/2025	4:53:12	00d	01:00.0	39.6	57.4	45.6	36.6	-:-	43.9	41.9	38.5	37.2	36.9	----	-----	9120.1	49.2
1235	9/11/2025	4:54:12	00d	01:00.0	43	60.8	49.6	37.1	-:-	49.5	47.6	39.4	37.7	37.5	----	-----	19952.6	49.2
1236	9/11/2025	4:55:12	00d	01:00.0	37.5	55.3	38.8	36	-:-	38.6	38.5	37.7	36.3	36.3	----	-----	5623.4	49.2
1237	9/11/2025	4:56:12	00d	01:00.0	39.7	57.5	41	37.4	-:-	40.8	40.6	39.8	38.5	37.9	----	-----	9332.5	49.3
1238	9/11/2025	4:57:12	00d	01:00.0	46.3	64.1	52.2	39	-:-	52.1	51.4	41.9	39.5	39.2	----	-----	42658.0	49.3
1239	9/11/2025	4:58:12	00d	01:00.0	49.6	67.4	55.8	38.5	-:-	55.4	53.1	47.9	39.3	38.8	----	-----	91201.1	49.3
1240	9/11/2025	4:59:12	00d	01:00.0	42.4	60.2	48.6	39.3	-:-	46.6	45	41.2	40	39.7	----	-----	17378.0	49.2
1241	9/11/2025	5:00:12	00d	01:00.0	45.8	63.6	53.5	39.2	-:-	52.9	50	42.9	40.1	39.8	----	-----	38018.9	49.2
1242	9/11/2025	5:01:12	00d	01:00.0	42.2	60	46	39.9	-:-	44.7	44	41.8	40.5	40.1	----	-----	16595.9	49.2
1243	9/11/2025	5:02:12	00d	01:00.0	48.2	66	54.5	37.5	-:-	54.1	53.5	45.2	38.5	37.8	----	-----	66069.3	49.2
1244	9/11/2025	5:03:12	00d	01:00.0	45.6	63.4	53.6	36.7	-:-	53.1	50.7	41	37.5	37.1	----	-----	36307.8	49.2
1245	9/11/2025	5:04:12	00d	01:00.0	46.7	64.5	54.3	37.7	-:-	53.8	50.9	42.8	38.3	38	----	-----	46773.5	49.2
1246	9/11/2025	5:05:12	00d	01:00.0	39	56.8	44	37	-:-	42.1	40.5	38.8	37.4	37.2	----	-----	7943.3	49.1
1247	9/11/2025	5:06:12	00d	01:00.0	40	57.8	45.5	36.5	-:-	44.4	42.6	38.9	37.3	36.9	----	-----	10000.0	49.1
1248	9/11/2025	5:07:12	00d	01:00.0	45.4	63.2	53.3	36.9	-:-	52.6	50.1	41.7	37.3	37	----	-----	34673.7	49.2
1249	9/11/2025	5:08:12	00d	01:00.0	38.5	56.3	39.9	36.5	-:-	39.7	39.5	38.5	37.4	36.9	----	-----	7079.5	49.1
1250	9/11/2025	5:09:12	00d	01:00.0	49.3	67.1	59.9	36.6	-:-	58.2	55.5	38.1	37.2	37	----	-----	85113.8	49.1
1251	9/11/2025	5:10:12	00d	01:00.0	55.7	73.5	67.2	36.8	-:-	65.2	61.9	41.9	38.6	37.3	----	-----	371535.2	49.1
1252	9/11/2025	5:11:12	00d	01:00.0	45.2	63	52.7	39	-:-	51.5	49.3	42.2	40.7	40.3	----	-----	33113.1	48.8
1253	9/11/2025	5:12:12	00d	01:00.0	50.5	68.3	58	37.4	-:-	57.1	55.6	45.1	38	37.6	----	-----	112201.8	48.8
1254	9/11/2025	5:13:12	00d	01:00.0	39.5	57.3	46	37.4	-:-	44.1	40.6	38.6	37.8	37.7	----	-----	8912.5	48.7
1255	9/11/2025	5:14:12	00d	01:00.0	44.8	62.6	52.7	37.3	-:-	52.6	50.2	39.3	38.1	37.9	----	-----	30199.5	48.7
1256	9/11/2025	5:15:12	00d	01:00.0	46.4	64.2	54.1	36.8	-:-	53.7	50.6	43.8	37.7	37.3	----	-----	43651.6	48.9
1257	9/11/2025	5:16:12	00d	01:00.0	51.2	69	58.8	39.5	-:-	58.5	57	45	40.5	40	----	-----	131825.7	48.9
1258	9/11/2025	5:17:12	00d	01:00.0	43.6	61.4	50.6	37.6	-:-	50.5	48.2	41	38	37.9	----	-----	22908.7	48.8
1259	9/11/2025	5:18:12	00d	01:00.0	45.7	63.5	49.9	39.4	-:-	49.6	49.3	45.1	41	39.8	----	-----	37153.5	48.8
1260	9/11/2025	5:19:12	00d	01:00.0	51.7	69.5	60.2	45.7	-:-	57.5	53.2	49.4	46.4	45.8	----	-----	147910.8	48.8
1261	9/11/2025	5:20:12	00d	01:00.0	52.7	70.5	60.3	41.6	-:-	58.3	57.6	49	42	41.8	----	-----	186208.7	48.7
1262	9/11/2025	5:21:12	00d	01:00.0	44.1	61.9	50	39.4	-:-	49.9	48.3	41.6	40	39.9	----	-----	25704.0	48.6
1263	9/11/2025	5:22:12	00d	01:00.0	40	57.8	42.2	37.3	-:-	42.1	41.8	39.6	37.9	37.6	----	-----	10000.0	48.6
1264	9/11/2025	5:23:12	00d	01:00.0	37.5	55.3	41.2	35.6	-:-	40.8	39.2	37.1	36	35.9	----	-----	5623.4	48.7
1265	9/11/2025	5:24:12	00d	01:00.0	49.1	66.9	55.3	38.1	-:-	55.1	54.5	46	39	38.3	----	-----	81283.1	48.7
1266	9/11/2025	5:25:12	00d	01:00.0	50.1	67.9	55.2	40.2	-:-	54.8	54.3	45.6	40.6	40.5	----	-----	102329.3	48.6
1267	9/11/2025	5:26:12	00d	01:00.0	47.9	65.7	54.4	40	-:-	53.6	52.8	44.9	40.3	40.2	----	-----	61659.5	48.5
1268	9/11/2025	5:27:12	00d	01:00.0	43.2	61	49.5	38.2	-:-	49.3	46.6	40.8	38.8	38.3	----	-----	20893.0	48.5
1269	9/11/2025	5:28:12	00d	01:00.0	49.8	67.6	53.9	41.6	-:-	53.9	53.3	49.4	42.2	41.8	----	-----	95499.3	48.5
1270	9/11/2025	5:29:12	00d	01:00.0	49.3	67.1	57.4	40.4	-:-	56.9	53.7	44.1	40.7	40.5	----	-----	85113.8	48.5
1271	9/11/2025	5:30:12	00d	01:00.0	48	65.8	56.2	38.7	-:-	55.3	52.4	43.6	39.5	39.1	----	-----	63095.7	48.4
1272	9/11/2025	5:31:12	00d	01:00.0	45.1	62.9	53.5	37.6	-:-	53.2	49.4	40.6	38.7	38.3	----	-----	32359.4	48.4
1273	9/11/2025	5:32:12	00d	01:00.0	39.2	57	42.6	37.1	-:-	42.1	41	38.6	37.5	37.5	----	-----	8317.6	48.4
1274	9/11/2025	5:33:12	00d	01:00.0	46.3	64.1	51.5	38.7	-:-	50.9	50.4	44.2	39	38.9	----	-----	42658.0	48.5
1275	9/11/2025	5:34:12	00d	01:00.0	48.2	66	55.7	39.5	-:-	55.2	54.4	42.5	40.1	40	----	-----	66069.3	48.5
1276	9/11/2025	5:35:12	00d	01:00.0	51.8	69.6	60.8	39.3	-:-	60	56.7	43.8	39.6	39.5	----	-----	151356.1	48.4
1277	9/11/2025	5:36:12	00d	01:00.0	41.2	59	47	38.8	-:-	45.2	44.2	40	39.2	39	----	-----	13182.6	48.3
1278	9/11/2025	5:37:12	00d	01:00.0	50.4	68.2	58.5	39.1	-:-	58	56.6	42.3	39.4	39.3	----	-----	109647.8	48.4
1279	9/11/2025	5:38:12	00d	01:00.0	49.1	66.9	57.6	39.4	-:-	57.4	54.7	41.8	39.9	39.7	----	-----	81283.1	48.3
1280	9/11/2025	5:39:12	00d	01:00.0	49.2	67	56.8	40.3	-:-	55.5	53.2	45.8	40.8	40.5	----	-----	83176.4	48.2
1281	9/11/2025	5:40:12	00d	01:00.0	43	60.8	53.8	40.3	-:-	47.4	46	41.8	40.7	40.6	----	-----	19952.6	48.5
1282	9/11/2025	5:41:12	00d	01:00.0	54.4	72.2	62	41.2	-:-	61.2	60.3	47.1	41.8	41.4	----	-----	275422.9	48.5
1283	9/11/2025	5:42:12	00d	01:00.0	51.9	69.7	57.8	42.1	-:-	57.4	55.6	51	42.6	42.5	----	-----	154881.7	48.3
1284	9/11/2025	5:43:12	00d	01:00.0	61.4	79.2	78	40.6	-:-	60.6	55.7	46.7	41.8	41.3	----	-----	1380384.3	48.2
1285	9/11/2025	5:44:12	00d	01:00.0	50.3	68.1	59.6	39.3	-:-	58.1	55.7	44.7	40	39.7	----	-----	107151.9	46.4
1286	9/11/2025	5:45:12	00d	01:00.0	48	65.8	56.2	39	-:-	54.2	52.9	42.9	39.9	39.3	----	-----	63095.7	46.3
1287	9/11/2025	5:46:12	00d	01:00.0	49.7	67.5	57.3	40.4	-:-	56.4	53.5	47	42.4	42.1	----	-----	93325.4	46.2
1288	9/11/2025	5:47:12	00d	01:00.0	46.6	64.4	52.6	38.7	-:-	52.4	49.5	45.4	39.8	39.2	----	-----	45708.8	46.1
1289	9/11/2025	5:48:12	00d	01:00.0	46.4	64.2	51	39.7	-:-	50.2	49.3	45.8	40.9	40.1	----	-----	43651.6	46.1
1290	9/11/2025	5:49:12	00d	01:00.0	42.1	59.9	48.6	34.7	-:-	48.3	48	37.5	35	34.8	----	-----	16218.1	46.1
1291	9/11/2025	5:50:12	00d	01:00.0	39.5	57.3	47.8	34.9	-:-	46.3	42.3	37.5	36.2	35.9	----	-----	8912.5	46.1
1292	9/11/2025	5:51:12	00d	01:00.0	39.1	56.9	47.8	35.2	-:-	46.4	41.8	36.6	35.7	35.5	----	-----	8128.3	46.2
1293	9/11/2025	5:52:12	00d	01:00.0	42.2	60	50.3	35.6	-:-	49.9	47.7	37.4	36.2	35.9	----	-----	16595.9	46.4
1294	9/11/2025	5:53:12	00d	01:00.0	40.7	58.5	50.8	36.5	-:-	46.8	43.1	37.8	36.9	36.7	----	-----	11749.0	46.5
1295	9/11/2025	5:54:12	00d	01:00.0	48.2	66	55.9	36.1	-:-	55.9	55	38.7	36.7	36.5	----	-----	66069.3	46.5
1296	9/11/2025	5:55:12	00d	01:00.0	45.5	63.3	52.1	35.7	-:-	51.6	50.5	42.7	36.7	36	----	-----	35481.3	46.6
1297	9/11/2025	5:56:12	00d	01:00.0	45.9	63.7	52.1	37.9	-:-	50.2	49.6	43.1	38.4	38	----	-----	38904.5	46.6
1298	9/11/2025	5:57:12	00d	01:00.0	46.2	64	52	38.1	-:-	51	50.5	43.2	38.8	38.6	----	-----	41686.9	46.7
1299	9/11/2025	5:58:12	00d	01:00.0	43.3	61.1	51.5	35.1	-:-	50.7	47.8	40.5	36.6	35.8	----	-----	21379.6	46.7
1300	9/11/2025	5:59:12	00d	01:00.0	42.4	60.2	57.3	37.8	-:-	40.8	40.5	39	38.3	38	----	-----	17378.0	46.7
1301	9/11/2025	6:00:12	00d	01:00.0	42	59.8	48	37.1	-:-	47.4	45.6	39.5	37.9	37.5	----	-----	15848.9	47.0
1302	9/11/2025	6:01:12	00d	01:00.0	45.1	62.9	52.3	36.9	-:-	51.1	49.3	41.6	37.6	37.4	----	-----	32359.4	47.2
1303	9/11/2025	6:02:12	00d	01:00.0	37.5	55.3	39.5	34.8	-:-	39.3	38.9	37.5	35.9	35.5	----	-----	5623.4	47.2
1304	9/11/2025	6:03:12	00d	01:00.0	38	55.8	41.9	34.9	-:-	41.1	40.6	37.3	35.4	35.3	----	-----	6309.6	47.2
1305	9/11/2025	6:04:12	00d	01:00.0	48.2	66	53.9	39.7	-:-	53.1	51.5	46.5	41.3	41	----	-----	66069.3	47.3
1306	9/11/2025	6:05:12	00d	01:00.0	41.1	58.9	47.8	35.3	-:-	47.7	45.4	38.6	35.7	35.4	----	-----	12882.5	47.3
1307	9/11/2025	6:06:12	00d	01:00.0	39.3	57.1	44.7	36.1	-:-	44.5	43.5	37.4	36.3	36.2	----	-----	8511.4	47.3
1308	9/11/2025	6:07:12	00d	01:00.0	41.1	58.9	48.6	35.3	-:-	48.2	45.8	37.7	35.5	35.4	----	-----	12882.5	47.4
1309	9/11/2025	6:08:12	00d	01:00.0	41.3	59.1	48.8	35.9	-:-	48.7	46	37.6	36.4	36.2	----	-----	13489.6	47.4
1310	9/11/2025	6:09:12	00d	01:00.0	36.7	54.5	38.5	34.6	-:-	38	37.8	36.6	35.7	35	----	-----	4677.4	47.5
1311	9/11/2025	6:10:12	00d	01:00.0	47.2	65	54.6	37.1	-:-	54.2	51.3	44.2	38.8	37.5	----	-----	52480.7	47.6
1312	9/11/2025	6:11:12	00d	01:00.0	43.4	61.2	50.8	35.4	-:-	50.5	48.5	37.6	36.5	36.1	----	-----	21877.6	47.6
1313	9/11/2025	6:12:12	00d	01:00.0	36.4	54.2	39	35	-:-	37.7	37.6	36.4	35.5	35.1	----	-----	4365.2	47.6
1314	9/11/2025	6:13:12	00d	01:00.0	47.8	65.6	55.2	38.8	-:-	55	52.5	45.4	39.6	39.1	----	-----	60256.0	47.7
1315	9/11/2025	6:14:12	00d	01:00.0	45	62.8	50.7	39.1	-:-	50.5	49.4	42.7	40.2	39.4	----	-----	31622.8	47.6
1316	9/11/2025	6:15:12	00d	01:00.0	53.7	71.5	62.7	37.6	-:-	62.1	59.4	46.6	39.6	38.3	----	-----	234422.9	47.7
1317	9/11/2025	6:16:12	00d	01:00.0	46.5	64.3	60.4	36.5	-:-	53.8	50.9	39.2	37	36.8	----	-----	44668.4	47.5
1318	9/11/2025	6:17:12	00d	01:00.0	40.4	58.2	46.2	36.1	-:-	45.9	44.2	38.1	36.4	36.3	----	-----	10964.8	47.6
1319	9/11/2025	6:18:12	00d	01:00.0	45.2	63	51.7	37.7	-:-	51.2	49.2	42.9	39.3	38.6	----	-----	33113.1	47.6
1320	9/11/2025	6:19:12	00d	01:00.0	41.8	59.6	46.7	38.4	-:-	46.2	45.1	40.4	38.7	38.5	----	-----	15135.6	47.7
1321	9/11/2025	6:20:12	00d	01:00.0	45.4	63.2	49.3	39.2	-:-	49.1	48.8	44.2	39.9	39.5	----	-----	34673.7	47.8
1322	9/11/2025	6:21:12	00d	01:00.0	49.2	67	57.3	38.9	-:-	56.2	54.2	44	40	39.7	----	-----	83176.4	47.8
1323	9/11/2025	6:22:12	00d	01:00.0	44.6	62.4	48.6	40.9	-:-	48.4	47.3	43.8	41.8	41.4	----	-----	28840.3	47.8
1324	9/11/2025	6:23:12	00d	01:00.0	48.5	66.3	53.8	41.5	-:-	53.5	52.7	46.7	42.3	41.7	----	-----	70794.6	47.9
1325	9/11/2025	6:24:12	00d	01:00.0	41.7	59.5	45.9	38.6	-:-	43.7	43.5	41.7	39.6	38.9	----	-----	14791.1	47.9
1326	9/11/2025	6:25:12	00d	01:00.0	42.1	59.9	49.1	38	-:-	48.1	45.7	39.4	38.5	38.3	----	-----	16218.1	48.1
1327	9/11/2025	6:26:12	00d	01:00.0	46	63.8	51	38.9	-:-	51.1	50.4	44.6	39.8	39.2	----	-----	39810.7	48.1
1328	9/11/2025	6:27:12	00d	01:00.0	47.2	65	54.2	37.6	-:-	53.5	52.9	42.8	38.1	37.8	----	-----	52480.7	48.3
1329	9/11/2025	6:28:12	00d	01:00.0	43.7	61.5	52.6	38.9	-:-	48.4	47.9	41.1	39.5	39.1	----	-----	23442.3	48.6

1330	9/11/2025	6:29:12	00d	01:00.0	44.6	62.4	51.5	38.1	-:-	50.6	48.7	42	38.8	38.3	----	-----	28840.3	48.7
1331	9/11/2025	6:30:12	00d	01:00.0	45	62.8	51.4	39.2	-:-	50.8	49.6	42	40	39.6	----	-----	31622.8	48.8
1332	9/11/2025	6:31:12	00d	01:00.0	45.3	63.1	51.2	39.2	-:-	50.9	50	42.9	39.4	39.3	----	-----	33884.4	48.9
1333	9/11/2025	6:32:12	00d	01:00.0	48.7	66.5	54	40.4	-:-	54	53.1	45.4	41.5	41.1	----	-----	74131.0	49.0
1334	9/11/2025	6:33:12	00d	01:00.0	47.4	65.2	54.1	38.2	-:-	53.8	53.4	43.2	39.1	38.4	----	-----	54954.1	49.0
1335	9/11/2025	6:34:12	00d	01:00.0	44	61.8	50	38.1	-:-	49.9	48.1	41.7	38.5	38.4	----	-----	25118.9	49.0
1336	9/11/2025	6:35:12	00d	01:00.0	43.2	61	52.7	37.6	-:-	50.5	46	38.4	37.8	37.7	----	-----	20893.0	49.0
1337	9/11/2025	6:36:12	00d	01:00.0	49.4	67.2	56.3	41.9	-:-	55.2	52.6	47.5	43.4	42.5	----	-----	87096.4	49.0
1338	9/11/2025	6:37:12	00d	01:00.0	45.3	63.1	53	40.6	-:-	51.9	48.3	42.7	41	40.9	----	-----	33884.4	49.0
1339	9/11/2025	6:38:12	00d	01:00.0	47.6	65.4	52.9	42.1	-:-	52.7	50.1	46.4	43.1	42.7	----	-----	57544.0	49.1
1340	9/11/2025	6:39:12	00d	01:00.0	44.4	62.2	51.7	41.4	-:-	48	47.1	43.3	41.8	41.5	----	-----	27542.3	49.1
1341	9/11/2025	6:40:12	00d	01:00.0	55	72.8	65.8	42.3	-:-	63.8	60.6	47.4	43.4	42.8	----	-----	316227.8	49.3
1342	9/11/2025	6:41:12	00d	01:00.0	47.3	65.1	53.7	41.1	-:-	52.8	51.4	44.1	41.7	41.3	----	-----	53703.2	49.1
1343	9/11/2025	6:42:12	00d	01:00.0	45.3	63.1	48.3	42.5	-:-	48.3	48.1	44.1	42.9	42.8	----	-----	33884.4	49.1
1344	9/11/2025	6:43:12	00d	01:00.0	46.6	64.4	52.3	40.7	-:-	52	49.8	45.5	42	41.4	----	-----	45708.8	49.1
1345	9/11/2025	6:44:12	00d	01:00.0	45.9	63.7	51.2	40.7	-:-	50.5	49.7	44.1	41.8	41.5	----	-----	38904.5	49.1
1346	9/11/2025	6:45:12	00d	01:00.0	46	63.8	52	40.3	-:-	50.5	49.7	44.1	40.8	40.7	----	-----	39810.7	49.1
1347	9/11/2025	6:46:12	00d	01:00.0	45	62.8	52.4	39.2	-:-	52	49.4	41.7	39.7	39.6	----	-----	31622.8	49.2
1348	9/11/2025	6:47:12	00d	01:00.0	44.6	62.4	50.2	41	-:-	49.4	48.4	42.8	41.3	41.2	----	-----	28840.3	49.3
1349	9/11/2025	6:48:12	00d	01:00.0	47.4	65.2	52.9	41.8	-:-	52.3	51.1	45.4	42.3	42.1	----	-----	54954.1	49.3
1350	9/11/2025	6:49:12	00d	01:00.0	44.7	62.5	51.4	40.1	-:-	48.5	48.1	42.6	40.3	40.2	----	-----	29512.1	49.4
1351	9/11/2025	6:50:12	00d	01:00.0	46.4	64.2	52.1	40.7	-:-	51.9	50.1	45.3	41.9	41.1	----	-----	43651.6	49.5
1352	9/11/2025	6:51:12	00d	01:00.0	47.5	65.3	53.4	40.2	-:-	52.7	51.1	45.7	42.2	40.7	----	-----	56234.1	49.5
1353	9/11/2025	6:52:12	00d	01:00.0	51	68.8	56.6	38.6	-:-	56.5	55.8	49.5	39	38.9	----	-----	125892.5	49.5
1354	9/11/2025	6:53:12	00d	01:00.0	46	63.8	51.5	38.8	-:-	51.2	50.2	44.6	39.1	39.1	----	-----	39810.7	49.5
1355	9/11/2025	6:54:12	00d	01:00.0	47.7	65.5	52.7	39.3	-:-	52.5	52.3	41.6	39.9	39.7	----	-----	58884.4	49.5
1356	9/11/2025	6:55:12	00d	01:00.0	49	66.8	52.6	43.6	-:-	52.7	52	48.3	44.7	44.4	----	-----	79432.8	49.6
1357	9/11/2025	6:56:12	00d	01:00.0	48.4	66.2	54.2	40.5	-:-	53.6	52.4	46.4	41.8	41	----	-----	69183.1	49.7
1358	9/11/2025	6:57:12	00d	01:00.0	49.1	66.9	55.4	41.4	-:-	55.2	54.4	45.5	42.3	41.9	----	-----	81283.1	49.7
1359	9/11/2025	6:58:12	00d	01:00.0	47.3	65.1	52.4	40.8	-:-	52	51.1	45.7	41.6	41.1	----	-----	53703.2	49.6
1360	9/11/2025	6:59:12	00d	01:00.0	47.2	65	52.5	41.9	-:-	52.2	51.1	44.9	42.4	42	----	-----	52480.7	49.7
1361	9/11/2025	7:00:12	00d	01:00.0	53.4	71.2	57.1	47.5	-:-	57	56.9	52.8	48.2	48	----	-----	218776.2	49.7
1362	9/11/2025	7:01:12	00d	01:00.0	50.3	68.1	52.7	47.5	-:-	52.6	52.4	49.7	48.7	48.3	----	-----	107151.9	49.6
1363	9/11/2025	7:02:12	00d	01:00.0	47.8	65.6	52.6	38.4	-:-	52.3	51.9	46.1	40	39.1	----	-----	60256.0	49.6
1364	9/11/2025	7:03:12	00d	01:00.0	45.8	63.6	51.9	38.8	-:-	50.8	49.7	43.9	40.1	39.6	----	-----	38018.9	49.6
1365	9/11/2025	7:04:12	00d	01:00.0	47.3	65.1	54.3	39.3	-:-	53.4	51.7	45.4	40.4	39.9	----	-----	53703.2	49.6
1366	9/11/2025	7:05:12	00d	01:00.0	46.4	64.2	52.7	39.5	-:-	52.5	51.8	43.5	40.1	39.8	----	-----	43651.6	49.6
1367	9/11/2025	7:06:12	00d	01:00.0	47.3	65.1	52.6	40.6	-:-	51.8	50.9	46	41.7	41.4	----	-----	53703.2	49.6
1368	9/11/2025	7:07:12	00d	01:00.0	46.8	64.6	52.1	38.4	-:-	52	51.6	43.8	38.6	38.6	----	-----	47863.0	49.6
1369	9/11/2025	7:08:12	00d	01:00.0	47.9	65.7	53.6	39.2	-:-	52.9	51.6	46	39.6	39.4	----	-----	61659.5	49.6
1370	9/11/2025	7:09:12	00d	01:00.0	46.3	64.1	51	38.9	-:-	50.5	50.2	45	40.4	39.2	----	-----	42658.0	49.6
1371	9/11/2025	7:10:12	00d	01:00.0	50.3	68.1	59.3	39.6	-:-	57	55.9	44.5	40.1	39.8	----	-----	107151.9	49.6
1372	9/11/2025	7:11:12	00d	01:00.0	45.5	63.3	50.4	42.2	-:-	49.9	47.9	43.7	42.6	42.5	----	-----	35481.3	49.6
1373	9/11/2025	7:12:12	00d	01:00.0	47.9	65.7	51.8	42.3	-:-	51.5	50.8	47.3	43.3	42.7	----	-----	61659.5	49.6
1374	9/11/2025	7:13:12	00d	01:00.0	45.1	62.9	49.8	39.2	-:-	49.5	48.2	43.5	41.1	39.8	----	-----	32359.4	49.6
1375	9/11/2025	7:14:12	00d	01:00.0	44.3	62.1	48.5	40.7	-:-	47.8	47.7	43.2	41.2	41	----	-----	26915.3	49.6
1376	9/11/2025	7:15:12	00d	01:00.0	47.2	65	51.4	41.3	-:-	51	50.5	46.5	42.5	42.2	----	-----	52480.7	49.6
1377	9/11/2025	7:16:12	00d	01:00.0	49.1	66.9	54.4	43.9	-:-	53.6	52.3	48.2	44.7	44.2	----	-----	81283.1	49.6
1378	9/11/2025	7:17:12	00d	01:00.0	51.8	69.6	55.9	47.7	-:-	55.1	54.3	51.1	48.4	48.2	----	-----	151356.1	49.6
1379	9/11/2025	7:18:12	00d	01:00.0	47.1	64.9	53.9	39.8	-:-	53.3	51.6	42.3	40.1	39.9	----	-----	51286.1	49.5
1380	9/11/2025	7:19:12	00d	01:00.0	50.3	68.1	59	40.7	-:-	57.2	55.2	46.4	41.6	41.2	----	-----	107151.9	49.8
1381	9/11/2025	7:20:12	00d	01:00.0	46.7	64.5	51.3	40.1	-:-	51.2	50.5	44	40.5	40.3	----	-----	46773.5	52.1
1382	9/11/2025	7:21:12	00d	01:00.0	48.5	66.3	53	42	-:-	52.6	51.5	47.9	42.5	42.2	----	-----	70794.6	52.2
1383	9/11/2025	7:22:12	00d	01:00.0	46.2	64	51.6	40.2	-:-	51.1	50.3	44.2	40.8	40.5	----	-----	41686.9	52.2
1384	9/11/2025	7:23:12	00d	01:00.0	51.5	69.3	62.5	38.9	-:-	61.1	55.8	40.6	39.2	39	----	-----	141253.8	52.3
1385	9/11/2025	7:24:12	00d	01:00.0	47.4	65.2	53.4	41.1	-:-	53.2	52.4	44.9	43.1	42.9	----	-----	54954.1	52.3
1386	9/11/2025	7:25:12	00d	01:00.0	52.4	70.2	61.1	43.8	-:-	59.6	56	50.5	44.7	43.8	----	-----	173780.1	52.3
1387	9/11/2025	7:26:12	00d	01:00.0	48.9	66.7	61.6	41.8	-:-	52.5	51.5	46	42.5	42.2	----	-----	77624.7	52.3
1388	9/11/2025	7:27:12	00d	01:00.0	53.7	71.5	64.2	42.8	-:-	63.8	57.3	47.4	44.6	44.5	----	-----	234422.9	52.4
1389	9/11/2025	7:28:12	00d	01:00.0	55.4	73.2	62.5	49.1	-:-	60.6	59	54.2	50	49.6	----	-----	346736.9	52.4
1390	9/11/2025	7:29:12	00d	01:00.0	48.6	66.4	56.4	42.8	-:-	54.8	52.4	46.6	44	43.6	----	-----	72443.6	52.3
1391	9/11/2025	7:30:12	00d	01:00.0	51.4	69.2	56.5	45.1	-:-	55.9	53.4	51	45.7	45.4	----	-----	138038.4	52.3
1392	9/11/2025	7:31:12	00d	01:00.0	50.4	68.2	54.4	43.1	-:-	54.3	53.7	49.7	44.1	43.5	----	-----	109647.8	52.3
1393	9/11/2025	7:32:12	00d	01:00.0	51.9	69.7	57.8	44.7	-:-	57.2	55.5	50.5	45.6	45.1	----	-----	154881.7	52.4
1394	9/11/2025	7:33:12	00d	01:00.0	48.3	66.1	53	42.8	-:-	52.8	51.9	46.7	43.4	43	----	-----	67608.3	52.4
1395	9/11/2025	7:34:12	00d	01:00.0	47.7	65.5	53.1	41.1	-:-	52.7	52	45.5	41.5	41.4	----	-----	58884.4	52.4
1396	9/11/2025	7:35:12	00d	01:00.0	49.2	67	55.4	40.2	-:-	55	53	48.3	41.2	40.6	----	-----	83176.4	52.5
1397	9/11/2025	7:36:12	00d	01:00.0	47.3	65.1	52.8	41.5	-:-	52.1	50.5	46	43.4	42.1	----	-----	53703.2	52.5
1398	9/11/2025	7:37:12	00d	01:00.0	49.3	67.1	55.2	43.9	-:-	54.8	52.7	47.8	44.8	44.4	----	-----	85113.8	52.6
1399	9/11/2025	7:38:12	00d	01:00.0	48	65.8	53.2	41.4	-:-	52.8	52.4	45.5	42.1	41.9	----	-----	63095.7	52.7
1400	9/11/2025	7:39:12	00d	01:00.0	51.2	69	60.5	41.9	-:-	57.3	54.1	48.4	43.5	42.9	----	-----	131825.7	52.7
1401	9/11/2025	7:40:12	00d	01:00.0	53.8	71.6	63.6	45.1	-:-	62.7	58.2	48.4	45.9	45.7	----	-----	239883.3	52.8
1402	9/11/2025	7:41:12	00d	01:00.0	48.4	66.2	57	38.6	-:-	54.4	52.8	43.7	39.7	38.9	----	-----	69183.1	52.7
1403	9/11/2025	7:42:12	00d	01:00.0	44.8	62.6	48.2	40.9	-:-	48.2	47.4	44.4	41.4	41.2	----	-----	30199.5	52.8
1404	9/11/2025	7:43:12	00d	01:00.0	46.2	64	51.9	39	-:-	51.5	50.2	41.9	39.5	39.1	----	-----	41686.9	52.9
1405	9/11/2025	7:44:12	00d	01:00.0	47.8	65.6	50.5	41.4	-:-	50.3	50	48.2	43.9	41.9	----	-----	60256.0	53.0
1406	9/11/2025	7:45:12	00d	01:00.0	47.9	65.7	52.9	41.1	-:-	52.1	50.5	47.3	42.1	41.7	----	-----	61659.5	53.1
1407	9/11/2025	7:46:12	00d	01:00.0	48.7	66.5	52	40.9	-:-	51.9	51.7	48.2	41.6	41.3	----	-----	74131.0	53.2
1408	9/11/2025	7:47:12	00d	01:00.0	53.1	70.9	62.5	45.4	-:-	59.7	57.8	48.9	46.1	45.5	----	-----	204173.8	53.2
1409	9/11/2025	7:48:12	00d	01:00.0	48.6	66.4	53.9	40.9	-:-	53.3	52.8	47.5	41.9	41.6	----	-----	72443.6	53.2
1410	9/11/2025	7:49:12	00d	01:00.0	50.4	68.2	54.6	44.9	-:-	52.9	52	50.5	46.1	45.2	----	-----	109647.8	53.3
1411	9/11/2025	7:50:12	00d	01:00.0	51.4	69.2	57	42.5	-:-	56.2	54.4	50.4	43.5	43	----	-----	138038.4	53.4
1412	9/11/2025	7:51:12	00d	01:00.0	50	67.8	52.1	47.4	-:-	51.9	51.6	49.8	48.5	47.4	----	-----	100000.0	53.5
1413	9/11/2025	7:52:12	00d	01:00.0	47.7	65.5	51.6	41.7	-:-	51.4	50.2	47.6	43.1	42	----	-----	58884.4	53.5
1414	9/11/2025	7:53:12	00d	01:00.0	47.6	65.4	54.6	40.4	-:-	53.1	51.8	45.4	40.8	40.5	----	-----	57544.0	53.7
1415	9/11/2025	7:54:12	00d	01:00.0	50.9	68.7	57.8	39.1	-:-	56.8	56.3	50.2	39.5	39.4	----	-----	123026.9	53.8
1416	9/11/2025	7:55:12	00d	01:00.0	49.9	67.7	59.7	39.3	-:-	58.3	56.3	42	39.7	39.5	----	-----	97723.7	53.8
1417	9/11/2025	7:56:12	00d	01:00.0	53.6	71.4	65.1	43	-:-	59	55.4	49.6	43.9	42.9	----	-----	229086.8	54.0
1418	9/11/2025	7:57:12	00d	01:00.0	46.7	64.5	52.7	39.7	-:-	51.5	50.4	44.8	40.3	40	----	-----	46773.5	54.0
1419	9/11/2025	7:58:12	00d	01:00.0	46.7	64.5	50.4	40.8	-:-	50	49.7	45.7	41.4	41.2	----	-----	46773.5	54.1
1420	9/11/2025	7:59:12	00d	01:00.0	52.5	70.3	61.8	38.6	-:-	60.8	57.7	44.3	39.2	38.8	----	-----	177827.9	54.3
1421	9/11/2025	8:00:12	00d	01:00.0	48.5	66.3	53.2	37.9	-:-	52.4	52.1	47.6	38.4	38.1	----	-----	70794.6	54.3
1422	9/11/2025	8:01:12	00d	01:00.0	48	65.8	54.4	38.1	-:-	54.1	52.1	45.1	38.8	38.3	----	-----	63095.7	54.5
1423	9/11/2025	8:02:12	00d	01:00.0	47.2	65	50.2	38.4	-:-	50.2	49.9	46.3	42.4	40.5	----	-----	52480.7	54.7
1424	9/11/2025	8:03:12	00d	01:00.0	46.1	63.9	51.1	39.5	-:-	50.2	49.4	44.7	39.9	39.7	----	-----	40738.0	54.9
1425	9/11/2025	8:04:12	00d	01:00.0	47.8	65.6	52.4	37.6	-:-	51.6	51	46.9	38.9	38.1	----	-----	60256.0	55.1
1426	9/11/2025	8:05:12	00d	01:00.0	50.8	68.6	59	40.1	-:-	58.3	55.3	47.5	41.1	40.4	----	-----	120226.4	55.3
1427	9/11/2025	8:06:12	00d	01:00.0	43.2	61	51	35.7	-:-	50.5	48.1	38.3	36	35.9	----	-----	20893.0	55.5
1428	9/11/2025	8:07:12	00d	01:00.0	46.5	64.3	50.8	37.1	-:-	50.4	50	46.4	38.1	37.4	----	-----	44668.4	55.8
1429	9/11/2025	8:08:12	00d	01:00.0	46.3	64.1	52.9	39.1	-:-	52.8	51.2	43.6	40.2	39.9	----	-----	42658.0	56.1
1430	9/11/2025	8:09:12	00d	01:00.0	47.8	65.6	52.5	43.3	-:-	52.1	50	47.2	44.1	43.7	----	-----	60256.0	56.4
1431	9/11/2025	8:10:12	00d	01:00.0	44.6	62.4	50.7	37.3	-:-	50.3	48	43.5	37.8	37.5	----	-----	28840.3	56.7
1432	9/11/2025	8:11:12	00d	01:00.0	49.6	67.4	58.7	36	-:-	56.8	53.8	46.5	37.1	36.5	----	-----	91201.1	57.1
1433	9/11/2025	8:12:12	00d	01:00.0	46.7	64.5	52.8	39	-:-	49.8	49.6	46.6	40.5	39.8	----	-----	46773.5	57.5
1434	9/11/2025	8:13:12	00d	01:00.0	42	59.8	48	36.7	-:-	47.9	46.4	38.7	37.4	37	----	-----	15848.9	57.9
1435	9/11/2025	8:14:12	00d	01:00.0	45.1	62.9	50.4	38.3	-:-	50.2	49.1	42.7	39	38.8	----	-----	32359.4	58.5
1436	9/11/2025	8:15:12	00d	01:00.0	44.5	62.3	52.7	37.3	-:-	50.3	48.8	42	38.3	37.9	----	-----	28183.8	59.1
1437	9/11/2025	8:16:12	00d	01:00.0	51.3	69.1	60.5	37.8	-:-	59.8	56.4	46.5	38.5	38.1	----	-----	134896.3	59.9
1438	9/11/2025	8:17:12	00d	01:00.0	45.6	63.4	49	40.6	-:-	48.8	48.1	44.7	42	41	----	-----	36307.8	60.8
1439	9/11/2025	8:18:12	00d	01:00.0	45.7	63.5	50.1	39.2	-:-	50	49	45.1	39.5	39.2	----	-----	37153.5	62.0
1440	9/11/2025	8:19:12	00d	01:00.0	56.2	74	64.7	39.1	-:-	62.7	59.5	54.5	46.6	46.3	----	-----	416869.4	63.7

1441	9/11/2025	8:20:12	00d	00:21.9	66.3	79.7	72.8	52.4	-.-	72	71.4	58.4	52.5	52.5	----	-----	4265795.2	**66.3**

Address	Start Time	Measurement Time			Leq	LE	LMAX	LMIN	Ly	LN1	LN2	LN3	LN4	LN5	Over	Under	Inverse Log	Overall Leq	Rolling 24 Hour	Rolling Hour Avg
M-02																				
1	9/10/2025	8:32:21	00d	01:00.0	65.4	83.2	72.6	44.7	-:-	70.9	70.3	60.2	45.7	45.4	----	-----	3467368.5	65.3	65.8	65.4
2	9/10/2025	8:33:21	00d	01:00.0	65.2	83	74.1	47.2	-:-	73	69.5	59.7	52.9	50	----	-----	3311311.2		65.8	Hourly
3	9/10/2025	8:34:21	00d	01:00.0	69.7	87.5	81.8	47.7	-:-	77.6	70.7	57.5	49.3	47.7	----	-----	9332543.0		66.0	
4	9/10/2025	8:35:21	00d	01:00.0	59.9	77.7	75.1	42.3	-:-	68.5	62.5	49.9	42.5	42.4	----	-----	977237.2		66.0	
5	9/10/2025	8:36:21	00d	01:00.0	50.6	68.4	63.5	41.8	-:-	57.3	51.8	45.4	42.5	42.2	----	-----	114815.4		66.1	
6	9/10/2025	8:37:21	00d	01:00.0	66.6	84.4	73.9	48.5	-:-	73.8	71.8	60.9	48.9	48	----	-----	4570881.9		66.1	
7	9/10/2025	8:38:21	00d	01:00.0	67.3	85.1	77	47.3	-:-	73.2	72.6	60.3	48.4	47.7	----	-----	5370318.0		66.1	
8	9/10/2025	8:39:21	00d	01:00.0	64.6	82.4	73.5	44.6	-:-	72.4	71.3	51.5	45.9	45.2	----	-----	2884031.5		66.2	
9	9/10/2025	8:40:21	00d	01:00.0	65.6	83.4	72.9	44.7	-:-	72.9	70.8	58.1	45.5	45.1	----	-----	3630780.5		66.1	
10	9/10/2025	8:41:21	00d	01:00.0	66.2	84	77.4	47.4	-:-	73.2	72	56.3	48	47.6	----	-----	4168693.8		66.1	
11	9/10/2025	8:42:21	00d	01:00.0	44	61.8	52.7	41.4	-:-	47.7	45.8	43.4	42.6	41.9	----	-----	25118.9		66.1	
12	9/10/2025	8:43:21	00d	01:00.0	66.5	84.3	75.8	45.4	-:-	73.2	71.4	58	46.2	45.7	----	-----	4466835.9		66.2	
13	9/10/2025	8:44:21	00d	01:00.0	65.2	83	74.1	42.9	-:-	73.4	70.9	52.4	43.6	43.2	----	-----	3311311.2		66.1	
14	9/10/2025	8:45:21	00d	01:00.0	72.2	90	85.4	42.5	-:-	79.4	75.5	47.7	42.7	42.7	----	-----	16595869.1		66.1	
15	9/10/2025	8:46:21	00d	01:00.0	65.5	83.3	73	45.5	-:-	73.1	72.2	54.5	46.5	46.2	----	-----	3548133.9		65.8	
16	9/10/2025	8:47:21	00d	01:00.0	67.9	85.7	81.9	44.4	-:-	72.4	71	57.4	45.2	44.9	----	-----	6165950.0		65.8	
17	9/10/2025	8:48:21	00d	01:00.0	70.6	88.4	83.8	47.8	-:-	76.6	74	61.3	50.1	49.2	----	-----	11481536.2		65.8	
18	9/10/2025	8:49:21	00d	01:00.0	62.9	80.7	73	42.2	-:-	72	69.6	45.4	43.3	42.7	----	-----	1949844.6		65.6	
19	9/10/2025	8:50:21	00d	01:00.0	67.6	85.4	76.2	44.7	-:-	75.6	72.9	62.3	48.8	44.8	----	-----	5754399.4		65.7	
20	9/10/2025	8:51:21	00d	01:00.0	66	83.8	74.6	42.6	-:-	74.6	72	53.4	43	42.8	----	-----	3981071.7		65.7	
21	9/10/2025	8:52:21	00d	01:00.0	61.6	79.4	73.4	42.2	-:-	70.8	65.4	45.9	42.7	42.4	----	-----	1445439.8		65.7	
22	9/10/2025	8:53:21	00d	01:00.0	62.8	80.6	69.4	43.7	-:-	69.3	69.1	56.7	44.9	44	----	-----	1905460.7		65.7	
23	9/10/2025	8:54:21	00d	01:00.0	66.2	84	74.8	44.9	-:-	73	71.8	59.7	45.6	45.2	----	-----	4168693.8		65.7	
24	9/10/2025	8:55:21	00d	01:00.0	56.1	73.9	68.1	41.2	-:-	66	58.4	44.1	42.1	41.7	----	-----	407380.3		65.8	
25	9/10/2025	8:56:21	00d	01:00.0	42.6	60.4	44.7	40.9	-:-	44.5	43.9	42.3	41.7	41.5	----	-----	18197.0		65.9	
26	9/10/2025	8:57:21	00d	01:00.0	60.6	78.4	72	42.2	-:-	69	67	44.6	42.7	42.3	----	-----	1148153.6		65.9	
27	9/10/2025	8:58:21	00d	01:00.0	65.7	83.5	73.9	48.2	-:-	71.9	71.2	57.9	48.5	47.7	----	-----	3715352.3		66.0	
28	9/10/2025	8:59:21	00d	01:00.0	71.5	89.3	85.3	42.3	-:-	78.8	72.2	48.5	42.8	42.6	----	-----	14125375.4		66.0	
29	9/10/2025	9:00:21	00d	01:00.0	64.6	82.4	72.8	41.9	-:-	72.6	71.7	55.1	42.3	42.1	----	-----	2884031.5		65.8	
30	9/10/2025	9:01:21	00d	01:00.0	53.7	71.5	66.1	40.7	-:-	62.2	55	42.5	41.3	41.2	----	-----	234422.9		65.8	
31	9/10/2025	9:02:21	00d	01:00.0	66.9	84.7	74.1	41.5	-:-	73.7	71.3	62.2	42.9	42.3	----	-----	4897788.2		65.9	
32	9/10/2025	9:03:21	00d	01:00.0	63.6	81.4	76.4	41.2	-:-	71	64.8	47.7	41.6	41.6	----	-----	2290867.7		66.0	
33	9/10/2025	9:04:21	00d	01:00.0	60.9	78.7	70.6	40.9	-:-	69.8	68.5	45.5	41.3	41.1	----	-----	1230268.8		66.0	
34	9/10/2025	9:05:21	00d	01:00.0	64.7	82.5	72.6	42.6	-:-	72.7	70.9	52.1	44.8	43.5	----	-----	2951209.2		66.0	
35	9/10/2025	9:06:21	00d	01:00.0	68	85.8	80.9	40.4	-:-	77.9	69.1	45.4	40.9	40.7	----	-----	6309573.4		66.1	
36	9/10/2025	9:07:21	00d	01:00.0	60.9	78.7	73.1	40.3	-:-	68.8	65.6	46	40.9	40.6	----	-----	1230268.8		66.1	
37	9/10/2025	9:08:21	00d	01:00.0	61.8	79.6	70.6	40.1	-:-	70.2	68.6	50.7	41	40.5	----	-----	1513561.2		66.5	
38	9/10/2025	9:09:21	00d	01:00.0	66.5	84.3	75.4	40.4	-:-	74.4	72.3	57.4	44.4	41.4	----	-----	4466835.9		66.5	
39	9/10/2025	9:10:21	00d	01:00.0	66.9	84.7	74.6	41.1	-:-	74.6	72.1	59.1	42.6	41.3	----	-----	4897788.2		66.4	
40	9/10/2025	9:11:21	00d	01:00.0	59.6	77.4	71.6	40.4	-:-	68.9	63.4	46.2	41.1	40.6	----	-----	912010.8		66.3	
41	9/10/2025	9:12:21	00d	01:00.0	61.5	79.3	74.2	39.7	-:-	72.1	55.7	43.6	40.8	40.1	----	-----	1412537.5		66.4	
42	9/10/2025	9:13:21	00d	01:00.0	66	83.8	77.8	40.4	-:-	74.6	70.5	45.3	40.7	40.5	----	-----	3981071.7		66.4	
43	9/10/2025	9:14:21	00d	01:00.0	68.2	86	77.5	43.1	-:-	73.7	72.4	62.5	45.1	43.6	----	-----	6606934.5		66.4	
44	9/10/2025	9:15:21	00d	01:00.0	60.8	78.6	71.6	42.6	-:-	70.1	65.7	48.8	43.1	42.9	----	-----	1202264.4		66.3	
45	9/10/2025	9:16:21	00d	01:00.0	66.7	84.5	77.3	40.2	-:-	74.7	73.1	53	43.2	41.7	----	-----	4677351.4		66.3	
46	9/10/2025	9:17:21	00d	01:00.0	63.3	81.1	72.4	43.1	-:-	72	68.9	50.1	43.9	43.3	----	-----	2137962.1		66.3	
47	9/10/2025	9:18:21	00d	01:00.0	63.8	81.6	75.6	44.8	-:-	72.7	68	51	45.2	44.8	----	-----	2398832.9		66.4	
48	9/10/2025	9:19:21	00d	01:00.0	68.7	86.5	77.2	46.1	-:-	77	73.1	61.6	49.4	48.3	----	-----	7413102.4		66.4	
49	9/10/2025	9:20:21	00d	01:00.0	59.4	77.2	71.4	41.7	-:-	68.5	62	45.6	42.5	42.1	----	-----	870963.6		66.3	
50	9/10/2025	9:21:21	00d	01:00.0	64.8	82.6	71.9	46	-:-	72	70.2	59.3	48.9	45.8	----	-----	3019951.7		66.3	
51	9/10/2025	9:22:21	00d	01:00.0	70.3	88.1	82.1	42.5	-:-	78.8	74.9	53.9	42.9	42.6	----	-----	10715193.1		66.3	
52	9/10/2025	9:23:21	00d	01:00.0	63.8	81.6	72	43.4	-:-	72.3	70.4	53.5	44.1	43.5	----	-----	2398832.9		66.1	
53	9/10/2025	9:24:21	00d	01:00.0	65.7	83.5	74.6	42.3	-:-	74.2	71.8	50.6	42.7	42.5	----	-----	3715352.3		66.1	
54	9/10/2025	9:25:21	00d	01:00.0	66.8	84.6	76.6	42.7	-:-	75.3	73.5	45.3	43.2	43.1	----	-----	4786300.9		66.1	
55	9/10/2025	9:26:21	00d	01:00.0	66.4	84.2	75.6	44.4	-:-	74.4	73.3	52.3	46	45.1	----	-----	4365158.3		66.1	
56	9/10/2025	9:27:21	00d	01:00.0	61.8	79.6	73	42.5	-:-	71.1	68	50.9	43.6	42.9	----	-----	1513561.2		66.0	
57	9/10/2025	9:28:21	00d	01:00.0	62.5	80.3	71.6	42.7	-:-	70.9	69.8	48.7	44.2	43.3	----	-----	1778279.4		66.1	
58	9/10/2025	9:29:21	00d	01:00.0	63.5	81.3	71.5	42.8	-:-	71.5	70.4	48.3	43.5	43.2	----	-----	2238721.1		66.1	
59	9/10/2025	9:30:21	00d	01:00.0	62.4	80.2	72.5	45.5	-:-	70.4	69.3	53.1	46.9	46.1	----	-----	1737800.8		66.1	
60	9/10/2025	9:31:21	00d	01:00.0	63.6	81.4	73.1	44.2	-:-	71.4	69.7	51.7	44.9	44.1	----	-----	2290867.7		66.3	
61	9/10/2025	9:32:21	00d	01:00.0	69.1	86.9	79.5	46.4	-:-	78	73.4	59.2	47.7	47.1	----	-----	8128305.2		66.3	
62	9/10/2025	9:33:21	00d	01:00.0	65.1	82.9	73.1	44	-:-	72.5	70.8	57.5	44.4	44.3	----	-----	3235936.6		66.2	
63	9/10/2025	9:34:21	00d	01:00.0	71.7	89.5	84.8	43.3	-:-	78.3	73.1	56.7	43.8	43.4	----	-----	14791083.9		66.2	
64	9/10/2025	9:35:21	00d	01:00.0	70	87.8	82.9	44.6	-:-	77.4	71.8	54.2	45.7	44.9	----	-----	10000000.0		66.2	
65	9/10/2025	9:36:21	00d	01:00.0	64.8	82.6	75.1	43.1	-:-	72.8	71.1	48.7	44.5	43.9	----	-----	3019951.7		66.1	
66	9/10/2025	9:37:21	00d	01:00.0	63.4	81.2	74.7	43.7	-:-	72.4	71	49.8	44.7	44.3	----	-----	2187761.6		66.1	
67	9/10/2025	9:38:21	00d	01:00.0	63.4	81.2	73.5	44	-:-	73.7	68.3	52	44.4	44.2	----	-----	2187761.6		66.1	
68	9/10/2025	9:39:21	00d	01:00.0	70.7	88.5	84.2	43.8	-:-	78.2	73.3	51.9	44.2	44.1	----	-----	11748975.5		66.1	
69	9/10/2025	9:40:21	00d	01:00.0	57	74.8	68.8	43.1	-:-	65.1	60.9	48.8	43.2	43.1	----	-----	501187.2		66.0	
70	9/10/2025	9:41:21	00d	01:00.0	61.9	79.7	71.3	43.3	-:-	70.4	68.5	51	44.4	44	----	-----	1548816.6		66.0	
71	9/10/2025	9:42:21	00d	01:00.0	61.8	79.6	72.3	45.3	-:-	70.3	67	48.6	45.7	45.5	----	-----	1513561.2		66.0	
72	9/10/2025	9:43:21	00d	01:00.0	67.9	85.7	75.1	46.4	-:-	74.3	72.5	63.1	48	47.3	----	-----	6165950.0		66.0	
73	9/10/2025	9:44:21	00d	01:00.0	61	78.8	73.1	43.7	-:-	69.7	66.7	46.1	44.1	43.8	----	-----	1258925.4		66.0	
74	9/10/2025	9:45:21	00d	01:00.0	62.1	79.9	73.4	44.8	-:-	72.7	65.6	47.5	45.8	45.3	----	-----	1621810.1		66.0	
75	9/10/2025	9:46:21	00d	01:00.0	63.2	81	72.9	45.5	-:-	72.4	69.9	50.2	46	45.9	----	-----	2089296.1		66.0	
76	9/10/2025	9:47:21	00d	01:00.0	66.9	84.7	77.8	47	-:-	73.8	72	56	47.2	46.9	----	-----	4897788.2		66.1	
77	9/10/2025	9:48:21	00d	01:00.0	63.9	81.7	74.4	43.9	-:-	73.2	71.1	48.5	44.1	44	----	-----	2454708.9		66.1	
78	9/10/2025	9:49:21	00d	01:00.0	64.7	82.5	73	44.9	-:-	70.9	70.2	55.5	46.4	45.7	----	-----	2951209.2		66.1	
79	9/10/2025	9:50:21	00d	01:00.0	68.9	86.7	77.8	44.6	-:-	75.9	74.8	59.9	48.2	45.5	----	-----	7762471.2		66.1	
80	9/10/2025	9:51:21	00d	01:00.0	65.8	83.6	74.1	47.2	-:-	73.4	71.5	55.2	48.3	47.9	----	-----	3801894.0		66.1	
81	9/10/2025	9:52:21	00d	01:00.0	66.9	84.7	76.1	46.6	-:-	74.3	72.2	56.2	47.2	46.9	----	-----	4897788.2		66.1	
82	9/10/2025	9:53:21	00d	01:00.0	62.9	80.7	73.6	45.1	-:-	71.8	68.9	49.9	45.5	45.2	----	-----	1949844.6		66.0	
83	9/10/2025	9:54:21	00d	01:00.0	64	81.8	75.9	44.7	-:-	71.2	69	46.8	44.9	44.8	----	-----	2511886.4		66.0	
84	9/10/2025	9:55:21	00d	01:00.0	68.8	86.6	82.5	43.8	-:-	77.1	70	54.6	44.3	44	----	-----	7585775.8		66.0	
85	9/10/2025	9:56:21	00d	01:00.0	69.1	86.9	80.1	44.8	-:-	78.2	71.6	59.5	46.3	45	----	-----	8128305.2		65.9	
86	9/10/2025	9:57:21	00d	01:00.0	59.5	77.3	70.2	44	-:-	67.7	63.7	48.2	44.3	44.2	----	-----	891250.9		65.8	
87	9/10/2025	9:58:21	00d	01:00.0	64.9	82.7	73	44.9	-:-	72.1	70.8	56.2	45.9	45.3	----	-----	3090295.4		65.8	
88	9/10/2025	9:59:21	00d	01:00.0	68.5	86.3	79.7	44.5	-:-	76.7	72.7	52.9	45.7	45.2	----	-----	7079457.8		65.8	
89	9/10/2025	10:00:21	00d	01:00.0	62.5	80.3	71.8	44	-:-	72	68.5	48.7	44.8	44.4	----	-----	1778279.4		65.7	
90	9/10/2025	10:01:21	00d	01:00.0	66.3	84.1	77.6	45.4	-:-	74.5	72.2	53.2	46	45.5	----	-----	4265795.2		65.7	
91	9/10/2025	10:02:21	00d	01:00.0	67.4	85.2	78.2	48.4	-:-	74	73.1	56.4	50.9	49.5	----	-----	5495408.7		65.7	
92	9/10/2025	10:03:21	00d	01:00.0	69.1	86.9	81.1	46.4	-:-	74.6	72.6	63	48.2	47.3	----	-----	8128305.2		65.7	
93	9/10/2025	10:04:21	00d	01:00.0	65.9	83.7	78.5	45.5	-:-	73.3	70.4	50.5	46.2	45.9	----	-----	3890451.4		65.5	
94	9/10/2025	10:05:21	00d	01:00.0	63.1	80.9	74	44.3	-:-	72	69.8	47	45.1	44.4	----	-----	2041737.9		65.5	
95	9/10/2025	10:06:21	00d	01:00.0	67.8	85.6	78.8	44.7	-:-	78.4	71.3	47.1	45.1	45	----	-----	6025595.9		65.5	
96	9/10/2025	10:07:21	00d	01:00.0	66.9	84.7	80.3	44.5	-:-	72.9	71.2	47	44.7	44.6	----	-----	4897788.2		65.5	
97	9/10/2025	10:08:21	00d	01:00.0	73.9	91.7	87.2	48.8	-:-	79.3	75.7	57.7	49.5	49.1	----	-----	24547089.2		65.4	
98	9/10/2025	10:09:21	00d	01:00.0	59.5	77.3	70.9	44.4	-:-	68.6	65.3	46.2	44.6	44.6	----	-----	891250.9		65.0	
99	9/10/2025	10:10:21	00d	01:00.0	60.1	77.9	71.8	43.6	-:-	68	64.1	47.5	44.3	44	----	-----	1023293.0		65.0	
100	9/10/2025	10:11:21	00d	01:00.0	62.2	80	71	43.4	-:-	71.1	69.4	45.3	43.8	43.7	----	-----	1659586.9		65.0	
101	9/10/2025	10:12:21	00d	01:00.0	62.4	80.2	72.5	44.5	-:-	71.4	68.7	48.1	45.6	45.2	----	-----	1737800.8		65.0	
102	9/10/2025	10:13:21	00d	01:00.0	66.9	84.7	74.5	45.5	-:-	74.7	72.7	55.5	47.8	46.2	----	-----	4897788.2		65.0	
103	9/10/2025	10:14:21	00d	01:00.0	64.2	82	75.1	43.5	-:-	72.9	69.9	48.5	43.8	43.7	----	-----	2630268.0		64.9	
104	9/10/2025	10:15:21	00d	01:00.0	63.3	81.1	73.2	44.7	-:-	71.6	68.8	52.4	45.2	45	----	-----	2137962.1		64.9	
105	9/10/2025	10:16:21	00d	01:00.0	62.3	80.1	74.1	43.1	-:-	71.1	67.2	49.1	43.4	43.3	----	-----	1698243.7		64.9	
106	9/10/2025	10:17:21	00d	01:00.0	64.2	82	72.2	43.5	-:-	71.5	70.3	50.4	44.2	44	----	-----	2630268.0		65.0	

107	9/10/2025	10:18:21	00d	01:00.0	69.2	87	83.1	44.4	-:-	76.7	68.8	47.7	44.8	44.6	----	-----	8317637.7	65.0
108	9/10/2025	10:19:21	00d	01:00.0	59.7	77.5	69.6	44.2	-:-	68.8	67	47.4	44.6	44.4	----	-----	933254.3	64.8
109	9/10/2025	10:20:21	00d	01:00.0	60.2	78	73.5	45.3	-:-	69.6	60.5	46.7	46	45.8	----	-----	1047128.5	64.9
110	9/10/2025	10:21:21	00d	01:00.0	63.4	81.2	72.6	44.5	-:-	71.8	70	47.3	44.6	44.6	----	-----	2187761.6	64.9
111	9/10/2025	10:22:21	00d	01:00.0	60	77.8	71.6	44.4	-:-	68.1	64.5	45.7	44.7	44.7	----	-----	1000000.0	64.9
112	9/10/2025	10:23:21	00d	01:00.0	66	83.8	73.4	45.6	-:-	73.4	71.7	56.7	46.6	46.1	----	-----	3981071.7	65.0
113	9/10/2025	10:24:21	00d	01:00.0	64.1	81.9	74.4	43.3	-:-	73.2	70.4	47.6	44	43.5	----	-----	2570395.8	64.9
114	9/10/2025	10:25:21	00d	01:00.0	65.7	83.5	74.3	44.9	-:-	74	71.9	56.7	46.3	45.6	----	-----	3715352.3	65.0
115	9/10/2025	10:26:21	00d	01:00.0	62.9	80.7	74.1	43.4	-:-	73	68.1	47.3	44	43.8	----	-----	1949844.6	64.9
116	9/10/2025	10:27:21	00d	01:00.0	62.2	80	71.2	43.5	-:-	70.4	67.6	53.4	43.8	43.7	----	-----	1659586.9	64.9
117	9/10/2025	10:28:21	00d	01:00.0	67.1	84.9	81	43.7	-:-	73.5	70.5	48	44.1	44	----	-----	5128613.8	64.9
118	9/10/2025	10:29:21	00d	01:00.0	63.8	81.6	72.7	44.8	-:-	71.5	70.6	51.1	45.1	45	----	-----	2398832.9	64.9
119	9/10/2025	10:30:21	00d	01:00.0	65.2	83	73	45.8	-:-	73	70.5	58.2	46.5	46.3	----	-----	3311311.2	65.0
120	9/10/2025	10:31:21	00d	01:00.0	70.8	88.6	85	44.3	-:-	78	66.7	46.6	44.7	44.4	----	-----	12022644.3	65.0
121	9/10/2025	10:32:21	00d	01:00.0	62.7	80.5	79.6	45.5	-:-	69.9	67.9	52.3	46.6	45.7	----	-----	1862087.1	64.8
122	9/10/2025	10:33:21	00d	01:00.0	64.2	82	73.2	44.9	-:-	72.1	70.6	46.8	45.3	45.2	----	-----	2630268.0	64.8
123	9/10/2025	10:34:21	00d	01:00.0	60.6	78.4	71.6	45.8	-:-	69.3	67	47.5	46.1	46.1	----	-----	1148153.6	64.8
124	9/10/2025	10:35:21	00d	01:00.0	72.8	90.6	84.5	46.6	-:-	81.3	75.4	57.4	47.1	47	----	-----	19054607.2	65.0
125	9/10/2025	10:36:21	00d	01:00.0	56.8	74.6	69.8	45.3	-:-	66.7	57	46.6	45.8	45.7	----	-----	478630.1	64.6
126	9/10/2025	10:37:21	00d	01:00.0	61.8	79.6	72.4	45.8	-:-	71.5	67.1	47.3	46.1	46	----	-----	1513561.2	64.6
127	9/10/2025	10:38:21	00d	01:00.0	67.8	85.6	76.6	48.3	-:-	74.5	72.8	61.5	51.4	51	----	-----	6025595.9	64.6
128	9/10/2025	10:39:21	00d	01:00.0	63	80.8	73.8	45.7	-:-	70.7	68.5	50.1	46.3	46.1	----	-----	1995262.3	64.6
129	9/10/2025	10:40:21	00d	01:00.0	64.3	82.1	74.3	45.8	-:-	73.2	69.9	50.7	46.1	45.8	----	-----	2691534.8	64.6
130	9/10/2025	10:41:21	00d	01:00.0	60.8	78.6	70.7	44.6	-:-	70.7	67.4	46.5	45.4	45.3	----	-----	1202264.4	64.6
131	9/10/2025	10:42:21	00d	01:00.0	63	80.8	74.5	44	-:-	71.8	67.3	45.1	44.2	44.1	----	-----	1995262.3	64.6
132	9/10/2025	10:43:21	00d	01:00.0	64.6	82.4	73.8	47.8	-:-	72.6	70.4	54.2	49.1	47.9	----	-----	2884031.5	64.6
133	9/10/2025	10:44:21	00d	01:00.0	65.8	83.6	74.7	45.2	-:-	72.2	71.5	55.4	45.8	45.4	----	-----	3801894.0	64.6
134	9/10/2025	10:45:21	00d	01:00.0	65.2	83	72.3	44.9	-:-	71.9	71.4	60	46.1	45.2	----	-----	3311311.2	64.7
135	9/10/2025	10:46:21	00d	01:00.0	57.4	75.2	70.6	44.2	-:-	64.6	57.5	45.4	44.7	44.4	----	-----	549540.9	64.8
136	9/10/2025	10:47:21	00d	01:00.0	70.1	87.9	81.8	47.3	-:-	76.5	71.8	61.7	50.3	48.1	----	-----	10232929.9	64.9
137	9/10/2025	10:48:21	00d	01:00.0	57.7	75.5	70.8	44	-:-	64	54.9	45.8	44.7	44.4	----	-----	588843.7	64.8
138	9/10/2025	10:49:21	00d	01:00.0	67.7	85.5	78.1	44.6	-:-	74.8	72.5	57.7	47.1	45.4	----	-----	5888436.6	64.8
139	9/10/2025	10:50:21	00d	01:00.0	66.9	84.7	77.1	46.2	-:-	74.5	71.8	57.6	48.1	46.6	----	-----	4897788.2	64.9
140	9/10/2025	10:51:21	00d	01:00.0	64.8	82.6	72.7	47.6	-:-	72.1	71.1	56	49.5	48.9	----	-----	3019951.7	65.1
141	9/10/2025	10:52:21	00d	01:00.0	65.1	82.9	74.8	43.8	-:-	72.7	70.4	48.2	45.3	44.2	----	-----	3235936.6	65.1
142	9/10/2025	10:53:21	00d	01:00.0	62.6	80.4	70.7	43.7	-:-	70.2	68.3	51.9	45.3	44.9	----	-----	1819700.9	65.1
143	9/10/2025	10:54:21	00d	01:00.0	63.9	81.7	71.7	45.5	-:-	70.9	69.4	51.6	46.9	46	----	-----	2454708.9	65.1
144	9/10/2025	10:55:21	00d	01:00.0	65.3	83.1	74.8	46.1	-:-	72.5	71.8	55.1	46.5	46.3	----	-----	3388441.6	65.1
145	9/10/2025	10:56:21	00d	01:00.0	59.1	76.9	69	45.8	-:-	67.4	64.6	49.5	46.1	45.9	----	-----	812830.5	65.1
146	9/10/2025	10:57:21	00d	01:00.0	56.1	73.9	69.4	44	-:-	64.8	52.2	45.4	44.3	44.2	----	-----	407380.3	65.2
147	9/10/2025	10:58:21	00d	01:00.0	63.3	81.1	73.4	46.2	-:-	70.3	68.5	54.2	47.1	46.8	----	-----	2137962.1	65.2
148	9/10/2025	10:59:21	00d	01:00.0	64.3	82.1	76.6	45.3	-:-	73.3	69	49.1	46.3	45.8	----	-----	2691534.8	65.3
149	9/10/2025	11:00:21	00d	01:00.0	64	81.8	73	47.8	-:-	72.1	70.1	54.3	49.3	48.4	----	-----	2511886.4	65.3
150	9/10/2025	11:01:21	00d	01:00.0	65.5	83.3	73.1	47.8	-:-	72.6	70.6	55.9	48.5	48.3	----	-----	3548133.9	65.3
151	9/10/2025	11:02:21	00d	01:00.0	62.4	80.2	73.8	45.9	-:-	71.4	68.3	49.3	46.5	46.3	----	-----	1737800.8	65.3
152	9/10/2025	11:03:21	00d	01:00.0	66.6	84.4	77.4	47.8	-:-	75.3	70.8	56.5	48.2	48.1	----	-----	4570881.9	65.3
153	9/10/2025	11:04:21	00d	01:00.0	64.3	82.1	72.6	46.3	-:-	71.7	71	54	47.2	46.5	----	-----	2691534.8	65.3
154	9/10/2025	11:05:21	00d	01:00.0	63.1	80.9	72.3	45.6	-:-	71.3	69.9	49.2	46.3	46.1	----	-----	2041737.9	65.3
155	9/10/2025	11:06:21	00d	01:00.0	56.4	74.2	68.6	45	-:-	66.4	58.6	46.3	45.5	45.4	----	-----	436515.8	65.2
156	9/10/2025	11:07:21	00d	01:00.0	67	84.8	77.1	46.2	-:-	74.6	72.5	54.5	47.2	46.5	----	-----	5011872.3	65.3
157	9/10/2025	11:08:21	00d	01:00.0	63.2	81	70.5	45.1	-:-	70.3	69.7	54.3	46.3	45.3	----	-----	2089296.1	65.5
158	9/10/2025	11:09:21	00d	01:00.0	67.9	85.7	79.1	45.9	-:-	73.3	71.9	56.6	46.2	46	----	-----	6165950.0	65.5
159	9/10/2025	11:10:21	00d	01:00.0	60.7	78.5	73.1	44.7	-:-	70.8	64.4	46.2	45	44.8	----	-----	1174897.6	65.4
160	9/10/2025	11:11:21	00d	01:00.0	56.9	74.7	70	45.2	-:-	66	55.8	45.9	45.4	45.3	----	-----	489778.8	65.5
161	9/10/2025	11:12:21	00d	01:00.0	61.8	79.6	71.9	46.2	-:-	70.1	69	48.9	46.6	46.5	----	-----	1513561.2	65.6
162	9/10/2025	11:13:21	00d	01:00.0	63.1	80.9	74.2	45.5	-:-	72.4	69.2	46.7	45.8	45.7	----	-----	2041737.9	65.6
163	9/10/2025	11:14:21	00d	01:00.0	48.5	66.3	58.7	45.8	-:-	51.5	48.4	46.6	46	45.9	----	-----	70794.6	67.5
164	9/10/2025	11:15:21	00d	01:00.0	63.5	81.3	74.4	46.8	-:-	71.8	69	49.9	47	47	----	-----	2238721.1	67.5
165	9/10/2025	11:16:21	00d	01:00.0	64.7	82.5	73.6	47.8	-:-	72.7	70.4	57	48.1	48	----	-----	2951209.2	67.5
166	9/10/2025	11:17:21	00d	01:00.0	67.6	85.4	76.4	48	-:-	74.6	73.1	58.3	48.9	48.3	----	-----	5754399.4	67.6
167	9/10/2025	11:18:21	00d	01:00.0	65.3	83.1	73.4	46.6	-:-	72.8	71.3	50.6	47.1	47	----	-----	3388441.6	67.5
168	9/10/2025	11:19:21	00d	01:00.0	56.2	74	68	45.9	-:-	66.5	57.3	47.5	46.3	46.1	----	-----	416869.4	67.5
169	9/10/2025	11:20:21	00d	01:00.0	62.6	80.4	70.4	46.8	-:-	69.3	68.9	52.7	47.3	47.2	----	-----	1819700.9	67.6
170	9/10/2025	11:21:21	00d	01:00.0	66.7	84.5	75.2	46.9	-:-	75.5	72	60.4	47.2	47	----	-----	4677351.4	67.6
171	9/10/2025	11:22:21	00d	01:00.0	62	79.8	71.5	46.6	-:-	71.3	69.5	49.4	47.1	46.9	----	-----	1584893.2	67.6
172	9/10/2025	11:23:21	00d	01:00.0	65.4	83.2	74.6	47.4	-:-	72.9	71.5	52.4	47.7	47.5	----	-----	3467368.5	67.9
173	9/10/2025	11:24:21	00d	01:00.0	63.6	81.4	73.2	46.4	-:-	72.5	68.7	54.1	47.7	47.1	----	-----	2290867.7	67.9
174	9/10/2025	11:25:21	00d	01:00.0	65.2	83	76	46.1	-:-	71.4	70.6	53.5	46.5	46.4	----	-----	3311311.2	67.9
175	9/10/2025	11:26:21	00d	01:00.0	65.3	83.1	74	47.1	-:-	73.2	70.8	54.2	47.3	47.1	----	-----	3388441.6	67.9
176	9/10/2025	11:27:21	00d	01:00.0	62.8	80.6	73.7	45.4	-:-	71.5	68.9	48.8	45.8	45.6	----	-----	1905460.7	67.9
177	9/10/2025	11:28:21	00d	01:00.0	61.8	79.6	74.2	45.3	-:-	69.9	65	48.1	45.6	45.5	----	-----	1513561.2	67.9
178	9/10/2025	11:29:21	00d	01:00.0	66.1	83.9	75	45.4	-:-	72.5	70.8	53.4	45.6	45.5	----	-----	4073802.8	67.9
179	9/10/2025	11:30:21	00d	01:00.0	68	85.8	75.4	46.6	-:-	74.6	72.8	61.7	49.7	47.2	----	-----	6309573.4	67.9
180	9/10/2025	11:31:21	00d	01:00.0	65.5	83.3	74.6	45	-:-	74	72.3	53.6	45.7	45.2	----	-----	3548133.9	67.8
181	9/10/2025	11:32:21	00d	01:00.0	60.7	78.5	71.1	44.2	-:-	70.2	66.3	47.3	44.8	44.5	----	-----	1174897.6	67.9
182	9/10/2025	11:33:21	00d	01:00.0	65.3	83.1	73.5	46	-:-	71.8	70.5	58.7	47.6	46.8	----	-----	3388441.6	67.9
183	9/10/2025	11:34:21	00d	01:00.0	60.9	78.7	71.1	45.4	-:-	69.8	66.6	48.3	46.1	45.8	----	-----	1230268.8	68.0
184	9/10/2025	11:35:21	00d	01:00.0	70.8	88.6	83.1	45.4	-:-	79.4	72.5	56.3	46	45.7	----	-----	12022644.3	68.0
185	9/10/2025	11:36:21	00d	01:00.0	61.4	79.2	71.7	45.8	-:-	69.8	66.7	50.7	46.9	46.3	----	-----	1380384.3	67.9
186	9/10/2025	11:37:21	00d	01:00.0	63.6	81.4	70.5	46.5	-:-	71	68.9	55.1	46.8	46.6	----	-----	2290867.7	67.9
187	9/10/2025	11:38:21	00d	01:00.0	60.8	78.6	70.2	45	-:-	69.9	66.5	47	45.3	45	----	-----	1202264.4	67.9
188	9/10/2025	11:39:21	00d	01:00.0	64	81.8	75.6	45.4	-:-	73	68.9	48.2	45.8	45.7	----	-----	2511886.4	68.0
189	9/10/2025	11:40:21	00d	01:00.0	63.6	81.4	74.3	46.4	-:-	73.3	69.4	48.7	46.9	46.6	----	-----	2290867.7	68.0
190	9/10/2025	11:41:21	00d	01:00.0	64.6	82.4	75.9	46.4	-:-	72.4	69.6	52.1	47	46.8	----	-----	2884031.5	67.9
191	9/10/2025	11:42:21	00d	01:00.0	62.1	79.9	71.3	46.8	-:-	70.4	68.5	48.8	47.2	47	----	-----	1621810.1	67.9
192	9/10/2025	11:43:21	00d	01:00.0	64.5	82.3	72.4	46.7	-:-	72.1	71.2	57.1	47.2	46.8	----	-----	2818382.9	67.9
193	9/10/2025	11:44:21	00d	01:00.0	64.9	82.7	73.8	45.4	-:-	73.7	71	50.9	46.7	46.3	----	-----	3090295.4	67.9
194	9/10/2025	11:45:21	00d	01:00.0	69.1	86.9	82.5	46.2	-:-	76.9	71.5	55	47.3	46.9	----	-----	8128305.2	67.9
195	9/10/2025	11:46:21	00d	01:00.0	68.6	86.4	76.4	52.1	-:-	75.6	73.4	65.2	53.6	51.4	----	-----	7244359.6	68.1
196	9/10/2025	11:47:21	00d	01:00.0	67.8	85.6	77.6	47.2	-:-	74.9	73.5	55.2	48.1	47.8	----	-----	6025595.9	68.1
197	9/10/2025	11:48:21	00d	01:00.0	65.9	83.7	75.1	45.7	-:-	74.5	72	50.7	46.5	46.3	----	-----	3890451.4	68.0
198	9/10/2025	11:49:21	00d	01:00.0	64	81.8	72.2	46.1	-:-	72.1	70.2	52.1	46.4	46.2	----	-----	2511886.4	68.0
199	9/10/2025	11:50:21	00d	01:00.0	70.4	88.2	83.9	46.5	-:-	77.8	72	49.8	47.5	47.3	----	-----	10964782.0	68.0
200	9/10/2025	11:51:21	00d	01:00.0	71.5	89.3	84.7	47.9	-:-	77.5	73.7	60.5	50.9	49.7	----	-----	14125375.4	67.9
201	9/10/2025	11:52:21	00d	01:00.0	64.3	82.1	74.1	47.1	-:-	72.9	71.4	51.8	47.6	47.3	----	-----	2691534.8	67.8
202	9/10/2025	11:53:21	00d	01:00.0	65	82.8	75	45.4	-:-	73.2	72.2	46.9	45.8	45.6	----	-----	3162277.7	67.8
203	9/10/2025	11:54:21	00d	01:00.0	62.4	80.2	72.5	45.9	-:-	70.8	68.8	48.4	46.2	46.2	----	-----	1737800.8	67.8
204	9/10/2025	11:55:21	00d	01:00.0	64.5	82.3	72.4	46.9	-:-	72.3	69.6	59	47.4	47	----	-----	2818382.9	67.8
205	9/10/2025	11:56:21	00d	01:00.0	64.3	82.1	74.3	47.1	-:-	72.5	69.8	53.5	47.5	47.4	----	-----	2691534.8	67.8
206	9/10/2025	11:57:21	00d	01:00.0	64.6	82.4	76.4	47.1	-:-	73.8	68.7	48.3	47.6	47.3	----	-----	2884031.5	67.8
207	9/10/2025	11:58:21	00d	01:00.0	62.5	80.3	75	46.3	-:-	69.7	66.5	49.1	47	46.5	----	-----	1778279.4	67.8
208	9/10/2025	11:59:21	00d	01:00.0	67.1	84.9	79.5	46.4	-:-	77.6	68.5	54	49.1	47.4	----	-----	5128613.8	67.9
209	9/10/2025	12:00:21	00d	01:00.0	63.6	81.4	73	46.2	-:-	72.4	69	50.7	47.6	47.1	----	-----	2290867.7	67.9
210	9/10/2025	12:01:21	00d	01:00.0	65.7	83.5	77.4	46.9	-:-	73.2	71	55.4	47.9	47.7	----	-----	3715352.3	67.9
211	9/10/2025	12:02:21	00d	01:00.0	66.9	84.7	74.2	48.9	-:-	72	71.4	62.4	51.1	49.5	----	-----	4897788.2	67.9
212	9/10/2025	12:03:21	00d	01:00.0	63.2	81	75.4	46.6	-:-	71.1	67.8	49.1	47.1	46.8	----	-----	2089296.1	67.8
213	9/10/2025	12:04:21	00d	01:00.0	63.4	81.2	71.8	46.9	-:-	71	70.2	51.7	48.2	47.8	----	-----	2187761.6	67.8
214	9/10/2025	12:05:21	00d	01:00.0	64.6	82.4	72.1	46.1	-:-	70.9	70.6	55.1	47.1	46.3	----	-----	2884031.5	67.8
215	9/10/2025	12:06:21	00d	01:00.0	58.5	76.3	71.3	44.9	-:-	69.8	53.9	46.3	45.3	45.1	----	-----	707945.8	67.8

216	9/10/2025	12:07:21	00d	01:00.0	65.2	83	77.3	45.7	-:-	75.2	67.3	47.3	46	45.8	----	-----	3311311.2	67.9
217	9/10/2025	12:08:21	00d	01:00.0	72	89.8	82.1	46.3	-:-	80.6	76.5	64.9	49.5	48	----	-----	15848931.9	67.9
218	9/10/2025	12:09:21	00d	01:00.0	64.3	82.1	72.4	47	-:-	72.7	69.4	55.9	47.2	47	----	-----	2691534.8	67.7
219	9/10/2025	12:10:21	00d	01:00.0	58.5	76.3	71.2	45.6	-:-	66.2	59.3	46.4	46	45.8	----	-----	707945.8	68.2
220	9/10/2025	12:11:21	00d	01:00.0	66.7	84.5	75.9	45.7	-:-	73.7	72.2	57.9	46.2	45.8	----	-----	4677351.4	68.2
221	9/10/2025	12:12:21	00d	01:00.0	65.2	83	72.5	47.7	-:-	72.4	70.5	57.6	48.1	47.8	----	-----	3311311.2	68.2
222	9/10/2025	12:13:21	00d	01:00.0	65.1	82.9	75.4	46.4	-:-	73	71.5	52.1	47.3	46.8	----	-----	3235936.6	68.2
223	9/10/2025	12:14:21	00d	01:00.0	80.9	98.7	96.4	45.6	-:-	87.4	77.1	58.7	47.3	46.4	----	-----	123026877.1	68.2
224	9/10/2025	12:15:21	00d	01:00.0	62.2	80	71.5	46.8	-:-	71.1	67.9	51	47.4	47	----	-----	1659586.9	66.6
225	9/10/2025	12:16:21	00d	01:00.0	66.8	84.6	75.3	46.6	-:-	74.5	72.4	58.5	47.1	46.9	----	-----	4786300.9	66.7
226	9/10/2025	12:17:21	00d	01:00.0	67.4	85.2	78.4	47.7	-:-	75	70.5	57.5	47.9	47.8	----	-----	5495408.7	66.7
227	9/10/2025	12:18:21	00d	01:00.0	64.9	82.7	74	46.8	-:-	73.4	70	53.1	47.5	47.2	----	-----	3090295.4	66.6
228	9/10/2025	12:19:21	00d	01:00.0	66.2	84	76.2	47.8	-:-	75.4	71.5	53.1	48.3	48.1	----	-----	4168693.8	66.6
229	9/10/2025	12:20:21	00d	01:00.0	65.2	83	74.5	47.6	-:-	73.1	71.1	55.1	48.4	48.2	----	-----	3311311.2	66.7
230	9/10/2025	12:21:21	00d	01:00.0	67.6	85.4	79.9	47	-:-	73.1	70.7	56.9	48.1	47.8	----	-----	5754399.4	66.7
231	9/10/2025	12:22:21	00d	01:00.0	64.9	82.7	74	47.1	-:-	72.4	71.4	52.9	48	47.7	----	-----	3090295.4	66.7
232	9/10/2025	12:23:21	00d	01:00.0	74.1	91.9	87.9	49.3	-:-	80.6	73.5	64.9	51.6	51.1	----	-----	25703957.8	66.7
233	9/10/2025	12:24:21	00d	01:00.0	61.2	79	71.4	46.2	-:-	69.9	66.8	49.2	46.5	46.4	----	-----	1318256.7	66.3
234	9/10/2025	12:25:21	00d	01:00.0	67.2	85	77.6	48.3	-:-	75.1	71.7	56.2	49.5	48.8	----	-----	5248074.6	66.3
235	9/10/2025	12:26:21	00d	01:00.0	64.3	82.1	72.2	45.5	-:-	72.1	70.6	55.8	46.5	46.1	----	-----	2691534.8	66.2
236	9/10/2025	12:27:21	00d	01:00.0	57.6	75.4	70.5	46.6	-:-	67.8	58.2	48.4	47	46.8	----	-----	575439.9	66.3
237	9/10/2025	12:28:21	00d	01:00.0	61.4	79.2	69.9	46.7	-:-	69.7	67.1	51.4	47.4	47.1	----	-----	1380384.3	66.4
238	9/10/2025	12:29:21	00d	01:00.0	56.7	74.5	70	45.7	-:-	63.1	54.9	48.5	46.4	46.1	----	-----	467735.1	66.6
239	9/10/2025	12:30:21	00d	01:00.0	67.8	85.6	79.9	45.5	-:-	74.2	72.2	48.6	46.1	46	----	-----	6025595.9	66.6
240	9/10/2025	12:31:21	00d	01:00.0	65.7	83.5	77	47.4	-:-	72.8	71	53.1	48.1	47.9	----	-----	3715352.3	66.6
241	9/10/2025	12:32:21	00d	01:00.0	68.7	86.5	81.3	49.6	-:-	74.9	71.1	59.7	50.5	49.8	----	-----	7413102.4	66.6
242	9/10/2025	12:33:21	00d	01:00.0	62.5	80.3	70.9	47	-:-	69.4	68.7	52.3	47.7	47.5	----	-----	1778279.4	66.5
243	9/10/2025	12:34:21	00d	01:00.0	71.7	89.5	85.1	48.6	-:-	80	73.1	56.6	49	48.9	----	-----	14791083.9	66.5
244	9/10/2025	12:35:21	00d	01:00.0	64.8	82.6	72.8	47.8	-:-	72.2	71.1	51.6	48.3	48	----	-----	3019951.7	66.4
245	9/10/2025	12:36:21	00d	01:00.0	64.8	82.6	76.7	47.5	-:-	72.4	67.9	53.4	47.9	47.8	----	-----	3019951.7	66.4
246	9/10/2025	12:37:21	00d	01:00.0	57.8	75.6	70.2	46.4	-:-	65	59	48.3	46.8	46.7	----	-----	602559.6	66.5
247	9/10/2025	12:38:21	00d	01:00.0	59	76.8	69.3	46.7	-:-	69.6	65.8	48.1	47	47	----	-----	794328.2	66.5
248	9/10/2025	12:39:21	00d	01:00.0	67	84.8	77.2	49	-:-	75.9	71.5	53.7	49.8	49.3	----	-----	5011872.3	66.9
249	9/10/2025	12:40:21	00d	01:00.0	64.3	82.1	76.9	49	-:-	72.3	70.3	49.8	49.2	49.1	----	-----	2691534.8	66.9
250	9/10/2025	12:41:21	00d	01:00.0	59.8	77.6	69.9	48.9	-:-	70	66.1	50.2	49.2	49.2	----	-----	954992.6	66.9
251	9/10/2025	12:42:21	00d	01:00.0	58.5	76.3	72.1	48.7	-:-	66.6	54.1	49.2	48.8	48.7	----	-----	707945.8	66.9
252	9/10/2025	12:43:21	00d	01:00.0	62.1	79.9	71.6	48.6	-:-	71.2	67.7	50.4	48.7	48.6	----	-----	1621810.1	67.0
253	9/10/2025	12:44:21	00d	01:00.0	63.5	81.3	70.3	48.6	-:-	69.9	69.4	57.7	49.1	48.9	----	-----	2238721.1	67.0
254	9/10/2025	12:45:21	00d	01:00.0	64.8	82.6	71.4	49.9	-:-	71.9	69.5	60.1	50.8	50.3	----	-----	3019951.7	67.0
255	9/10/2025	12:46:21	00d	01:00.0	74.4	92.2	85.8	49.9	-:-	83	78.5	64.7	52.1	50	----	-----	27542287.0	67.0
256	9/10/2025	12:47:21	00d	01:00.0	62.3	80.1	73.3	48.3	-:-	68.8	67.1	51.9	48.8	48.6	----	-----	1698243.7	66.7
257	9/10/2025	12:48:21	00d	01:00.0	62.4	80.2	71.4	48.7	-:-	70.9	69.8	50.6	49.6	49	----	-----	1737800.8	66.7
258	9/10/2025	12:49:21	00d	01:00.0	61.9	79.7	74.1	46.5	-:-	71.5	65.7	50.3	47.7	46.7	----	-----	1548816.6	66.7
259	9/10/2025	12:50:21	00d	01:00.0	65.1	82.9	73	47.6	-:-	73	72.3	55.9	47.7	47.4	----	-----	3235936.6	66.8
260	9/10/2025	12:51:21	00d	01:00.0	60	77.8	70.9	45.6	-:-	69.7	63.9	48.8	46.5	46	----	-----	1000000.0	66.8
261	9/10/2025	12:52:21	00d	01:00.0	65	82.8	77.4	47	-:-	72.4	69.4	50.5	47.3	47.1	----	-----	3162277.7	66.9
262	9/10/2025	12:53:21	00d	01:00.0	66.6	84.4	74.6	47.6	-:-	73.1	72.5	59	48.3	47.9	----	-----	4570881.9	66.9
263	9/10/2025	12:54:21	00d	01:00.0	63.4	81.2	71.1	46.5	-:-	69.9	69.7	55.1	47.1	46.9	----	-----	2187761.6	66.9
264	9/10/2025	12:55:21	00d	01:00.0	63.1	80.9	74.9	45.8	-:-	71.8	66.5	48.3	46.4	46.2	----	-----	2041737.9	66.9
265	9/10/2025	12:56:21	00d	01:00.0	64.8	82.6	75.4	44.3	-:-	71.4	69.2	53.6	44.6	44.6	----	-----	3019951.7	67.0
266	9/10/2025	12:57:21	00d	01:00.0	62.1	79.9	71.4	45.4	-:-	70.1	68.5	49.5	45.9	45.6	----	-----	1621810.1	67.0
267	9/10/2025	12:58:21	00d	01:00.0	64.7	82.5	73.4	47.6	-:-	72.2	70.8	51.6	47.6	47.4	----	-----	2951209.2	67.1
268	9/10/2025	12:59:21	00d	01:00.0	71.5	89.3	82.5	46.5	-:-	79.4	76.8	61	48.8	47	----	-----	14125375.4	67.1
269	9/10/2025	13:00:21	00d	01:00.0	65.2	83	74.3	46.7	-:-	71.2	70.7	57.2	48.7	47.8	----	-----	3311311.2	66.9
270	9/10/2025	13:01:21	00d	01:00.0	65	82.8	74.2	47.3	-:-	72.7	69.6	57.6	49.1	47	----	-----	3162277.7	67.1
271	9/10/2025	13:02:21	00d	01:00.0	61.5	79.3	72.7	48.5	-:-	69	66.9	51.1	48.8	48.6	----	-----	1412537.5	67.2
272	9/10/2025	13:03:21	00d	01:00.0	60.3	78.1	70.3	47.5	-:-	68.8	64.8	54	50	47.8	----	-----	1071519.3	67.2
273	9/10/2025	13:04:21	00d	01:00.0	65.3	83.1	74.4	46.4	-:-	73	70.4	54	48.2	47.3	----	-----	3388441.6	67.2
274	9/10/2025	13:05:21	00d	01:00.0	61.1	78.9	71.5	46	-:-	70.3	67.4	48.7	46.7	46.4	----	-----	1288249.6	67.3
275	9/10/2025	13:06:21	00d	01:00.0	58.7	76.5	72.3	45.9	-:-	66	55.8	47.4	46.3	46.1	----	-----	741310.2	67.3
276	9/10/2025	13:07:21	00d	01:00.0	67.9	85.7	78.3	50.3	-:-	74	70.4	62.6	51	50.9	----	-----	6165950.0	67.4
277	9/10/2025	13:08:21	00d	01:00.0	66.4	84.2	76.9	47.4	-:-	74.2	72.2	54.9	49.1	48.2	----	-----	4365158.3	67.4
278	9/10/2025	13:09:21	00d	01:00.0	64.1	81.9	73.7	45.7	-:-	73.4	70.1	50.1	46	45.8	----	-----	2570395.8	67.5
279	9/10/2025	13:10:21	00d	01:00.0	76.5	94.3	89.9	46.6	-:-	85.8	77.6	62	50.2	49.2	----	-----	44668359.2	67.5
280	9/10/2025	13:11:21	00d	01:00.0	60.6	78.4	70.7	47.6	-:-	70.8	65.1	50.6	48.2	47.7	----	-----	1148153.6	66.9
281	9/10/2025	13:12:21	00d	01:00.0	58.1	75.9	69	44.6	-:-	66.8	62.9	50.3	46.9	44.5	----	-----	645654.2	66.9
282	9/10/2025	13:13:21	00d	01:00.0	63.5	81.3	74.2	44.9	-:-	70.8	68.3	51.6	45.4	45.2	----	-----	2238721.1	67.0
283	9/10/2025	13:14:21	00d	01:00.0	66.2	84	77.8	48	-:-	74.9	71	53.1	49.1	48.6	----	-----	4168693.8	67.1
284	9/10/2025	13:15:21	00d	01:00.0	66.1	83.9	74.3	44.6	-:-	73.6	71.3	61.2	45.1	44.8	----	-----	4073802.8	67.1
285	9/10/2025	13:16:21	00d	01:00.0	69.1	86.9	80.7	45.8	-:-	77	72.5	55.2	48.2	45.8	----	-----	8128305.2	67.1
286	9/10/2025	13:17:21	00d	01:00.0	64.4	82.2	78.5	49.2	-:-	71.9	70.2	53.5	49.5	49.2	----	-----	2754228.7	67.0
287	9/10/2025	13:18:21	00d	01:00.0	61.5	79.3	70.7	46.5	-:-	70.7	68	50.5	48.5	48.4	----	-----	1412537.5	67.1
288	9/10/2025	13:19:21	00d	01:00.0	64.6	82.4	72.5	46.8	-:-	71.7	70.3	52.9	46.7	46.3	----	-----	2884031.5	67.1
289	9/10/2025	13:20:21	00d	01:00.0	67.2	85	80.9	45.7	-:-	72	69.3	54	46.7	46.1	----	-----	5248074.6	67.1
290	9/10/2025	13:21:21	00d	01:00.0	67.2	85	77	46	-:-	76.4	73.1	51.7	47.2	46.8	----	-----	5248074.6	67.4
291	9/10/2025	13:22:21	00d	01:00.0	66.9	84.7	75.1	50.5	-:-	73	71.3	62.3	50.9	50.3	----	-----	4897788.2	67.3
292	9/10/2025	13:23:21	00d	01:00.0	63.5	81.3	73.5	47.4	-:-	72.1	70.2	53	48.2	47.6	----	-----	2238721.1	67.3
293	9/10/2025	13:24:21	00d	01:00.0	62.6	80.4	71.3	49	-:-	70.9	67.8	51.5	49.5	49.2	----	-----	1819700.9	67.3
294	9/10/2025	13:25:21	00d	01:00.0	65.5	83.3	76.3	50.2	-:-	72.6	71.8	52.5	50.7	50.4	----	-----	3548133.9	67.3
295	9/10/2025	13:26:21	00d	01:00.0	61.3	79.1	70.2	49.7	-:-	69	67.3	51.1	49.9	49.8	----	-----	1348962.9	67.3
296	9/10/2025	13:27:21	00d	01:00.0	67	84.8	76.5	50.2	-:-	74.1	72.1	56	51.4	51.2	----	-----	5011872.3	67.3
297	9/10/2025	13:28:21	00d	01:00.0	68.8	86.6	79	52.5	-:-	78.8	73.7	58.9	52.9	52.5	----	-----	7585775.8	67.2
298	9/10/2025	13:29:21	00d	01:00.0	71.1	88.9	84.6	50.6	-:-	78.4	71.1	57.2	51.2	50.8	----	-----	12882495.5	67.3
299	9/10/2025	13:30:21	00d	01:00.0	65.6	83.4	77.7	49.6	-:-	70.7	69.4	55.3	50	49.8	----	-----	3630780.5	67.2
300	9/10/2025	13:31:21	00d	01:00.0	64.4	82.2	72	47.5	-:-	72.5	71	52.5	49.5	48.3	----	-----	2754228.7	67.1
301	9/10/2025	13:32:21	00d	01:00.0	66.1	83.9	75.2	46.9	-:-	72.2	72	58.1	48.3	47.3	----	-----	4073802.8	67.1
302	9/10/2025	13:33:21	00d	01:00.0	62.8	80.6	71.4	49.6	-:-	71.6	69.5	51.4	49.9	49.7	----	-----	1905460.7	70.1
303	9/10/2025	13:34:21	00d	01:00.0	64.9	82.7	72.7	46.7	-:-	71	69.9	58.9	49	47.4	----	-----	3090295.4	70.1
304	9/10/2025	13:35:21	00d	01:00.0	66.5	84.3	76	46.9	-:-	74.3	71.4	57.3	48.5	47.9	----	-----	4466835.9	70.1
305	9/10/2025	13:36:21	00d	01:00.0	65.7	83.5	76.8	45.4	-:-	71.8	70.2	47.4	45.9	45.7	----	-----	3715352.3	70.1
306	9/10/2025	13:37:21	00d	01:00.0	71.1	88.9	85	49.2	-:-	76.7	71	60.3	49.6	49.5	----	-----	12882495.5	70.1
307	9/10/2025	13:38:21	00d	01:00.0	63.2	81	72.9	49	-:-	70.2	68.8	53.6	49.3	49.1	----	-----	2089296.1	70.1
308	9/10/2025	13:39:21	00d	01:00.0	74	91.8	86.2	55.1	-:-	83.8	77.1	67.5	58.3	54.3	----	-----	25118864.3	70.1
309	9/10/2025	13:40:21	00d	01:00.0	66.9	84.7	78.9	50.9	-:-	74.8	70.7	55.8	51.4	51.3	----	-----	4897788.2	70.0
310	9/10/2025	13:41:21	00d	01:00.0	65.5	83.3	74.4	50.9	-:-	73.4	70.6	58.6	53	51.2	----	-----	3548133.9	70.0
311	9/10/2025	13:42:21	00d	01:00.0	62.9	80.7	68.8	51.8	-:-	69	67.5	57	52	51.7	----	-----	1949844.6	70.0
312	9/10/2025	13:43:21	00d	01:00.0	65.4	83.2	72.5	50.8	-:-	72.5	70.5	58.4	51.1	50.8	----	-----	3467368.5	70.0
313	9/10/2025	13:44:21	00d	01:00.0	63.1	80.9	74.4	49.1	-:-	71.9	67.5	51.5	49.4	49.3	----	-----	2041737.9	70.0
314	9/10/2025	13:45:21	00d	01:00.0	61.4	79.2	71.7	48.7	-:-	70.6	66.1	50.3	49.1	48.7	----	-----	1380384.3	70.0
315	9/10/2025	13:46:21	00d	01:00.0	66.2	84	76.6	49.5	-:-	73.3	71.9	56.5	50.1	49.6	----	-----	4168693.8	70.0
316	9/10/2025	13:47:21	00d	01:00.0	68.2	86	80.7	48.6	-:-	75.6	71.5	51.2	49.1	48.9	----	-----	6606934.5	70.0
317	9/10/2025	13:48:21	00d	01:00.0	62.4	80.2	80.2	49.1	-:-	71.5	68.1	51.2	49.4	49.3	----	-----	1737800.8	70.0
318	9/10/2025	13:49:21	00d	01:00.0	67.9	85.7	73	49.8	-:-	72.9	72.5	64.3	54.4	52	----	-----	6165950.0	70.0
319	9/10/2025	13:50:21	00d	01:00.0	66.5	84.3	73.9	49.4	-:-	73.5	71	59.5	49.9	49.8	----	-----	4466835.9	70.1
320	9/10/2025	13:51:21	00d	01:00.0	63.5	81.3	74.6	51.8	-:-	69.8	68.6	55.3	52.6	52.3	----	-----	2238721.1	70.1
321	9/10/2025	13:52:21	00d	01:00.0	70.8	88.6	81.5	57.3	-:-	76.7	73.7	67.1	58	56.7	----	-----	12022644.3	70.1
322	9/10/2025	13:53:21	00d	01:00.0	60.9	78.7	71.3	49.7	-:-	69.9	66.4	52.3	50.3	50.2	----	-----	1230268.8	70.0
323	9/10/2025	13:54:21	00d	01:00.0	67.7	85.5	79.1	50.6	-:-	75.1	70.5	59.2	52.8	51	----	-----	5888436.6	70.0
324	9/10/2025	13:55:21	00d	01:00.0	64.9	82.7	72.3	50.5	-:-	71.8	70.1	56.9	51	50.7	----	-----	3090295.4	70.0

325	9/10/2025	13:56:21	00d	01:00.0	69.2	87	83.2	49.6	-:-	72.7	69	53.2	49.8	49.8	----	-----	8317637.7	70.0
326	9/10/2025	13:57:21	00d	01:00.0	60.6	78.4	69.8	46.6	-:-	69.2	64.9	53.3	48.2	46.9	----	-----	1148153.6	70.0
327	9/10/2025	13:58:21	00d	01:00.0	67.2	85	76.6	49.5	-:-	72.5	71.8	61.2	50.4	49.6	----	-----	5248074.6	70.1
328	9/10/2025	13:59:21	00d	01:00.0	64	81.8	72.1	50	-:-	72.2	69.6	56.4	51.1	49.4	----	-----	2511886.4	70.0
329	9/10/2025	14:00:21	00d	01:00.0	60.9	78.7	71.4	44.3	-:-	69.3	67	52.2	46	45.8	----	-----	1230268.8	70.1
330	9/10/2025	14:01:21	00d	01:00.0	73.1	90.9	86.9	44.2	-:-	78	75.9	55.1	48.3	44.4	----	-----	20417379.4	70.1
331	9/10/2025	14:02:21	00d	01:00.0	68.9	86.7	77.5	48.2	-:-	77.4	73.2	62.2	49.6	48.3	----	-----	7762471.2	69.9
332	9/10/2025	14:03:21	00d	01:00.0	64.5	82.3	76.7	46.9	-:-	70	69.2	52.1	48.1	47.6	----	-----	2818382.9	69.9
333	9/10/2025	14:04:21	00d	01:00.0	66	83.8	77.2	46.9	-:-	75.1	67.9	51.7	47.5	47.1	----	-----	3981071.7	69.9
334	9/10/2025	14:05:21	00d	01:00.0	68.1	85.9	76.1	50.8	-:-	75.8	73	60	53.5	52	----	-----	6456542.3	69.9
335	9/10/2025	14:06:21	00d	01:00.0	67.6	85.4	77.4	49.2	-:-	75.7	71.9	54.7	50	49.5	----	-----	5754399.4	70.0
336	9/10/2025	14:07:21	00d	01:00.0	66	83.8	75.9	50.7	-:-	72.4	71.3	56.8	51	50.8	----	-----	3981071.7	70.1
337	9/10/2025	14:08:21	00d	01:00.0	69.5	87.3	77.9	49.9	-:-	77.5	74.6	65.3	51.8	50.5	----	-----	8912509.4	70.1
338	9/10/2025	14:09:21	00d	01:00.0	69.5	87.3	76.9	50.6	-:-	76.7	75.5	61.5	51.8	50.4	----	-----	8912509.4	70.0
339	9/10/2025	14:10:21	00d	01:00.0	63.8	81.6	76	47.5	-:-	73.1	68	51.8	48.6	48.2	----	-----	2398832.9	70.0
340	9/10/2025	14:11:21	00d	01:00.0	65.9	83.7	76.7	49	-:-	71.3	70.2	56.2	49.8	49.2	----	-----	3890451.4	70.0
341	9/10/2025	14:12:21	00d	01:00.0	64.1	81.9	71.4	48.3	-:-	71.8	70.1	57.2	49.4	48.7	----	-----	2570395.8	70.0
342	9/10/2025	14:13:21	00d	01:00.0	67.5	85.3	77.9	46.1	-:-	77.8	70.8	54.5	46.4	46.2	----	-----	5623413.3	70.0
343	9/10/2025	14:14:21	00d	01:00.0	70	87.8	82.8	48.7	-:-	78.1	70.5	54.5	48.8	48.6	----	-----	10000000.0	70.0
344	9/10/2025	14:15:21	00d	01:00.0	66	83.8	76.7	47.7	-:-	72.8	71.6	51.8	47.9	47.7	----	-----	3981071.7	70.0
345	9/10/2025	14:16:21	00d	01:00.0	64.3	82.1	74.3	47.6	-:-	73.8	69.6	51	48.3	48.1	----	-----	2691534.8	69.9
346	9/10/2025	14:17:21	00d	01:00.0	65.7	83.5	75.1	49.3	-:-	73.9	72.1	54.7	50.6	49.2	----	-----	3715352.3	70.0
347	9/10/2025	14:18:21	00d	01:00.0	66.9	84.7	77.2	49.9	-:-	74.1	71.5	55.3	51.1	50.3	----	-----	4897788.2	70.0
348	9/10/2025	14:19:21	00d	01:00.0	61.9	79.7	71.4	48.2	-:-	70	68.4	51.1	48.6	48.5	----	-----	1548816.6	69.9
349	9/10/2025	14:20:21	00d	01:00.0	64.4	82.2	77	47.6	-:-	71.6	68.3	51.2	48.1	47.8	----	-----	2754228.7	69.9
350	9/10/2025	14:21:21	00d	01:00.0	74.3	92.1	87.8	46	-:-	83.9	73.5	49.2	46.5	46.2	----	-----	26915348.0	69.9
351	9/10/2025	14:22:21	00d	01:00.0	65.4	83.2	75.2	46.1	-:-	74.3	71.7	52.4	46.5	46.3	----	-----	3467368.5	69.8
352	9/10/2025	14:23:21	00d	01:00.0	63.4	81.2	71.7	45.7	-:-	70.7	69.9	52.1	46.2	45.9	----	-----	2187761.6	69.8
353	9/10/2025	14:24:21	00d	01:00.0	60.9	78.7	72.3	44.7	-:-	70.8	64.3	46.5	45	44.9	----	-----	1230268.8	69.8
354	9/10/2025	14:25:21	00d	01:00.0	64.5	82.3	71.4	46.2	-:-	70.7	69.6	56.2	47.3	46.8	----	-----	2818382.9	69.8
355	9/10/2025	14:26:21	00d	01:00.0	64.1	81.9	76.7	47.1	-:-	70	67.1	51.7	47.6	47.2	----	-----	2570395.8	69.8
356	9/10/2025	14:27:21	00d	01:00.0	63.4	81.2	74.2	46.4	-:-	71.2	68.7	50.2	47.7	47.4	----	-----	2187761.6	69.9
357	9/10/2025	14:28:21	00d	01:00.0	60.6	78.4	69.1	46.7	-:-	68.9	67.2	50.6	47.5	47.5	----	-----	1148153.6	69.9
358	9/10/2025	14:29:21	00d	01:00.0	69.8	87.6	82.5	47.5	-:-	76.3	70.5	61.9	48.5	47.8	----	-----	9549925.9	70.0
359	9/10/2025	14:30:21	00d	01:00.0	66.7	84.5	77.7	45.7	-:-	74.3	72.5	54.2	47	46.2	----	-----	4677351.4	70.0
360	9/10/2025	14:31:21	00d	01:00.0	59.2	77	69.8	45.4	-:-	68.6	63.8	46.7	45.5	45.4	----	-----	831763.8	70.0
361	9/10/2025	14:32:21	00d	01:00.0	59.3	77.1	70.9	45.6	-:-	67.4	63.2	48	46.1	45.9	----	-----	851138.0	70.0
362	9/10/2025	14:33:21	00d	01:00.0	85	102.8	100.2	45.8	-:-	85	75.7	61.9	46.3	45.4	----	-----	316227766.0	70.0
363	9/10/2025	14:34:21	00d	01:00.0	67	84.8	78.6	49.5	-:-	72.9	70.6	59.4	50.4	49.4	----	-----	5011872.3	66.9
364	9/10/2025	14:35:21	00d	01:00.0	64.6	82.4	74.7	44.1	-:-	72.6	71.7	48.7	44.5	44.4	----	-----	2884031.5	66.9
365	9/10/2025	14:36:21	00d	01:00.0	66.6	84.4	75.5	46.6	-:-	74.9	71.2	59.6	49.7	48.8	----	-----	4570881.9	67.0
366	9/10/2025	14:37:21	00d	01:00.0	56.5	74.3	68.8	44.4	-:-	66.7	58.7	46.1	44.7	44.6	----	-----	446683.6	66.9
367	9/10/2025	14:38:21	00d	01:00.0	71.7	89.5	83.1	44.9	-:-	82.1	74.6	61.3	45.3	45.1	----	-----	14791083.9	67.0
368	9/10/2025	14:39:21	00d	01:00.0	67	84.8	75.2	50	-:-	73.1	72.1	62.8	50.6	50.1	----	-----	5011872.3	66.9
369	9/10/2025	14:40:21	00d	01:00.0	61.2	79	71.1	44.6	-:-	69.5	67.2	48.9	44.9	44.8	----	-----	1318256.7	67.0
370	9/10/2025	14:41:21	00d	01:00.0	69.6	87.4	82.7	46.3	-:-	74.6	71.2	56.5	46.9	46.5	----	-----	9120108.4	67.0
371	9/10/2025	14:42:21	00d	01:00.0	64	81.8	71.7	45	-:-	71.8	70.2	51.2	46.2	45.8	----	-----	2511886.4	67.0
372	9/10/2025	14:43:21	00d	01:00.0	63.5	81.3	70.9	45.1	-:-	70.9	69.6	53.6	46.5	45.5	----	-----	2238721.1	67.0
373	9/10/2025	14:44:21	00d	01:00.0	63.1	80.9	74.8	44.9	-:-	70.9	68.8	49.3	45.6	44.9	----	-----	2041737.9	67.1
374	9/10/2025	14:45:21	00d	01:00.0	65.4	83.2	75.4	45.5	-:-	72.3	71.3	56	46.2	45.9	----	-----	3467368.5	67.1
375	9/10/2025	14:46:21	00d	01:00.0	66.5	84.3	73.6	50.8	-:-	73	71.1	61	52.5	52.1	----	-----	4466835.9	67.2
376	9/10/2025	14:47:21	00d	01:00.0	58.5	76.3	70.7	45	-:-	67.7	63.7	48.4	45.2	45.1	----	-----	707945.8	67.2
377	9/10/2025	14:48:21	00d	01:00.0	69.6	87.4	82.9	44	-:-	74	73.2	55.9	44.9	44.6	----	-----	9120108.4	67.4
378	9/10/2025	14:49:21	00d	01:00.0	66.3	84.1	74	43.9	-:-	73.7	71.5	56.7	44.7	44.4	----	-----	4265795.2	67.4
379	9/10/2025	14:50:21	00d	01:00.0	72.7	90.5	87	45.3	-:-	75	71.9	60.8	45.9	45.7	----	-----	18620871.4	67.4
380	9/10/2025	14:51:21	00d	01:00.0	66.5	84.3	77.7	48.9	-:-	73.7	72.3	59.6	49.6	48.8	----	-----	4466835.9	67.3
381	9/10/2025	14:52:21	00d	01:00.0	62.6	80.4	71.4	44.7	-:-	70.7	68.7	54.2	45	44.9	----	-----	1819700.9	67.3
382	9/10/2025	14:53:21	00d	01:00.0	65.1	82.9	72.4	45.1	-:-	72.1	71.5	56.8	45.2	45.2	----	-----	3235936.6	67.3
383	9/10/2025	14:54:21	00d	01:00.0	62.4	80.2	71.5	44.9	-:-	70.2	68.9	54.3	45.2	45.1	----	-----	1737800.8	67.3
384	9/10/2025	14:55:21	00d	01:00.0	62.4	80.2	73.9	43.3	-:-	71.1	68.7	47.4	43.4	43.3	----	-----	1737800.8	67.4
385	9/10/2025	14:56:21	00d	01:00.0	62.1	79.9	72.5	43.6	-:-	70.5	67.9	48.7	44.2	43.8	----	-----	1621810.1	67.5
386	9/10/2025	14:57:21	00d	01:00.0	69.9	87.7	82	47.1	-:-	76	73.7	58.6	48	47.4	----	-----	9772372.2	67.5
387	9/10/2025	14:58:21	00d	01:00.0	67.4	85.2	75.9	47.1	-:-	76.1	72.9	57.4	48.8	48.3	----	-----	5495408.7	67.4
388	9/10/2025	14:59:21	00d	01:00.0	65.4	83.2	75.4	46.2	-:-	75.1	70.9	51	46.7	46.4	----	-----	3467368.5	67.4
389	9/10/2025	15:00:21	00d	01:00.0	67	84.8	75.7	50.7	-:-	74.2	72.2	59.6	54.8	54.3	----	-----	5011872.3	67.5
390	9/10/2025	15:01:21	00d	01:00.0	64.1	81.9	71.6	46.2	-:-	71.7	70.4	56.2	46.6	46.4	----	-----	2570395.8	67.5
391	9/10/2025	15:02:21	00d	01:00.0	60.5	78.3	71.2	47.4	-:-	70.2	64.8	51.4	47.8	47.5	----	-----	1122018.5	67.6
392	9/10/2025	15:03:21	00d	01:00.0	68.8	86.6	75.6	49.7	-:-	74.8	73.8	63.1	51.9	51.4	----	-----	7585775.8	67.6
393	9/10/2025	15:04:21	00d	01:00.0	65.1	82.9	73.5	50.1	-:-	72.1	70.7	56.1	50.6	50.4	----	-----	3235936.6	67.6
394	9/10/2025	15:05:21	00d	01:00.0	67.1	84.9	73.1	46.8	-:-	72.8	71.9	60.7	48.6	47.3	----	-----	5128613.8	67.6
395	9/10/2025	15:06:21	00d	01:00.0	70.5	88.3	83.6	46.8	-:-	75.8	73.5	54.7	47.2	47	----	-----	11220184.5	67.6
396	9/10/2025	15:07:21	00d	01:00.0	73.2	91	86.9	48.2	-:-	81	72.8	61.8	50.5	48.3	----	-----	20892961.3	67.5
397	9/10/2025	15:08:21	00d	01:00.0	67.7	85.5	75.3	52.7	-:-	73.8	72.1	62.7	53.2	52.9	----	-----	5888436.6	67.3
398	9/10/2025	15:09:21	00d	01:00.0	62.9	80.7	70.9	47.1	-:-	69.5	68.3	56.8	47.4	47.2	----	-----	1949844.6	67.3
399	9/10/2025	15:10:21	00d	01:00.0	63.7	81.5	74.9	46.8	-:-	69.2	68.5	52.8	46.9	46.8	----	-----	2344228.8	67.4
400	9/10/2025	15:11:21	00d	01:00.0	65.2	83	76	46.5	-:-	71.9	70.5	50.6	46.7	46.7	----	-----	3311311.2	67.4
401	9/10/2025	15:12:21	00d	01:00.0	64.9	82.7	71.3	46.9	-:-	70.6	70.1	59.5	47.4	47.3	----	-----	3090295.4	67.4
402	9/10/2025	15:13:21	00d	01:00.0	63.6	81.4	72.4	47.4	-:-	72.6	70.7	51.3	48	47.4	----	-----	2290867.7	67.4
403	9/10/2025	15:14:21	00d	01:00.0	63.5	81.3	73.8	45.1	-:-	72.8	71.3	47	45.7	45.5	----	-----	2238721.1	67.5
404	9/10/2025	15:15:21	00d	01:00.0	69.5	87.3	78.6	45.3	-:-	77	73.6	64.3	47	45.8	----	-----	8912509.4	67.5
405	9/10/2025	15:16:21	00d	01:00.0	62.1	79.9	71.5	44.4	-:-	70.1	68.9	46.8	44.8	44.6	----	-----	1621810.1	67.5
406	9/10/2025	15:17:21	00d	01:00.0	66.4	84.2	75.1	46.5	-:-	74.4	72.3	54.8	47.7	47.2	----	-----	4365158.3	67.5
407	9/10/2025	15:18:21	00d	01:00.0	66.5	84.3	75.3	46.1	-:-	73.2	71.8	59.8	48	46.5	----	-----	4466835.9	67.5
408	9/10/2025	15:19:21	00d	01:00.0	61.4	79.2	71.2	45.2	-:-	69.5	67.2	51.1	45.6	45.4	----	-----	1380384.3	67.5
409	9/10/2025	15:20:21	00d	01:00.0	61.3	79.1	70.2	45.6	-:-	69.6	67.8	51.9	46	45.8	----	-----	1348962.9	67.5
410	9/10/2025	15:21:21	00d	01:00.0	65	82.8	74	45.4	-:-	72.3	71.6	55.5	45.7	45.7	----	-----	3162277.7	67.6
411	9/10/2025	15:22:21	00d	01:00.0	66.8	84.6	73.3	45.5	-:-	72.7	71.3	61.4	48.1	47.1	----	-----	4786300.9	67.7
412	9/10/2025	15:23:21	00d	01:00.0	67.6	85.4	76.2	48.7	-:-	74.1	72.3	62.2	49.4	48.5	----	-----	5754399.4	67.8
413	9/10/2025	15:24:21	00d	01:00.0	69.1	86.9	81.6	46.2	-:-	73.8	71.7	57.9	47.7	46.9	----	-----	8128305.2	67.8
414	9/10/2025	15:25:21	00d	01:00.0	59.4	77.2	70.8	44.4	-:-	67.7	65.8	46.2	45	44.4	----	-----	870963.6	67.8
415	9/10/2025	15:26:21	00d	01:00.0	65.6	83.4	74.1	44.5	-:-	73.9	71.6	51.4	44.9	44.8	----	-----	3630780.5	67.8
416	9/10/2025	15:27:21	00d	01:00.0	65.9	83.7	74.4	45	-:-	73.3	70.3	59.5	45.6	45.3	----	-----	3890451.4	67.8
417	9/10/2025	15:28:21	00d	01:00.0	69.5	87.3	80.8	47.7	-:-	75.9	73.8	58.9	49.5	48.2	----	-----	8912509.4	67.9
418	9/10/2025	15:29:21	00d	01:00.0	72.1	89.9	85.8	49.7	-:-	78.3	72.2	63.6	50.7	49.6	----	-----	16218101.0	67.8
419	9/10/2025	15:30:21	00d	01:00.0	65	82.8	76.7	45.7	-:-	73.5	70.6	51.5	46.5	46.1	----	-----	3162277.7	67.7
420	9/10/2025	15:31:21	00d	01:00.0	64.7	82.5	73.8	46.2	-:-	73.4	70.3	56	46.7	46.4	----	-----	2951209.2	67.7
421	9/10/2025	15:32:21	00d	01:00.0	66.7	84.5	74	45.3	-:-	73.4	72	57.9	45.9	45.5	----	-----	4677351.4	67.8
422	9/10/2025	15:33:21	00d	01:00.0	67.5	85.3	79.3	44.8	-:-	74.9	72.2	49.1	45.4	45.1	----	-----	5623413.3	67.8
423	9/10/2025	15:34:21	00d	01:00.0	66.7	84.5	73.3	45.2	-:-	72.7	71.2	62.1	46.7	45.7	----	-----	4677351.4	67.8
424	9/10/2025	15:35:21	00d	01:00.0	67.1	84.9	76.2	46.7	-:-	74.1	72.5	59.2	51	47.2	----	-----	5128613.8	67.8
425	9/10/2025	15:36:21	00d	01:00.0	68.4	86.2	79	45.3	-:-	77.5	73.9	49.7	45.6	45.4	----	-----	6918309.7	67.8
426	9/10/2025	15:37:21	00d	01:00.0	61.5	79.3	70.6	44.6	-:-	70.1	69.1	48.3	45	44.9	----	-----	1412537.5	67.8
427	9/10/2025	15:38:21	00d	01:00.0	69	86.8	80.2	46.2	-:-	74.9	72.8	59	46.6	46.5	----	-----	7943282.3	67.8
428	9/10/2025	15:39:21	00d	01:00.0	68.8	86.6	77.7	49.2	-:-	74.6	73.4	63.9	51.1	49.2	----	-----	7585775.8	67.9
429	9/10/2025	15:40:21	00d	01:00.0	68.8	86.6	80.8	47	-:-	76.5	71	56.4	47.5	47	----	-----	7585775.8	67.9
430	9/10/2025	15:41:21	00d	01:00.0	67.6	85.4	76.8	46.2	-:-	74.1	73.3	57.8	46.6	46.4	----	-----	5754399.4	67.9
431	9/10/2025	15:42:21	00d	01:00.0	65.3	83.1	73	46.8	-:-	72.4	71.5	57.7	47.7	46.8	----	-----	3388441.6	67.9
432	9/10/2025	15:43:21	00d	01:00.0	68	85.8	76.1	50.9	-:-	73.9	72.9	62.4	52	51.8	----	-----	6309573.4	67.9
433	9/10/2025	15:44:21	00d	01:00.0	68.2	86	77	45.6	-:-	76.1	73.5	59.4	46.1	46	----	-----	6606934.5	68.0

434	9/10/2025	15:45:21	00d	01:00.0	65	82.8	75.2	44.6	-:-	74	70.2	49.3	45.1	44.7	----	-----	3162277.7	67.9
435	9/10/2025	15:46:21	00d	01:00.0	70.8	88.6	78.4	53.9	-:-	77.9	76.9	64.2	54.3	53.5	----	-----	12022644.3	68.0
436	9/10/2025	15:47:21	00d	01:00.0	67.7	85.5	77.2	48.6	-:-	75.1	72.3	59.9	49.3	48.5	----	-----	5888436.6	67.9
437	9/10/2025	15:48:21	00d	01:00.0	72.3	90.1	79.9	50.1	-:-	79.8	77.6	68.8	54.7	49.7	----	-----	16982436.5	67.9
438	9/10/2025	15:49:21	00d	01:00.0	67.2	85	76.4	47.1	-:-	73.6	72.1	60.8	48.7	48.5	----	-----	5248074.6	67.7
439	9/10/2025	15:50:21	00d	01:00.0	68	85.8	74.5	50.9	-:-	74.1	73	62.8	52.6	51.4	----	-----	6309573.4	67.7
440	9/10/2025	15:51:21	00d	01:00.0	68.2	86	77.6	48.3	-:-	73.7	72	64	49.7	49.4	----	-----	6606934.5	67.7
441	9/10/2025	15:52:21	00d	01:00.0	67.2	85	75.3	48.2	-:-	73.9	71.4	59.1	49.7	49.4	----	-----	5248074.6	67.7
442	9/10/2025	15:53:21	00d	01:00.0	64.8	82.6	75.6	47.9	-:-	72.2	70.1	56.8	49.6	49.4	----	-----	3019951.7	67.6
443	9/10/2025	15:54:21	00d	01:00.0	67.4	85.2	73.5	49.5	-:-	73.5	72.4	61.6	51.3	50.2	----	-----	5495408.7	67.6
444	9/10/2025	15:55:21	00d	01:00.0	69.5	87.3	77.6	49.4	-:-	76.8	73.4	64.7	53.2	49.9	----	-----	8912509.4	67.6
445	9/10/2025	15:56:21	00d	01:00.0	66.9	84.7	77.4	47.8	-:-	73.7	71.4	55.6	48.7	48.6	----	-----	4897788.2	67.5
446	9/10/2025	15:57:21	00d	01:00.0	65	82.8	77.6	48.4	-:-	70.3	69.7	54.6	48.6	48.5	----	-----	3162277.7	67.5
447	9/10/2025	15:58:21	00d	01:00.0	63.6	81.4	73	47.4	-:-	71.8	69.1	52.9	48	47.6	----	-----	2290867.7	67.6
448	9/10/2025	15:59:21	00d	01:00.0	69.9	87.7	82.2	48.4	-:-	75.2	72.4	61.9	49.3	48.7	----	-----	9772372.2	67.6
449	9/10/2025	16:00:21	00d	01:00.0	67.3	85.1	81.1	48.3	-:-	74.8	72	55.8	48.8	48.6	----	-----	5370318.0	67.6
450	9/10/2025	16:01:21	00d	01:00.0	68.1	85.9	79.7	46.8	-:-	73.8	71.4	61	47.4	46.9	----	-----	6456542.3	67.6
451	9/10/2025	16:02:21	00d	01:00.0	69.7	87.5	80	50.6	-:-	76.3	73.6	66	51.5	50.8	----	-----	9332543.0	67.7
452	9/10/2025	16:03:21	00d	01:00.0	66.2	84	75.7	45.9	-:-	73	72.4	58.1	46.5	46.2	----	-----	4168693.8	67.6
453	9/10/2025	16:04:21	00d	01:00.0	66.4	84.2	72.6	46.5	-:-	72.2	72.1	58.6	47.2	46.6	----	-----	4365158.3	67.6
454	9/10/2025	16:05:21	00d	01:00.0	65	82.8	73.1	48.3	-:-	72	70.7	56	49.3	48.5	----	-----	3162277.7	67.6
455	9/10/2025	16:06:21	00d	01:00.0	69.5	87.3	76.1	54.5	-:-	74.8	73.6	68.6	58	55.8	----	-----	8912509.4	67.7
456	9/10/2025	16:07:21	00d	01:00.0	66.7	84.5	77.3	47.2	-:-	72.8	71.3	57.2	48.9	47.7	----	-----	4677351.4	67.7
457	9/10/2025	16:08:21	00d	01:00.0	68.8	86.6	77.4	53.8	-:-	73.5	73.1	67.4	55	53.3	----	-----	7585775.8	67.7
458	9/10/2025	16:09:21	00d	01:00.0	66.9	84.7	73.2	47.4	-:-	71.8	71	63.8	48	47.5	----	-----	4897788.2	67.7
459	9/10/2025	16:10:21	00d	01:00.0	66.4	84.2	75.3	47.6	-:-	73.6	71.9	58.6	48	47.7	----	-----	4365158.3	67.7
460	9/10/2025	16:11:21	00d	01:00.0	68.1	85.9	74.4	46.5	-:-	74	72.4	64	48.6	47.2	----	-----	6456542.3	67.7
461	9/10/2025	16:12:21	00d	01:00.0	64.5	82.3	73.3	45.9	-:-	71.9	70.7	51.4	46.2	46.1	----	-----	2818382.9	67.7
462	9/10/2025	16:13:21	00d	01:00.0	67.3	85.1	78.7	46	-:-	73.9	70.8	56.8	46.4	46.1	----	-----	5370318.0	67.7
463	9/10/2025	16:14:21	00d	01:00.0	66.5	84.3	77.9	47.5	-:-	72	70.5	53.1	47.8	47.4	----	-----	4466835.9	67.7
464	9/10/2025	16:15:21	00d	01:00.0	67.9	85.7	79.1	47.7	-:-	74.3	72.2	58.4	49.4	48.2	----	-----	6165950.0	67.7
465	9/10/2025	16:16:21	00d	01:00.0	65.3	83.1	74.5	46.7	-:-	73.4	70.9	52.1	47	46.9	----	-----	3388441.6	67.6
466	9/10/2025	16:17:21	00d	01:00.0	67.9	85.7	77	52.9	-:-	72.3	70.5	64.8	58.1	53.8	----	-----	6165950.0	67.7
467	9/10/2025	16:18:21	00d	01:00.0	64.1	81.9	72	48.4	-:-	71	69.9	55.9	48.5	48.4	----	-----	2570395.8	67.6
468	9/10/2025	16:19:21	00d	01:00.0	65.9	83.7	76.6	47	-:-	73.6	72.1	54.3	47.5	47.2	----	-----	3890451.4	67.6
469	9/10/2025	16:20:21	00d	01:00.0	68.3	86.1	79.2	50.7	-:-	74.7	72.3	59.6	51.1	50.4	----	-----	6760829.8	67.7
470	9/10/2025	16:21:21	00d	01:00.0	67.7	85.5	77.1	47.9	-:-	74	71.5	61.6	48.8	48.4	----	-----	5888436.6	67.8
471	9/10/2025	16:22:21	00d	01:00.0	71.3	89.1	83.5	52.9	-:-	78.1	73.2	65	53.9	52.7	----	-----	13489628.8	67.8
472	9/10/2025	16:23:21	00d	01:00.0	68.3	86.1	76.5	50	-:-	75.4	72.3	64.1	53.2	51.3	----	-----	6760829.8	67.6
473	9/10/2025	16:24:21	00d	01:00.0	69.6	87.4	78.1	51.1	-:-	74.7	73.4	67.9	53.3	51.6	----	-----	9120108.4	67.6
474	9/10/2025	16:25:21	00d	01:00.0	69	86.8	75.5	47.3	-:-	75.1	74.4	64.9	48.9	47.7	----	-----	7943282.3	67.5
475	9/10/2025	16:26:21	00d	01:00.0	64.9	82.7	73.9	46.3	-:-	72.6	69.9	56.9	47.2	46.5	----	-----	3090295.4	67.4
476	9/10/2025	16:27:21	00d	01:00.0	65.8	83.6	75.1	47.9	-:-	72.9	70.7	58	48.7	48.1	----	-----	3801894.0	67.5
477	9/10/2025	16:28:21	00d	01:00.0	69.3	87.1	77	48.9	-:-	73.8	72.2	68.1	60	56.1	----	-----	8511380.4	67.5
478	9/10/2025	16:29:21	00d	01:00.0	67.7	85.5	74.9	53.2	-:-	72.9	71.4	65.2	54.2	53.1	----	-----	5888436.6	67.4
479	9/10/2025	16:30:21	00d	01:00.0	66.8	84.6	73.5	46.5	-:-	72.3	70.9	61.6	47	46.7	----	-----	4786300.9	67.4
480	9/10/2025	16:31:21	00d	01:00.0	65	82.8	73.4	46.8	-:-	72.6	71.6	53.9	47.2	47	----	-----	3162277.7	67.4
481	9/10/2025	16:32:21	00d	01:00.0	69.2	87	75.9	47.6	-:-	74.6	73.7	64.2	52.2	51.6	----	-----	8317637.7	67.4
482	9/10/2025	16:33:21	00d	01:00.0	66.1	83.9	73.7	47.9	-:-	73.6	71	59.5	48.5	48	----	-----	4073802.8	67.4
483	9/10/2025	16:34:21	00d	01:00.0	68.8	86.6	79.1	50	-:-	74.8	73.6	60.3	51.1	50.6	----	-----	7585775.8	67.4
484	9/10/2025	16:35:21	00d	01:00.0	66.5	84.3	72.4	48.3	-:-	72	71.3	61.6	48.7	48.3	----	-----	4466835.9	67.3
485	9/10/2025	16:36:21	00d	01:00.0	65.2	83	76.9	47.7	-:-	72.3	70.7	51.6	48	47.9	----	-----	3311311.2	67.3
486	9/10/2025	16:37:21	00d	01:00.0	70	87.8	75.3	48.8	-:-	75.4	74.4	67.4	49.8	48.9	----	-----	10000000.0	67.4
487	9/10/2025	16:38:21	00d	01:00.0	67.8	85.6	73.4	51.9	-:-	73.4	72.4	63.8	53.6	52.9	----	-----	6025595.9	67.3
488	9/10/2025	16:39:21	00d	01:00.0	71.6	89.4	83.3	51.7	-:-	77.4	75.2	65.7	52.6	52	----	-----	14454397.7	67.2
489	9/10/2025	16:40:21	00d	01:00.0	67.6	85.4	77.2	49.8	-:-	74.1	73.1	59.4	50.8	50.2	----	-----	5754399.4	67.1
490	9/10/2025	16:41:21	00d	01:00.0	69.9	87.7	76.7	50.2	-:-	75.4	74.4	66.5	52.7	50.6	----	-----	9772372.2	67.1
491	9/10/2025	16:42:21	00d	01:00.0	67.3	85.1	73.2	48.3	-:-	73.2	72.2	63.5	49.3	48.7	----	-----	5370318.0	67.0
492	9/10/2025	16:43:21	00d	01:00.0	66.1	83.9	73.1	50.5	-:-	71.8	70.7	61.3	52.9	51.1	----	-----	4073802.8	67.0
493	9/10/2025	16:44:21	00d	01:00.0	69.6	87.4	76.6	51.3	-:-	74.9	74	67.3	54.8	51.1	----	-----	9120108.4	67.1
494	9/10/2025	16:45:21	00d	01:00.0	66.7	84.5	75.3	51.7	-:-	74.8	70.9	61.2	52.4	52	----	-----	4677351.4	67.1
495	9/10/2025	16:46:21	00d	01:00.0	67.1	84.9	74	50.5	-:-	72.7	71.8	63.4	52	51	----	-----	5128613.8	67.1
496	9/10/2025	16:47:21	00d	01:00.0	68.1	85.9	76.2	47.6	-:-	74.1	72.8	63.1	48.9	48.1	----	-----	6456542.3	67.0
497	9/10/2025	16:48:21	00d	01:00.0	65	82.8	75.6	48.7	-:-	71.7	70.8	59.2	49.9	49.4	----	-----	3162277.7	67.0
498	9/10/2025	16:49:21	00d	01:00.0	67.8	85.6	74.4	52.3	-:-	74	72.1	63.9	53.8	52.4	----	-----	6025595.9	67.1
499	9/10/2025	16:50:21	00d	01:00.0	67.4	85.2	77.9	49.8	-:-	72.1	70.9	60.5	50.9	50.1	----	-----	5495408.7	67.1
500	9/10/2025	16:51:21	00d	01:00.0	64.4	82.2	72.6	49.4	-:-	72.3	71.3	55.6	50	49.6	----	-----	2754228.7	67.0
501	9/10/2025	16:52:21	00d	01:00.0	66.6	84.4	78.6	48.3	-:-	73.3	70.4	53.8	49.1	48.8	----	-----	4570881.9	67.1
502	9/10/2025	16:53:21	00d	01:00.0	59.6	77.4	70.3	47.8	-:-	68.6	63.5	49.5	48.4	48.3	----	-----	912010.8	67.2
503	9/10/2025	16:54:21	00d	01:00.0	64.6	82.4	73	48.2	-:-	72.7	70.1	55.1	48.9	48.6	----	-----	2884031.5	67.2
504	9/10/2025	16:55:21	00d	01:00.0	65.9	83.7	74.5	47.4	-:-	74.1	71.3	56.7	48.1	47.7	----	-----	3890451.4	67.2
505	9/10/2025	16:56:21	00d	01:00.0	61.9	79.7	71.4	46.1	-:-	70.5	68.2	47.7	46.5	46.1	----	-----	1548816.6	67.1
506	9/10/2025	16:57:21	00d	01:00.0	66.9	84.7	74.3	46.7	-:-	74.1	72.4	60.4	50.1	49	----	-----	4897788.2	67.2
507	9/10/2025	16:58:21	00d	01:00.0	69.8	87.6	80.2	54.7	-:-	77.8	73.4	64.3	56	54.3	----	-----	9549925.9	67.2
508	9/10/2025	16:59:21	00d	01:00.0	68.3	86.1	73.8	51.5	-:-	74.1	72.5	66.7	53.2	52.3	----	-----	6760829.8	67.1
509	9/10/2025	17:00:21	00d	01:00.0	67.1	84.9	75.8	51.2	-:-	73.2	73	61.8	52.2	51.5	----	-----	5128613.8	67.1
510	9/10/2025	17:01:21	00d	01:00.0	69.9	87.7	81.8	52	-:-	73.2	72.6	63.6	54.1	52.7	----	-----	9772372.2	67.1
511	9/10/2025	17:02:21	00d	01:00.0	70.8	88.6	80.3	50.1	-:-	76.6	75.4	66.7	53.8	50.7	----	-----	12022644.3	67.0
512	9/10/2025	17:03:21	00d	01:00.0	64.7	82.5	71.4	46.9	-:-	71.7	70.4	57.9	47.3	47.1	----	-----	2951209.2	66.9
513	9/10/2025	17:04:21	00d	01:00.0	65	82.8	73.7	46.3	-:-	73.3	71.1	55.9	48.2	47.5	----	-----	3162277.7	67.0
514	9/10/2025	17:05:21	00d	01:00.0	66.7	84.5	75.3	48.3	-:-	73.8	71.6	60.8	49.8	48.5	----	-----	4677351.4	67.0
515	9/10/2025	17:06:21	00d	01:00.0	70.2	88	79.1	45.7	-:-	78.3	74.9	55.1	46.7	46.1	----	-----	10471285.5	67.1
516	9/10/2025	17:07:21	00d	01:00.0	67.3	85.1	76.9	51.9	-:-	74.6	72.6	61.4	52.3	52	----	-----	5370318.0	67.2
517	9/10/2025	17:08:21	00d	01:00.0	69.1	86.9	76.9	52.6	-:-	75.2	73.8	65.1	55.8	53.6	----	-----	8128305.2	67.2
518	9/10/2025	17:09:21	00d	01:00.0	67.1	84.9	73.7	48.7	-:-	72.8	72.2	64	50.9	49.6	----	-----	5128613.8	67.1
519	9/10/2025	17:10:21	00d	01:00.0	69	86.8	81	48.8	-:-	76.5	74	60.1	50.6	49.1	----	-----	7943282.3	67.1
520	9/10/2025	17:11:21	00d	01:00.0	67.2	85	74.7	50.6	-:-	73.8	73	62.1	52.5	51.7	----	-----	5248074.6	67.0
521	9/10/2025	17:12:21	00d	01:00.0	62.5	80.3	72.2	45.3	-:-	71.7	68.9	48.1	45.8	45.8	----	-----	1778279.4	67.0
522	9/10/2025	17:13:21	00d	01:00.0	65.7	83.5	72.9	48.2	-:-	72.5	71.8	57.9	49.4	48.7	----	-----	3715352.3	67.0
523	9/10/2025	17:14:21	00d	01:00.0	66	83.8	73.5	48.8	-:-	72.2	71.3	59.9	51	49.7	----	-----	3981071.7	67.0
524	9/10/2025	17:15:21	00d	01:00.0	67	84.8	76.6	49.6	-:-	74.3	72.7	56.1	50	49.8	----	-----	5011872.3	67.0
525	9/10/2025	17:16:21	00d	01:00.0	65.8	83.6	77	47.5	-:-	72.5	71.4	53.1	48	47.7	----	-----	3801894.0	67.0
526	9/10/2025	17:17:21	00d	01:00.0	67.5	85.3	77.5	48.1	-:-	73.1	72	60.1	50.2	48.4	----	-----	5623413.3	67.0
527	9/10/2025	17:18:21	00d	01:00.0	63	80.8	72.2	48.4	-:-	70	69.6	56	48.9	48.4	----	-----	1995262.3	67.0
528	9/10/2025	17:19:21	00d	01:00.0	64.4	82.2	72.7	48	-:-	71.1	70.3	55	48.6	48.2	----	-----	2754228.7	67.0
529	9/10/2025	17:20:21	00d	01:00.0	71.3	89.1	83.6	51.6	-:-	75.8	73.5	65.5	55.5	52	----	-----	13489628.8	67.1
530	9/10/2025	17:21:21	00d	01:00.0	70.1	87.9	82.6	50.7	-:-	75.6	72.3	61.9	51.3	50.6	----	-----	10232929.9	67.0
531	9/10/2025	17:22:21	00d	01:00.0	67	84.8	76.9	50.5	-:-	74.6	70.7	60.8	50.5	50.3	----	-----	5011872.3	66.9
532	9/10/2025	17:23:21	00d	01:00.0	63.3	81.1	72.7	48.2	-:-	69.8	68.2	56.2	49	48.6	----	-----	2137962.1	66.9
533	9/10/2025	17:24:21	00d	01:00.0	60.4	78.2	70.2	46.2	-:-	68.3	67.3	49.9	47	46.7	----	-----	1096478.2	66.9
534	9/10/2025	17:25:21	00d	01:00.0	66.7	84.5	75.8	46.8	-:-	74.3	73.2	56.7	47.9	47.2	----	-----	4677351.4	66.9
535	9/10/2025	17:26:21	00d	01:00.0	64.9	82.7	73.5	45.8	-:-	72.5	72.1	53.2	46.4	46	----	-----	3090295.4	67.0
536	9/10/2025	17:27:21	00d	01:00.0	67.3	85.1	74.3	48.9	-:-	73.6	72.5	61.6	51.3	49.6	----	-----	5370318.0	67.1
537	9/10/2025	17:28:21	00d	01:00.0	66.2	84	76.9	44.8	-:-	74.2	72.4	47.5	45	44.9	----	-----	4168693.8	67.1
538	9/10/2025	17:29:21	00d	01:00.0	64.8	82.6	75.8	43.5	-:-	71.1	70.1	54.6	44.2	43.6	----	-----	3019951.7	67.1
539	9/10/2025	17:30:21	00d	01:00.0	66.5	84.3	74.7	43.4	-:-	72.4	71.4	60.4	52.2	45.9	----	-----	4466835.9	67.1
540	9/10/2025	17:31:21	00d	01:00.0	66.9	84.7	74.8	45.7	-:-	74.6	71.7	61.5	46.8	46	----	-----	4897788.2	67.1
541	9/10/2025	17:32:21	00d	01:00.0	65.6	83.4	73.9	46.2	-:-	73.9	72.4	55.4	47.9	47.3	----	-----	3630780.5	67.0
542	9/10/2025	17:33:21	00d	01:00.0	67.4	85.2	74.5	47.7	-:-	73.3	72.3	64.1	53.4	51.9	----	-----	5495408.7	67.1

543	9/10/2025	17:34:21	00d	01:00.0	65.6	83.4	72.3	51.2	-:-	72	70.9	60.9	52	51.6	----	-----	3630780.5	67.0
544	9/10/2025	17:35:21	00d	01:00.0	64.4	82.2	72.1	45.4	-:-	71.4	70.5	57.2	45.8	45.7	----	-----	2754228.7	67.0
545	9/10/2025	17:36:21	00d	01:00.0	66.4	84.2	76.9	44	-:-	73.7	72.1	52	44.8	44.4	----	-----	4365158.3	67.1
546	9/10/2025	17:37:21	00d	01:00.0	70.1	87.9	82.9	47.6	-:-	78.9	71.8	59.2	48.6	48.1	----	-----	10232929.9	67.0
547	9/10/2025	17:38:21	00d	01:00.0	65.3	83.1	74.2	46.5	-:-	73.2	69.8	55.7	47	46.8	----	-----	3388441.6	67.0
548	9/10/2025	17:39:21	00d	01:00.0	62.9	80.7	70.8	46.3	-:-	70.8	69.1	52.6	46.9	46.7	----	-----	1949844.6	67.0
549	9/10/2025	17:40:21	00d	01:00.0	65.7	83.5	76.4	47	-:-	73.4	70.6	56.4	47.3	47.3	----	-----	3715352.3	67.0
550	9/10/2025	17:41:21	00d	01:00.0	65.3	83.1	72.3	46.8	-:-	72.2	71.3	58	48.6	48.2	----	-----	3388441.6	67.0
551	9/10/2025	17:42:21	00d	01:00.0	67.8	85.6	76.5	45.3	-:-	74.6	72.4	63	49.3	46.2	----	-----	6025595.9	67.0
552	9/10/2025	17:43:21	00d	01:00.0	69.1	86.9	79.3	43.8	-:-	75.7	72.7	64.1	44.2	44.1	----	-----	8128305.2	66.9
553	9/10/2025	17:44:21	00d	01:00.0	70.5	88.3	79.2	55	-:-	76.5	74.7	68	57.5	56.6	----	-----	11220184.5	66.8
554	9/10/2025	17:45:21	00d	01:00.0	65.9	83.7	73.3	43.5	-:-	72.9	70.4	61.4	44.1	43.7	----	-----	3890451.4	66.7
555	9/10/2025	17:46:21	00d	01:00.0	66.4	84.2	74.3	46.3	-:-	73.9	72.1	57.9	48.4	47.1	----	-----	4365158.3	66.7
556	9/10/2025	17:47:21	00d	01:00.0	65.4	83.2	74.4	44.4	-:-	72.6	71.7	54.3	44.7	44.7	----	-----	3467368.5	66.7
557	9/10/2025	17:48:21	00d	01:00.0	57.5	75.3	69.4	43.8	-:-	67.3	60.4	45.6	44.3	44.1	----	-----	562341.3	66.7
558	9/10/2025	17:49:21	00d	01:00.0	69.8	87.6	79.7	45.4	-:-	77.2	74.8	60.8	46.1	45.8	----	-----	9549925.9	66.7
559	9/10/2025	17:50:21	00d	01:00.0	68.6	86.4	77.6	47.3	-:-	74.7	73	63.7	49.2	47.4	----	-----	7244359.6	66.7
560	9/10/2025	17:51:21	00d	01:00.0	63.6	81.4	71.5	45.2	-:-	72.1	69	55.5	47.9	45.9	----	-----	2290867.7	66.6
561	9/10/2025	17:52:21	00d	01:00.0	69.6	87.4	80.1	50.8	-:-	76.1	73.2	65.1	54.5	52.6	----	-----	9120108.4	66.6
562	9/10/2025	17:53:21	00d	01:00.0	69.7	87.5	78	53.9	-:-	74.5	73.4	66.1	56.7	54.5	----	-----	9332543.0	66.5
563	9/10/2025	17:54:21	00d	01:00.0	60.8	78.6	71.1	45.4	-:-	70.5	64.9	52.6	46.8	46.3	----	-----	1202264.4	66.3
564	9/10/2025	17:55:21	00d	01:00.0	58.3	76.1	70.7	43.8	-:-	67.8	61.1	44.8	44.2	44.2	----	-----	676083.0	66.4
565	9/10/2025	17:56:21	00d	01:00.0	64.9	82.7	73.6	44.7	-:-	73	70.9	53.5	45.2	45.1	----	-----	3090295.4	66.4
566	9/10/2025	17:57:21	00d	01:00.0	68.9	86.7	77.6	44.8	-:-	75.1	74	62.2	45.4	45.1	----	-----	7762471.2	66.4
567	9/10/2025	17:58:21	00d	01:00.0	66.3	84.1	73.2	48.5	-:-	73.2	71.9	58	51.4	49.9	----	-----	4265795.2	66.3
568	9/10/2025	17:59:21	00d	01:00.0	65.2	83	71.8	49.5	-:-	71.7	70.2	58.4	51	50.4	----	-----	3311311.2	66.2
569	9/10/2025	18:00:21	00d	01:00.0	64.7	82.5	71.8	47.2	-:-	70.7	70.4	58.3	48	47.3	----	-----	2951209.2	66.2
570	9/10/2025	18:01:21	00d	01:00.0	65.2	83	73.1	47.2	-:-	71.5	69.8	59.4	48.4	47.8	----	-----	3311311.2	66.2
571	9/10/2025	18:02:21	00d	01:00.0	66.1	83.9	72.7	48.2	-:-	73.1	71.2	61.8	50.8	50	----	-----	4073802.8	66.2
572	9/10/2025	18:03:21	00d	01:00.0	69.9	87.7	82.1	49.4	-:-	78.1	70.6	64	50.6	50	----	-----	9772372.2	66.2
573	9/10/2025	18:04:21	00d	01:00.0	67.7	85.5	76.5	49.7	-:-	75.7	71.6	62.6	51.4	50	----	-----	5888436.6	66.1
574	9/10/2025	18:05:21	00d	01:00.0	68.8	86.6	77.6	46.8	-:-	77.5	72.8	63.3	49.8	48.2	----	-----	7585775.8	66.0
575	9/10/2025	18:06:21	00d	01:00.0	69.1	86.9	81.9	44.4	-:-	75.9	72.7	53.3	44.8	44.6	----	-----	8128305.2	66.0
576	9/10/2025	18:07:21	00d	01:00.0	73.4	91.2	87.3	45	-:-	78.2	74.1	59.4	47.2	45.4	----	-----	21877616.2	65.9
577	9/10/2025	18:08:21	00d	01:00.0	60.7	78.5	71.7	43.9	-:-	70.1	64.5	47	44.3	44.2	----	-----	1174897.6	65.6
578	9/10/2025	18:09:21	00d	01:00.0	65.1	82.9	74.7	48.6	-:-	74	71.9	55	49.9	49.5	----	-----	3235936.6	65.6
579	9/10/2025	18:10:21	00d	01:00.0	64.9	82.7	74.5	46.3	-:-	73.4	70.2	53.4	46.9	46.3	----	-----	3090295.4	65.6
580	9/10/2025	18:11:21	00d	01:00.0	63.9	81.7	74.4	43.3	-:-	72	70	50.5	44.1	43.5	----	-----	2454708.9	65.6
581	9/10/2025	18:12:21	00d	01:00.0	66.5	84.3	75.5	47.7	-:-	74.2	70.7	61	50.7	49	----	-----	4466835.9	65.7
582	9/10/2025	18:13:21	00d	01:00.0	64.5	82.3	72.4	44.3	-:-	72.1	71.4	54	44.9	44.4	----	-----	2818382.9	65.6
583	9/10/2025	18:14:21	00d	01:00.0	64.8	82.6	74.2	45.7	-:-	73.1	71	51.9	46.6	46.3	----	-----	3019951.7	65.6
584	9/10/2025	18:15:21	00d	01:00.0	64	81.8	74	44.5	-:-	73	70.7	49.1	45.1	44.9	----	-----	2511886.4	65.6
585	9/10/2025	18:16:21	00d	01:00.0	67.8	85.6	74.6	50.2	-:-	73.5	72.8	62.4	52.7	52	----	-----	6025595.9	65.6
586	9/10/2025	18:17:21	00d	01:00.0	66.8	84.6	74.2	44.6	-:-	72.9	72.5	59.3	45.2	44.8	----	-----	4786300.9	65.5
587	9/10/2025	18:18:21	00d	01:00.0	67.8	85.6	78.3	44.1	-:-	76.3	71.2	59.6	44.4	44.3	----	-----	6025595.9	65.5
588	9/10/2025	18:19:21	00d	01:00.0	65.3	83.1	72.9	49.7	-:-	72.7	71.5	59.7	51.4	50.6	----	-----	3388441.6	65.4
589	9/10/2025	18:20:21	00d	01:00.0	68.3	86.1	79.6	49.1	-:-	74.1	71.9	61.2	51.3	49.6	----	-----	6760829.8	65.4
590	9/10/2025	18:21:21	00d	01:00.0	64.8	82.6	73.2	45.2	-:-	72.9	69.7	56	45.7	45.5	----	-----	3019951.7	65.3
591	9/10/2025	18:22:21	00d	01:00.0	67.2	85	76.6	50.6	-:-	73.8	72.2	61.6	52.2	51.1	----	-----	5248074.6	65.3
592	9/10/2025	18:23:21	00d	01:00.0	65.4	83.2	71.9	50.2	-:-	71.5	70.9	59.5	52.6	51.5	----	-----	3467368.5	65.3
593	9/10/2025	18:24:21	00d	01:00.0	65.9	83.7	72.4	50.3	-:-	71.1	70.1	64	53.8	51.4	----	-----	3890451.4	65.2
594	9/10/2025	18:25:21	00d	01:00.0	66.7	84.5	76.8	45.5	-:-	72.8	71.5	57.9	45.8	45.7	----	-----	4677351.4	65.1
595	9/10/2025	18:26:21	00d	01:00.0	70.9	88.7	81.2	60.3	-:-	78	73.4	67.2	61.1	59.8	----	-----	12302687.7	65.2
596	9/10/2025	18:27:21	00d	01:00.0	69.4	87.2	81	46.9	-:-	77.2	72.7	59.9	47.3	47.1	----	-----	8709635.9	65.0
597	9/10/2025	18:28:21	00d	01:00.0	63	80.8	73.2	46.1	-:-	70.6	68.9	47.9	46.4	46.3	----	-----	1995262.3	65.0
598	9/10/2025	18:29:21	00d	01:00.0	64.8	82.6	72	47.4	-:-	71.4	69.6	59.7	48.7	47.8	----	-----	3019951.7	65.0
599	9/10/2025	18:30:21	00d	01:00.0	67.9	85.7	75.6	47	-:-	75.2	73.2	60.6	47.3	47.3	----	-----	6165950.0	65.0
600	9/10/2025	18:31:21	00d	01:00.0	63.5	81.3	72	47.6	-:-	72.2	69.2	55.1	48.3	48.2	----	-----	2238721.1	64.9
601	9/10/2025	18:32:21	00d	01:00.0	64.4	82.2	71	46.6	-:-	71	69.6	58.3	48	47.1	----	-----	2754228.7	64.9
602	9/10/2025	18:33:21	00d	01:00.0	67.5	85.3	76.2	47.1	-:-	75.6	73.5	57	47.4	47.3	----	-----	5623413.3	64.9
603	9/10/2025	18:34:21	00d	01:00.0	54	71.8	73.2	45.8	-:-	60.4	52.3	46.9	46.1	45.9	----	-----	251188.6	64.8
604	9/10/2025	18:35:21	00d	01:00.0	68.1	85.9	79.9	46	-:-	75.2	71.8	54.7	46.3	46.1	----	-----	6456542.3	64.9
605	9/10/2025	18:36:21	00d	01:00.0	66.6	84.4	74	47.1	-:-	73.4	72	60	47.8	47.3	----	-----	4570881.9	64.8
606	9/10/2025	18:37:21	00d	01:00.0	61.5	79.3	69.8	48.4	-:-	69.1	67.4	54.6	48.9	48.5	----	-----	1412537.5	64.8
607	9/10/2025	18:38:21	00d	01:00.0	68.3	86.1	75.1	51.9	-:-	73.7	72.2	65.2	54.2	53	----	-----	6760829.8	64.9
608	9/10/2025	18:39:21	00d	01:00.0	63.4	81.2	74	47.2	-:-	72.3	67.5	50.1	47.4	47.3	----	-----	2187761.6	64.8
609	9/10/2025	18:40:21	00d	01:00.0	67.6	85.4	78.3	47.2	-:-	77	72.3	57.1	47.4	47.3	----	-----	5754399.4	64.8
610	9/10/2025	18:41:21	00d	01:00.0	66.5	84.3	73.3	50.7	-:-	72.6	71.3	62.5	51.8	51	----	-----	4466835.9	64.8
611	9/10/2025	18:42:21	00d	01:00.0	48.9	66.7	62.6	45.3	-:-	53.8	50.2	47.6	45.7	45.5	----	-----	77624.7	64.7
612	9/10/2025	18:43:21	00d	01:00.0	57.1	74.9	68.9	45.8	-:-	66.6	59.3	48.8	46.3	46.1	----	-----	512861.4	64.9
613	9/10/2025	18:44:21	00d	01:00.0	66.5	84.3	74.8	45.9	-:-	74.9	72	56.4	46.4	46.1	----	-----	4466835.9	65.0
614	9/10/2025	18:45:21	00d	01:00.0	62.2	80	72.7	46.3	-:-	71.4	68.1	51.7	47.5	47.3	----	-----	1659586.9	65.0
615	9/10/2025	18:46:21	00d	01:00.0	64.2	82	74.9	46.9	-:-	71.8	69.3	49.4	47.3	47.1	----	-----	2630268.0	65.1
616	9/10/2025	18:47:21	00d	01:00.0	66.1	83.9	75.1	51.7	-:-	74.2	71.1	57.7	53	52.4	----	-----	4073802.8	65.1
617	9/10/2025	18:48:21	00d	01:00.0	68	85.8	75.9	51.7	-:-	75.1	73	63.2	54.7	52.1	----	-----	6309573.4	65.2
618	9/10/2025	18:49:21	00d	01:00.0	61.7	79.5	71.3	46.7	-:-	68.5	67.2	53.3	47.8	47.2	----	-----	1479108.4	65.1
619	9/10/2025	18:50:21	00d	01:00.0	68.4	86.2	78.2	48.2	-:-	75.3	72.8	59.6	48.7	48.4	----	-----	6918309.7	65.2
620	9/10/2025	18:51:21	00d	01:00.0	60.1	77.9	69.2	47.6	-:-	67.2	66.9	50.8	47.8	47.7	----	-----	1023293.0	65.1
621	9/10/2025	18:52:21	00d	01:00.0	63.7	81.5	71.9	48.2	-:-	71	68.4	57.3	49	48.8	----	-----	2344228.8	65.1
622	9/10/2025	18:53:21	00d	01:00.0	61.4	79.2	73.3	47.7	-:-	70.6	64.9	49.9	48.1	48	----	-----	1380384.3	65.1
623	9/10/2025	18:54:21	00d	01:00.0	60.6	78.4	71.7	46.5	-:-	68.8	65.7	48.2	47.2	46.8	----	-----	1148153.6	65.1
624	9/10/2025	18:55:21	00d	01:00.0	63.6	81.4	74	46.7	-:-	71.7	68.6	52.9	47.5	46.9	----	-----	2290867.7	65.1
625	9/10/2025	18:56:21	00d	01:00.0	65.8	83.6	75.4	47.2	-:-	72.6	71.2	54.9	47.9	47.7	----	-----	3801894.0	65.1
626	9/10/2025	18:57:21	00d	01:00.0	62.8	80.6	72.4	47.8	-:-	70.9	68.5	53.5	48.1	47.9	----	-----	1905460.7	65.1
627	9/10/2025	18:58:21	00d	01:00.0	63.2	81	72.9	47.7	-:-	71.2	70.2	51.7	48.1	47.8	----	-----	2089296.1	65.1
628	9/10/2025	18:59:21	00d	01:00.0	57.7	75.5	69	47.3	-:-	67	61.4	49.5	47.8	47.7	----	-----	588843.7	65.1
629	9/10/2025	19:00:21	00d	01:00.0	65.3	83.1	72.6	48.5	-:-	72.9	71.8	56.6	49.3	49	----	-----	3388441.6	65.2
630	9/10/2025	19:01:21	00d	01:00.0	64.3	82.1	75	48.5	-:-	72.9	68	51.3	48.8	48.7	----	-----	2691534.8	65.2
631	9/10/2025	19:02:21	00d	01:00.0	66.3	84.1	74.3	51	-:-	74.3	72.3	58.5	51.9	51.4	----	-----	4265795.2	65.2
632	9/10/2025	19:03:21	00d	01:00.0	65.3	83.1	73.2	49.1	-:-	72.9	71.1	56.7	50.6	49.4	----	-----	3388441.6	65.1
633	9/10/2025	19:04:21	00d	01:00.0	62.3	80.1	73	48.1	-:-	71	66.9	49.6	48.6	48.4	----	-----	1698243.7	65.1
634	9/10/2025	19:05:21	00d	01:00.0	63.7	81.5	74.4	48.1	-:-	73.2	69.1	49.8	48.5	48.3	----	-----	2344228.8	65.2
635	9/10/2025	19:06:21	00d	01:00.0	66.3	84.1	76.9	48.6	-:-	73.6	72.4	54.4	49.9	48.9	----	-----	4265795.2	65.2
636	9/10/2025	19:07:21	00d	01:00.0	66.6	84.4	74.5	47.7	-:-	74.6	72.7	51.3	48.3	48	----	-----	4570881.9	65.2
637	9/10/2025	19:08:21	00d	01:00.0	65	82.8	74	47.9	-:-	71.8	69.4	57.1	48.4	48.4	----	-----	3162277.7	65.3
638	9/10/2025	19:09:21	00d	01:00.0	66.8	84.6	74.8	50.9	-:-	74	71.9	59.6	52.1	51.4	----	-----	4786300.9	65.3
639	9/10/2025	19:10:21	00d	01:00.0	59.4	77.2	71.1	49.4	-:-	67.5	62.3	50.8	49.6	49.6	----	-----	870963.6	65.2
640	9/10/2025	19:11:21	00d	01:00.0	66.5	84.3	75.1	49	-:-	73	72.4	59.8	49.2	49.1	----	-----	4466835.9	65.3
641	9/10/2025	19:12:21	00d	01:00.0	67.2	85	76.6	50.5	-:-	73.9	71.9	60.1	51.3	50.9	----	-----	5248074.6	65.2
642	9/10/2025	19:13:21	00d	01:00.0	64	81.8	71.5	49.4	-:-	71.5	70.2	52.7	49.7	49.5	----	-----	2511886.4	65.1
643	9/10/2025	19:14:21	00d	01:00.0	63.1	80.9	72.2	49.5	-:-	70.8	69.3	53.9	49.9	49.8	----	-----	2041737.9	65.1
644	9/10/2025	19:15:21	00d	01:00.0	64.6	82.4	73.8	49.7	-:-	73.2	70.9	55.2	50.3	50.1	----	-----	2884031.5	65.1
645	9/10/2025	19:16:21	00d	01:00.0	64.7	82.5	75.2	49.9	-:-	70	68.5	59.3	50.8	50.2	----	-----	2951209.2	65.1
646	9/10/2025	19:17:21	00d	01:00.0	59	76.8	73.8	50.1	-:-	65.1	58.3	51.4	50.9	50.4	----	-----	794328.2	65.0
647	9/10/2025	19:18:21	00d	01:00.0	67.2	85	79.4	50.7	-:-	72.9	70.7	58.1	51.7	51.1	----	-----	5248074.6	65.1
648	9/10/2025	19:19:21	00d	01:00.0	62.8	80.6	73	51.2	-:-	71.2	68.1	53	51.6	51.5	----	-----	1905460.7	65.0
649	9/10/2025	19:20:21	00d	01:00.0	63.4	81.2	72.4	51.2	-:-	72.3	69.7	54.7	51.8	51.6	----	-----	2187761.6	65.0
650	9/10/2025	19:21:21	00d	01:00.0	65.1	82.9	73.4	51.9	-:-	73.1	71.2	55.9	52.6	52.4	----	-----	3235936.6	65.0
651	9/10/2025	19:22:21	00d	01:00.0	64.4	82.2	75.5	52	-:-	72.6	69.3	54.7	52.3	52.2	----	-----	2754228.7	65.1

652	9/10/2025	19:23:21	00d	01:00.0	61.8	79.6	70.9	51.7	-:-	71.1	67.5	53.8	52	51.9	----	-----	1513561.2		65.1
653	9/10/2025	19:24:21	00d	01:00.0	58.9	76.7	70	52.9	-:-	66.6	64.1	54.1	53.2	53.1	----	-----	776247.1		65.2
654	9/10/2025	19:25:21	00d	01:00.0	59.3	77.1	70.4	53.6	-:-	68	61.5	54.4	53.8	53.7	----	-----	851138.0		65.3
655	9/10/2025	19:26:21	00d	01:00.0	68.4	86.2	73.8	54.3	-:-	73	72.7	65.9	55	54.8	----	-----	6918309.7		65.4
656	9/10/2025	19:27:21	00d	01:00.0	65.7	83.5	73.5	54.4	-:-	72.1	70.8	59.6	54.8	54.6	----	-----	3715352.3		65.3
657	9/10/2025	19:28:21	00d	01:00.0	69	86.8	80.8	54	-:-	75.3	72.4	56.4	54.4	54.2	----	-----	7943282.3		65.4
658	9/10/2025	19:29:21	00d	01:00.0	66.5	84.3	74.6	54.1	-:-	74.4	72.6	57.4	54.3	54.2	----	-----	4466835.9		65.2
659	9/10/2025	19:30:21	00d	01:00.0	62.1	79.9	72.4	54	-:-	70.3	66.7	55.2	54.4	54.2	----	-----	1621810.1		65.2
660	9/10/2025	19:31:21	00d	01:00.0	61.8	79.6	71.4	54.9	-:-	70.5	66.7	55.8	55.3	55.2	----	-----	1513561.2		65.2
661	9/10/2025	19:32:21	00d	01:00.0	65.1	82.9	73.8	55.5	-:-	72.5	70.9	56.5	55.8	55.7	----	-----	3235936.6		65.2
662	9/10/2025	19:33:21	00d	01:00.0	65.7	83.5	71.6	55.9	-:-	71.9	71.2	59.4	56.6	56.2	----	-----	3715352.3		65.3
663	9/10/2025	19:34:21	00d	01:00.0	62.2	80	73	55.7	-:-	69	66.9	56.4	55.9	55.8	----	-----	1659586.9		65.3
664	9/10/2025	19:35:21	00d	01:00.0	62.7	80.5	72.1	55.8	-:-	71.7	68.7	56.5	56.1	55.9	----	-----	1862087.1		65.3
665	9/10/2025	19:36:21	00d	01:00.0	65.1	82.9	75	56	-:-	72.2	70.5	57.2	56.4	56.3	----	-----	3235936.6		65.4
666	9/10/2025	19:37:21	00d	01:00.0	64.1	81.9	74.8	56.2	-:-	73.1	67.2	57.1	56.6	56.5	----	-----	2570395.8		65.4
667	9/10/2025	19:38:21	00d	01:00.0	68.7	86.5	78.2	56.5	-:-	77.2	72.5	62.5	56.9	56.8	----	-----	7413102.4		65.4
668	9/10/2025	19:39:21	00d	01:00.0	63.5	81.3	72	56.2	-:-	71.2	69.6	57.4	56.6	56.5	----	-----	2238721.1		65.2
669	9/10/2025	19:40:21	00d	01:00.0	64.6	82.4	73.4	56.6	-:-	71.8	70.8	59.3	56.8	56.7	----	-----	2884031.5		65.3
670	9/10/2025	19:41:21	00d	01:00.0	65.6	83.4	72.3	57.6	-:-	72.1	70.3	61.6	58.2	57.8	----	-----	3630780.5		65.3
671	9/10/2025	19:42:21	00d	01:00.0	65.8	83.6	74.2	58.1	-:-	73.7	71.1	59.6	58.2	58.2	----	-----	3801894.0		65.2
672	9/10/2025	19:43:21	00d	01:00.0	67.8	85.6	76.5	58.4	-:-	75.2	70.9	65.4	59.4	59.1	----	-----	6025595.9		65.1
673	9/10/2025	19:44:21	00d	01:00.0	68.3	86.1	79.4	57.5	-:-	74.8	73.1	58.7	57.7	57.6	----	-----	6760829.8		65.1
674	9/10/2025	19:45:21	00d	01:00.0	67.1	84.9	73.5	57.1	-:-	72.8	71.1	63.5	57.7	57.4	----	-----	5128613.8		64.9
675	9/10/2025	19:46:21	00d	01:00.0	65.2	83	74.9	56.5	-:-	72.5	70.3	57.9	56.8	56.6	----	-----	3311311.2		64.8
676	9/10/2025	19:47:21	00d	01:00.0	63.8	81.6	72.8	56.4	-:-	72.6	67.8	57.2	56.6	56.5	----	-----	2398832.9		64.8
677	9/10/2025	19:48:21	00d	01:00.0	69.9	87.7	81.8	56.7	-:-	77.8	72.7	58.1	57	56.8	----	-----	9772372.2		64.7
678	9/10/2025	19:49:21	00d	01:00.0	65.3	83.1	75.6	56.6	-:-	74.9	70.2	57.2	56.8	56.7	----	-----	3388441.6		64.5
679	9/10/2025	19:50:21	00d	01:00.0	63.6	81.4	72.8	56.7	-:-	71	67.4	57.6	56.9	56.9	----	-----	2290867.7		64.5
680	9/10/2025	19:51:21	00d	01:00.0	65.2	83	73.1	56.6	-:-	72.4	70.9	58.2	57.1	57	----	-----	3311311.2		64.5
681	9/10/2025	19:52:21	00d	01:00.0	61.2	79	71.8	56.6	-:-	68.1	62.5	57.1	56.8	56.8	----	-----	1318256.7		64.5
682	9/10/2025	19:53:21	00d	01:00.0	63.9	81.7	74	56.5	-:-	72.5	68.5	57.1	56.7	56.6	----	-----	2454708.9		64.5
683	9/10/2025	19:54:21	00d	01:00.0	62.5	80.3	72.1	56.8	-:-	70.4	65.2	57.5	57.2	57	----	-----	1778279.4		64.6
684	9/10/2025	19:55:21	00d	01:00.0	58.5	76.3	68.7	56.3	-:-	60.7	57.9	57	56.7	56.5	----	-----	707945.8		64.5
685	9/10/2025	19:56:21	00d	01:00.0	63	80.8	73.2	56.1	-:-	71.4	67.4	57.2	56.4	56.2	----	-----	1995262.3		64.5
686	9/10/2025	19:57:21	00d	01:00.0	67.5	85.3	74.3	57	-:-	74.2	73.1	61.5	57.4	57.2	----	-----	5623413.3		64.5
687	9/10/2025	19:58:21	00d	01:00.0	60.9	78.7	71.4	56.9	-:-	69	62.7	57.6	57.1	57	----	-----	1230268.8		64.4
688	9/10/2025	19:59:21	00d	01:00.0	66	83.8	74.8	56.7	-:-	74.3	71.9	58.1	57.1	57	----	-----	3981071.7		64.4
689	9/10/2025	20:00:21	00d	01:00.0	64.5	82.3	71.5	56.4	-:-	71	70.3	57.5	56.8	56.8	----	-----	2818382.9		64.3
690	9/10/2025	20:01:21	00d	01:00.0	65.7	83.5	72.1	56.9	-:-	72.4	71.4	61.3	57.2	57.1	----	-----	3715352.3		64.3
691	9/10/2025	20:02:21	00d	01:00.0	64.5	82.3	75.2	55.8	-:-	73.6	68.7	56.9	56.2	56	----	-----	2818382.9		64.2
692	9/10/2025	20:03:21	00d	01:00.0	60.8	78.6	72.2	55	-:-	69.2	62.3	55.9	55.4	55.3	----	-----	1202264.4		64.2
693	9/10/2025	20:04:21	00d	01:00.0	66	83.8	75.7	56	-:-	73.7	70.7	57.8	56.2	56	----	-----	3981071.7		64.1
694	9/10/2025	20:05:21	00d	01:00.0	65.7	83.5	73.5	57	-:-	72.6	71.2	59.6	57.3	57.1	----	-----	3715352.3		64.1
695	9/10/2025	20:06:21	00d	01:00.0	66.6	84.4	75.7	56.4	-:-	75.3	72.2	57.4	56.7	56.6	----	-----	4570881.9		64.1
696	9/10/2025	20:07:21	00d	01:00.0	64.9	82.7	71.5	56.8	-:-	71.4	70.4	60.4	57.2	57	----	-----	3090295.4		63.9
697	9/10/2025	20:08:21	00d	01:00.0	69.9	87.7	83.4	56.3	-:-	77.5	71.5	58	56.7	56.5	----	-----	9772372.2		63.9
698	9/10/2025	20:09:21	00d	01:00.0	63.3	81.1	70.6	56.2	-:-	70.2	68.2	57.9	56.4	56.3	----	-----	2137962.1		63.6
699	9/10/2025	20:10:21	00d	01:00.0	63.5	81.3	71.6	56.3	-:-	70	69.8	58.2	56.7	56.6	----	-----	2238721.1		63.6
700	9/10/2025	20:11:21	00d	01:00.0	63.7	81.5	73.1	55.7	-:-	71.1	68.7	57	56	55.8	----	-----	2344228.8		63.5
701	9/10/2025	20:12:21	00d	01:00.0	59.7	77.5	70.6	55.6	-:-	67.6	61	56.1	55.7	55.7	----	-----	933254.3		63.5
702	9/10/2025	20:13:21	00d	01:00.0	62.3	80.1	72.5	55.4	-:-	71.5	66.1	56	55.7	55.5	----	-----	1698243.7		63.5
703	9/10/2025	20:14:21	00d	01:00.0	64.4	82.2	73.4	55.8	-:-	71.3	69.2	57.9	56.1	56	----	-----	2754228.7		63.5
704	9/10/2025	20:15:21	00d	01:00.0	56	73.8	56.6	55.4	-:-	56.3	56.2	56	55.7	55.6	----	-----	398107.2		63.5
705	9/10/2025	20:16:21	00d	01:00.0	62.8	80.6	72.6	55.6	-:-	70.9	68.3	56.4	55.8	55.7	----	-----	1905460.7		63.5
706	9/10/2025	20:17:21	00d	01:00.0	59.8	77.6	69.8	55.1	-:-	68.1	62.6	55.9	55.5	55.4	----	-----	954992.6		63.6
707	9/10/2025	20:18:21	00d	01:00.0	62.5	80.3	71.3	55.7	-:-	69.7	67.4	57.2	56	55.8	----	-----	1778279.4		63.6
708	9/10/2025	20:19:21	00d	01:00.0	64.5	82.3	73.3	55.5	-:-	72.3	70.5	56.4	55.8	55.7	----	-----	2818382.9		63.5
709	9/10/2025	20:20:21	00d	01:00.0	63.8	81.6	74.8	55.5	-:-	71.7	67.7	56.5	55.8	55.7	----	-----	2398832.9		63.5
710	9/10/2025	20:21:21	00d	01:00.0	65.4	83.2	72.6	55.8	-:-	72.8	71.4	59.6	56.3	56	----	-----	3467368.5		63.4
711	9/10/2025	20:22:21	00d	01:00.0	66	83.8	75.7	56.2	-:-	73.3	71.7	57.9	56.4	56.4	----	-----	3981071.7		63.4
712	9/10/2025	20:23:21	00d	01:00.0	65.8	83.6	77.4	55.6	-:-	73.3	70.1	56.5	55.8	55.8	----	-----	3801894.0		63.4
713	9/10/2025	20:24:21	00d	01:00.0	69.6	87.4	79.2	55.6	-:-	76.9	75.1	59.9	56	55.8	----	-----	9120108.4		63.3
714	9/10/2025	20:25:21	00d	01:00.0	63.8	81.6	72.9	55	-:-	71.5	70.8	57.2	55.4	55.4	----	-----	2398832.9		62.9
715	9/10/2025	20:26:21	00d	01:00.0	68.3	86.1	76.6	56.2	-:-	75.4	73	63	56.7	56.6	----	-----	6760829.8		62.9
716	9/10/2025	20:27:21	00d	01:00.0	63.4	81.2	71.6	54.8	-:-	71.4	68.8	56.8	55.2	55.2	----	-----	2187761.6		62.7
717	9/10/2025	20:28:21	00d	01:00.0	68.5	86.3	76.5	55.3	-:-	76.5	73.8	58.9	55.6	55.5	----	-----	7079457.8		62.6
718	9/10/2025	20:29:21	00d	01:00.0	60.7	78.5	69.2	54.9	-:-	68.3	66	55.7	55.3	55.2	----	-----	1174897.6		62.3
719	9/10/2025	20:30:21	00d	01:00.0	61.6	79.4	70.2	55.1	-:-	69.3	67.5	56	55.4	55.3	----	-----	1445439.8		62.4
720	9/10/2025	20:31:21	00d	01:00.0	65.9	83.7	74.7	54.7	-:-	73.5	71.2	56.8	55.1	54.9	----	-----	3890451.4		62.4
721	9/10/2025	20:32:21	00d	01:00.0	64.7	82.5	74.9	54.9	-:-	73.9	68.5	56.4	55.1	55	----	-----	2951209.2		62.3
722	9/10/2025	20:33:21	00d	01:00.0	67	84.8	75.4	54.8	-:-	75	73.2	56.8	55.3	55.1	----	-----	5011872.3		62.2
723	9/10/2025	20:34:21	00d	01:00.0	66.7	84.5	76.1	55.1	-:-	73.9	72.6	57.7	55.3	55.1	----	-----	4677351.4		62.1
724	9/10/2025	20:35:21	00d	01:00.0	65.5	83.3	73.4	55.5	-:-	72.3	71.4	60.2	55.9	55.7	----	-----	3548133.9		61.9
725	9/10/2025	20:36:21	00d	01:00.0	66	83.8	75.7	55.3	-:-	73.8	71.7	56.5	55.6	55.5	----	-----	3981071.7		61.9
726	9/10/2025	20:37:21	00d	01:00.0	63.9	81.7	73.8	55	-:-	72.5	68.4	56	55.5	55.4	----	-----	2454708.9		61.7
727	9/10/2025	20:38:21	00d	01:00.0	63.9	81.7	76.2	55.3	-:-	71	68.6	55.9	55.6	55.4	----	-----	2454708.9		61.6
728	9/10/2025	20:39:21	00d	01:00.0	62.3	80.1	76.4	55.1	-:-	69.8	61.4	55.6	55.3	55.1	----	-----	1698243.7		61.5
729	9/10/2025	20:40:21	00d	01:00.0	65.4	83.2	75.5	54.9	-:-	74.7	71.1	56.4	55.3	55.2	----	-----	3467368.5		61.5
730	9/10/2025	20:41:21	00d	01:00.0	63.4	81.2	72.1	55.1	-:-	72	68.7	56.7	55.3	55.3	----	-----	2187761.6		61.3
731	9/10/2025	20:42:21	00d	01:00.0	55.2	73	55.7	54.7	-:-	55.6	55.5	55.2	55	54.9	----	-----	331131.1		61.2
732	9/10/2025	20:43:21	00d	01:00.0	57.6	75.4	66.3	54.4	-:-	64.7	60.4	55	54.7	54.5	----	-----	575439.9		61.2
733	9/10/2025	20:44:21	00d	01:00.0	64.8	82.6	78	54.3	-:-	71.8	63.6	54.8	54.5	54.4	----	-----	3019951.7		61.3
734	9/10/2025	20:45:21	00d	01:00.0	59.4	77.2	69.4	54.5	-:-	68	62.4	55.1	54.7	54.6	----	-----	870963.6		61.2
735	9/10/2025	20:46:21	00d	01:00.0	60.3	78.1	70.9	54.6	-:-	67.6	63.6	55.3	54.9	54.9	----	-----	1071519.3		61.2
736	9/10/2025	20:47:21	00d	01:00.0	61.2	79	69.5	54.7	-:-	68.4	66.8	55.6	54.9	54.9	----	-----	1318256.7		61.3
737	9/10/2025	20:48:21	00d	01:00.0	60.9	78.7	69.8	54.6	-:-	68.2	66.4	55.6	55.1	55	----	-----	1230268.8		61.4
738	9/10/2025	20:49:21	00d	01:00.0	61	78.8	72.6	54.4	-:-	68.3	63.3	55	54.6	54.5	----	-----	1258925.4		61.4
739	9/10/2025	20:50:21	00d	01:00.0	54.6	72.4	55.1	54.3	-:-	55	54.9	54.7	54.5	54.4	----	-----	288403.2		61.3
740	9/10/2025	20:51:21	00d	01:00.0	63.3	81.1	71.7	54.6	-:-	71.1	70.2	55.1	54.9	54.8	----	-----	2137962.1		61.4
741	9/10/2025	20:52:21	00d	01:00.0	65.6	83.4	75.1	54.5	-:-	74.9	70.7	56.6	55	54.9	----	-----	3630780.5		61.3
742	9/10/2025	20:53:21	00d	01:00.0	66.2	84	72.9	55.1	-:-	72.1	71.4	61.9	56.3	55.5	----	-----	4168693.8		61.3
743	9/10/2025	20:54:21	00d	01:00.0	65.8	83.6	74.2	54.7	-:-	72	71	59.4	56.2	55.4	----	-----	3801894.0		61.2
744	9/10/2025	20:55:21	00d	01:00.0	54.9	72.7	55.4	54.4	-:-	55.3	55.2	54.9	54.6	54.5	----	-----	309029.5		61.1
745	9/10/2025	20:56:21	00d	01:00.0	60.8	78.6	72.2	54.5	-:-	68.1	63.1	55.2	54.9	54.8	----	-----	1202264.4		61.1
746	9/10/2025	20:57:21	00d	01:00.0	61.8	79.6	72.5	54.5	-:-	69.3	65.7	55.2	54.7	54.7	----	-----	1513561.2		61.1
747	9/10/2025	20:58:21	00d	01:00.0	55.2	73	55.7	54.6	-:-	55.6	55.5	55.1	54.9	54.9	----	-----	331131.1		61.1
748	9/10/2025	20:59:21	00d	01:00.0	54.9	72.7	55.4	54.5	-:-	55.4	55.3	54.9	54.6	54.6	----	-----	309029.5		61.1
749	9/10/2025	21:00:21	00d	01:00.0	63.8	81.6	73.7	54.4	-:-	71.5	70.6	55.7	54.5	54.4	----	-----	2398832.9		61.1
750	9/10/2025	21:01:21	00d	01:00.0	56.6	74.4	66.8	54	-:-	61.1	56.3	54.6	54.2	54.2	----	-----	457088.2		61.0
751	9/10/2025	21:02:21	00d	01:00.0	59.9	77.7	71	54.2	-:-	68.6	60.9	54.9	54.5	54.4	----	-----	977237.2		61.0
752	9/10/2025	21:03:21	00d	01:00.0	60.8	78.6	72.5	54.6	-:-	69.4	60.7	55.2	54.8	54.8	----	-----	1202264.4		61.0
753	9/10/2025	21:04:21	00d	01:00.0	55.4	73.2	61.6	54.3	-:-	57	55.6	54.9	54.5	54.4	----	-----	346736.9		61.0
754	9/10/2025	21:05:21	00d	01:00.0	65.4	83.2	73.4	54.7	-:-	73	70.8	58	55.1	54.9	----	-----	3467368.5		61.0
755	9/10/2025	21:06:21	00d	01:00.0	62.6	80.4	74.5	54.6	-:-	70.5	64.6	55.5	54.9	54.8	----	-----	1819700.9		60.8
756	9/10/2025	21:07:21	00d	01:00.0	55.2	73	55.9	54.7	-:-	55.6	55.5	55.3	55	55	----	-----	331131.1		60.7
757	9/10/2025	21:08:21	00d	01:00.0	59.2	77	69.7	54.6	-:-	66.5	61.8	55.2	54.8	54.7	----	-----	831763.8		60.8
758	9/10/2025	21:09:21	00d	01:00.0	55.1	72.9	55.6	54.3	-:-	55.5	55.4	55.1	54.8	54.5	----	-----	323593.7		60.8
759	9/10/2025	21:10:21	00d	01:00.0	60.6	78.4	72.8	54.5	-:-	66.8	61.3	55.1	54.8	54.8	----	-----	1148153.6		61.2
760	9/10/2025	21:11:21	00d	01:00.0	55.4	73.2	60.4	54.7	-:-	57.5	55.6	55.1	54.9	54.8	----	-----	346736.9		61.2

761	9/10/2025	21:12:21	00d	01:00.0	65.3	83.1	75.4	54.7	-:-	72.7	71.3	56.3	55	55	----	-----	3388441.6	61.2
762	9/10/2025	21:13:21	00d	01:00.0	55.1	72.9	55.5	54.4	-:-	55.4	55.4	55.1	54.8	54.6	----	-----	323593.7	61.1
763	9/10/2025	21:14:21	00d	01:00.0	63.7	81.5	72.1	54.8	-:-	71.8	69.1	56.5	55.1	55	----	-----	2344228.8	61.2
764	9/10/2025	21:15:21	00d	01:00.0	62.3	80.1	70.2	54.7	-:-	70	68.1	56.4	55.1	55	----	-----	1698243.7	61.1
765	9/10/2025	21:16:21	00d	01:00.0	61.5	79.3	71.2	54.8	-:-	68.6	67.9	55.6	55.1	54.9	----	-----	1412537.5	61.0
766	9/10/2025	21:17:21	00d	01:00.0	64.4	82.2	73.1	54.9	-:-	73	71.8	55.5	55.1	55.1	----	-----	2754228.7	60.9
767	9/10/2025	21:18:21	00d	01:00.0	58.9	76.7	69.5	54.5	-:-	65	61.4	55	54.7	54.6	----	-----	776247.1	60.8
768	9/10/2025	21:19:21	00d	01:00.0	58.5	76.3	68.6	54.5	-:-	67	59.4	55.2	54.8	54.7	----	-----	707945.8	60.8
769	9/10/2025	21:20:21	00d	01:00.0	60	77.8	71.5	54.6	-:-	69.2	62	55.2	54.8	54.7	----	-----	1000000.0	60.8
770	9/10/2025	21:21:21	00d	01:00.0	60.2	78	71.1	54.2	-:-	67.3	63.6	54.7	54.5	54.4	----	-----	1047128.5	60.8
771	9/10/2025	21:22:21	00d	01:00.0	65.9	83.7	76.9	54	-:-	76.1	69.9	54.7	54.2	54.2	----	-----	3890451.4	60.7
772	9/10/2025	21:23:21	00d	01:00.0	62.8	80.6	70.7	54.2	-:-	70.4	68.9	55.8	54.5	54.4	----	-----	1905460.7	60.8
773	9/10/2025	21:24:21	00d	01:00.0	54.9	72.7	57.1	54.1	-:-	55.6	55.4	54.9	54.5	54.4	----	-----	309029.5	60.8
774	9/10/2025	21:25:21	00d	01:00.0	54.4	72.2	54.9	53.8	-:-	54.8	54.7	54.4	54	54	----	-----	275422.9	60.8
775	9/10/2025	21:26:21	00d	01:00.0	54.4	72.2	55	53.9	-:-	54.9	54.7	54.4	54.1	54	----	-----	275422.9	60.9
776	9/10/2025	21:27:21	00d	01:00.0	59.8	77.6	70.9	54.4	-:-	68	62.1	54.9	54.5	54.5	----	-----	954992.6	60.9
777	9/10/2025	21:28:21	00d	01:00.0	60.6	78.4	72.9	54.4	-:-	68.7	61.1	55	54.6	54.5	----	-----	1148153.6	61.0
778	9/10/2025	21:29:21	00d	01:00.0	55	72.8	60.4	54.1	-:-	57	55.1	54.6	54.3	54.3	----	-----	316227.8	61.0
779	9/10/2025	21:30:21	00d	01:00.0	64.8	82.6	73.5	54.3	-:-	71.8	70.1	57.9	54.6	54.5	----	-----	3019951.7	61.0
780	9/10/2025	21:31:21	00d	01:00.0	63	80.8	71.6	54.1	-:-	71.5	69.8	55.5	54.4	54.2	----	-----	1995262.3	60.9
781	9/10/2025	21:32:21	00d	01:00.0	57.5	75.3	66.6	54	-:-	64.8	59.5	54.9	54.4	54.2	----	-----	562341.3	60.9
782	9/10/2025	21:33:21	00d	01:00.0	61.7	79.5	71.7	54.1	-:-	70	66	54.9	54.4	54.2	----	-----	1479108.4	60.8
783	9/10/2025	21:34:21	00d	01:00.0	59.3	77.1	71.3	53.5	-:-	67.1	58.1	54.3	53.8	53.8	----	-----	851138.0	60.8
784	9/10/2025	21:35:21	00d	01:00.0	57.1	74.9	66.8	53.8	-:-	65	58.4	54.4	54	53.9	----	-----	512861.4	60.8
785	9/10/2025	21:36:21	00d	01:00.0	65.1	82.9	74.9	53.5	-:-	73.5	70.5	54.5	53.9	53.8	----	-----	3235936.6	60.9
786	9/10/2025	21:37:21	00d	01:00.0	54.3	72.1	54.8	53.9	-:-	54.8	54.6	54.3	54.1	54	----	-----	269153.5	60.8
787	9/10/2025	21:38:21	00d	01:00.0	54	71.8	54.5	53.3	-:-	54.4	54.4	53.9	53.6	53.4	----	-----	251188.6	60.8
788	9/10/2025	21:39:21	00d	01:00.0	54.4	72.2	55	53.9	-:-	54.9	54.7	54.5	54.1	54	----	-----	275422.9	60.8
789	9/10/2025	21:40:21	00d	01:00.0	61.9	79.7	71.7	54.1	-:-	71.6	66	55.1	54.3	54.2	----	-----	1548816.6	60.8
790	9/10/2025	21:41:21	00d	01:00.0	59.5	77.3	70.7	53.6	-:-	67.2	61.7	54.2	53.9	53.7	----	-----	891250.9	60.7
791	9/10/2025	21:42:21	00d	01:00.0	53.9	71.7	54.4	53.4	-:-	54.4	54.3	53.9	53.6	53.6	----	-----	245470.9	60.7
792	9/10/2025	21:43:21	00d	01:00.0	56.9	74.7	68.8	53.5	-:-	62.5	54.8	54.1	53.7	53.7	----	-----	489778.8	60.8
793	9/10/2025	21:44:21	00d	01:00.0	64.7	82.5	74.9	53.6	-:-	71.5	70.8	54.8	53.9	53.7	----	-----	2951209.2	60.9
794	9/10/2025	21:45:21	00d	01:00.0	54.6	72.4	58.4	53.9	-:-	55.2	55.1	54.5	54.1	54.1	----	-----	288403.2	60.8
795	9/10/2025	21:46:21	00d	01:00.0	58.9	76.7	68	54	-:-	67.2	63.6	54.6	54.3	54.2	----	-----	776247.1	60.8
796	9/10/2025	21:47:21	00d	01:00.0	65.6	83.4	77.5	53.5	-:-	74.3	68.8	55.2	53.8	53.7	----	-----	3630780.5	60.7
797	9/10/2025	21:48:21	00d	01:00.0	64.3	82.1	72.7	53.6	-:-	71.5	70.9	56.1	53.9	53.8	----	-----	2691534.8	60.5
798	9/10/2025	21:49:21	00d	01:00.0	55.5	73.3	70.9	54	-:-	57.9	55.2	54.5	54.2	54.1	----	-----	354813.4	60.4
799	9/10/2025	21:50:21	00d	01:00.0	60	77.8	71.4	53.9	-:-	67.3	61	54.5	54.2	54.2	----	-----	1000000.0	60.5
800	9/10/2025	21:51:21	00d	01:00.0	62.9	80.7	74.3	54	-:-	71.8	65.7	55	54.3	54.3	----	-----	1949844.6	60.5
801	9/10/2025	21:52:21	00d	01:00.0	54.5	72.3	62.2	53.9	-:-	55	54.9	54.5	54.2	54.1	----	-----	281838.3	60.4
802	9/10/2025	21:53:21	00d	01:00.0	64.7	82.5	78.5	53.3	-:-	71.4	63.6	54.2	53.8	53.8	----	-----	2951209.2	60.4
803	9/10/2025	21:54:21	00d	01:00.0	62.6	80.4	77.4	53.6	-:-	65.5	57.6	54.1	53.7	53.7	----	-----	1819700.9	60.2
804	9/10/2025	21:55:21	00d	01:00.0	63.2	81	78.6	52.9	-:-	69.6	60.3	53.5	53.1	53.1	----	-----	2089296.1	60.2
805	9/10/2025	21:56:21	00d	01:00.0	59.4	77.2	71.1	53	-:-	66.2	62.9	53.5	53.2	53.1	----	-----	870963.6	60.0
806	9/10/2025	21:57:21	00d	01:00.0	61.4	79.2	71.4	53	-:-	70.5	66.7	53.7	53.4	53.2	----	-----	1380384.3	60.0
807	9/10/2025	21:58:21	00d	01:00.0	60.5	78.3	71.9	53.2	-:-	68.3	63.3	54.2	53.8	53.5	----	-----	1122018.5	59.9
808	9/10/2025	21:59:21	00d	01:00.0	53.3	71.1	54.2	52.5	-:-	53.8	53.8	53.3	52.8	52.7	----	-----	213796.2	59.9
809	9/10/2025	22:00:21	00d	01:00.0	53.5	71.3	53.9	53.1	-:-	53.9	53.8	53.5	53.3	53.2	----	-----	223872.1	59.9
810	9/10/2025	22:01:21	00d	01:00.0	58.8	76.6	69.6	53.2	-:-	66.3	62.1	53.7	53.3	53.2	----	-----	758577.6	59.9
811	9/10/2025	22:02:21	00d	01:00.0	59.2	77	71.4	53.3	-:-	66.3	59.9	53.8	53.6	53.4	----	-----	831763.8	59.9
812	9/10/2025	22:03:21	00d	01:00.0	53.6	71.4	54.1	52.7	-:-	54	53.9	53.6	53.2	52.9	----	-----	229086.8	59.8
813	9/10/2025	22:04:21	00d	01:00.0	61.1	78.9	73.4	52.4	-:-	71	62.3	53	52.6	52.5	----	-----	1288249.6	59.8
814	9/10/2025	22:05:21	00d	01:00.0	52.9	70.7	53.3	52.5	-:-	53.2	53.2	52.9	52.7	52.7	----	-----	194984.5	59.7
815	9/10/2025	22:06:21	00d	01:00.0	60.7	78.5	73.9	52.5	-:-	66.8	59.3	53.2	52.8	52.7	----	-----	1174897.6	59.7
816	9/10/2025	22:07:21	00d	01:00.0	53.4	71.2	54.1	52.8	-:-	53.9	53.7	53.3	53.1	53	----	-----	218776.2	59.7
817	9/10/2025	22:08:21	00d	01:00.0	61.9	79.7	73.7	52.9	-:-	72	64.7	54.2	53.2	53.2	----	-----	1548816.6	59.7
818	9/10/2025	22:09:21	00d	01:00.0	53.7	71.5	54.3	53.1	-:-	54.2	54.2	53.8	53.3	53.2	----	-----	234422.9	59.6
819	9/10/2025	22:10:21	00d	01:00.0	68.7	86.5	80.8	53.6	-:-	77.5	72.3	55.8	54	53.9	----	-----	7413102.4	59.5
820	9/10/2025	22:11:21	00d	01:00.0	61.6	79.4	74.6	53.6	-:-	69.3	58.1	54.2	53.8	53.7	----	-----	1445439.8	59.0
821	9/10/2025	22:12:21	00d	01:00.0	57.7	75.5	69.4	53.5	-:-	63	55.5	54.2	53.7	53.6	----	-----	588843.7	59.0
822	9/10/2025	22:13:21	00d	01:00.0	59.8	77.6	71	53.4	-:-	68.6	61.1	54	53.6	53.6	----	-----	954992.6	59.1
823	9/10/2025	22:14:21	00d	01:00.0	64.3	82.1	75.1	53.6	-:-	73.6	69.6	54.6	53.8	53.8	----	-----	2691534.8	59.0
824	9/10/2025	22:15:21	00d	01:00.0	53.7	71.5	54.6	53.2	-:-	54.4	54.2	53.7	53.4	53.3	----	-----	234422.9	58.8
825	9/10/2025	22:16:21	00d	01:00.0	53.8	71.6	54.2	53.2	-:-	54.2	54.1	53.8	53.4	53.3	----	-----	239883.3	58.8
826	9/10/2025	22:17:21	00d	01:00.0	53.8	71.6	54.6	53.2	-:-	54.4	54.2	53.7	53.4	53.3	----	-----	239883.3	58.8
827	9/10/2025	22:18:21	00d	01:00.0	59.1	76.9	70.1	53.1	-:-	68	61.6	53.9	53.5	53.3	----	-----	812830.5	58.8
828	9/10/2025	22:19:21	00d	01:00.0	59.3	77.1	70.2	53.5	-:-	68.1	61.5	54.1	53.7	53.7	----	-----	851138.0	58.8
829	9/10/2025	22:20:21	00d	01:00.0	54	71.8	54.5	53.4	-:-	54.5	54.4	54	53.7	53.6	----	-----	251188.6	58.7
830	9/10/2025	22:21:21	00d	01:00.0	53.7	71.5	54.3	53.2	-:-	54.1	54.1	53.7	53.4	53.4	----	-----	234422.9	58.7
831	9/10/2025	22:22:21	00d	01:00.0	58.1	75.9	67.5	53.4	-:-	64.8	61.4	54.1	53.8	53.6	----	-----	645654.2	58.7
832	9/10/2025	22:23:21	00d	01:00.0	67.1	84.9	77.7	53.4	-:-	74.4	71.6	55.8	53.7	53.5	----	-----	5128613.8	58.7
833	9/10/2025	22:24:21	00d	01:00.0	61.2	79	70.5	53	-:-	70.7	66.9	54.3	53.4	53.2	----	-----	1318256.7	58.2
834	9/10/2025	22:25:21	00d	01:00.0	53.2	71	53.7	52.8	-:-	53.6	53.5	53.2	53	53	----	-----	208929.6	58.1
835	9/10/2025	22:26:21	00d	01:00.0	63	80.8	76	52.9	-:-	72.3	63.3	54.2	53.6	53.2	----	-----	1995262.3	58.1
836	9/10/2025	22:27:21	00d	01:00.0	54.1	71.9	54.6	53.5	-:-	54.5	54.4	54.2	53.8	53.8	----	-----	257039.6	57.9
837	9/10/2025	22:28:21	00d	01:00.0	65.5	83.3	76.3	53.4	-:-	73.9	70.8	54.2	53.7	53.6	----	-----	3548133.9	57.9
838	9/10/2025	22:29:21	00d	01:00.0	60.1	77.9	71.1	53.3	-:-	69.8	64.8	54	53.5	53.4	----	-----	1023293.0	57.6
839	9/10/2025	22:30:21	00d	01:00.0	59.5	77.3	71.2	53.4	-:-	66.8	61	54.2	53.7	53.6	----	-----	891250.9	57.7
840	9/10/2025	22:31:21	00d	01:00.0	54.2	72	54.7	53.5	-:-	54.6	54.5	54.3	54	53.9	----	-----	263026.8	57.6
841	9/10/2025	22:32:21	00d	01:00.0	61.1	78.9	71.1	53.6	-:-	69.9	65.8	54.5	53.9	53.9	----	-----	1288249.6	57.6
842	9/10/2025	22:33:21	00d	01:00.0	54.1	71.9	54.6	53.4	-:-	54.5	54.4	54.1	53.8	53.7	----	-----	257039.6	57.5
843	9/10/2025	22:34:21	00d	01:00.0	54.1	71.9	54.5	53.5	-:-	54.4	54.4	54.1	53.7	53.6	----	-----	257039.6	57.5
844	9/10/2025	22:35:21	00d	01:00.0	61.9	79.7	72.2	53.7	-:-	70.4	66.7	54.5	53.9	53.9	----	-----	1548816.6	57.7
845	9/10/2025	22:36:21	00d	01:00.0	61.2	79	73.2	53.2	-:-	70.3	63	54.1	53.5	53.3	----	-----	1318256.7	57.5
846	9/10/2025	22:37:21	00d	01:00.0	64.3	82.1	76.2	52.9	-:-	72.5	68.4	53.9	53.1	53	----	-----	2691534.8	57.4
847	9/10/2025	22:38:21	00d	01:00.0	53.6	71.4	55.3	52.9	-:-	54.1	54	53.6	53.2	53.1	----	-----	229086.8	57.1
848	9/10/2025	22:39:21	00d	01:00.0	53.4	71.2	54.1	52.8	-:-	54	53.8	53.5	53.1	53	----	-----	218776.2	57.2
849	9/10/2025	22:40:21	00d	01:00.0	53.8	71.6	54.5	53.1	-:-	54.4	54.3	53.8	53.4	53.2	----	-----	239883.3	57.1
850	9/10/2025	22:41:21	00d	01:00.0	53.7	71.5	54.6	53	-:-	54.3	54.2	53.7	53.2	53	----	-----	234422.9	57.1
851	9/10/2025	22:42:21	00d	01:00.0	53.4	71.2	54.1	52.9	-:-	54	53.8	53.4	53.1	53.1	----	-----	218776.2	57.1
852	9/10/2025	22:43:21	00d	01:00.0	61.5	79.3	74	53.3	-:-	68.7	63.1	53.9	53.6	53.5	----	-----	1412537.5	57.1
853	9/10/2025	22:44:21	00d	01:00.0	63.9	81.7	74.8	52.9	-:-	72.5	67.6	54.4	53.3	53.2	----	-----	2454708.9	56.9
854	9/10/2025	22:45:21	00d	01:00.0	59.6	77.4	71.2	52.7	-:-	67.6	61.7	53.3	52.9	52.9	----	-----	912010.8	56.6
855	9/10/2025	22:46:21	00d	01:00.0	57.9	75.7	68.4	52.4	-:-	65.6	60.8	53.1	52.6	52.5	----	-----	616595.0	56.4
856	9/10/2025	22:47:21	00d	01:00.0	52.8	70.6	53.5	52.4	-:-	53.3	53.2	52.9	52.5	52.4	----	-----	190546.1	56.6
857	9/10/2025	22:48:21	00d	01:00.0	52.6	70.4	53.4	52.1	-:-	53.2	53	52.6	52.3	52.1	----	-----	181970.1	56.6
858	9/10/2025	22:49:21	00d	01:00.0	61.3	79.1	73.8	52.3	-:-	68.7	62.7	53.2	52.6	52.6	----	-----	1348962.9	56.8
859	9/10/2025	22:50:21	00d	01:00.0	60.7	78.5	73.1	52.1	-:-	68.1	60.1	52.8	52.4	52.3	----	-----	1174897.6	56.6
860	9/10/2025	22:51:21	00d	01:00.0	61	78.8	70.4	52.2	-:-	69.5	66.3	52.8	52.5	52.4	----	-----	1258925.4	56.4
861	9/10/2025	22:52:21	00d	01:00.0	52.3	70.1	52.8	51.8	-:-	52.7	52.7	52.3	52	51.9	----	-----	169824.4	56.5
862	9/10/2025	22:53:21	00d	01:00.0	52.5	70.3	53.1	51.6	-:-	53	52.8	52.6	52.1	51.8	----	-----	177827.9	56.5
863	9/10/2025	22:54:21	00d	01:00.0	52.8	70.6	56.6	52.1	-:-	54.5	52.9	52.6	52.3	52.3	----	-----	190546.1	56.5
864	9/10/2025	22:55:21	00d	01:00.0	59.8	77.6	72.5	51.9	-:-	68.1	59.2	52.4	52.1	52	----	-----	954992.6	56.4
865	9/10/2025	22:56:21	00d	01:00.0	54.7	72.5	60.3	51.8	-:-	59.1	57.9	52.6	52	51.9	----	-----	295120.9	56.3
866	9/10/2025	22:57:21	00d	01:00.0	52.3	70.1	52.8	51.7	-:-	52.7	52.6	52.4	52.2	52.1	----	-----	169824.4	56.3
867	9/10/2025	22:58:21	00d	01:00.0	54.7	72.5	66.1	51.8	-:-	55.9	53	52.5	52	51.9	----	-----	295120.9	56.3
868	9/10/2025	22:59:21	00d	01:00.0	61.1	78.9	73.9	51.7	-:-	70.4	59.5	52.7	52.3	52.3	----	-----	1288249.6	56.3
869	9/10/2025	23:00:21	00d	01:00.0	52.4	70.2	53.1	51.8	-:-	53	52.8	52.4	52.1	52	----	-----	173780.1	56.1

870	9/10/2025	23:01:21	00d	01:00.0	52.4	70.2	52.9	51.7	-:-	52.8	52.8	52.4	52	51.9	----	-----	173780.1	56.0
871	9/10/2025	23:02:21	00d	01:00.0	52.3	70.1	53.4	51.3	-:-	53.2	53.1	52.3	51.7	51.5	----	-----	169824.4	56.0
872	9/10/2025	23:03:21	00d	01:00.0	52.6	70.4	53.3	51.8	-:-	53.2	53.1	52.6	52.1	52	----	-----	181970.1	56.2
873	9/10/2025	23:04:21	00d	01:00.0	51.9	69.7	52.8	51	-:-	52.6	52.4	52	51.3	51.2	----	-----	154881.7	56.2
874	9/10/2025	23:05:21	00d	01:00.0	56.2	74	67.3	51	-:-	62.8	59.1	51.8	51.3	51.1	----	-----	416869.4	56.3
875	9/10/2025	23:06:21	00d	01:00.0	52.5	70.3	62.5	51.4	-:-	54.4	53.5	52	51.6	51.5	----	-----	177827.9	56.2
876	9/10/2025	23:07:21	00d	01:00.0	51.9	69.7	52.8	51.2	-:-	52.5	52.4	51.9	51.3	51.3	----	-----	154881.7	56.6
877	9/10/2025	23:08:21	00d	01:00.0	52.1	69.9	52.8	51.3	-:-	52.6	52.5	52.2	51.7	51.5	----	-----	162181.0	56.9
878	9/10/2025	23:09:21	00d	01:00.0	52.2	70	52.8	51.7	-:-	52.6	52.5	52.2	51.9	51.8	----	-----	165958.7	56.9
879	9/10/2025	23:10:21	00d	01:00.0	52.4	70.2	53.2	51.8	-:-	53.1	53	52.4	52	52	----	-----	173780.1	56.9
880	9/10/2025	23:11:21	00d	01:00.0	60.2	78	71.7	52.5	-:-	69.2	61.8	53.1	52.7	52.7	----	-----	1047128.5	57.1
881	9/10/2025	23:12:21	00d	01:00.0	59.3	77.1	70.9	52.5	-:-	68	60.9	53.2	52.8	52.8	----	-----	851138.0	56.9
882	9/10/2025	23:13:21	00d	01:00.0	63.1	80.9	74.2	52.3	-:-	71.9	68.1	53.1	52.6	52.5	----	-----	2041737.9	56.8
883	9/10/2025	23:14:21	00d	01:00.0	52.7	70.5	64.6	51.6	-:-	55.5	53.2	52.2	51.8	51.8	----	-----	186208.7	56.5
884	9/10/2025	23:15:21	00d	01:00.0	59.2	77	70.4	51.7	-:-	69.1	63.1	52.4	52	52	----	-----	831763.8	56.5
885	9/10/2025	23:16:21	00d	01:00.0	52.4	70.2	53	51.9	-:-	52.9	52.8	52.4	52.1	52	----	-----	173780.1	56.4
886	9/10/2025	23:17:21	00d	01:00.0	52.4	70.2	54.8	51.7	-:-	53.6	53.1	52.3	52	51.8	----	-----	173780.1	56.5
887	9/10/2025	23:18:21	00d	01:00.0	52.2	70	52.6	51.7	-:-	52.7	52.5	52.2	52	51.9	----	-----	165958.7	56.5
888	9/10/2025	23:19:21	00d	01:00.0	52.3	70.1	52.9	51.6	-:-	52.8	52.7	52.3	51.9	51.8	----	-----	169824.4	56.5
889	9/10/2025	23:20:21	00d	01:00.0	52.1	69.9	52.8	51.7	-:-	52.7	52.5	52.2	51.9	51.8	----	-----	162181.0	56.5
890	9/10/2025	23:21:21	00d	01:00.0	58.5	76.3	70.4	51.2	-:-	66	62	52	51.5	51.4	----	-----	707945.8	56.5
891	9/10/2025	23:22:21	00d	01:00.0	51.8	69.6	52.4	51.2	-:-	52.2	52.1	51.8	51.5	51.4	----	-----	151356.1	56.4
892	9/10/2025	23:23:21	00d	01:00.0	57.5	75.3	68.5	51.3	-:-	66.8	59.7	51.9	51.5	51.4	----	-----	562341.3	56.4
893	9/10/2025	23:24:21	00d	01:00.0	51.4	69.2	52.3	50.8	-:-	52	51.8	51.4	51.1	50.9	----	-----	138038.4	56.3
894	9/10/2025	23:25:21	00d	01:00.0	51.5	69.3	52.2	50.9	-:-	52	52	51.5	51.1	51.1	----	-----	141253.8	56.3
895	9/10/2025	23:26:21	00d	01:00.0	51.3	69.1	51.7	50.8	-:-	51.6	51.5	51.3	51	51	----	-----	134896.3	56.3
896	9/10/2025	23:27:21	00d	01:00.0	51.3	69.1	52	50.9	-:-	51.8	51.7	51.4	51	51	----	-----	134896.3	56.3
897	9/10/2025	23:28:21	00d	01:00.0	51	68.8	51.6	50.5	-:-	51.4	51.3	51	50.7	50.6	----	-----	125892.5	56.3
898	9/10/2025	23:29:21	00d	01:00.0	61.2	79	73	51	-:-	70.3	65	51.6	51.3	51.1	----	-----	1318256.7	56.3
899	9/10/2025	23:30:21	00d	01:00.0	62.1	79.9	71.8	50.8	-:-	71.7	67.9	51.6	51.1	51	----	-----	1621810.1	56.1
900	9/10/2025	23:31:21	00d	01:00.0	52	69.8	66.3	50.6	-:-	55.4	53.6	51.3	50.9	50.7	----	-----	158489.3	55.9
901	9/10/2025	23:32:21	00d	01:00.0	51.1	68.9	51.9	50.5	-:-	51.8	51.6	51.1	50.7	50.6	----	-----	128825.0	55.8
902	9/10/2025	23:33:21	00d	01:00.0	57.9	75.7	69	50.1	-:-	66	62.6	51	50.5	50.3	----	-----	616595.0	55.8
903	9/10/2025	23:34:21	00d	01:00.0	56.7	74.5	67.6	50	-:-	65.4	62.1	50.8	50.3	50.2	----	-----	467735.1	55.7
904	9/10/2025	23:35:21	00d	01:00.0	62.2	80	74.3	50	-:-	72.6	63.6	51	50.5	50.4	----	-----	1659586.9	55.8
905	9/10/2025	23:36:21	00d	01:00.0	50.6	68.4	51.2	50.2	-:-	51.1	51	50.7	50.3	50.3	----	-----	114815.4	55.5
906	9/10/2025	23:37:21	00d	01:00.0	59.4	77.2	71.3	49.9	-:-	68.6	63.7	50.5	50.1	50.1	----	-----	870963.6	55.5
907	9/10/2025	23:38:21	00d	01:00.0	51.6	69.4	64.2	49.8	-:-	55.8	52.6	50.6	49.9	49.9	----	-----	144544.0	55.3
908	9/10/2025	23:39:21	00d	01:00.0	57.7	75.5	68.9	49.8	-:-	66.3	61.1	50.6	49.9	49.9	----	-----	588843.7	55.3
909	9/10/2025	23:40:21	00d	01:00.0	50.8	68.6	53.1	50.1	-:-	51.3	51.1	50.8	50.4	50.4	----	-----	120226.4	55.2
910	9/10/2025	23:41:21	00d	01:00.0	50.8	68.6	51.4	50.2	-:-	51.3	51.3	50.8	50.6	50.5	----	-----	120226.4	55.2
911	9/10/2025	23:42:21	00d	01:00.0	51	68.8	52.3	50.5	-:-	51.8	51.4	51	50.7	50.7	----	-----	125892.5	55.3
912	9/10/2025	23:43:21	00d	01:00.0	52	69.8	53.9	50.6	-:-	53.9	53.2	51.9	51	50.8	----	-----	158489.3	55.3
913	9/10/2025	23:44:21	00d	01:00.0	51.2	69	51.8	50.9	-:-	51.7	51.5	51.2	50.9	50.9	----	-----	131825.7	55.3
914	9/10/2025	23:45:21	00d	01:00.0	51.1	68.9	51.7	50.5	-:-	51.4	51.3	51.1	50.8	50.6	----	-----	128825.0	55.3
915	9/10/2025	23:46:21	00d	01:00.0	51	68.8	51.5	50.4	-:-	51.4	51.3	51	50.8	50.7	----	-----	125892.5	55.3
916	9/10/2025	23:47:21	00d	01:00.0	62.5	80.3	75.7	50.6	-:-	72	60.4	51.1	50.8	50.7	----	-----	1778279.4	56.0
917	9/10/2025	23:48:21	00d	01:00.0	51	68.8	51.5	50.6	-:-	51.3	51.3	51	50.8	50.7	----	-----	125892.5	55.7
918	9/10/2025	23:49:21	00d	01:00.0	61.3	79.1	73.7	50.5	-:-	70.6	63.7	51.3	50.9	50.8	----	-----	1348962.9	55.7
919	9/10/2025	23:50:21	00d	01:00.0	51.1	68.9	51.6	50.5	-:-	51.5	51.5	51.1	50.8	50.7	----	-----	128825.0	55.4
920	9/10/2025	23:51:21	00d	01:00.0	51.6	69.4	52.2	51	-:-	52.2	52.1	51.7	51.3	51.2	----	-----	144544.0	55.4
921	9/10/2025	23:52:21	00d	01:00.0	61.4	79.2	73.9	51.1	-:-	71	61.6	51.8	51.4	51.4	----	-----	1380384.3	55.4
922	9/10/2025	23:53:21	00d	01:00.0	51.3	69.1	51.9	50.5	-:-	51.9	51.8	51.3	50.9	50.9	----	-----	134896.3	55.1
923	9/10/2025	23:54:21	00d	01:00.0	51.5	69.3	52.2	50.8	-:-	52	51.9	51.5	51.1	51.1	----	-----	141253.8	55.1
924	9/10/2025	23:55:21	00d	01:00.0	51.5	69.3	52.3	50.9	-:-	52.1	52	51.5	51.2	51	----	-----	141253.8	55.1
925	9/10/2025	23:56:21	00d	01:00.0	51.3	69.1	52.1	50.5	-:-	51.9	51.9	51.4	50.8	50.6	----	-----	134896.3	55.0
926	9/10/2025	23:57:21	00d	01:00.0	50.8	68.6	51.3	50.3	-:-	51.2	51.1	50.8	50.5	50.4	----	-----	120226.4	55.0
927	9/10/2025	23:58:21	00d	01:00.0	50.8	68.6	51.3	50.2	-:-	51.2	51.1	50.9	50.5	50.3	----	-----	120226.4	55.4
928	9/10/2025	23:59:21	00d	01:00.0	51.4	69.2	52.1	50.6	-:-	51.8	51.8	51.4	51	50.9	----	-----	138038.4	55.4
929	9/11/2025	0:00:21	00d	01:00.0	51.5	69.3	52.2	50.6	-:-	52.1	52	51.5	50.9	50.7	----	-----	141253.8	56.5
930	9/11/2025	0:01:21	00d	01:00.0	51.3	69.1	52.1	50.3	-:-	52	51.9	51.3	50.6	50.5	----	-----	134896.3	56.5
931	9/11/2025	0:02:21	00d	01:00.0	51.1	68.9	52.3	50.5	-:-	52	51.5	51.1	50.8	50.7	----	-----	128825.0	56.7
932	9/11/2025	0:03:21	00d	01:00.0	59.9	77.7	72	51	-:-	69.4	62.8	52.1	51.8	51.6	----	-----	977237.2	56.8
933	9/11/2025	0:04:21	00d	01:00.0	52	69.8	52.3	51.5	-:-	52.3	52.2	52	51.7	51.7	----	-----	158489.3	56.6
934	9/11/2025	0:05:21	00d	01:00.0	58.8	76.6	70.7	51	-:-	68.1	60.5	52	51.5	51.2	----	-----	758577.6	56.6
935	9/11/2025	0:06:21	00d	01:00.0	52.4	70.2	52.8	51.8	-:-	52.8	52.7	52.4	52	52	----	-----	173780.1	56.7
936	9/11/2025	0:07:21	00d	01:00.0	64.2	82	77.8	52	-:-	70.6	62	52.6	52.2	52	----	-----	2630268.0	56.6
937	9/11/2025	0:08:21	00d	01:00.0	62.7	80.5	74.4	51.6	-:-	70.5	68.7	52.2	51.8	51.8	----	-----	1862087.1	56.2
938	9/11/2025	0:09:21	00d	01:00.0	52.2	70	52.7	50.9	-:-	52.5	52.5	52.3	51.9	51.1	----	-----	165958.7	55.9
939	9/11/2025	0:10:21	00d	01:00.0	52.4	70.2	54.1	51.8	-:-	52.9	52.6	52.4	52	52	----	-----	173780.1	55.9
940	9/11/2025	0:11:21	00d	01:00.0	61.2	79	70.8	49.8	-:-	68.9	67.9	53	50.4	50	----	-----	1318256.7	55.9
941	9/11/2025	0:12:21	00d	01:00.0	51.1	68.9	52.2	50	-:-	52	51.9	51.2	50.2	50.2	----	-----	128825.0	55.6
942	9/11/2025	0:13:21	00d	01:00.0	51.2	69	51.8	50.2	-:-	51.6	51.5	51.2	50.9	50.6	----	-----	131825.7	55.6
943	9/11/2025	0:14:21	00d	01:00.0	51	68.8	51.7	49.6	-:-	51.6	51.4	51.2	50.4	50.1	----	-----	125892.5	55.7
944	9/11/2025	0:15:21	00d	01:00.0	51.4	69.2	52.8	50	-:-	52.6	52.4	51.4	50.5	50.2	----	-----	138038.4	55.7
945	9/11/2025	0:16:21	00d	01:00.0	52.6	70.4	53.1	51.5	-:-	53.1	53	52.7	51.8	51.7	----	-----	181970.1	55.7
946	9/11/2025	0:17:21	00d	01:00.0	58.9	76.7	70.1	50	-:-	66.8	62.7	52.9	50.6	50.4	----	-----	776247.1	55.6
947	9/11/2025	0:18:21	00d	01:00.0	51.3	69.1	52.6	49.9	-:-	52.5	52.4	51	50.3	50.2	----	-----	134896.3	55.5
948	9/11/2025	0:19:21	00d	01:00.0	51.8	69.6	52.6	49.9	-:-	52.4	52.2	51.9	50.9	50.4	----	-----	151356.1	55.7
949	9/11/2025	0:20:21	00d	01:00.0	51.7	69.5	52.2	49.7	-:-	52.2	52.1	51.8	51.4	49.9	----	-----	147910.8	55.7
950	9/11/2025	0:21:21	00d	01:00.0	51.4	69.2	52.8	49.8	-:-	52.5	52.3	51.8	50.1	50	----	-----	138038.4	55.8
951	9/11/2025	0:22:21	00d	01:00.0	52.1	69.9	52.7	50.4	-:-	52.6	52.6	52.3	51.5	51.4	----	-----	162181.0	55.8
952	9/11/2025	0:23:21	00d	01:00.0	52.4	70.2	53.2	51.2	-:-	53.1	53	52.6	51.4	51.3	----	-----	173780.1	55.7
953	9/11/2025	0:24:21	00d	01:00.0	52.3	70.1	52.9	51.1	-:-	52.8	52.7	52.6	51.4	51.3	----	-----	169824.4	55.7
954	9/11/2025	0:25:21	00d	01:00.0	51	68.8	52.3	48.6	-:-	52.3	52	51.2	49	48.6	----	-----	125892.5	55.7
955	9/11/2025	0:26:21	00d	01:00.0	51.4	69.2	52	50.3	-:-	52	51.9	51.6	50.7	50.5	----	-----	138038.4	55.7
956	9/11/2025	0:27:21	00d	01:00.0	51.5	69.3	52.1	48.3	-:-	52.2	52.1	51.8	49.7	48.7	----	-----	141253.8	55.9
957	9/11/2025	0:28:21	00d	01:00.0	50.7	68.5	52.2	49.6	-:-	52.1	52	50.2	49.9	49.9	----	-----	117489.8	55.9
958	9/11/2025	0:29:21	00d	01:00.0	49.7	67.5	50.4	48.1	-:-	50.4	50.3	50	48.3	48.3	----	-----	93325.4	55.8
959	9/11/2025	0:30:21	00d	01:00.0	49.2	67	51.2	48.1	-:-	51.2	49.8	49	48.5	48.4	----	-----	83176.4	55.8
960	9/11/2025	0:31:21	00d	01:00.0	48.9	66.7	49.5	48.2	-:-	49.3	49.2	48.9	48.5	48.4	----	-----	77624.7	55.8
961	9/11/2025	0:32:21	00d	01:00.0	49.5	67.3	50.1	48.6	-:-	49.9	49.8	49.6	49.2	48.9	----	-----	89125.1	55.8
962	9/11/2025	0:33:21	00d	01:00.0	48.4	66.2	49.5	47.7	-:-	49.4	49.3	48.4	48	47.9	----	-----	69183.1	55.8
963	9/11/2025	0:34:21	00d	01:00.0	48.5	66.3	49.2	47.4	-:-	49.1	49	48.5	47.8	47.7	----	-----	70794.6	55.8
964	9/11/2025	0:35:21	00d	01:00.0	59.5	77.3	72.1	48.5	-:-	68.9	59.6	50.3	48.8	48.6	----	-----	891250.9	55.8
965	9/11/2025	0:36:21	00d	01:00.0	48.4	66.2	49.2	47.8	-:-	48.9	48.8	48.5	48.1	48.1	----	-----	69183.1	55.6
966	9/11/2025	0:37:21	00d	01:00.0	48.2	66	49.1	47.5	-:-	48.7	48.6	48.2	47.9	47.7	----	-----	66069.3	55.6
967	9/11/2025	0:38:21	00d	01:00.0	47.9	65.7	48.4	47.5	-:-	48.3	48.2	47.9	47.7	47.6	----	-----	61659.5	55.6
968	9/11/2025	0:39:21	00d	01:00.0	48.1	65.9	48.6	47.5	-:-	48.5	48.4	48.1	47.8	47.6	----	-----	64565.4	55.6
969	9/11/2025	0:40:21	00d	01:00.0	49.3	67.1	50.9	47.9	-:-	50.3	50	49.4	48.3	48.1	----	-----	85113.8	56.1
970	9/11/2025	0:41:21	00d	01:00.0	48.8	66.6	49.5	47.8	-:-	49.3	49.2	48.8	48.1	48	----	-----	75857.8	56.1
971	9/11/2025	0:42:21	00d	01:00.0	58.9	76.7	71.3	47.7	-:-	68.7	61.2	48.4	48	47.9	----	-----	776247.1	56.1
972	9/11/2025	0:43:21	00d	01:00.0	47.8	65.6	48.4	47	-:-	48.3	48.2	47.8	47.3	47.1	----	-----	60256.0	56.0
973	9/11/2025	0:44:21	00d	01:00.0	47.7	65.5	48.3	46.9	-:-	48.2	48.1	47.8	47.3	47.1	----	-----	58884.4	56.0
974	9/11/2025	0:45:21	00d	01:00.0	48.2	66	48.6	47.7	-:-	48.6	48.5	48.3	47.9	47.8	----	-----	66069.3	56.0
975	9/11/2025	0:46:21	00d	01:00.0	48	65.8	49	47.3	-:-	48.6	48.4	48	47.6	47.5	----	-----	63095.7	56.0
976	9/11/2025	0:47:21	00d	01:00.0	66	83.8	80.5	46.8	-:-	72.1	60	48	47.1	46.9	----	-----	3981071.7	56.0
977	9/11/2025	0:48:21	00d	01:00.0	47.3	65.1	48.8	46.5	-:-	48.5	48.1	47.3	46.7	46.7	----	-----	53703.2	55.3
978	9/11/2025	0:49:21	00d	01:00.0	47.2	65	47.7	46.6	-:-	47.6	47.6	47.2	46.9	46.8	----	-----	52480.7	55.3

979	9/11/2025	0:50:21	00d	01:00.0	48.7	66.5	52.1	46.2	-:-	51.3	50.9	47.9	46.6	46.4	----	-----	74131.0	55.3
980	9/11/2025	0:51:21	00d	01:00.0	46.2	64	46.7	45.6	-:-	46.6	46.6	46.2	45.8	45.7	----	-----	41686.9	55.3
981	9/11/2025	0:52:21	00d	01:00.0	46.7	64.5	47.8	45.9	-:-	47.3	47.1	46.7	46.1	46.1	----	-----	46773.5	55.3
982	9/11/2025	0:53:21	00d	01:00.0	47.3	65.1	48	46.4	-:-	47.9	47.8	47.3	46.9	46.8	----	-----	53703.2	55.7
983	9/11/2025	0:54:21	00d	01:00.0	47.2	65	47.7	46.7	-:-	47.7	47.6	47.3	46.9	46.8	----	-----	52480.7	55.9
984	9/11/2025	0:55:21	00d	01:00.0	47.1	64.9	47.6	46.5	-:-	47.5	47.5	47.1	46.7	46.6	----	-----	51286.1	55.9
985	9/11/2025	0:56:21	00d	01:00.0	47	64.8	47.7	46.4	-:-	47.4	47.3	47	46.7	46.6	----	-----	50118.7	55.9
986	9/11/2025	0:57:21	00d	01:00.0	51.5	69.3	64.8	46.2	-:-	52.7	49.8	46.8	46.4	46.4	----	-----	141253.8	55.9
987	9/11/2025	0:58:21	00d	01:00.0	62.4	80.2	75.3	46.6	-:-	71.9	63	47.7	46.9	46.7	----	-----	1737800.8	56.0
988	9/11/2025	0:59:21	00d	01:00.0	48.4	66.2	49.5	46.8	-:-	49.2	49.1	48.7	47.1	47	----	-----	69183.1	55.8
989	9/11/2025	1:00:21	00d	01:00.0	68.1	85.9	82.9	45.3	-:-	75.4	62.7	47.2	46	45.7	----	-----	6456542.3	55.8
990	9/11/2025	1:01:21	00d	01:00.0	46.7	64.5	47.4	45.9	-:-	47.2	47.1	46.8	46.3	46.2	----	-----	46773.5	54.4
991	9/11/2025	1:02:21	00d	01:00.0	61.2	79	74.7	46.5	-:-	70.7	60	47.3	46.7	46.7	----	-----	1318256.7	54.4
992	9/11/2025	1:03:21	00d	01:00.0	58.1	75.9	70.1	46.6	-:-	67.2	60	50.5	47.1	46.9	----	-----	645654.2	54.1
993	9/11/2025	1:04:21	00d	01:00.0	50.5	68.3	51.6	49.2	-:-	50.8	50.8	50.6	50.2	50.1	----	-----	112201.8	53.9
994	9/11/2025	1:05:21	00d	01:00.0	50.1	67.9	50.8	47.2	-:-	50.8	50.7	50.5	47.5	47.4	----	-----	102329.3	53.9
995	9/11/2025	1:06:21	00d	01:00.0	59.7	77.5	71.4	47.2	-:-	68.3	63	51	48.9	47.6	----	-----	933254.3	54.3
996	9/11/2025	1:07:21	00d	01:00.0	50.2	68	51.2	49.2	-:-	50.9	50.6	50.4	49.4	49.3	----	-----	104712.9	54.1
997	9/11/2025	1:08:21	00d	01:00.0	49.1	66.9	50.6	46.5	-:-	50.5	50.4	49.5	46.8	46.7	----	-----	81283.1	54.0
998	9/11/2025	1:09:21	00d	01:00.0	47.6	65.4	50.5	46.4	-:-	50.4	50.2	47.1	46.6	46.6	----	-----	57544.0	54.3
999	9/11/2025	1:10:21	00d	01:00.0	46.7	64.5	47.4	46.2	-:-	47.2	47	46.7	46.4	46.3	----	-----	46773.5	54.3
1000	9/11/2025	1:11:21	00d	01:00.0	47.1	64.9	48.1	46.5	-:-	47.7	47.5	47.1	46.7	46.6	----	-----	51286.1	54.2
1001	9/11/2025	1:12:21	00d	01:00.0	46.7	64.5	47	46.3	-:-	47	46.9	46.7	46.4	46.4	----	-----	46773.5	54.2
1002	9/11/2025	1:13:21	00d	01:00.0	47.4	65.2	50.6	46.3	-:-	49.6	48.2	47.3	46.7	46.5	----	-----	54954.1	54.4
1003	9/11/2025	1:14:21	00d	01:00.0	57	74.8	69.3	46.7	-:-	65.4	58.9	47.3	47	46.8	----	-----	501187.2	54.4
1004	9/11/2025	1:15:21	00d	01:00.0	47.1	64.9	48.4	46.7	-:-	48.1	47.6	47.1	46.8	46.7	----	-----	51286.1	54.3
1005	9/11/2025	1:16:21	00d	01:00.0	47.4	65.2	48.3	46.8	-:-	48.1	47.9	47.4	47	46.9	----	-----	54954.1	54.3
1006	9/11/2025	1:17:21	00d	01:00.0	47.5	65.3	49	46.8	-:-	49.1	47.9	47.4	47	46.9	----	-----	56234.1	54.3
1007	9/11/2025	1:18:21	00d	01:00.0	47.5	65.3	48.8	46.7	-:-	48.8	48.7	47.3	46.9	46.8	----	-----	56234.1	54.5
1008	9/11/2025	1:19:21	00d	01:00.0	59.9	77.7	72.5	46.6	-:-	68.5	62.9	47.1	46.8	46.8	----	-----	977237.2	54.5
1009	9/11/2025	1:20:21	00d	01:00.0	53.1	70.9	67.3	46.3	-:-	56.5	48.4	47.2	46.6	46.4	----	-----	204173.8	54.2
1010	9/11/2025	1:21:21	00d	01:00.0	58.3	76.1	71.6	46.4	-:-	65.8	56.9	47.5	46.7	46.6	----	-----	676083.0	54.2
1011	9/11/2025	1:22:21	00d	01:00.0	48	65.8	49.3	46.6	-:-	48.7	48.6	48.3	47	46.9	----	-----	63095.7	54.0
1012	9/11/2025	1:23:21	00d	01:00.0	48.1	65.9	48.6	47.2	-:-	48.5	48.5	48.1	47.5	47.3	----	-----	64565.4	54.0
1013	9/11/2025	1:24:21	00d	01:00.0	48	65.8	49.3	46.8	-:-	49.3	48.4	48	47	46.9	----	-----	63095.7	54.0
1014	9/11/2025	1:25:21	00d	01:00.0	47.8	65.6	48.4	47.3	-:-	48.4	48.3	47.9	47.4	47.4	----	-----	60256.0	53.9
1015	9/11/2025	1:26:21	00d	01:00.0	47.6	65.4	48.1	46.4	-:-	48	48	47.8	46.8	46.7	----	-----	57544.0	53.9
1016	9/11/2025	1:27:21	00d	01:00.0	60.5	78.3	73.8	47.1	-:-	69.1	60.1	48	47.4	47.3	----	-----	1122018.5	53.9
1017	9/11/2025	1:28:21	00d	01:00.0	47.4	65.2	48.1	45.8	-:-	48	47.9	47.6	46.3	46	----	-----	54954.1	53.6
1018	9/11/2025	1:29:21	00d	01:00.0	47.8	65.6	48.5	46.2	-:-	48.4	48.3	47.9	46.7	46.6	----	-----	60256.0	54.2
1019	9/11/2025	1:30:21	00d	01:00.0	47.9	65.7	48.4	46.6	-:-	48.3	48.3	47.9	47.4	47.3	----	-----	61659.5	54.3
1020	9/11/2025	1:31:21	00d	01:00.0	47.3	65.1	48.3	46	-:-	48.3	48.1	47.3	46.5	46.3	----	-----	53703.2	54.3
1021	9/11/2025	1:32:21	00d	01:00.0	47	64.8	47.9	46.4	-:-	47.7	47.5	47	46.7	46.6	----	-----	50118.7	54.3
1022	9/11/2025	1:33:21	00d	01:00.0	46.7	64.5	47.5	45.7	-:-	47.4	47.3	46.7	46.2	45.8	----	-----	46773.5	54.3
1023	9/11/2025	1:34:21	00d	01:00.0	47.2	65	48.1	45.8	-:-	47.9	47.8	47.4	46.5	46	----	-----	52480.7	54.3
1024	9/11/2025	1:35:21	00d	01:00.0	47.2	65	48	46.3	-:-	47.9	47.8	47.2	46.5	46.4	----	-----	52480.7	54.3
1025	9/11/2025	1:36:21	00d	01:00.0	46.5	64.3	47	45.8	-:-	46.9	46.8	46.6	46	46	----	-----	44668.4	54.3
1026	9/11/2025	1:37:21	00d	01:00.0	46.5	64.3	47	45.8	-:-	46.9	46.9	46.6	46.1	46	----	-----	44668.4	54.3
1027	9/11/2025	1:38:21	00d	01:00.0	46.6	64.4	47.4	45.9	-:-	47.3	47	46.6	46.2	46.1	----	-----	45708.8	54.3
1028	9/11/2025	1:39:21	00d	01:00.0	47	64.8	48.1	46.1	-:-	48	47.8	46.8	46.4	46.3	----	-----	50118.7	54.3
1029	9/11/2025	1:40:21	00d	01:00.0	64.3	82.1	75.9	46.2	-:-	73.1	69.7	47.8	46.5	46.4	----	-----	2691534.8	54.3
1030	9/11/2025	1:41:21	00d	01:00.0	51.2	69	68.2	46.1	-:-	59.2	53.4	47.6	46.4	46.3	----	-----	131825.7	53.5
1031	9/11/2025	1:42:21	00d	01:00.0	46.6	64.4	48.3	44.9	-:-	48	47.9	46.5	45.3	45.2	----	-----	45708.8	53.5
1032	9/11/2025	1:43:21	00d	01:00.0	46.4	64.2	47.7	45.6	-:-	47.4	47.2	46.4	45.8	45.8	----	-----	43651.6	53.5
1033	9/11/2025	1:44:21	00d	01:00.0	46	63.8	46.7	45.3	-:-	46.5	46.5	46	45.6	45.4	----	-----	39810.7	53.4
1034	9/11/2025	1:45:21	00d	01:00.0	45.7	63.5	46.3	45.2	-:-	46.2	46	45.7	45.3	45.3	----	-----	37153.5	53.4
1035	9/11/2025	1:46:21	00d	01:00.0	45.1	62.9	46	44.2	-:-	45.8	45.6	45.1	44.6	44.5	----	-----	32359.4	53.4
1036	9/11/2025	1:47:21	00d	01:00.0	44.9	62.7	45.8	44.2	-:-	45.4	45.3	44.8	44.5	44.4	----	-----	30903.0	53.4
1037	9/11/2025	1:48:21	00d	01:00.0	58	75.8	70.6	44	-:-	66.5	62	44.8	44.4	44.3	----	-----	630957.3	53.7
1038	9/11/2025	1:49:21	00d	01:00.0	47.7	65.5	65.4	44.3	-:-	54.3	50.7	44.9	44.5	44.4	----	-----	58884.4	53.5
1039	9/11/2025	1:50:21	00d	01:00.0	44.6	62.4	45.9	43.7	-:-	45.7	45.6	44.5	44.1	43.9	----	-----	28840.3	53.5
1040	9/11/2025	1:51:21	00d	01:00.0	44.6	62.4	46	43.7	-:-	45.7	45.5	44.4	44	43.9	----	-----	28840.3	53.5
1041	9/11/2025	1:52:21	00d	01:00.0	44.6	62.4	45.3	44	-:-	45.1	45	44.6	44.3	44.2	----	-----	28840.3	53.5
1042	9/11/2025	1:53:21	00d	01:00.0	63.5	81.3	77.1	44.2	-:-	71.1	63.6	45	44.6	44.4	----	-----	2238721.1	53.5
1043	9/11/2025	1:54:21	00d	01:00.0	59.6	77.4	72.2	44.4	-:-	67.4	63.2	45.5	44.7	44.5	----	-----	912010.8	53.1
1044	9/11/2025	1:55:21	00d	01:00.0	45.4	63.2	46	44.8	-:-	45.8	45.7	45.4	45	44.9	----	-----	34673.7	52.7
1045	9/11/2025	1:56:21	00d	01:00.0	45.7	63.5	46.5	45.1	-:-	46.3	46.2	45.7	45.4	45.3	----	-----	37153.5	52.7
1046	9/11/2025	1:57:21	00d	01:00.0	48.1	65.9	60.7	44.4	-:-	50.7	47.3	45.5	44.7	44.6	----	-----	64565.4	52.7
1047	9/11/2025	1:58:21	00d	01:00.0	59.8	77.6	72	45.3	-:-	70.5	63.2	45.9	45.5	45.4	----	-----	954992.6	52.7
1048	9/11/2025	1:59:21	00d	01:00.0	57.9	75.7	70.1	45.4	-:-	67.6	59.9	46.2	45.7	45.6	----	-----	616595.0	52.3
1049	9/11/2025	2:00:21	00d	01:00.0	46	63.8	46.6	45.1	-:-	46.5	46.5	46.1	45.3	45.2	----	-----	39810.7	52.1
1050	9/11/2025	2:01:21	00d	01:00.0	45.8	63.6	46.2	45.1	-:-	46.2	46.1	45.8	45.4	45.3	----	-----	38018.9	52.1
1051	9/11/2025	2:02:21	00d	01:00.0	45.8	63.6	46.4	45.1	-:-	46.3	46.2	45.9	45.4	45.4	----	-----	38018.9	52.1
1052	9/11/2025	2:03:21	00d	01:00.0	45.4	63.2	46	45	-:-	45.8	45.7	45.4	45.1	45.1	----	-----	34673.7	52.1
1053	9/11/2025	2:04:21	00d	01:00.0	45.9	63.7	46.2	45.3	-:-	46.2	46.1	46	45.6	45.6	----	-----	38904.5	52.1
1054	9/11/2025	2:05:21	00d	01:00.0	45.4	63.2	46	44.8	-:-	45.9	45.9	45.4	44.9	44.8	----	-----	34673.7	52.1
1055	9/11/2025	2:06:21	00d	01:00.0	61.9	79.7	74.6	44.5	-:-	70	64.8	45.5	44.8	44.6	----	-----	1548816.6	52.1
1056	9/11/2025	2:07:21	00d	01:00.0	44.8	62.6	45.3	43.8	-:-	45.2	45.2	44.9	44.4	44.1	----	-----	30199.5	51.4
1057	9/11/2025	2:08:21	00d	01:00.0	45.1	62.9	47.3	44.1	-:-	45.8	45.4	45.2	44.7	44.5	----	-----	32359.4	51.4
1058	9/11/2025	2:09:21	00d	01:00.0	59.3	77.1	71.2	44.5	-:-	67.9	63.4	45.3	44.8	44.6	----	-----	851138.0	51.4
1059	9/11/2025	2:10:21	00d	01:00.0	44.9	62.7	45.6	44	-:-	45.5	45.4	45	44.3	44.1	----	-----	30903.0	51.0
1060	9/11/2025	2:11:21	00d	01:00.0	45.1	62.9	45.7	44.2	-:-	45.7	45.5	45.1	44.7	44.6	----	-----	32359.4	51.0
1061	9/11/2025	2:12:21	00d	01:00.0	44.7	62.5	45.4	43.8	-:-	45.4	45.3	44.6	44	43.9	----	-----	29512.1	51.2
1062	9/11/2025	2:13:21	00d	01:00.0	58.8	76.6	70.2	43.4	-:-	68.4	63.1	44.5	43.7	43.6	----	-----	758577.6	51.2
1063	9/11/2025	2:14:21	00d	01:00.0	43.7	61.5	44.4	42.9	-:-	44.3	44.2	43.8	43.2	43.1	----	-----	23442.3	50.9
1064	9/11/2025	2:15:21	00d	01:00.0	43.7	61.5	44.4	43	-:-	44.4	44.2	43.7	43.2	43.2	----	-----	23442.3	51.2
1065	9/11/2025	2:16:21	00d	01:00.0	44.1	61.9	44.9	43.2	-:-	44.8	44.7	44.1	43.8	43.5	----	-----	25704.0	51.2
1066	9/11/2025	2:17:21	00d	01:00.0	44.7	62.5	45.1	44.3	-:-	45.1	45.1	44.8	44.5	44.4	----	-----	29512.1	51.2
1067	9/11/2025	2:18:21	00d	01:00.0	59.1	76.9	72.3	42.7	-:-	68.1	58.6	44.2	43.3	43.2	----	-----	812830.5	51.2
1068	9/11/2025	2:19:21	00d	01:00.0	43.1	60.9	43.8	42.6	-:-	43.7	43.5	43.1	42.8	42.7	----	-----	20417.4	50.8
1069	9/11/2025	2:20:21	00d	01:00.0	42.4	60.2	43.3	41.5	-:-	43.2	43.1	42.3	41.7	41.7	----	-----	17378.0	51.3
1070	9/11/2025	2:21:21	00d	01:00.0	42.4	60.2	43.7	41.4	-:-	43.3	43	42.4	41.8	41.7	----	-----	17378.0	51.4
1071	9/11/2025	2:22:21	00d	01:00.0	43.4	61.2	44.1	42.3	-:-	43.9	43.9	43.5	42.8	42.5	----	-----	21877.6	51.4
1072	9/11/2025	2:23:21	00d	01:00.0	42.6	60.4	43.4	41.8	-:-	43.4	43.2	42.5	42	41.9	----	-----	18197.0	51.4
1073	9/11/2025	2:24:21	00d	01:00.0	42.3	60.1	43.1	41.5	-:-	43	42.7	42.3	41.8	41.7	----	-----	16982.4	51.4
1074	9/11/2025	2:25:21	00d	01:00.0	42.6	60.4	44.5	42.1	-:-	43.3	42.9	42.5	42.2	42.2	----	-----	18197.0	52.4
1075	9/11/2025	2:26:21	00d	01:00.0	42.4	60.2	43.5	41.5	-:-	43.5	43.3	42.3	41.7	41.6	----	-----	17378.0	52.4
1076	9/11/2025	2:27:21	00d	01:00.0	43.1	60.9	44.2	42	-:-	43.9	43.8	43.1	42.3	42.1	----	-----	20417.4	52.8
1077	9/11/2025	2:28:21	00d	01:00.0	42.7	60.5	43.4	42.1	-:-	43.1	43.1	42.7	42.3	42.2	----	-----	18620.9	53.6
1078	9/11/2025	2:29:21	00d	01:00.0	63.6	81.4	75.6	42.9	-:-	73.1	67.1	44	43.5	43.4	----	-----	2290867.7	53.6
1079	9/11/2025	2:30:21	00d	01:00.0	55.6	73.4	72.8	42.9	-:-	63	55.9	43.6	43.2	43	----	-----	363078.1	52.8
1080	9/11/2025	2:31:21	00d	01:00.0	43.4	61.2	44	42.6	-:-	43.9	43.8	43.4	43	42.9	----	-----	21877.6	52.9
1081	9/11/2025	2:32:21	00d	01:00.0	43.4	61.2	44.9	42.6	-:-	44.4	44.2	43.3	42.9	42.7	----	-----	21877.6	52.9
1082	9/11/2025	2:33:21	00d	01:00.0	43.5	61.3	44.8	42	-:-	44.7	44.5	43.6	42.3	42.1	----	-----	22387.2	52.9
1083	9/11/2025	2:34:21	00d	01:00.0	43.3	61.1	44.3	42.4	-:-	44.1	44	43.4	42.6	42.5	----	-----	21379.6	52.9
1084	9/11/2025	2:35:21	00d	01:00.0	43.4	61.2	45.1	42.2	-:-	44.9	44.6	43.2	42.6	42.5	----	-----	21877.6	52.9
1085	9/11/2025	2:36:21	00d	01:00.0	45.6	63.4	46.4	42.7	-:-	46.3	46.2	45.8	44.4	44.3	----	-----	36307.8	52.9
1086	9/11/2025	2:37:21	00d	01:00.0	45.3	63.1	46.3	43.4	-:-	46.1	45.9	45.5	44.2	43.9	----	-----	33884.4	52.9
1087	9/11/2025	2:38:21	00d	01:00.0	45.7	63.5	46.6	44.9	-:-	46.4	46.4	45.7	45.2	45	----	-----	37153.5	52.9

1088	9/11/2025	2:39:21	00d	01:00.0	45.9	63.7	46.5	45.1	-:-	46.3	46.3	45.9	45.5	45.2	----	-----	38904.5	53.1
1089	9/11/2025	2:40:21	00d	01:00.0	45.9	63.7	46.7	44.9	-:-	46.5	46.2	45.9	45.6	45.2	----	-----	38904.5	53.1
1090	9/11/2025	2:41:21	00d	01:00.0	45	62.8	46	42.7	-:-	45.9	45.8	45.3	43.2	42.9	----	-----	31622.8	53.3
1091	9/11/2025	2:42:21	00d	01:00.0	45.1	62.9	45.8	43.1	-:-	45.6	45.5	45.3	44.2	43.4	----	-----	32359.4	53.4
1092	9/11/2025	2:43:21	00d	01:00.0	45.1	62.9	46.3	43.2	-:-	46.2	46	45.4	43.5	43.3	----	-----	32359.4	53.4
1093	9/11/2025	2:44:21	00d	01:00.0	43.9	61.7	45.2	43	-:-	44.8	44.6	44	43.2	43.1	----	-----	24547.1	53.4
1094	9/11/2025	2:45:21	00d	01:00.0	43.3	61.1	44.4	42.4	-:-	44.3	44	43.2	42.7	42.6	----	-----	21379.6	53.4
1095	9/11/2025	2:46:21	00d	01:00.0	42.7	60.5	43.5	42.1	-:-	43.4	43.2	42.7	42.3	42.2	----	-----	18620.9	53.7
1096	9/11/2025	2:47:21	00d	01:00.0	43	60.8	43.7	42.1	-:-	43.5	43.5	42.9	42.4	42.3	----	-----	19952.6	53.7
1097	9/11/2025	2:48:21	00d	01:00.0	59.8	77.6	73.3	42.6	-:-	67.9	60.5	43.7	43	42.8	----	-----	954992.6	53.7
1098	9/11/2025	2:49:21	00d	01:00.0	43.2	61	44.8	42.6	-:-	43.7	43.5	43.1	42.8	42.8	----	-----	20893.0	53.4
1099	9/11/2025	2:50:21	00d	01:00.0	42.7	60.5	44.2	41.8	-:-	43.7	43.2	42.8	42.1	42	----	-----	18620.9	53.4
1100	9/11/2025	2:51:21	00d	01:00.0	43.1	60.9	45.8	42.4	-:-	44	43.5	43	42.5	42.5	----	-----	20417.4	53.4
1101	9/11/2025	2:52:21	00d	01:00.0	43.4	61.2	44	42.5	-:-	43.9	43.9	43.4	42.9	42.7	----	-----	21877.6	54.5
1102	9/11/2025	2:53:21	00d	01:00.0	44.7	62.5	47.8	42	-:-	47.8	47.4	43.4	42.4	42.2	----	-----	29512.1	54.5
1103	9/11/2025	2:54:21	00d	01:00.0	59.4	77.2	72.6	43.4	-:-	68.3	60.4	45.8	43.6	43.4	----	-----	870963.6	54.5
1104	9/11/2025	2:55:21	00d	01:00.0	44.5	62.3	47.6	42.2	-:-	47.1	46.8	43.2	42.6	42.3	----	-----	28183.8	54.2
1105	9/11/2025	2:56:21	00d	01:00.0	42.8	60.6	43.5	42.2	-:-	43.4	43.4	42.8	42.4	42.3	----	-----	19054.6	54.2
1106	9/11/2025	2:57:21	00d	01:00.0	43.1	60.9	44.9	42	-:-	44.7	44.6	42.8	42.3	42.2	----	-----	20417.4	54.3
1107	9/11/2025	2:58:21	00d	01:00.0	45.6	63.4	47.7	41.9	-:-	47.6	47.5	44.9	42.4	42.2	----	-----	36307.8	54.3
1108	9/11/2025	2:59:21	00d	01:00.0	46.5	64.3	49.8	42.2	-:-	49.2	48.3	46.6	42.7	42.3	----	-----	44668.4	54.3
1109	9/11/2025	3:00:21	00d	01:00.0	49	66.8	53.5	44.5	-:-	54.3	52.1	47.9	45.1	44.9	----	-----	79432.8	54.5
1110	9/11/2025	3:01:21	00d	01:00.0	45	62.8	45.5	44.6	-:-	45.4	45.3	45	44.8	44.7	----	-----	31622.8	54.5
1111	9/11/2025	3:02:21	00d	01:00.0	44.3	62.1	45.3	43.1	-:-	45.2	45	44.3	43.8	43.6	----	-----	26915.3	54.5
1112	9/11/2025	3:03:21	00d	01:00.0	44.2	62	45.6	42.8	-:-	45.3	45	44.3	43.4	43	----	-----	26302.7	54.5
1113	9/11/2025	3:04:21	00d	01:00.0	43.7	61.5	44.7	42.3	-:-	44.7	44.5	43.7	42.7	42.5	----	-----	23442.3	54.5
1114	9/11/2025	3:05:21	00d	01:00.0	47.7	65.5	48.2	44.6	-:-	48.2	48.1	47.8	47.2	47	----	-----	58884.4	54.8
1115	9/11/2025	3:06:21	00d	01:00.0	47.7	65.5	48.2	43.1	-:-	48.1	48	47.8	47.6	45.9	----	-----	58884.4	54.9
1116	9/11/2025	3:07:21	00d	01:00.0	46	63.8	48.4	42.4	-:-	48.2	48.2	45.5	42.5	42.5	----	-----	39810.7	54.9
1117	9/11/2025	3:08:21	00d	01:00.0	48.1	65.9	48.6	47.8	-:-	48.4	48.3	48.2	48	48	----	-----	64565.4	54.9
1118	9/11/2025	3:09:21	00d	01:00.0	47.9	65.7	48.3	47.1	-:-	48.2	48.2	47.9	47.7	47.5	----	-----	61659.5	54.9
1119	9/11/2025	3:10:21	00d	01:00.0	47	64.8	48.1	41.8	-:-	47.9	47.9	47.5	42.4	42.1	----	-----	50118.7	55.4
1120	9/11/2025	3:11:21	00d	01:00.0	48.1	65.9	50.3	47.6	-:-	49.1	48.3	48	47.7	47.7	----	-----	64565.4	55.4
1121	9/11/2025	3:12:21	00d	01:00.0	56	73.8	68	41	-:-	66.3	56.3	48	42	41.5	----	-----	398107.2	55.4
1122	9/11/2025	3:13:21	00d	01:00.0	47.4	65.2	48.2	42	-:-	48.2	48.1	47.8	44.3	42.2	----	-----	54954.1	55.7
1123	9/11/2025	3:14:21	00d	01:00.0	53	70.8	67.2	41.9	-:-	59.3	52.1	44.4	42	41.7	----	-----	199526.2	55.7
1124	9/11/2025	3:15:21	00d	01:00.0	56.3	74.1	70.2	41.7	-:-	61.5	48.3	46.5	42.2	41.8	----	-----	426579.5	56.0
1125	9/11/2025	3:16:21	00d	01:00.0	47.6	65.4	48.2	46.8	-:-	48	47.9	47.7	47.2	47.1	----	-----	57544.0	55.9
1126	9/11/2025	3:17:21	00d	01:00.0	46.6	64.4	48	41.7	-:-	47.9	47.8	47.6	41.8	41.7	----	-----	45708.8	55.9
1127	9/11/2025	3:18:21	00d	01:00.0	47.6	65.4	48.2	44.7	-:-	48.1	48.1	47.8	47	46.8	----	-----	57544.0	55.9
1128	9/11/2025	3:19:21	00d	01:00.0	47.8	65.6	48.2	47.5	-:-	48.1	48	47.8	47.6	47.6	----	-----	60256.0	55.9
1129	9/11/2025	3:20:21	00d	01:00.0	60.1	77.9	73.4	46.2	-:-	68.8	58.9	47.7	47.3	46.3	----	-----	1023293.0	56.3
1130	9/11/2025	3:21:21	00d	01:00.0	47.3	65.1	47.8	42.3	-:-	47.8	47.7	47.5	46.9	44	----	-----	53703.2	56.1
1131	9/11/2025	3:22:21	00d	01:00.0	47.6	65.4	48.2	43.5	-:-	48.1	48	47.7	47.4	47	----	-----	57544.0	56.1
1132	9/11/2025	3:23:21	00d	01:00.0	47.7	65.5	48.6	42.8	-:-	48.5	48.3	47.9	46.2	43.4	----	-----	58884.4	56.3
1133	9/11/2025	3:24:21	00d	01:00.0	47.3	65.1	47.9	42.3	-:-	47.9	47.9	47.6	46.2	42.2	----	-----	53703.2	56.5
1134	9/11/2025	3:25:21	00d	01:00.0	63.4	81.2	75.8	47.3	-:-	71.6	66.6	47.8	47.6	47.5	----	-----	2187761.6	56.5
1135	9/11/2025	3:26:21	00d	01:00.0	47.3	65.1	52	44.7	-:-	47.9	47.8	47.5	46.3	45.4	----	-----	53703.2	56.2
1136	9/11/2025	3:27:21	00d	01:00.0	59.4	77.2	72.3	43.2	-:-	67.7	60	47.8	44.8	44.1	----	-----	870963.6	56.3
1137	9/11/2025	3:28:21	00d	01:00.0	63.8	81.6	77	46	-:-	72.9	64.3	47.6	46.8	46.4	----	-----	2398832.9	56.2
1138	9/11/2025	3:29:21	00d	01:00.0	46.7	64.5	48.3	41.4	-:-	48.2	48	47.3	42.1	41.5	----	-----	46773.5	55.9
1139	9/11/2025	3:30:21	00d	01:00.0	47.8	65.6	49.2	44.3	-:-	48.9	48.6	48.1	46	45.5	----	-----	60256.0	56.0
1140	9/11/2025	3:31:21	00d	01:00.0	57.1	74.9	68.9	42.8	-:-	67.2	61.1	48.1	43	42.9	----	-----	512861.4	56.2
1141	9/11/2025	3:32:21	00d	01:00.0	47.5	65.3	48.2	47	-:-	48	47.9	47.4	47.2	47.2	----	-----	56234.1	56.1
1142	9/11/2025	3:33:21	00d	01:00.0	46.6	64.4	47.9	41	-:-	47.8	47.7	47.4	41.7	41.2	----	-----	45708.8	56.4
1143	9/11/2025	3:34:21	00d	01:00.0	46.7	64.5	48.3	40.3	-:-	48.1	47.9	47.3	42.3	41.6	----	-----	46773.5	56.6
1144	9/11/2025	3:35:21	00d	01:00.0	46.8	64.6	47.9	41.1	-:-	47.7	47.7	47.4	42.2	41.2	----	-----	47863.0	56.9
1145	9/11/2025	3:36:21	00d	01:00.0	46.6	64.4	47.7	41.7	-:-	47.6	47.6	47.2	42.3	42	----	-----	45708.8	56.9
1146	9/11/2025	3:37:21	00d	01:00.0	44.7	62.5	51.8	41.6	-:-	48	46.2	43.8	41.9	41.8	----	-----	29512.1	56.8
1147	9/11/2025	3:38:21	00d	01:00.0	42.4	60.2	44.9	41.6	-:-	44	43.4	42.2	41.7	41.6	----	-----	17378.0	56.9
1148	9/11/2025	3:39:21	00d	01:00.0	57.1	74.9	69.5	41	-:-	66.8	59.4	42.3	41.5	41.3	----	-----	512861.4	57.1
1149	9/11/2025	3:40:21	00d	01:00.0	42.7	60.5	44.4	41	-:-	44.2	43.7	42.6	41.5	41.2	----	-----	18620.9	57.1
1150	9/11/2025	3:41:21	00d	01:00.0	58	75.8	70.6	42.4	-:-	68.8	59.7	43.9	42.8	42.7	----	-----	630957.3	57.3
1151	9/11/2025	3:42:21	00d	01:00.0	57.2	75	70.2	41	-:-	66.3	59.7	43.6	41.8	41.4	----	-----	524807.5	57.2
1152	9/11/2025	3:43:21	00d	01:00.0	43.2	61	50.9	40.6	-:-	47.2	46.1	41.7	40.9	40.7	----	-----	20893.0	57.2
1153	9/11/2025	3:44:21	00d	01:00.0	42.9	60.7	45.7	41	-:-	45	44.4	42.7	41.8	41.6	----	-----	19498.4	57.2
1154	9/11/2025	3:45:21	00d	01:00.0	42.5	60.3	43.5	41.5	-:-	43.3	43.1	42.4	41.9	41.7	----	-----	17782.8	57.4
1155	9/11/2025	3:46:21	00d	01:00.0	58.9	76.7	71.6	42.4	-:-	66.6	59.9	43.5	42.8	42.7	----	-----	776247.1	57.4
1156	9/11/2025	3:47:21	00d	01:00.0	42.8	60.6	43.5	42.1	-:-	43.6	43.2	42.7	42.3	42.3	----	-----	19054.6	57.3
1157	9/11/2025	3:48:21	00d	01:00.0	42.9	60.7	43.9	42.4	-:-	43.6	43.4	42.8	42.5	42.5	----	-----	19498.4	57.6
1158	9/11/2025	3:49:21	00d	01:00.0	42.5	60.3	43.1	41.9	-:-	43	42.9	42.5	42.1	42.1	----	-----	17782.8	57.6
1159	9/11/2025	3:50:21	00d	01:00.0	42.6	60.4	43.5	41.8	-:-	43.3	43.1	42.6	42.2	42	----	-----	18197.0	58.0
1160	9/11/2025	3:51:21	00d	01:00.0	45.3	63.1	56.3	41.6	-:-	50.2	44.9	42.6	42	41.9	----	-----	33884.4	58.3
1161	9/11/2025	3:52:21	00d	01:00.0	65.8	83.6	76.8	41.9	-:-	76.1	69.2	44.4	42.3	42.1	----	-----	3801894.0	58.3
1162	9/11/2025	3:53:21	00d	01:00.0	43.4	61.2	45.8	42.4	-:-	45.4	44.4	43.1	42.6	42.5	----	-----	21877.6	57.9
1163	9/11/2025	3:54:21	00d	01:00.0	42.5	60.3	43.2	41.7	-:-	43.2	43	42.5	42	41.8	----	-----	17782.8	58.0
1164	9/11/2025	3:55:21	00d	01:00.0	42.6	60.4	43.7	41.5	-:-	43.5	43.2	42.6	42.1	41.9	----	-----	18197.0	58.0
1165	9/11/2025	3:56:21	00d	01:00.0	42.2	60	44.6	40.1	-:-	44.1	43.6	42	40.7	40.3	----	-----	16595.9	58.0
1166	9/11/2025	3:57:21	00d	01:00.0	56.1	73.9	68.5	40.2	-:-	66.9	57.4	41.5	40.6	40.4	----	-----	407380.3	58.0
1167	9/11/2025	3:58:21	00d	01:00.0	41.3	59.1	44.2	39.4	-:-	43	42.7	40.9	39.9	39.7	----	-----	13489.6	58.2
1168	9/11/2025	3:59:21	00d	01:00.0	42.9	60.7	47.3	40.8	-:-	46.7	45.8	41.7	41	40.9	----	-----	19498.4	58.2
1169	9/11/2025	4:00:21	00d	01:00.0	59.4	77.2	71.6	43.9	-:-	68.7	62.9	47.7	44.3	44.1	----	-----	870963.6	58.3
1170	9/11/2025	4:01:21	00d	01:00.0	42.1	59.9	47.7	39.2	-:-	44.6	44.2	41.3	40.1	39.7	----	-----	16218.1	58.3
1171	9/11/2025	4:02:21	00d	01:00.0	42.2	60	48.1	40.2	-:-	44	43.7	41.7	40.7	40.5	----	-----	16595.9	58.6
1172	9/11/2025	4:03:21	00d	01:00.0	43	60.8	46.7	41.1	-:-	46.4	44.9	42.1	41.4	41.3	----	-----	19952.6	58.8
1173	9/11/2025	4:04:21	00d	01:00.0	44.7	62.5	46.5	40.5	-:-	46.3	46.2	45.2	41.2	40.6	----	-----	29512.1	58.9
1174	9/11/2025	4:05:21	00d	01:00.0	60.2	78	72.7	40.7	-:-	69.3	64	45.9	41.4	40.9	----	-----	1047128.5	58.8
1175	9/11/2025	4:06:21	00d	01:00.0	58	75.8	70.4	41	-:-	66.3	60.4	46.2	45.2	41.4	----	-----	630957.3	58.8
1176	9/11/2025	4:07:21	00d	01:00.0	43	60.8	45.8	38.6	-:-	45.6	45.5	42.7	38.9	38.7	----	-----	19952.6	58.8
1177	9/11/2025	4:08:21	00d	01:00.0	43.1	60.9	46.5	39.3	-:-	46.5	46.2	41.3	39.7	39.6	----	-----	20417.4	58.8
1178	9/11/2025	4:09:21	00d	01:00.0	40.5	58.3	42	38.9	-:-	41.8	41.7	40.4	39.6	39.1	----	-----	11220.2	60.1
1179	9/11/2025	4:10:21	00d	01:00.0	64.2	82	76.1	40	-:-	74	67.6	46.4	40.3	40.2	----	-----	2630268.0	60.1
1180	9/11/2025	4:11:21	00d	01:00.0	40.3	58.1	42	39.3	-:-	41.7	41.3	40.3	39.4	39.3	----	-----	10715.2	59.9
1181	9/11/2025	4:12:21	00d	01:00.0	47.4	65.2	61.6	39	-:-	52.3	45.7	40.1	39.4	39.2	----	-----	54954.1	60.3
1182	9/11/2025	4:13:21	00d	01:00.0	62.4	80.2	76	41	-:-	69.5	61.8	45.8	42.4	41.8	----	-----	1737800.8	60.3
1183	9/11/2025	4:14:21	00d	01:00.0	41.3	59.1	47.7	38.9	-:-	45.4	43	40.6	39.4	39.3	----	-----	13489.6	60.2
1184	9/11/2025	4:15:21	00d	01:00.0	62.7	80.5	74.4	41	-:-	70.7	68.1	46.6	41.7	41.2	----	-----	1862087.1	60.3
1185	9/11/2025	4:16:21	00d	01:00.0	40.3	58.1	48.4	38.8	-:-	43.8	41.6	39.8	39	38.9	----	-----	10715.2	60.5
1186	9/11/2025	4:17:21	00d	01:00.0	40.4	58.2	41.7	39.5	-:-	41.7	41.3	40.3	39.8	39.6	----	-----	10964.8	60.6
1187	9/11/2025	4:18:21	00d	01:00.0	40	57.8	41.5	38.9	-:-	41.5	40.8	39.9	39.2	39	----	-----	10000.0	60.6
1188	9/11/2025	4:19:21	00d	01:00.0	40.2	58	41.7	39.2	-:-	41.7	41.1	40.1	39.4	39.3	----	-----	10471.3	60.8
1189	9/11/2025	4:20:21	00d	01:00.0	63.2	81	76.7	40.4	-:-	71.7	62.1	42.8	40.7	40.5	----	-----	2089296.1	61.3
1190	9/11/2025	4:21:21	00d	01:00.0	39.8	57.6	41.5	38.5	-:-	40.7	40.5	39.7	39.3	39	----	-----	9549.9	61.2
1191	9/11/2025	4:22:21	00d	01:00.0	39.5	57.3	40.7	37.5	-:-	40.6	40.4	39.5	38.3	38	----	-----	8912.5	61.2
1192	9/11/2025	4:23:21	00d	01:00.0	62.1	79.9	73.2	38.8	-:-	71.1	69.5	43.1	39.9	39.8	----	-----	1621810.1	61.2
1193	9/11/2025	4:24:21	00d	01:00.0	61.3	79.1	74.2	39.1	-:-	69.1	63.3	40.5	39.7	39.4	----	-----	1348962.9	61.3
1194	9/11/2025	4:25:21	00d	01:00.0	44.7	62.5	63	37.9	-:-	51.9	44.6	40.5	38.3	38.1	----	-----	29512.1	61.4
1195	9/11/2025	4:26:21	00d	01:00.0	42.2	60	51.4	39.3	-:-	49.3	43.1	40.2	39.7	39.6	----	-----	16595.9	61.6
1196	9/11/2025	4:27:21	00d	01:00.0	59	76.8	71.9	38.6	-:-	67.2	59.1	40.6	39.6	38.9	----	-----	794328.2	61.6

1197	9/11/2025	4:28:21	00d	01:00.0	39.5	57.3	41	38	-:-	40.6	40.2	39.4	38.6	38.2	----	-----	8912.5	61.7
1198	9/11/2025	4:29:21	00d	01:00.0	60.2	78	73.4	39.8	-:-	70.6	60.3	40.9	40.2	40.1	----	-----	1047128.5	61.9
1199	9/11/2025	4:30:21	00d	01:00.0	57	74.8	69.2	39.2	-:-	66.1	60.9	41.4	39.5	39.3	----	-----	501187.2	61.9
1200	9/11/2025	4:31:21	00d	01:00.0	60.3	78.1	73.3	39.8	-:-	69.3	62.5	42	40.3	39.9	----	-----	1071519.3	61.9
1201	9/11/2025	4:32:21	00d	01:00.0	39.7	57.5	41.5	38.5	-:-	40.9	40.9	39.5	38.7	38.7	----	-----	9332.5	61.9
1202	9/11/2025	4:33:21	00d	01:00.0	63	80.8	74.9	39.7	-:-	72.2	67.4	43.8	40.2	40	----	-----	1995262.3	62.0
1203	9/11/2025	4:34:21	00d	01:00.0	61.5	79.3	74.5	39.2	-:-	71.1	62.5	40.4	39.7	39.4	----	-----	1412537.5	62.0
1204	9/11/2025	4:35:21	00d	01:00.0	61.8	79.6	75.2	39.1	-:-	71.7	64.6	41.9	40.3	39.9	----	-----	1513561.2	62.2
1205	9/11/2025	4:36:21	00d	01:00.0	39.5	57.3	41.6	37.9	-:-	41.2	40.6	39.4	38.3	38.1	----	-----	8912.5	62.1
1206	9/11/2025	4:37:21	00d	01:00.0	42.3	60.1	53.1	38.1	-:-	49.9	43	39.6	38.5	38.2	----	-----	16982.4	62.3
1207	9/11/2025	4:38:21	00d	01:00.0	58.2	76	71.3	39.4	-:-	69.2	58	40.6	39.5	39.4	----	-----	660693.4	62.5
1208	9/11/2025	4:39:21	00d	01:00.0	60.6	78.4	74.2	39.3	-:-	70.9	60	40.7	39.8	39.7	----	-----	1148153.6	62.6
1209	9/11/2025	4:40:21	00d	01:00.0	57.7	75.5	69.8	39.9	-:-	67.7	61.8	44.3	41	40.1	----	-----	588843.7	62.6
1210	9/11/2025	4:41:21	00d	01:00.0	60.8	78.6	74.5	39.8	-:-	68.8	62	41.7	40.2	40	----	-----	1202264.4	62.9
1211	9/11/2025	4:42:21	00d	01:00.0	43.1	60.9	66.7	37.9	-:-	49.5	42.3	40.3	38.2	37.9	----	-----	20417.4	63.0
1212	9/11/2025	4:43:21	00d	01:00.0	55.8	73.6	71.3	38.5	-:-	58.7	51.6	40.7	38.9	38.7	----	-----	380189.4	63.3
1213	9/11/2025	4:44:21	00d	01:00.0	57.6	75.4	73.3	39.3	-:-	62.5	47.9	40.5	39.6	39.4	----	-----	575439.9	63.5
1214	9/11/2025	4:45:21	00d	01:00.0	59.1	76.9	72.7	39.8	-:-	69.1	58	41.3	40.4	40	----	-----	812830.5	63.7
1215	9/11/2025	4:46:21	00d	01:00.0	56.7	74.5	69.1	39.7	-:-	65.5	59.5	41	40	40	----	-----	467735.1	63.9
1216	9/11/2025	4:47:21	00d	01:00.0	39.9	57.7	42	38.5	-:-	41.5	41.2	39.9	38.8	38.8	----	-----	9772.4	64.0
1217	9/11/2025	4:48:21	00d	01:00.0	64	81.8	75.3	40.7	-:-	72.1	68.8	49.3	43	41.6	----	-----	2511886.4	64.2
1218	9/11/2025	4:49:21	00d	01:00.0	42.1	59.9	44.5	38.5	-:-	44	43.6	42.3	39.3	38.8	----	-----	16218.1	64.1
1219	9/11/2025	4:50:21	00d	01:00.0	65.5	83.3	79	38.6	-:-	74.3	66.8	40.8	39.2	39	----	-----	3548133.9	64.1
1220	9/11/2025	4:51:21	00d	01:00.0	64.2	82	73.5	39.4	-:-	73.2	69.5	50.4	40	39.8	----	-----	2630268.0	64.1
1221	9/11/2025	4:52:21	00d	01:00.0	40.3	58.1	42.6	38.8	-:-	42.1	41.5	40	39.4	39	----	-----	10715.2	64.0
1222	9/11/2025	4:53:21	00d	01:00.0	40.3	58.1	43.1	38	-:-	42.3	42.2	39.8	38.8	38.7	----	-----	10715.2	64.2
1223	9/11/2025	4:54:21	00d	01:00.0	57.4	75.2	70.6	38.6	-:-	66.4	58.2	40.7	39.3	38.9	----	-----	549540.9	64.2
1224	9/11/2025	4:55:21	00d	01:00.0	41.5	59.3	43.9	38.6	-:-	43.6	43.4	40.8	39.2	39	----	-----	14125.4	64.3
1225	9/11/2025	4:56:21	00d	01:00.0	43.4	61.2	44.2	40.7	-:-	44.1	44.1	43.7	42.1	41.2	----	-----	21877.6	64.4
1226	9/11/2025	4:57:21	00d	01:00.0	47.5	65.3	56.1	42	-:-	53.7	51	44.8	42.7	42.1	----	-----	56234.1	64.5
1227	9/11/2025	4:58:21	00d	01:00.0	63.8	81.6	77.4	42	-:-	71.6	65.2	44.3	43	42.2	----	-----	2398832.9	64.5
1228	9/11/2025	4:59:21	00d	01:00.0	42.7	60.5	66.6	38.9	-:-	48.8	44.9	40.5	39.3	39.1	----	-----	18620.9	64.4
1229	9/11/2025	5:00:21	00d	01:00.0	61.8	79.6	75.5	39.9	-:-	70.9	61.3	41.8	40.3	40	----	-----	1513561.2	64.5
1230	9/11/2025	5:01:21	00d	01:00.0	40.5	58.3	43.2	39.2	-:-	41.9	41.4	40.5	39.6	39.4	----	-----	11220.2	64.5
1231	9/11/2025	5:02:21	00d	01:00.0	65.3	83.1	76.9	39.3	-:-	75.1	68.5	46.3	39.8	39.7	----	-----	3388441.6	64.5
1232	9/11/2025	5:03:21	00d	01:00.0	63.1	80.9	74.8	38.4	-:-	71.8	68.4	41.8	38.9	38.6	----	-----	2041737.9	64.4
1233	9/11/2025	5:04:21	00d	01:00.0	57.7	75.5	71	38.9	-:-	65.8	57.2	42.7	40.2	39.1	----	-----	588843.7	64.5
1234	9/11/2025	5:05:21	00d	01:00.0	40.4	58.2	60.9	38.4	-:-	44.5	41.5	39.7	38.8	38.5	----	-----	10964.8	64.6
1235	9/11/2025	5:06:21	00d	01:00.0	40.1	57.9	43.5	38.1	-:-	42.6	41.6	39.7	38.8	38.3	----	-----	10232.9	64.6
1236	9/11/2025	5:07:21	00d	01:00.0	62	79.8	75.5	39.8	-:-	71.9	62.9	41.8	40.2	40.2	----	-----	1584893.2	64.6
1237	9/11/2025	5:08:21	00d	01:00.0	40.6	58.4	42	39.2	-:-	41.9	41.7	40.5	39.8	39.4	----	-----	11481.5	64.6
1238	9/11/2025	5:09:21	00d	01:00.0	71.8	89.6	84.9	40.2	-:-	79.7	74	42	40.5	40.3	----	-----	15135612.5	64.6
1239	9/11/2025	5:10:21	00d	01:00.0	47.5	65.3	58.8	39.6	-:-	53.6	50.9	45.4	40.1	39.6	----	-----	56234.1	64.3
1240	9/11/2025	5:11:21	00d	01:00.0	56.2	74	68.4	40.2	-:-	65.4	60.3	42.8	40.8	40.6	----	-----	416869.4	64.4
1241	9/11/2025	5:12:21	00d	01:00.0	67.1	84.9	78.2	38.7	-:-	75.3	73	45.2	39.2	38.9	----	-----	5128613.8	64.4
1242	9/11/2025	5:13:21	00d	01:00.0	40.1	57.9	44.9	38.3	-:-	43.1	41.1	39.6	38.9	38.5	----	-----	10232.9	64.4
1243	9/11/2025	5:14:21	00d	01:00.0	61.3	79.1	75	38.4	-:-	70.8	59	40.9	39.3	38.6	----	-----	1348962.9	64.4
1244	9/11/2025	5:15:21	00d	01:00.0	61.9	79.7	75.7	38.5	-:-	69.3	60.8	43.2	40.7	39.6	----	-----	1548816.6	64.8
1245	9/11/2025	5:16:21	00d	01:00.0	67	84.8	77.2	40.2	-:-	76.1	72.3	53.3	41.5	41	----	-----	5011872.3	64.7
1246	9/11/2025	5:17:21	00d	01:00.0	58.9	76.7	72.2	39.3	-:-	67.8	58.2	41.9	40	39.6	----	-----	776247.1	64.6
1247	9/11/2025	5:18:21	00d	01:00.0	46.3	64.1	50.2	41.2	-:-	50.1	49.2	46	42.1	41.5	----	-----	42658.0	64.7
1248	9/11/2025	5:19:21	00d	01:00.0	66.4	84.2	76.2	45.2	-:-	73.8	71.9	55.6	46.2	45.5	----	-----	4365158.3	64.7
1249	9/11/2025	5:20:21	00d	01:00.0	68.9	86.7	81.4	43	-:-	76	74.5	53.2	44.5	43.2	----	-----	7762471.2	64.8
1250	9/11/2025	5:21:21	00d	01:00.0	59.2	77	72.2	41	-:-	67.7	60.1	43.7	41.9	41.5	----	-----	831763.8	64.7
1251	9/11/2025	5:22:21	00d	01:00.0	41.9	59.7	44.1	39.9	-:-	43.5	43.3	41.9	40.2	40	----	-----	15488.2	64.7
1252	9/11/2025	5:23:21	00d	01:00.0	41.3	59.1	45.6	37.8	-:-	44.9	44.4	40.1	38.7	38.1	----	-----	13489.6	64.9
1253	9/11/2025	5:24:21	00d	01:00.0	64.4	82.2	76.1	44	-:-	72.6	70.1	50	44.8	44.4	----	-----	2754228.7	64.9
1254	9/11/2025	5:25:21	00d	01:00.0	66.4	84.2	75.6	44	-:-	75	72.8	50.3	44.8	44.4	----	-----	4365158.3	64.8
1255	9/11/2025	5:26:21	00d	01:00.0	64.4	82.2	75.4	44.7	-:-	72.4	71	48.3	45.1	45	----	-----	2754228.7	64.8
1256	9/11/2025	5:27:21	00d	01:00.0	46.2	64	50.2	44	-:-	49.9	48.9	45.3	44.2	44.2	----	-----	41686.9	64.8
1257	9/11/2025	5:28:21	00d	01:00.0	64.6	82.4	75.2	44.7	-:-	74	68.6	49.8	45.7	45.4	----	-----	2884031.5	64.9
1258	9/11/2025	5:29:21	00d	01:00.0	67	84.8	78.3	44.8	-:-	74.1	72.5	53	45.4	45	----	-----	5011872.3	64.8
1259	9/11/2025	5:30:21	00d	01:00.0	59.9	77.7	72.9	41.2	-:-	68.7	60.3	44.5	42	41.7	----	-----	977237.2	64.8
1260	9/11/2025	5:31:21	00d	01:00.0	58.9	76.7	71.8	42.1	-:-	66.7	60.7	45.5	44.4	44	----	-----	776247.1	64.8
1261	9/11/2025	5:32:21	00d	01:00.0	44.3	62.1	46	42.8	-:-	45.4	45.2	44.2	43.3	43.1	----	-----	26915.3	64.9
1262	9/11/2025	5:33:21	00d	01:00.0	62.6	80.4	73	42.1	-:-	72.5	66.9	46.8	43.3	42.2	----	-----	1819700.9	65.0
1263	9/11/2025	5:34:21	00d	01:00.0	65	82.8	76.8	41	-:-	74.6	70.5	45.6	41.4	41.3	----	-----	3162277.7	65.0
1264	9/11/2025	5:35:21	00d	01:00.0	67.5	85.3	80.2	42.1	-:-	76	71.9	44.9	42.7	42.5	----	-----	5623413.3	65.0
1265	9/11/2025	5:36:21	00d	01:00.0	43	60.8	46.1	41.2	-:-	45.7	44.8	42.7	41.5	41.4	----	-----	19952.6	65.1
1266	9/11/2025	5:37:21	00d	01:00.0	66.6	84.4	78.7	40.1	-:-	76.1	71.4	45.4	40.4	40.3	----	-----	4570881.9	65.1
1267	9/11/2025	5:38:21	00d	01:00.0	65.8	83.6	78.6	40.5	-:-	74.2	69	42.9	41.4	41.2	----	-----	3801894.0	65.1
1268	9/11/2025	5:39:21	00d	01:00.0	66.1	83.9	78.6	41.8	-:-	74.2	71.2	48	42.4	42.3	----	-----	4073802.8	65.1
1269	9/11/2025	5:40:21	00d	01:00.0	55.9	73.7	78.6	41.7	-:-	59.2	50.6	43.9	42.2	42.1	----	-----	389045.1	65.3
1270	9/11/2025	5:41:21	00d	01:00.0	70.1	87.9	81	42.2	-:-	78.5	75.4	56.7	45.5	44.1	----	-----	10232929.9	65.3
1271	9/11/2025	5:42:21	00d	01:00.0	65.6	83.4	79.9	45.5	-:-	73.5	71.4	52.3	46.3	45.9	----	-----	3630780.5	65.2
1272	9/11/2025	5:43:21	00d	01:00.0	68.1	85.9	76.2	47.5	-:-	76.3	73.5	57.1	49	48.1	----	-----	6456542.3	65.1
1273	9/11/2025	5:44:21	00d	01:00.0	68.4	86.2	79.9	42.6	-:-	75.1	73.8	54	43.3	42.9	----	-----	6918309.7	65.0
1274	9/11/2025	5:45:21	00d	01:00.0	68.4	86.2	79.9	44	-:-	78.5	73.8	48.2	45	44.4	----	-----	6918309.7	64.9
1275	9/11/2025	5:46:21	00d	01:00.0	70.1	87.9	82.7	45.1	-:-	77	73.9	53.9	47.4	45.8	----	-----	10232929.9	64.8
1276	9/11/2025	5:47:21	00d	01:00.0	65.2	83	75.4	45.9	-:-	72.6	71.7	54.9	47.3	46.3	----	-----	3311311.2	64.6
1277	9/11/2025	5:48:21	00d	01:00.0	67	84.8	74.4	45.5	-:-	74	72.6	57.8	47.3	46.6	----	-----	5011872.3	64.6
1278	9/11/2025	5:49:21	00d	01:00.0	61.8	79.6	72.6	40.8	-:-	71	65.4	43.9	41.2	41	----	-----	1513561.2	64.5
1279	9/11/2025	5:50:21	00d	01:00.0	46.9	64.7	56.6	41.8	-:-	53.6	48.4	43.8	42.3	41.9	----	-----	48977.9	64.6
1280	9/11/2025	5:51:21	00d	01:00.0	61.4	79.2	74.4	40.6	-:-	71.2	63.8	42.2	41.1	41	----	-----	1380384.3	64.9
1281	9/11/2025	5:52:21	00d	01:00.0	61.9	79.7	75.2	40.6	-:-	68.6	62.7	42.9	41.2	40.8	----	-----	1548816.6	64.9
1282	9/11/2025	5:53:21	00d	01:00.0	66.5	84.3	78.6	41.9	-:-	74.3	70.6	44.2	42.8	42.5	----	-----	4466835.9	64.9
1283	9/11/2025	5:54:21	00d	01:00.0	46.9	64.7	66.4	41.5	-:-	53.3	48.2	43.7	42	41.7	----	-----	48977.9	65.0
1284	9/11/2025	5:55:21	00d	01:00.0	65.9	83.7	74.4	41.2	-:-	74.2	72.3	57.1	42.7	41.8	----	-----	3890451.4	65.1
1285	9/11/2025	5:56:21	00d	01:00.0	65.8	83.6	74.9	43	-:-	74	72.5	54.3	43.9	43.4	----	-----	3801894.0	65.2
1286	9/11/2025	5:57:21	00d	01:00.0	65.6	83.4	76.4	44.4	-:-	74.4	70.4	52.9	46.5	44.8	----	-----	3630780.5	65.3
1287	9/11/2025	5:58:21	00d	01:00.0	61.2	79	73.6	42.4	-:-	71.1	63	45.4	42.9	42.7	----	-----	1318256.7	65.3
1288	9/11/2025	5:59:21	00d	01:00.0	43.7	61.5	46.6	41.6	-:-	46.3	45.5	43.3	42.3	41.8	----	-----	23442.3	65.4
1289	9/11/2025	6:00:21	00d	01:00.0	60.6	78.4	71.4	40.8	-:-	70.7	66	45.2	41.6	41.5	----	-----	1148153.6	65.7
1290	9/11/2025	6:01:21	00d	01:00.0	64.6	82.4	76.7	42.3	-:-	73.5	70.3	46.6	42.7	42.7	----	-----	2884031.5	65.8
1291	9/11/2025	6:02:21	00d	01:00.0	43.7	61.5	45.3	42.5	-:-	45	44.7	43.7	42.7	42.5	----	-----	23442.3	65.9
1292	9/11/2025	6:03:21	00d	01:00.0	59.1	76.9	71.8	40.3	-:-	69.1	56.3	43.4	41.4	41.2	----	-----	812830.5	65.9
1293	9/11/2025	6:04:21	00d	01:00.0	68.2	86	79.5	47	-:-	75.8	72.9	59.9	48.8	48	----	-----	6606934.5	65.9
1294	9/11/2025	6:05:21	00d	01:00.0	59.8	77.6	72.8	42	-:-	68.4	59.2	44	42.4	42.3	----	-----	954992.6	65.9
1295	9/11/2025	6:06:21	00d	01:00.0	52.4	70.2	67	42.6	-:-	56.9	49.7	44.5	43.2	43.2	----	-----	173780.1	65.9
1296	9/11/2025	6:07:21	00d	01:00.0	62.2	80	74.7	41.1	-:-	71.5	65.8	45.3	42	41.3	----	-----	1659586.9	66.0
1297	9/11/2025	6:08:21	00d	01:00.0	60.1	77.9	73.2	42.1	-:-	69.5	62.2	44.1	42.7	42.3	----	-----	1023293.0	66.1
1298	9/11/2025	6:09:21	00d	01:00.0	42.8	60.6	46.1	40.6	-:-	45.1	44.8	42.4	41.1	40.9	----	-----	19054.6	66.1
1299	9/11/2025	6:10:21	00d	01:00.0	67.3	85.1	76.3	43.8	-:-	75	72.7	55.7	45.1	44.2	----	-----	5370318.0	66.2
1300	9/11/2025	6:11:21	00d	01:00.0	61.8	79.6	74.5	42.4	-:-	69.8	65.8	45.2	43.3	42.7	----	-----	1513561.2	66.2
1301	9/11/2025	6:12:21	00d	01:00.0	63.5	81.3	76.1	40.4	-:-	74.6	58	42.5	41.5	41	----	-----	2238721.1	66.2
1302	9/11/2025	6:13:21	00d	01:00.0	66.2	84	75.9	46	-:-	73.1	72.1	57.2	47.5	46.5	----	-----	4168693.8	66.2
1303	9/11/2025	6:14:21	00d	01:00.0	62.4	80.2	74	43.4	-:-	72.9	65.9	47	44.1	43.7	----	-----	1737800.8	66.2
1304	9/11/2025	6:15:21	00d	01:00.0	71.8	89.6	82.2	43.8	-:-	80.8	77	59.3	46	44.8	----	-----	15135612.5	66.2
1305	9/11/2025	6:16:21	00d	01:00.0	48.5	66.3	68.6	40.9	-:-	56.6	50.5	43.2	41.7	41.4	----	-----	70794.6	66.1

1306	9/11/2025	6:17:21	00d	01:00.0	57.6	75.4	70.7	40.7	-:-	67.6	58.8	42.4	41.1	40.9	----	-----	575439.9	66.3
1307	9/11/2025	6:18:21	00d	01:00.0	65.1	82.9	77.5	41.4	-:-	73.3	68.9	51.1	43	42.3	----	-----	3235936.6	66.3
1308	9/11/2025	6:19:21	00d	01:00.0	57.4	75.2	69.5	42.3	-:-	66.6	61	45.3	42.8	42.6	----	-----	549540.9	66.4
1309	9/11/2025	6:20:21	00d	01:00.0	69.5	87.3	81.4	42.9	-:-	75.8	73.5	52.3	43.6	43.4	----	-----	8912509.4	66.4
1310	9/11/2025	6:21:21	00d	01:00.0	60.9	78.7	72	44.4	-:-	70.1	65.9	47.9	44.8	44.6	----	-----	1230268.8	66.4
1311	9/11/2025	6:22:21	00d	01:00.0	62.2	80	72.6	44.1	-:-	72	68.9	48	45	44.7	----	-----	1659586.9	66.4
1312	9/11/2025	6:23:21	00d	01:00.0	68.6	86.4	79	45.2	-:-	77	75	53	45.9	45.6	----	-----	7244359.6	66.6
1313	9/11/2025	6:24:21	00d	01:00.0	48.9	66.7	69.6	41.7	-:-	56.6	51.4	43.3	42.1	41.8	----	-----	77624.7	66.5
1314	9/11/2025	6:25:21	00d	01:00.0	59.4	77.2	72	41.1	-:-	69.7	60	42	41.4	41.2	----	-----	870963.6	66.9
1315	9/11/2025	6:26:21	00d	01:00.0	65.7	83.5	74.7	42.6	-:-	74.4	71.9	53	43	42.8	----	-----	3715352.3	67.0
1316	9/11/2025	6:27:21	00d	01:00.0	66.1	83.9	74.3	42.3	-:-	72.9	72.6	51.7	43.6	42.7	----	-----	4073802.8	67.1
1317	9/11/2025	6:28:21	00d	01:00.0	60.7	78.5	73.8	42.8	-:-	68.8	62.6	45.6	43.2	42.8	----	-----	1174897.6	67.4
1318	9/11/2025	6:29:21	00d	01:00.0	62.2	80	74.1	43.7	-:-	71.2	66.4	48.2	45	44.5	----	-----	1659586.9	67.4
1319	9/11/2025	6:30:21	00d	01:00.0	64.8	82.6	76.6	43.6	-:-	72.2	70.8	49.9	44.3	43.9	----	-----	3019951.7	67.5
1320	9/11/2025	6:31:21	00d	01:00.0	60.9	78.7	74.8	44.4	-:-	66.6	60.8	46.2	45.1	44.9	----	-----	1230268.8	67.6
1321	9/11/2025	6:32:21	00d	01:00.0	68.6	86.4	75.9	48.6	-:-	75	74.3	62.9	52.3	50.5	----	-----	7244359.6	67.7
1322	9/11/2025	6:33:21	00d	01:00.0	66.3	84.1	76.5	43	-:-	75.4	73.9	49.1	43.7	43.5	----	-----	4265795.2	67.7
1323	9/11/2025	6:34:21	00d	01:00.0	63.6	81.4	76.6	42.7	-:-	71.5	63.9	44.8	43	42.9	----	-----	2290867.7	67.6
1324	9/11/2025	6:35:21	00d	01:00.0	56.9	74.7	69.7	42.6	-:-	67.7	56.7	44.2	43.2	42.9	----	-----	489778.8	67.7
1325	9/11/2025	6:36:21	00d	01:00.0	70.1	87.9	81.7	49.8	-:-	75.4	73.5	62.8	51.3	50.4	----	-----	10232929.9	67.7
1326	9/11/2025	6:37:21	00d	01:00.0	62.1	79.9	74.9	45.9	-:-	71.4	64.1	49.5	46.7	46.5	----	-----	1621810.1	67.7
1327	9/11/2025	6:38:21	00d	01:00.0	66.6	84.4	78.1	45.6	-:-	73.2	70.8	54.1	46.1	45.9	----	-----	4570881.9	67.8
1328	9/11/2025	6:39:21	00d	01:00.0	61.2	79	74.7	45	-:-	70.3	67.2	48.6	45.8	45.5	----	-----	1318256.7	67.8
1329	9/11/2025	6:40:21	00d	01:00.0	71.4	89.2	84.2	45.7	-:-	81.4	73.5	60.6	47.6	45.8	----	-----	13803842.6	67.9
1330	9/11/2025	6:41:21	00d	01:00.0	65.2	83	73.6	46.9	-:-	73.5	71.3	50.7	47.4	47.1	----	-----	3311311.2	67.8
1331	9/11/2025	6:42:21	00d	01:00.0	63	80.8	74.5	45.3	-:-	71.5	69.3	48.7	46.6	46	----	-----	1995262.3	67.8
1332	9/11/2025	6:43:21	00d	01:00.0	64.1	81.9	73.9	45.5	-:-	72.4	70.3	52.2	46.5	45.8	----	-----	2570395.8	67.8
1333	9/11/2025	6:44:21	00d	01:00.0	63.5	81.3	74.5	46.2	-:-	72.7	68.8	48.6	46.7	46.5	----	-----	2238721.1	67.8
1334	9/11/2025	6:45:21	00d	01:00.0	64.4	82.2	75.1	45.7	-:-	74.5	69	48.4	46	46	----	-----	2754228.7	67.8
1335	9/11/2025	6:46:21	00d	01:00.0	64.1	81.9	76.5	42.7	-:-	71.5	66.8	47.3	43.4	42.8	----	-----	2570395.8	67.9
1336	9/11/2025	6:47:21	00d	01:00.0	58.3	76.1	71.4	46.8	-:-	68	58.4	48.7	47.4	47.2	----	-----	676083.0	68.0
1337	9/11/2025	6:48:21	00d	01:00.0	65.5	83.3	75.2	46.4	-:-	73.6	72.9	55.5	47.9	47.4	----	-----	3548133.9	68.0
1338	9/11/2025	6:49:21	00d	01:00.0	61.3	79.1	72.4	44.6	-:-	70.2	66.5	50.9	45.8	44.9	----	-----	1348962.9	68.1
1339	9/11/2025	6:50:21	00d	01:00.0	65.6	83.4	77.9	47.8	-:-	74.5	69.6	53	48.2	47.7	----	-----	3630780.5	68.2
1340	9/11/2025	6:51:21	00d	01:00.0	70.7	88.5	81.8	46.8	-:-	76.4	75.4	60.7	47.3	47	----	-----	11748975.5	68.2
1341	9/11/2025	6:52:21	00d	01:00.0	63.1	80.9	74.8	43.1	-:-	72	69	48.9	43.6	43.5	----	-----	2041737.9	68.1
1342	9/11/2025	6:53:21	00d	01:00.0	65.1	82.9	76.9	44.1	-:-	73.2	70.9	49	45	44.6	----	-----	3235936.6	68.2
1343	9/11/2025	6:54:21	00d	01:00.0	67.8	85.6	77.5	45	-:-	75.7	73	56.4	45.4	45.3	----	-----	6025595.9	68.2
1344	9/11/2025	6:55:21	00d	01:00.0	69.2	87	77.2	50.1	-:-	77.4	75.1	60.9	52	51.7	----	-----	8317637.7	68.2
1345	9/11/2025	6:56:21	00d	01:00.0	69.1	86.9	77.4	47.3	-:-	76.2	74.8	60	48.1	47.8	----	-----	8128305.2	68.2
1346	9/11/2025	6:57:21	00d	01:00.0	67.6	85.4	76.8	50.7	-:-	74.9	72.3	60	51.8	51.2	----	-----	5754399.4	68.1
1347	9/11/2025	6:58:21	00d	01:00.0	66.4	84.2	77.2	47.6	-:-	74.5	71.4	53.4	49.4	48.8	----	-----	4365158.3	68.1
1348	9/11/2025	6:59:21	00d	01:00.0	69.1	86.9	77	54.9	-:-	76.4	75.3	62.3	55.8	55.5	----	-----	8128305.2	68.2
1349	9/11/2025	7:00:21	00d	01:00.0	71.6	89.4	78.8	56.5	-:-	78.5	77.2	68	58.2	57.8	----	-----	14454397.7	68.1
1350	9/11/2025	7:01:21	00d	01:00.0	67	84.8	76.7	55.6	-:-	76	72	58.5	56.6	56.2	----	-----	5011872.3	68.0
1351	9/11/2025	7:02:21	00d	01:00.0	68.2	86	76.6	46.5	-:-	75.4	73.4	58.3	47.7	47.3	----	-----	6606934.5	68.0
1352	9/11/2025	7:03:21	00d	01:00.0	60.6	78.4	71.1	45.7	-:-	69.8	64.4	48.8	46	45.7	----	-----	1148153.6	68.0
1353	9/11/2025	7:04:21	00d	01:00.0	66.3	84.1	75	44.8	-:-	72.7	72.3	58.4	45.8	45.3	----	-----	4265795.2	68.1
1354	9/11/2025	7:05:21	00d	01:00.0	65.8	83.6	77	46.4	-:-	74.2	70.6	54.5	47.1	46.5	----	-----	3801894.0	68.2
1355	9/11/2025	7:06:21	00d	01:00.0	65.8	83.6	77.2	44.3	-:-	75.8	69.9	53.5	45.5	44.6	----	-----	3801894.0	68.1
1356	9/11/2025	7:07:21	00d	01:00.0	67.5	85.3	77.6	44.2	-:-	76	73.5	47.2	45	44.8	----	-----	5623413.3	68.1
1357	9/11/2025	7:08:21	00d	01:00.0	66	83.8	77	44.2	-:-	74.1	72.1	51.6	44.8	44.5	----	-----	3981071.7	68.1
1358	9/11/2025	7:09:21	00d	01:00.0	65.9	83.7	74.8	44.7	-:-	73.2	71.8	52.4	45.3	44.8	----	-----	3890451.4	68.1
1359	9/11/2025	7:10:21	00d	01:00.0	66.2	84	77.5	47.6	-:-	72.2	71.4	55.5	48.4	48	----	-----	4168693.8	68.1
1360	9/11/2025	7:11:21	00d	01:00.0	65.5	83.3	72.2	55.4	-:-	71.4	70.4	62.5	59	58.2	----	-----	3548133.9	68.2
1361	9/11/2025	7:12:21	00d	01:00.0	67.2	85	74.9	59.8	-:-	74	72.7	62.4	60.7	60.3	----	-----	5248074.6	68.2
1362	9/11/2025	7:13:21	00d	01:00.0	64	81.8	73.1	47.5	-:-	71.5	68.8	60.1	47.7	47.5	----	-----	2511886.4	68.1
1363	9/11/2025	7:14:21	00d	01:00.0	63	80.8	73.4	46.5	-:-	71	70	51.9	47.2	46.9	----	-----	1995262.3	68.1
1364	9/11/2025	7:15:21	00d	01:00.0	64.1	81.9	72.6	48.5	-:-	72.2	70.1	58.3	49.9	49.3	----	-----	2570395.8	68.1
1365	9/11/2025	7:16:21	00d	01:00.0	68.2	86	76.1	56.6	-:-	74.8	73.6	62	57.3	57	----	-----	6606934.5	68.2
1366	9/11/2025	7:17:21	00d	01:00.0	71.2	89	78.9	58.4	-:-	77.7	76.4	66.5	59.3	59	----	-----	13182567.4	68.2
1367	9/11/2025	7:18:21	00d	01:00.0	59.3	77.1	71	45.2	-:-	66.1	60.6	47.4	45.3	45.2	----	-----	851138.0	68.1
1368	9/11/2025	7:19:21	00d	01:00.0	69.2	87	79.5	48.5	-:-	77.3	74.1	59.1	50.9	50.3	----	-----	8317637.7	68.2
1369	9/11/2025	7:20:21	00d	01:00.0	65.5	83.3	76.5	46.3	-:-	73.8	70.7	54.3	46.7	46.5	----	-----	3548133.9	68.3
1370	9/11/2025	7:21:21	00d	01:00.0	66.9	84.7	75.1	50.9	-:-	75	72.7	59.9	52.5	51.4	----	-----	4897788.2	68.3
1371	9/11/2025	7:22:21	00d	01:00.0	66.1	83.9	76.7	47.3	-:-	72.7	70.9	55.3	49	47.8	----	-----	4073802.8	68.4
1372	9/11/2025	7:23:21	00d	01:00.0	71.2	89	85.9	44.3	-:-	73.8	72	47.2	44.6	44.5	----	-----	13182567.4	68.4
1373	9/11/2025	7:24:21	00d	01:00.0	64.7	82.5	75.8	49.5	-:-	71.6	70	52.9	50	49.8	----	-----	2951209.2	68.3
1374	9/11/2025	7:25:21	00d	01:00.0	74.3	92.1	85.5	52.6	-:-	83.9	76.1	64.2	53.9	53.1	----	-----	26915348.0	68.4
1375	9/11/2025	7:26:21	00d	01:00.0	64.7	82.5	73.9	46.9	-:-	73.7	70.1	54.7	48	47.4	----	-----	2951209.2	68.2
1376	9/11/2025	7:27:21	00d	01:00.0	70.4	88.2	84.4	46.7	-:-	73.9	72.1	55.4	47.4	47.3	----	-----	10964782.0	68.3
1377	9/11/2025	7:28:21	00d	01:00.0	74.5	92.3	85.3	53.1	-:-	82.1	78	68.6	56.5	54.9	----	-----	28183829.3	68.2
1378	9/11/2025	7:29:21	00d	01:00.0	65.8	83.6	75.2	49.3	-:-	73.8	72.2	53.9	49.9	49.3	----	-----	3801894.0	68.2
1379	9/11/2025	7:30:21	00d	01:00.0	70.2	88	79	51.7	-:-	78.4	74.2	64.6	52.5	52.1	----	-----	10471285.5	68.2
1380	9/11/2025	7:31:21	00d	01:00.0	67.1	84.9	74.2	50.3	-:-	73.8	71.5	63.2	51.9	51.3	----	-----	5128613.8	68.1
1381	9/11/2025	7:32:21	00d	01:00.0	70.4	88.2	81.6	47.8	-:-	77.4	76.1	58.7	49.7	48.2	----	-----	10964782.0	68.1
1382	9/11/2025	7:33:21	00d	01:00.0	66.7	84.5	75.9	47.3	-:-	72.5	71.6	55.5	47.9	47.7	----	-----	4677351.4	68.0
1383	9/11/2025	7:34:21	00d	01:00.0	65	82.8	74.4	47.1	-:-	73.5	71.7	53.6	48.1	47.5	----	-----	3162277.7	68.0
1384	9/11/2025	7:35:21	00d	01:00.0	68.1	85.9	78.5	48.2	-:-	76.3	72.1	59.5	48.9	48.6	----	-----	6456542.3	68.1
1385	9/11/2025	7:36:21	00d	01:00.0	66.7	84.5	75.8	51.8	-:-	73.9	72.5	57.8	51.9	51.5	----	-----	4677351.4	68.1
1386	9/11/2025	7:37:21	00d	01:00.0	69	86.8	76.8	48.6	-:-	75.1	73.9	63.6	50.2	48.7	----	-----	7943282.3	68.1
1387	9/11/2025	7:38:21	00d	01:00.0	67.7	85.5	76.6	48.3	-:-	75.7	73.9	58.4	49.7	49.1	----	-----	5888436.6	68.1
1388	9/11/2025	7:39:21	00d	01:00.0	68.7	86.5	79.7	51.8	-:-	74.7	72.9	61.7	53.1	52.1	----	-----	7413102.4	68.1
1389	9/11/2025	7:40:21	00d	01:00.0	70.8	88.6	83.5	48.2	-:-	77.1	73.6	60	49.3	48.6	----	-----	12022644.3	68.1
1390	9/11/2025	7:41:21	00d	01:00.0	66.4	84.2	83.4	45.6	-:-	74.2	70.9	55.8	46	46	----	-----	4365158.3	68.0
1391	9/11/2025	7:42:21	00d	01:00.0	62.4	80.2	72.1	45.4	-:-	70.7	68.2	50	45.9	45.7	----	-----	1737800.8	68.0
1392	9/11/2025	7:43:21	00d	01:00.0	66.2	84	74.9	43.8	-:-	74.5	72.9	46.1	44.4	44.2	----	-----	4168693.8	68.1
1393	9/11/2025	7:44:21	00d	01:00.0	65.9	83.7	74.5	49.5	-:-	73.9	70.2	59	49.9	49.4	----	-----	3890451.4	68.1
1394	9/11/2025	7:45:21	00d	01:00.0	64.5	82.3	74	47.3	-:-	72	70.6	56.3	48	47.9	----	-----	2818382.9	68.2
1395	9/11/2025	7:46:21	00d	01:00.0	67.9	85.7	74.9	56.8	-:-	74.5	71.8	63.5	57	55.3	----	-----	6165950.0	68.2
1396	9/11/2025	7:47:21	00d	01:00.0	69.5	87.3	79.4	53.5	-:-	74.6	74	61.9	56	54.7	----	-----	8912509.4	68.2
1397	9/11/2025	7:48:21	00d	01:00.0	65	82.8	74	48.1	-:-	73.5	71.3	56.8	51.8	48.8	----	-----	3162277.7	68.2
1398	9/11/2025	7:49:21	00d	01:00.0	70.2	88	77.7	52.8	-:-	76.3	74.3	68.4	54.5	52.4	----	-----	10471285.5	68.2
1399	9/11/2025	7:50:21	00d	01:00.0	70.2	88	81.7	46.6	-:-	77.5	74	62.9	47.6	47.2	----	-----	10471285.5	68.2
1400	9/11/2025	7:51:21	00d	01:00.0	69.8	87.6	75.2	50.5	-:-	74.2	73.7	68.6	52.1	50.4	----	-----	9549925.9	68.1
1401	9/11/2025	7:52:21	00d	01:00.0	65	82.8	73.2	47.9	-:-	72.9	71.6	55.5	49.1	47.8	----	-----	3162277.7	68.1
1402	9/11/2025	7:53:21	00d	01:00.0	66.4	84.2	76	45.7	-:-	74.6	71.3	57.9	46.6	45.9	----	-----	4365158.3	68.1
1403	9/11/2025	7:54:21	00d	01:00.0	69.7	87.5	80.8	43.6	-:-	77.5	74.8	58.1	44.1	43.9	----	-----	9332543.0	68.2
1404	9/11/2025	7:55:21	00d	01:00.0	61.7	79.5	75.1	45.2	-:-	70.5	62.6	47.9	45.9	45.8	----	-----	1479108.4	68.1
1405	9/11/2025	7:56:21	00d	01:00.0	70.3	88.1	82.4	49	-:-	78.7	72.2	62.8	52.3	50.7	----	-----	10715193.1	68.2
1406	9/11/2025	7:57:21	00d	01:00.0	64.4	82.2	71.8	44	-:-	71.5	70	57.5	44.7	44.6	----	-----	2754228.7	68.1
1407	9/11/2025	7:58:21	00d	01:00.0	66.2	84	75.1	46.1	-:-	74	72.9	52.3	47	46.4	----	-----	4168693.8	68.2
1408	9/11/2025	7:59:21	00d	01:00.0	69.9	87.7	82.1	44.8	-:-	76.3	73.2	61.2	45.8	45.2	----	-----	9772372.2	68.3
1409	9/11/2025	8:00:21	00d	01:00.0	66.7	84.5	75.7	43	-:-	75.6	72.5	54.1	44	43.7	----	-----	4677351.4	68.2
1410	9/11/2025	8:01:21	00d	01:00.0	67.1	84.9	76.1	43	-:-	74.9	73.4	53.5	44.6	43.7	----	-----	5128613.8	68.2
1411	9/11/2025	8:02:21	00d	01:00.0	67	84.8	74.6	45.4	-:-	72.9	71.9	57.8	48.2	46.7	----	-----	5011872.3	68.3
1412	9/11/2025	8:03:21	00d	01:00.0	64.9	82.7	74.7	42.9	-:-	72.9	70.5	51.6	43.7	43.3	----	-----	3090295.4	68.3
1413	9/11/2025	8:04:21	00d	01:00.0	67.8	85.6	75.2	43.7	-:-	75.8	73.7	59.8	47.4	46	----	-----	6025595.9	68.4
1414	9/11/2025	8:05:21	00d	01:00.0	71.2	89	84.7	44.6	-:-	77.3	72.5	53.8	45.5	44.3	----	-----	13182567.4	68.4

1415	9/11/2025	8:06:21	00d	01:00.0	62.4	80.2	72.1	42.1	-:-	72	68	46.5	42.5	42.3	----	-----	1737800.8	68.2
1416	9/11/2025	8:07:21	00d	01:00.0	66.1	83.9	76.6	44.2	-:-	73.5	72.7	58.1	45.7	44.6	----	-----	4073802.8	68.4
1417	9/11/2025	8:08:21	00d	01:00.0	65.5	83.3	73.4	57.1	-:-	72.1	71.5	60.1	57.5	57.1	----	-----	3548133.9	68.4
1418	9/11/2025	8:09:21	00d	01:00.0	67	84.8	76.6	54.9	-:-	74.5	72.9	60.8	56.1	55.6	----	-----	5011872.3	68.5
1419	9/11/2025	8:10:21	00d	01:00.0	62.7	80.5	73.7	45.3	-:-	70.5	66	52.6	45.9	45.5	----	-----	1862087.1	68.6
1420	9/11/2025	8:11:21	00d	01:00.0	70.1	87.9	83.6	44.7	-:-	75.1	71.9	60.7	45.7	44.9	----	-----	10232929.9	68.7
1421	9/11/2025	8:12:21	00d	01:00.0	67.4	85.2	79.5	46.4	-:-	73.4	71.9	61.2	48.3	47.5	----	-----	5495408.7	68.6
1422	9/11/2025	8:13:21	00d	01:00.0	45.7	63.5	62.5	43	-:-	50.1	47.4	44.8	43.6	43.5	----	-----	37153.5	68.7
1423	9/11/2025	8:14:21	00d	01:00.0	64.2	82	71.6	45.5	-:-	71.7	71.2	52.9	47.4	46.5	----	-----	2630268.0	68.9
1424	9/11/2025	8:15:21	00d	01:00.0	60.1	77.9	71	45.3	-:-	70.2	63.4	48.9	46.7	46.4	----	-----	1023293.0	69.1
1425	9/11/2025	8:16:21	00d	01:00.0	70.3	88.1	83.3	43.8	-:-	75.5	72.7	52.1	45.7	44.2	----	-----	10715193.1	69.3
1426	9/11/2025	8:17:21	00d	01:00.0	65.1	82.9	73.4	46.4	-:-	73.1	70.1	59.4	47.4	46.5	----	-----	3235936.6	69.2
1427	9/11/2025	8:18:21	00d	01:00.0	62.8	80.6	72.7	45.1	-:-	70.3	69.4	52.2	45.8	45.5	----	-----	1905460.7	69.4
1428	9/11/2025	8:19:21	00d	01:00.0	72.1	89.9	78.7	52.2	-:-	78.5	76.5	70.4	57.1	52.9	----	-----	16218101.0	69.6
1429	9/11/2025	8:20:21	00d	01:00.0	72.5	90.3	77.9	56.3	-:-	77.3	76.6	69.9	57.8	55.7	----	-----	17782794.1	69.4
1430	9/11/2025	8:21:21	00d	01:00.0	67.9	85.7	77.6	43.6	-:-	75.2	72.5	60.2	45.1	44.5	----	-----	6165950.0	69.0
1431	9/11/2025	8:22:21	00d	01:00.0	69.2	87	81.8	43.8	-:-	76.5	73.9	58.2	44.6	44.2	----	-----	8317637.7	69.1
1432	9/11/2025	8:23:21	00d	01:00.0	64.6	82.4	75.6	44.5	-:-	73.1	70.8	52.2	45.9	45.7	----	-----	2884031.5	69.1
1433	9/11/2025	8:24:21	00d	01:00.0	66.2	84	75.7	45.3	-:-	75.4	71.7	50.9	46.5	46.3	----	-----	4168693.8	69.3
1434	9/11/2025	8:25:21	00d	01:00.0	71	88.8	82.6	47.2	-:-	79.4	74.2	61	49.7	47.9	----	-----	12589254.1	69.6
1435	9/11/2025	8:26:21	00d	01:00.0	67.4	85.2	76.3	50.2	-:-	74.2	72.9	59	52	51.3	----	-----	5495408.7	69.4
1436	9/11/2025	8:27:21	00d	01:00.0	70.9	88.7	79.3	53.8	-:-	77.8	76	66.1	56.1	54.9	----	-----	12302687.7	69.6
1437	9/11/2025	8:28:21	00d	01:00.0	68.4	86.2	77.3	45.8	-:-	75.8	73.2	59	47.7	46.8	----	-----	6918309.7	69.3
1438	9/11/2025	8:29:21	00d	01:00.0	74.7	92.5	86.7	44.2	-:-	81.9	78.5	65	46.1	44.6	----	-----	29512092.3	69.5
1439	9/11/2025	8:30:21	00d	01:00.0	65.9	83.7	72.6	44.5	-:-	72.2	71.2	61.4	45.8	45	----	-----	3890451.4	63.4
1440	9/11/2025	8:31:21	00d	01:00.0	63.6	81.4	73.5	45.8	-:-	71.2	69.2	54.4	48.4	46.6	----	-----	2290867.7	61.1
1441	9/11/2025	8:32:21	00d	00:03.1	54.9	59.8	61	55.4	-:-	55.2	55.2	55.1	54.5	54.5	----	-----	309029.5	54.9

Address	Start Time	Measurement Time		Leq	LE	LMAX	LMIN	Ly	LN1	LN2	LN3	LN4	LN5	Over	Under	Inverse Log	Overall Leq	Rolling 24 Hour	Rolling Hour Avg
M-03																			
1	9/10/2025	8:49:13	00d 01:00.0	63	80.8	69.7	46.9	-:-	69.6	68	55.2	48.6	47.3	----	-----	1995262.3	60.4	60.8	60.4
2	9/10/2025	8:50:13	00d 01:00.0	63.3	81.1	71.8	48.1	-:-	70.6	67	57.5	48.6	47.7	----	-----	2137962.1		60.8	Hourly
3	9/10/2025	8:51:13	00d 01:00.0	63.1	80.9	74.5	44	-:-	71.1	68.9	46.8	45	44.4	----	-----	2041737.9		60.8	
4	9/10/2025	8:52:13	00d 01:00.0	60.7	78.5	69.3	46.5	-:-	68.7	67.2	52.9	47.1	46.9	----	-----	1174897.6		60.7	
5	9/10/2025	8:53:13	00d 01:00.0	62.6	80.4	70.8	45.8	-:-	69.5	67	58.2	48.8	46.5	----	-----	1819700.9		60.8	
6	9/10/2025	8:54:13	00d 01:00.0	60.6	78.4	68.5	44.9	-:-	68.3	65.6	54.9	45.6	45.1	----	-----	1148153.6		60.8	
7	9/10/2025	8:55:13	00d 01:00.0	53.6	71.4	63.5	39.8	-:-	60.6	58.2	44.9	40.4	40.2	----	-----	229086.8		60.7	
8	9/10/2025	8:56:13	00d 01:00.0	48.2	66	54.6	40.1	-:-	53	52.5	44.5	41	40.7	----	-----	66069.3		60.7	
9	9/10/2025	8:57:13	00d 01:00.0	53.2	71	63.2	42	-:-	60.7	58.1	47.6	42.7	42.1	----	-----	208929.6		60.8	
10	9/10/2025	8:58:13	00d 01:00.0	61.4	79.2	68	46.4	-:-	67.6	66.7	53.3	47.6	46.7	----	-----	1380384.3		60.8	
11	9/10/2025	8:59:13	00d 01:00.0	61.1	78.9	69.6	45.4	-:-	69	67.9	53.3	47.3	45.3	----	-----	1288249.6		60.8	
12	9/10/2025	9:00:13	00d 01:00.0	58.5	76.3	71.8	41.1	-:-	67.3	56.7	44.4	41.7	41.4	----	-----	707945.8		60.8	
13	9/10/2025	9:01:13	00d 01:00.0	61.6	79.4	69.2	40.3	-:-	68.8	67.8	52.1	41.6	40.7	----	-----	1445439.8		60.8	
14	9/10/2025	9:02:13	00d 01:00.0	60.2	78	69.5	40.5	-:-	68.6	65.2	49.4	41.5	41.1	----	-----	1047128.5		60.9	
15	9/10/2025	9:03:13	00d 01:00.0	60.9	78.7	68.8	41.2	-:-	68.8	67.4	49.8	42.1	41.4	----	-----	1230268.8		60.9	
16	9/10/2025	9:04:13	00d 01:00.0	56.8	74.6	67.9	40.9	-:-	66.7	62.4	43.6	41.3	41.1	----	-----	478630.1		61.0	
17	9/10/2025	9:05:13	00d 01:00.0	60.1	77.9	70.3	40.9	-:-	68.2	66.7	46.4	41.8	41.1	----	-----	1023293.0		61.0	
18	9/10/2025	9:06:13	00d 01:00.0	60.5	78.3	69	42.2	-:-	68.5	65.9	52	46.6	45.6	----	-----	1122018.5		61.0	
19	9/10/2025	9:07:13	00d 01:00.0	62.5	80.3	72.9	45.6	-:-	72.1	66.9	51.4	47.2	46.5	----	-----	1778279.4		61.0	
20	9/10/2025	9:08:13	00d 01:00.0	59.2	77	69.3	41.1	-:-	68.3	64.4	47	41.5	41.2	----	-----	831763.8		61.0	
21	9/10/2025	9:09:13	00d 01:00.0	62.2	80	69.1	46.1	-:-	69	68.5	55.8	48.3	46.9	----	-----	1659586.9		61.4	
22	9/10/2025	9:10:13	00d 01:00.0	63.9	81.7	72.2	48.2	-:-	71	68.6	58.1	49.3	48.8	----	-----	2454708.9		61.3	
23	9/10/2025	9:11:13	00d 01:00.0	56.4	74.2	69.1	39.8	-:-	66.7	57	41.2	40.1	40	----	-----	436515.8		61.2	
24	9/10/2025	9:12:13	00d 01:00.0	60.2	78	71.2	40.5	-:-	68.9	67.1	45.5	40.9	40.8	----	-----	1047128.5		61.3	
25	9/10/2025	9:13:13	00d 01:00.0	65.1	82.9	73.6	44.9	-:-	73.4	69.9	60	46.3	45.9	----	-----	3235936.6		61.2	
26	9/10/2025	9:14:13	00d 01:00.0	61.8	79.6	69.4	42.3	-:-	68.8	68	52.3	43.8	42.9	----	-----	1513561.2		61.2	
27	9/10/2025	9:15:13	00d 01:00.0	52.2	70	63.8	40.1	-:-	61.6	52.1	45	42	41.2	----	-----	165958.7		61.1	
28	9/10/2025	9:16:13	00d 01:00.0	60.8	78.6	71.1	43.1	-:-	69.7	66	50.2	44.8	43.5	----	-----	1202264.4		61.2	
29	9/10/2025	9:17:13	00d 01:00.0	56.2	74	66.2	41.4	-:-	65.8	62.6	44.8	42.1	41.8	----	-----	416869.4		61.1	
30	9/10/2025	9:18:13	00d 01:00.0	61.2	79	70	44.1	-:-	69.2	67.3	53.6	45.8	45.6	----	-----	1318256.7		61.2	
31	9/10/2025	9:19:13	00d 01:00.0	62.5	80.3	72	41.7	-:-	71.8	69	46.2	42.4	41.9	----	-----	1778279.4		61.2	
32	9/10/2025	9:20:13	00d 01:00.0	62.3	80.1	71.4	42.3	-:-	68.9	68.1	53.9	44.9	44.2	----	-----	1698243.7		61.1	
33	9/10/2025	9:21:13	00d 01:00.0	62.2	80	70.4	39.7	-:-	70.3	67.4	51.3	40.5	40.1	----	-----	1659586.9		61.1	
34	9/10/2025	9:22:13	00d 01:00.0	55.7	73.5	67.6	41	-:-	63.9	58.8	44.5	41.9	41	----	-----	371535.2		61.0	
35	9/10/2025	9:23:13	00d 01:00.0	59.1	76.9	67.9	40.7	-:-	66.6	65.4	51	44.4	42.1	----	-----	812830.5		61.0	
36	9/10/2025	9:24:13	00d 01:00.0	58.9	76.7	68.2	43.3	-:-	66.9	65.3	47.2	44	43.6	----	-----	776247.1		61.1	
37	9/10/2025	9:25:13	00d 01:00.0	57.4	75.2	68.7	41.6	-:-	64.5	63.3	46.7	43.2	42.4	----	-----	549540.9		61.1	
38	9/10/2025	9:26:13	00d 01:00.0	61.1	78.9	68.7	40.4	-:-	68.7	67.7	48.5	40.7	40.4	----	-----	1288249.6		61.2	
39	9/10/2025	9:27:13	00d 01:00.0	58.2	76	68.3	40.6	-:-	68	64.5	45.9	41.3	41	----	-----	660693.4		61.1	
40	9/10/2025	9:28:13	00d 01:00.0	56	73.8	67.1	40.2	-:-	66.2	60.8	44.3	40.7	40.5	----	-----	398107.2		61.2	
41	9/10/2025	9:29:13	00d 01:00.0	62.2	80	69.3	41.1	-:-	68.1	67.2	56.2	47.5	46.8	----	-----	1659586.9		61.2	
42	9/10/2025	9:30:13	00d 01:00.0	62	79.8	69.9	45.4	-:-	68.1	67.4	54.9	47.9	46.1	----	-----	1584893.2		61.2	
43	9/10/2025	9:31:13	00d 01:00.0	62.8	80.6	69.1	53.3	-:-	68.8	68.2	58.1	53.7	53.7	----	-----	1905460.7		61.1	
44	9/10/2025	9:32:13	00d 01:00.0	55.5	73.3	65.6	50.1	-:-	62	56.8	51.2	50.3	50.3	----	-----	354813.4		61.3	
45	9/10/2025	9:33:13	00d 01:00.0	62	79.8	71.1	51.4	-:-	69.1	68.6	54.6	52.1	51.9	----	-----	1584893.2		61.3	
46	9/10/2025	9:34:13	00d 01:00.0	59.4	77.2	69.7	50	-:-	67.8	66.2	51.4	50.1	50.1	----	-----	870963.6		61.2	
47	9/10/2025	9:35:13	00d 01:00.0	62.4	80.2	68.9	50.1	-:-	69.2	68.2	54.7	50.8	50.4	----	-----	1737800.8		61.2	
48	9/10/2025	9:36:13	00d 01:00.0	61	78.8	73.6	49.8	-:-	66.1	63.5	51.8	50.3	50.2	----	-----	1258925.4		61.2	
49	9/10/2025	9:37:13	00d 01:00.0	60.5	78.3	69.3	49.5	-:-	69	67.9	51.5	49.5	49.5	----	-----	1122018.5		61.2	
50	9/10/2025	9:38:13	00d 01:00.0	57	74.8	69.1	48.6	-:-	65.8	59.3	49.8	49	48.8	----	-----	501187.2		61.2	
51	9/10/2025	9:39:13	00d 01:00.0	61.3	79.1	69.4	49.8	-:-	69	68	52.4	50.3	50.1	----	-----	1348962.9		61.2	
52	9/10/2025	9:40:13	00d 01:00.0	65	82.8	78.1	48.5	-:-	73.1	63.3	49.6	48.8	48.7	----	-----	3162277.7		61.2	
53	9/10/2025	9:41:13	00d 01:00.0	58.5	76.3	66.3	49.2	-:-	66	63.8	51.1	49.6	49.5	----	-----	707945.8		61.1	
54	9/10/2025	9:42:13	00d 01:00.0	62.3	80.1	68.7	49.9	-:-	68.3	67.7	53.5	50.1	50	----	-----	1698243.7		61.1	
55	9/10/2025	9:43:13	00d 01:00.0	61	78.8	69.7	48.8	-:-	68.8	67.7	51	49.1	49	----	-----	1258925.4		61.0	
56	9/10/2025	9:44:13	00d 01:00.0	58.9	76.7	68.6	48.6	-:-	67.2	66.7	50.2	48.8	48.7	----	-----	776247.1		61.1	
57	9/10/2025	9:45:13	00d 01:00.0	58.5	76.3	69.3	48.5	-:-	67.2	65.1	49.5	48.9	48.7	----	-----	707945.8		61.1	
58	9/10/2025	9:46:13	00d 01:00.0	58.8	76.6	70.2	48	-:-	68.8	62	50.3	48.8	48.3	----	-----	758577.6		61.1	
59	9/10/2025	9:47:13	00d 01:00.0	62.2	80	71.6	47.6	-:-	70.4	68.4	51.9	47.9	47.8	----	-----	1659586.9		61.1	
60	9/10/2025	9:48:13	00d 01:00.0	62.8	80.6	71.1	50.1	-:-	71.1	68.3	53.7	50.3	50.2	----	-----	1905460.7		61.3	
61	9/10/2025	9:49:13	00d 01:00.0	58.6	76.4	70.3	48.2	-:-	67.6	63.2	49.5	48.5	48.4	----	-----	724436.0		61.3	
62	9/10/2025	9:50:13	00d 01:00.0	61	78.8	71	49	-:-	69.6	67.3	52.8	49.5	49.4	----	-----	1258925.4		61.3	
63	9/10/2025	9:51:13	00d 01:00.0	62.9	80.7	71.4	49.6	-:-	69.2	67.8	57.1	50.8	50	----	-----	1949844.6		61.3	
64	9/10/2025	9:52:13	00d 01:00.0	60.9	78.7	68.7	50.1	-:-	68.3	66.5	52.4	50.6	50.2	----	-----	1230268.8		61.3	
65	9/10/2025	9:53:13	00d 01:00.0	63.5	81.3	71.6	49.6	-:-	69.9	68.4	56.1	49.8	49.8	----	-----	2238721.1		61.2	
66	9/10/2025	9:54:13	00d 01:00.0	60.7	78.5	70.9	48.3	-:-	69.6	67.1	51	48.7	48.5	----	-----	1174897.6		61.2	
67	9/10/2025	9:55:13	00d 01:00.0	55.4	73.2	66.8	42	-:-	65.3	56.9	48.9	44.1	42.6	----	-----	346736.9		61.2	
68	9/10/2025	9:56:13	00d 01:00.0	57.6	75.4	67.7	42.7	-:-	65.8	62.7	47.3	44.1	43.6	----	-----	575439.9		61.2	
69	9/10/2025	9:57:13	00d 01:00.0	62.8	80.6	70.6	42.5	-:-	70.2	68	57.6	44.3	43.6	----	-----	1905460.7		61.2	
70	9/10/2025	9:58:13	00d 01:00.0	53.3	71.1	63	41.8	-:-	61.5	60.2	44.5	42.8	42.1	----	-----	213796.2		61.1	
71	9/10/2025	9:59:13	00d 01:00.0	57.6	75.4	69.4	40.7	-:-	65.6	61.5	45.9	41.6	41.1	----	-----	575439.9		61.2	
72	9/10/2025	10:00:13	00d 01:00.0	61.5	79.3	68.9	40.8	-:-	69.3	68.1	53.3	45.5	43.3	----	-----	1412537.5		61.2	
73	9/10/2025	10:01:13	00d 01:00.0	61.6	79.4	70.7	45	-:-	68.8	67.1	54.6	46.2	45.5	----	-----	1445439.8		61.2	
74	9/10/2025	10:02:13	00d 01:00.0	63.3	81.1	71	46	-:-	70.7	69.2	52	46.8	46.3	----	-----	2137962.1		61.2	
75	9/10/2025	10:03:13	00d 01:00.0	62.1	79.9	69.3	47.6	-:-	68.2	67.9	55.5	48.1	47.8	----	-----	1621810.1		61.1	
76	9/10/2025	10:04:13	00d 01:00.0	63.5	81.3	74.2	42.4	-:-	71	68.7	54.7	43.9	42.5	----	-----	2238721.1		61.1	
77	9/10/2025	10:05:13	00d 01:00.0	56.9	74.7	73.9	40.8	-:-	64.6	61.6	47.1	41.1	40.9	----	-----	489778.8		61.1	
78	9/10/2025	10:06:13	00d 01:00.0	59	76.8	71.3	42.1	-:-	69.3	62.6	45.5	43	42.6	----	-----	794328.2		61.1	
79	9/10/2025	10:07:13	00d 01:00.0	64	81.8	75.6	45.5	-:-	69.4	67	56.4	46.1	45.7	----	-----	2511886.4		61.1	
80	9/10/2025	10:08:13	00d 01:00.0	60.4	78.2	70.9	43.3	-:-	67.6	66.3	49.6	43.8	43.6	----	-----	1096478.2		61.0	
81	9/10/2025	10:09:13	00d 01:00.0	68.8	86.6	82.1	42.7	-:-	75.9	70.2	55.3	44.8	42.8	----	-----	7585775.8		61.0	
82	9/10/2025	10:10:13	00d 01:00.0	42.7	60.5	44.8	40.5	-:-	44.6	43.9	42.6	41.8	41	----	-----	18620.9		60.6	
83	9/10/2025	10:11:13	00d 01:00.0	58.2	76	66.7	42.2	-:-	65.7	63.4	52.4	45.8	45.5	----	-----	660693.4		60.7	
84	9/10/2025	10:12:13	00d 01:00.0	62.5	80.3	70.2	45.1	-:-	68.2	67.4	55.5	45.4	44.8	----	-----	1778279.4		60.6	
85	9/10/2025	10:13:13	00d 01:00.0	57	74.8	67.2	41.2	-:-	65.1	63.2	46.7	42.2	41.7	----	-----	501187.2		60.6	
86	9/10/2025	10:14:13	00d 01:00.0	62.8	80.6	70.1	42.9	-:-	68.8	68.5	56	45.1	44	----	-----	1905460.7		60.6	
87	9/10/2025	10:15:13	00d 01:00.0	60.5	78.3	70.6	42.3	-:-	68.9	67.9	47.2	42.7	42.5	----	-----	1122018.5		60.6	
88	9/10/2025	10:16:13	00d 01:00.0	60.7	78.5	70.2	41.6	-:-	69.2	67.8	43.8	42.3	41.8	----	-----	1174897.6		60.6	
89	9/10/2025	10:17:13	00d 01:00.0	56.9	74.7	69	40.1	-:-	66.2	60.7	42.1	40.4	40.3	----	-----	489778.8		60.6	
90	9/10/2025	10:18:13	00d 01:00.0	57.6	75.4	68.1	39.9	-:-	66.1	65	43.8	40.2	40.1	----	-----	575439.9		60.6	
91	9/10/2025	10:19:13	00d 01:00.0	63.4	81.2	76.5	41.4	-:-	73.3	66.1	44.2	41.6	41.5	----	-----	2187761.6		60.7	
92	9/10/2025	10:20:13	00d 01:00.0	55.3	73.1	67.3	41.3	-:-	63.7	57.8	43.1	41.9	41.7	----	-----	338844.2		60.6	
93	9/10/2025	10:21:13	00d 01:00.0	60.1	77.9	71.4	43.1	-:-	69.3	65	46.9	43.7	43.4	----	-----	1023293.0		60.7	
94	9/10/2025	10:22:13	00d 01:00.0	59.3	77.1	70.5	41	-:-	68.7	64.1	43.7	41.6	41.4	----	-----	851138.0		60.7	
95	9/10/2025	10:23:13	00d 01:00.0	54.6	72.4	66.2	41.8	-:-	63.3	59.8	44.8	43.4	43	----	-----	288403.2		60.7	
96	9/10/2025	10:24:13	00d 01:00.0	62.6	80.4	69	44.8	-:-	68.2	67.6	59.6	46.3	45.5	----	-----	1819700.9		60.8	
97	9/10/2025	10:25:13	00d 01:00.0	59.2	77	70.1	42.3	-:-	68.9	62.2	47.2	42.9	42.4	----	-----	831763.8		60.8	
98	9/10/2025	10:26:13	00d 01:00.0	62.2	80	69.5	44.9	-:-	68.5	67.9	54.3	45.5	45.2	----	-----	1659586.9		60.8	
99	9/10/2025	10:27:13	00d 01:00.0	56.5	74.3	69.2	42	-:-	65.2	56.2	44.7	43.7	42.8	----	-----	446683.6		60.7	
100	9/10/2025	10:28:13	00d 01:00.0	63.6	81.4	75.1	41.9	-:-	70.1	69	51.2	43	42.2	----	-----	2290867.7		60.7	
101	9/10/2025	10:29:13	00d 01:00.0	56.2	74	67.1	41.8	-:-	65.7	59.9	48.2	42.5	42.3	----	-----	416869.4		60.7	
102	9/10/2025	10:30:13	00d 01:00.0	60.4	78.2	69.8	40.7	-:-	69.6	67.6	45.2	41.8	41.3	----	-----	1096478.2		60.8	
103	9/10/2025	10:31:13	00d 01:00.0	57.4	75.2	67.8	40.5	-:-	66.2	64.4	46.6	41.5	40.7	----	-----	549540.9		60.8	
104	9/10/2025	10:32:13	00d 01:00.0	66.9	84.7	80.5	46.2	-:-	71.3	68.4	56.9	47.9	46.5	----	-----	4897788.2		60.8	
105	9/10/2025	10:33:13	00d 01:00.0	57.4	75.2	66.1	40.5	-:-	65.5	64.3	47.5	41.1	40.6	----	-----	549540.9		60.6	
106	9/10/2025	10:34:13	00d 01:00.0	59.2	77	70.4	40.4	-:-	67.2	65.6	44.6	41.7	41.5	----	-----	831763.8		60.7	

107	9/10/2025	10:35:13	00d	01:00.0	53.4	71.2	65.2	41.5	-:-	63.3	56.1	45.3	42.9	41.8	----	-----	218776.2	60.7
108	9/10/2025	10:36:13	00d	01:00.0	59.5	77.3	69	45.3	-:-	68.7	64.8	49.4	46	45.8	----	-----	891250.9	60.7
109	9/10/2025	10:37:13	00d	01:00.0	61.6	79.4	68.6	45.4	-:-	68.3	67.6	54.8	45.7	45.5	----	-----	1445439.8	60.7
110	9/10/2025	10:38:13	00d	01:00.0	60.8	78.6	70.1	43.1	-:-	69.5	66.9	47.7	44.3	43.9	----	-----	1202264.4	60.7
111	9/10/2025	10:39:13	00d	01:00.0	60.4	78.2	69.2	41.6	-:-	68.1	66.9	52.1	45.3	43	----	-----	1096478.2	60.7
112	9/10/2025	10:40:13	00d	01:00.0	61.3	79.1	71.2	44.7	-:-	67.9	67.4	49.1	45.3	45	----	-----	1348962.9	60.6
113	9/10/2025	10:41:13	00d	01:00.0	56.2	74	68.1	45.1	-:-	63.6	59.1	48.3	45.5	45.2	----	-----	416869.4	60.6
114	9/10/2025	10:42:13	00d	01:00.0	60.1	77.9	67.3	43.3	-:-	67	64.6	53.9	44.6	43.8	----	-----	1023293.0	60.7
115	9/10/2025	10:43:13	00d	01:00.0	59.9	77.7	69.6	42.9	-:-	68.5	65.5	47.9	44	43.4	----	-----	977237.2	60.7
116	9/10/2025	10:44:13	00d	01:00.0	63.5	81.3	71.2	46.6	-:-	69.7	69.3	57.7	48.5	47.2	----	-----	2238721.1	60.8
117	9/10/2025	10:45:13	00d	01:00.0	59.4	77.2	66.6	42.6	-:-	66.9	65.9	48.2	43	42.8	----	-----	870963.6	60.7
118	9/10/2025	10:46:13	00d	01:00.0	59.1	76.9	66.8	43.3	-:-	65.9	64.7	51.8	45	44.6	----	-----	812830.5	60.9
119	9/10/2025	10:47:13	00d	01:00.0	59.3	77.1	68.6	42.3	-:-	67.7	65.5	48.2	42.9	42.5	----	-----	851138.0	61.0
120	9/10/2025	10:48:13	00d	01:00.0	66.6	84.4	77	47.7	-:-	73.3	70.6	58.7	49.7	48.4	----	-----	4570881.9	61.0
121	9/10/2025	10:49:13	00d	01:00.0	63	80.8	74	45.4	-:-	71.8	68	52.2	45.9	45.4	----	-----	1995262.3	60.9
122	9/10/2025	10:50:13	00d	01:00.0	62.9	80.7	69.6	46.7	-:-	69.1	67.5	60	49.3	48.1	----	-----	1949844.6	61.0
123	9/10/2025	10:51:13	00d	01:00.0	59.4	77.2	69.3	45.1	-:-	67.8	63.8	50	45.4	45	----	-----	870963.6	61.0
124	9/10/2025	10:52:13	00d	01:00.0	60.9	78.7	69.8	44	-:-	69.5	65.9	53.3	46.1	43.9	----	-----	1230268.8	61.1
125	9/10/2025	10:53:13	00d	01:00.0	58.1	75.9	68.5	42.8	-:-	67.9	64.9	45	43.3	43	----	-----	645654.2	61.1
126	9/10/2025	10:54:13	00d	01:00.0	61.2	79	66.9	46.9	-:-	66.2	65.5	58.8	48.6	47.9	----	-----	1318256.7	61.1
127	9/10/2025	10:55:13	00d	01:00.0	55.3	73.1	64.4	42.3	-:-	61.7	61.2	48.3	43.5	43	----	-----	338844.2	61.1
128	9/10/2025	10:56:13	00d	01:00.0	61.3	79.1	72	40.3	-:-	69.2	67.2	49.8	41.1	40.9	----	-----	1348962.9	61.1
129	9/10/2025	10:57:13	00d	01:00.0	58.5	76.3	68	40.4	-:-	68	63.2	47.1	41.1	40.7	----	-----	707945.8	61.1
130	9/10/2025	10:58:13	00d	01:00.0	43.8	61.6	61.8	40.2	-:-	48.7	45.8	41.7	40.7	40.3	----	-----	23988.3	61.1
131	9/10/2025	10:59:13	00d	01:00.0	59.6	77.4	68.7	41.2	-:-	67.1	64.9	49.9	43.1	41.8	----	-----	912010.8	61.1
132	9/10/2025	11:00:13	00d	01:00.0	62.2	80	69.2	48.4	-:-	68.7	67.5	56.6	49.7	48.9	----	-----	1659586.9	61.1
133	9/10/2025	11:01:13	00d	01:00.0	60.2	78	69	42.8	-:-	68.5	66.4	50.8	43.4	43.1	----	-----	1047128.5	61.1
134	9/10/2025	11:02:13	00d	01:00.0	62.7	80.5	72.6	40.9	-:-	69	67.8	51.6	42.9	41.6	----	-----	1862087.1	61.1
135	9/10/2025	11:03:13	00d	01:00.0	59.7	77.5	70.5	41.2	-:-	69.1	63.6	47.5	42.4	42	----	-----	933254.3	61.5
136	9/10/2025	11:04:13	00d	01:00.0	60.2	78	70.9	42.9	-:-	69	64.6	46.5	43.3	43.1	----	-----	1047128.5	61.5
137	9/10/2025	11:05:13	00d	01:00.0	61.9	79.7	70.6	45.7	-:-	67.9	66.8	53	47.6	46.1	----	-----	1548816.6	61.6
138	9/10/2025	11:06:13	00d	01:00.0	45.5	63.3	64.8	40.6	-:-	50.6	47.8	42.8	41.2	41.1	----	-----	35481.3	61.6
139	9/10/2025	11:07:13	00d	01:00.0	59.3	77.1	67.4	41.6	-:-	67.7	66.2	50.5	44	43.5	----	-----	851138.0	61.6
140	9/10/2025	11:08:13	00d	01:00.0	62.1	79.9	70.9	43.3	-:-	69.3	67.6	49.6	44.1	43.4	----	-----	1621810.1	61.7
141	9/10/2025	11:09:13	00d	01:00.0	55.8	73.6	68.6	42.3	-:-	65.5	58.2	44.1	42.5	42.2	----	-----	380189.4	61.7
142	9/10/2025	11:10:13	00d	01:00.0	62.9	80.7	73.5	41.8	-:-	69.8	66.8	51.6	43	42.1	----	-----	1949844.6	61.7
143	9/10/2025	11:11:13	00d	01:00.0	56.2	74	69.7	41.1	-:-	63.9	55	44.5	42	41.6	----	-----	416869.4	61.7
144	9/10/2025	11:12:13	00d	01:00.0	53.4	71.2	65.4	40.9	-:-	63.5	53.1	44.8	41.7	41.2	----	-----	218776.2	61.8
145	9/10/2025	11:13:13	00d	01:00.0	61.2	79	70.7	40.8	-:-	70.3	67.2	47.3	42.8	41.5	----	-----	1318256.7	61.8
146	9/10/2025	11:14:13	00d	01:00.0	60.2	78	72.2	39.4	-:-	67.6	66.1	44.9	40.2	39.8	----	-----	1047128.5	61.8
147	9/10/2025	11:15:13	00d	01:00.0	59	76.8	68.5	41.4	-:-	66.4	65.4	46.5	42.1	41.6	----	-----	794328.2	61.9
148	9/10/2025	11:16:13	00d	01:00.0	61.6	79.4	72.6	41.4	-:-	70.3	68	48.5	42.6	41.7	----	-----	1445439.8	62.0
149	9/10/2025	11:17:13	00d	01:00.0	60.8	78.6	68.9	41.1	-:-	69.1	67.4	51.9	41.6	41.3	----	-----	1202264.4	62.0
150	9/10/2025	11:18:13	00d	01:00.0	57.3	75.1	68.3	40	-:-	66.8	62.5	43.5	40.5	40.3	----	-----	537031.8	62.4
151	9/10/2025	11:19:13	00d	01:00.0	62.6	80.4	70.4	40.5	-:-	69.1	67.8	54.2	43.9	41.8	----	-----	1819700.9	62.4
152	9/10/2025	11:20:13	00d	01:00.0	60.1	77.9	71.7	39.7	-:-	69.2	65.1	42.5	40	39.9	----	-----	1023293.0	62.4
153	9/10/2025	11:21:13	00d	01:00.0	64.3	82.1	73.9	44.3	-:-	72	69.1	52.4	45.1	44.5	----	-----	2691534.8	62.4
154	9/10/2025	11:22:13	00d	01:00.0	58.1	75.9	67.6	41.7	-:-	65.7	63.2	47.7	42.4	42.3	----	-----	645654.2	62.4
155	9/10/2025	11:23:13	00d	01:00.0	61.4	79.2	69.9	44.5	-:-	68.4	67	54	44.8	44.5	----	-----	1380384.3	62.4
156	9/10/2025	11:24:13	00d	01:00.0	60.8	78.6	71.4	41	-:-	68.2	67.9	45.6	41.3	41.1	----	-----	1202264.4	62.5
157	9/10/2025	11:25:13	00d	01:00.0	61.6	79.4	71.8	42.6	-:-	69.6	65.8	51	43.8	42.8	----	-----	1445439.8	62.5
158	9/10/2025	11:26:13	00d	01:00.0	60.1	77.9	70.8	42	-:-	67.4	64.4	49.9	44.3	42.8	----	-----	1023293.0	62.5
159	9/10/2025	11:27:13	00d	01:00.0	57.6	75.4	68.9	41.3	-:-	66.3	62	44.6	41.5	41.4	----	-----	575439.9	62.5
160	9/10/2025	11:28:13	00d	01:00.0	58.9	76.7	68	42.2	-:-	67.1	64.6	48	43.6	43	----	-----	776247.1	62.5
161	9/10/2025	11:29:13	00d	01:00.0	61.6	79.4	67.6	44	-:-	68	66.4	57.1	46.1	44.3	----	-----	1445439.8	62.4
162	9/10/2025	11:30:13	00d	01:00.0	63.9	81.7	69.5	49	-:-	69.2	68.7	61.4	51.8	50.6	----	-----	2454708.9	62.5
163	9/10/2025	11:31:13	00d	01:00.0	59.7	77.5	70.9	41.5	-:-	67.7	65.2	46.7	42	41.8	----	-----	933254.3	62.4
164	9/10/2025	11:32:13	00d	01:00.0	60.7	78.5	68.4	42.1	-:-	67	65.7	53.3	43.1	42.7	----	-----	1174897.6	62.5
165	9/10/2025	11:33:13	00d	01:00.0	60.8	78.6	69	45.4	-:-	68.1	66.6	53.4	45.9	45.7	----	-----	1202264.4	62.5
166	9/10/2025	11:34:13	00d	01:00.0	61.8	79.6	69.8	43.7	-:-	68.5	67.6	55.6	46.1	45.5	----	-----	1513561.2	62.5
167	9/10/2025	11:35:13	00d	01:00.0	59	76.8	68.6	41.3	-:-	68.1	66.3	45.5	41.7	41.5	----	-----	794328.2	62.5
168	9/10/2025	11:36:13	00d	01:00.0	55	72.8	66.4	40.9	-:-	65.5	56.4	46.7	42.1	41.1	----	-----	316227.8	62.5
169	9/10/2025	11:37:13	00d	01:00.0	60.9	78.7	67.8	46.9	-:-	67.3	66.7	53.8	47.4	47	----	-----	1230268.8	62.5
170	9/10/2025	11:38:13	00d	01:00.0	62.6	80.4	71.9	43.3	-:-	70.1	68.5	54.5	45.1	44.2	----	-----	1819700.9	62.5
171	9/10/2025	11:39:13	00d	01:00.0	42.5	60.3	47.5	39.6	-:-	46.2	45.4	41.9	40.3	39.9	----	-----	17782.8	62.4
172	9/10/2025	11:40:13	00d	01:00.0	57.2	75	68.2	41.1	-:-	66.8	62.8	43.7	41.4	41.3	----	-----	524807.5	62.5
173	9/10/2025	11:41:13	00d	01:00.0	62.2	80	71.9	44.7	-:-	69	68.2	51.9	45.5	45	----	-----	1659586.9	62.5
174	9/10/2025	11:42:13	00d	01:00.0	58.5	76.3	68.9	42.1	-:-	67.6	63.9	47.3	42.8	42.2	----	-----	707945.8	62.5
175	9/10/2025	11:43:13	00d	01:00.0	63.2	81	74.6	41.6	-:-	72.1	69	45.5	41.8	41.8	----	-----	2089296.1	62.5
176	9/10/2025	11:44:13	00d	01:00.0	61.8	79.6	70.7	43.3	-:-	68.4	67.2	56.9	43.9	43.4	----	-----	1513561.2	62.4
177	9/10/2025	11:45:13	00d	01:00.0	61.7	79.5	71.1	44.8	-:-	69.4	67.3	51.5	46.2	45.9	----	-----	1479108.4	62.4
178	9/10/2025	11:46:13	00d	01:00.0	65.6	83.4	78.1	44.8	-:-	73.5	67.7	53.3	47	46.6	----	-----	3630780.5	62.4
179	9/10/2025	11:47:13	00d	01:00.0	65.9	83.7	74.6	42.9	-:-	74	70.5	61.9	44.1	43.3	----	-----	3890451.4	62.4
180	9/10/2025	11:48:13	00d	01:00.0	59.2	77	70.5	43	-:-	70.1	64.2	45.8	43.3	43.2	----	-----	831763.8	62.3
181	9/10/2025	11:49:13	00d	01:00.0	62.1	79.9	72.4	43.8	-:-	70	67.2	49.9	43.9	43.8	----	-----	1621810.1	62.3
182	9/10/2025	11:50:13	00d	01:00.0	65.4	83.2	78.3	43.7	-:-	73.4	67.3	51.7	45.4	44.3	----	-----	3467368.5	62.3
183	9/10/2025	11:51:13	00d	01:00.0	64.8	82.6	74.9	45.4	-:-	72.6	69.5	52.3	46.4	45.5	----	-----	3019951.7	62.2
184	9/10/2025	11:52:13	00d	01:00.0	63.3	81.1	76	43.6	-:-	71.5	66.6	46.9	44.1	43.9	----	-----	2137962.1	62.1
185	9/10/2025	11:53:13	00d	01:00.0	57.2	75	68.9	41.4	-:-	66.1	62.2	42.8	41.8	41.4	----	-----	524807.5	62.1
186	9/10/2025	11:54:13	00d	01:00.0	60.6	78.4	68.2	43.7	-:-	68.1	65.9	54.7	46	44.9	----	-----	1148153.6	62.1
187	9/10/2025	11:55:13	00d	01:00.0	58.7	76.5	68.6	43.7	-:-	67.4	65	49.2	44.9	44.4	----	-----	741310.2	62.1
188	9/10/2025	11:56:13	00d	01:00.0	62.4	80.2	73.7	42.6	-:-	72.4	67.9	45.6	43	42.9	----	-----	1737800.8	62.1
189	9/10/2025	11:57:13	00d	01:00.0	59	76.8	73.7	41.2	-:-	67.5	63.8	45.9	42.6	41.9	----	-----	794328.2	62.1
190	9/10/2025	11:58:13	00d	01:00.0	56.2	74	66.7	40.9	-:-	65.6	60.9	45.7	42.5	42.2	----	-----	416869.4	62.2
191	9/10/2025	11:59:13	00d	01:00.0	58.7	76.5	72.7	41.4	-:-	66.8	56	43.5	41.8	41.4	----	-----	741310.2	62.3
192	9/10/2025	12:00:13	00d	01:00.0	59.4	77.2	70.6	41.2	-:-	68.9	63.8	44.3	41.8	41.5	----	-----	870963.6	62.4
193	9/10/2025	12:01:13	00d	01:00.0	61.5	79.3	67.4	48.4	-:-	67.1	65.3	59.6	49.6	47.8	----	-----	1412537.5	62.4
194	9/10/2025	12:02:13	00d	01:00.0	60.3	78.1	69.2	44.1	-:-	68.1	66.9	50.9	45.9	45.3	----	-----	1071519.3	62.3
195	9/10/2025	12:03:13	00d	01:00.0	70.1	87.9	85.1	49.1	-:-	77	70.5	56.9	50.4	49.6	----	-----	10232929.9	62.3
196	9/10/2025	12:04:13	00d	01:00.0	59.5	77.3	69.4	44.7	-:-	69.3	65.6	48.3	45.3	44.7	----	-----	891250.9	61.9
197	9/10/2025	12:05:13	00d	01:00.0	62	79.8	68	49	-:-	68.3	67.2	59.7	49.7	48.7	----	-----	1584893.2	61.9
198	9/10/2025	12:06:13	00d	01:00.0	60.8	78.6	70.5	41.1	-:-	69	67.6	48.1	42.3	41.4	----	-----	1202264.4	61.9
199	9/10/2025	12:07:13	00d	01:00.0	58.3	76.1	66.6	39.7	-:-	65.9	65.5	44.6	40.5	40.1	----	-----	676083.0	62.0
200	9/10/2025	12:08:13	00d	01:00.0	64.7	82.5	75.4	43.7	-:-	73.5	68.5	55.1	45.5	44.6	----	-----	2951209.2	62.0
201	9/10/2025	12:09:13	00d	01:00.0	62.2	80	68.8	45.3	-:-	68.5	67.4	54.2	46	45.6	----	-----	1659586.9	62.0
202	9/10/2025	12:10:13	00d	01:00.0	58.2	76	68.9	42.5	-:-	66.9	63.7	44.8	43	42.5	----	-----	660693.4	61.9
203	9/10/2025	12:11:13	00d	01:00.0	61.9	79.7	72.6	43.1	-:-	68.3	67.6	49.8	46.5	45.5	----	-----	1548816.6	62.1
204	9/10/2025	12:12:13	00d	01:00.0	64.9	82.7	72.9	47.9	-:-	71.7	69.9	61.3	49	48.3	----	-----	3090295.4	62.1
205	9/10/2025	12:13:13	00d	01:00.0	59.3	77.1	69	43.8	-:-	67.6	66.5	48.4	44.7	44.4	----	-----	851138.0	62.0
206	9/10/2025	12:14:13	00d	01:00.0	61.4	79.2	70.3	44	-:-	69.2	67.2	53.6	45.8	44.3	----	-----	1380384.3	62.0
207	9/10/2025	12:15:13	00d	01:00.0	64.9	82.7	77.6	40.8	-:-	71.2	69	45.9	41.9	41.4	----	-----	3090295.4	62.0
208	9/10/2025	12:16:13	00d	01:00.0	62.9	80.7	72.5	40.7	-:-	70	67.3	55.4	44.4	41.9	----	-----	1949844.6	61.9
209	9/10/2025	12:17:13	00d	01:00.0	63.6	81.4	70.1	42	-:-	69.1	68.8	56	43	42.4	----	-----	2290867.7	61.9
210	9/10/2025	12:18:13	00d	01:00.0	70.1	87.9	84	42.6	-:-	76.4	69.2	48.2	42.9	42.9	----	-----	10232929.9	61.8
211	9/10/2025	12:19:13	00d	01:00.0	61.1	78.9	72	43.6	-:-	69.1	66.9	51.7	45.1	44.8	----	-----	1288249.6	61.4
212	9/10/2025	12:20:13	00d	01:00.0	62.3	80.1	71.3	41.9	-:-	69.6	66.8	52.3	42.4	42.1	----	-----	1698243.7	61.4
213	9/10/2025	12:21:13	00d	01:00.0	59.8	77.6	70.2	40.3	-:-	68.5	65.6	44.7	40.9	40.4	----	-----	954992.6	61.4
214	9/10/2025	12:22:13	00d	01:00.0	61.7	79.5	69.8	44.9	-:-	68.4	67.7	55.3	46	45.3	----	-----	1479108.4	61.4
215	9/10/2025	12:23:13	00d	01:00.0	59.1	76.9	68.5	44	-:-	66.1	64.2	51.4	44.5	44.3	----	-----	812830.5	61.4

216	9/10/2025	12:24:13	00d	01:00.0	66.2	84	79.2	39.6	-:-	74.3	70.8	55.3	40.7	40	----	-----	4168693.8	61.4
217	9/10/2025	12:25:13	00d	01:00.0	58.3	76.1	66.2	41.2	-:-	65.6	63.9	52	42.8	42.1	----	-----	676083.0	61.2
218	9/10/2025	12:26:13	00d	01:00.0	62.1	79.9	72.3	41.7	-:-	69.6	67.9	48.3	42.2	42	----	-----	1621810.1	61.3
219	9/10/2025	12:27:13	00d	01:00.0	57.7	75.5	70.4	41.6	-:-	67.1	59.3	48.1	42.1	41.9	----	-----	588843.7	61.2
220	9/10/2025	12:28:13	00d	01:00.0	57.1	74.9	68.5	44.2	-:-	66.1	61.3	46.1	44.5	44.3	----	-----	512861.4	61.4
221	9/10/2025	12:29:13	00d	01:00.0	50.1	67.9	62.5	44	-:-	56.1	51.7	45.6	44.4	44	----	-----	102329.3	61.4
222	9/10/2025	12:30:13	00d	01:00.0	65.2	83	75.6	45.4	-:-	73.4	69.2	59.5	47.8	46.4	----	-----	3311311.2	61.5
223	9/10/2025	12:31:13	00d	01:00.0	58.1	75.9	67.3	44.4	-:-	65.7	64.2	49.8	44.8	44.4	----	-----	645654.2	61.4
224	9/10/2025	12:32:13	00d	01:00.0	62.7	80.5	70.4	49.3	-:-	68.3	67.7	58.1	49.6	49.3	----	-----	1862087.1	61.4
225	9/10/2025	12:33:13	00d	01:00.0	63.4	81.2	75.4	42.6	-:-	71	66.9	51	43.9	43.2	----	-----	2187761.6	61.4
226	9/10/2025	12:34:13	00d	01:00.0	60.4	78.2	67.9	42.1	-:-	68.3	67.1	46.6	42.8	42.5	----	-----	1096478.2	61.4
227	9/10/2025	12:35:13	00d	01:00.0	59.9	77.7	69.3	45.2	-:-	68.4	65.8	52.1	45.9	45.4	----	-----	977237.2	61.4
228	9/10/2025	12:36:13	00d	01:00.0	60.1	77.9	72.4	40.6	-:-	70.3	64.3	46.9	41.9	40.9	----	-----	1023293.0	61.5
229	9/10/2025	12:37:13	00d	01:00.0	55	72.8	67.6	39.7	-:-	63.2	56.3	41.9	39.9	39.8	----	-----	316227.8	61.5
230	9/10/2025	12:38:13	00d	01:00.0	54.1	71.9	66	40.5	-:-	62.7	57.2	45.3	41.8	41.2	----	-----	257039.6	61.5
231	9/10/2025	12:39:13	00d	01:00.0	58.9	76.7	66.2	44.9	-:-	66.2	64.3	50.6	45.5	45.2	----	-----	776247.1	61.8
232	9/10/2025	12:40:13	00d	01:00.0	62.9	80.7	71.5	43.5	-:-	70.7	68.2	56	44.9	43.8	----	-----	1949844.6	62.2
233	9/10/2025	12:41:13	00d	01:00.0	54.2	72	66.6	39.2	-:-	64.8	53.5	40.4	39.5	39.3	----	-----	263026.8	62.1
234	9/10/2025	12:42:13	00d	01:00.0	58.9	76.7	68.3	42	-:-	65.6	64.5	48.4	43.1	42.8	----	-----	776247.1	62.1
235	9/10/2025	12:43:13	00d	01:00.0	59.3	77.1	66.7	43.4	-:-	66.6	65.9	53.6	44.3	43.9	----	-----	851138.0	62.1
236	9/10/2025	12:44:13	00d	01:00.0	60.9	78.7	71.2	42.6	-:-	69.4	66.4	50.8	43.6	43	----	-----	1230268.8	62.2
237	9/10/2025	12:45:13	00d	01:00.0	62.4	80.2	70.9	43.2	-:-	70.6	68.4	51.6	44.1	43.7	----	-----	1737800.8	62.2
238	9/10/2025	12:46:13	00d	01:00.0	60.7	78.5	69.9	45.4	-:-	68	66.2	53.7	46.3	45.5	----	-----	1174897.6	62.2
239	9/10/2025	12:47:13	00d	01:00.0	65.2	83	77.5	47.2	-:-	72.1	68.5	53.7	49.1	47.9	----	-----	3311311.2	62.2
240	9/10/2025	12:48:13	00d	01:00.0	54.7	72.5	67.7	41.6	-:-	63.2	55.2	44.6	42.2	41.9	----	-----	295120.9	62.1
241	9/10/2025	12:49:13	00d	01:00.0	61.2	79	72.6	43	-:-	68.3	65	49.7	43.9	43	----	-----	1318256.7	62.2
242	9/10/2025	12:50:13	00d	01:00.0	59.3	77.1	68.1	40.9	-:-	67.8	66.3	48.5	41.6	41	----	-----	851138.0	62.2
243	9/10/2025	12:51:13	00d	01:00.0	62.7	80.5	70.3	41.6	-:-	69.7	69.3	50.8	42.3	41.8	----	-----	1862087.1	62.2
244	9/10/2025	12:52:13	00d	01:00.0	59.6	77.4	69.1	42.4	-:-	67.8	65.9	49.3	45	44	----	-----	912010.8	62.2
245	9/10/2025	12:53:13	00d	01:00.0	60.8	78.6	70.6	42.8	-:-	69.9	67.7	46.8	43.2	43.1	----	-----	1202264.4	62.2
246	9/10/2025	12:54:13	00d	01:00.0	62.6	80.4	70.3	47.9	-:-	69.9	68	56.7	48.4	48	----	-----	1819700.9	62.2
247	9/10/2025	12:55:13	00d	01:00.0	56.3	74.1	67.1	40.1	-:-	66.1	61.6	44.4	41.3	40.3	----	-----	426579.5	62.2
248	9/10/2025	12:56:13	00d	01:00.0	62.4	80.2	71	42.7	-:-	69.1	68.4	51.7	43	42.8	----	-----	1737800.8	62.3
249	9/10/2025	12:57:13	00d	01:00.0	58.5	76.3	67.9	44.6	-:-	66.5	65	49.6	44.8	44.7	----	-----	707945.8	62.3
250	9/10/2025	12:58:13	00d	01:00.0	65.6	83.4	78.8	41	-:-	73.7	66.1	46.6	41.2	41	----	-----	3630780.5	62.3
251	9/10/2025	12:59:13	00d	01:00.0	64.9	82.7	73.7	45.8	-:-	72.3	67.9	61.3	46.2	46.1	----	-----	3090295.4	62.2
252	9/10/2025	13:00:13	00d	01:00.0	63.3	81.1	72.7	46.4	-:-	70.9	67.9	54	47.9	46.9	----	-----	2137962.1	62.1
253	9/10/2025	13:01:13	00d	01:00.0	61.5	79.3	70.5	44.4	-:-	68.7	66.2	53.3	46.3	45.2	----	-----	1412537.5	62.0
254	9/10/2025	13:02:13	00d	01:00.0	55.4	73.2	67.5	39.9	-:-	64.4	59.7	42.7	40.7	40.5	----	-----	346736.9	62.0
255	9/10/2025	13:03:13	00d	01:00.0	58.5	76.3	67.2	39.8	-:-	66.9	65.6	48.2	40.1	39.9	----	-----	707945.8	62.1
256	9/10/2025	13:04:13	00d	01:00.0	60.5	78.3	70.5	43.3	-:-	69.5	66.1	52.3	44.2	43.6	----	-----	1122018.5	62.1
257	9/10/2025	13:05:13	00d	01:00.0	59.8	77.6	70.2	39.7	-:-	68.6	66.5	43.9	40.4	40.4	----	-----	954992.6	62.2
258	9/10/2025	13:06:13	00d	01:00.0	61.8	79.6	70.3	39.4	-:-	70	67.8	51.6	40	39.7	----	-----	1513561.2	62.3
259	9/10/2025	13:07:13	00d	01:00.0	61.9	79.7	72.8	43.1	-:-	67.7	65.3	54.6	44.6	44	----	-----	1548816.6	62.3
260	9/10/2025	13:08:13	00d	01:00.0	64.2	82	73.6	41.2	-:-	72.3	68.8	55	42.2	41.3	----	-----	2630268.0	62.2
261	9/10/2025	13:09:13	00d	01:00.0	62.8	80.6	75	45.6	-:-	69.2	67.6	51	46	45.8	----	-----	1905460.7	62.3
262	9/10/2025	13:10:13	00d	01:00.0	57.9	75.7	68.2	43.2	-:-	66.6	64.8	47.7	43.6	43.4	----	-----	616595.0	62.3
263	9/10/2025	13:11:13	00d	01:00.0	67	84.8	79.1	46.3	-:-	75.3	69	59.2	47.7	46.8	----	-----	5011872.3	62.4
264	9/10/2025	13:12:13	00d	01:00.0	57	74.8	67.1	41.1	-:-	66.4	64.2	45.7	42.2	41.7	----	-----	501187.2	62.2
265	9/10/2025	13:13:13	00d	01:00.0	60.2	78	70.3	45.8	-:-	68.9	66.7	49	46.3	45.8	----	-----	1047128.5	62.2
266	9/10/2025	13:14:13	00d	01:00.0	59.7	77.5	69.5	41.4	-:-	68.5	66	47.3	41.9	41.7	----	-----	933254.3	62.3
267	9/10/2025	13:15:13	00d	01:00.0	61.8	79.6	70.3	46.4	-:-	69.2	67	54.2	47.4	46.9	----	-----	1513561.2	62.3
268	9/10/2025	13:16:13	00d	01:00.0	61.9	79.7	70.3	45.6	-:-	69.2	66.7	53.6	47	45.9	----	-----	1548816.6	62.3
269	9/10/2025	13:17:13	00d	01:00.0	59.5	77.3	70.4	42.1	-:-	68.5	65.6	44.2	42.5	42.2	----	-----	891250.9	62.3
270	9/10/2025	13:18:13	00d	01:00.0	60.7	78.5	70	41.8	-:-	69.1	66.7	48.9	42.8	42.1	----	-----	1174897.6	62.4
271	9/10/2025	13:19:13	00d	01:00.0	61.5	79.3	67.3	43.6	-:-	66.5	65.4	59.4	44.5	43.7	----	-----	1412537.5	62.4
272	9/10/2025	13:20:13	00d	01:00.0	54.4	72.2	66.8	41.5	-:-	63.7	54.3	45.1	41.7	41.7	----	-----	275422.9	62.3
273	9/10/2025	13:21:13	00d	01:00.0	62.1	79.9	71.8	44.1	-:-	67.5	66.7	53.3	45.4	44.8	----	-----	1621810.1	62.4
274	9/10/2025	13:22:13	00d	01:00.0	63	80.8	71.8	44.9	-:-	69.4	67.9	55.7	47.7	45.7	----	-----	1995262.3	62.6
275	9/10/2025	13:23:13	00d	01:00.0	62.3	80.1	69.1	44.5	-:-	68.1	67.6	53.4	45.5	45	----	-----	1698243.7	62.6
276	9/10/2025	13:24:13	00d	01:00.0	58.5	76.3	67.1	44.7	-:-	66.6	64.7	48.9	45.6	45.3	----	-----	707945.8	62.6
277	9/10/2025	13:25:13	00d	01:00.0	59	76.8	67.2	45.9	-:-	66.5	64.9	52	46.9	46.3	----	-----	794328.2	62.6
278	9/10/2025	13:26:13	00d	01:00.0	61.1	78.9	70.6	43.1	-:-	70.1	68.5	48.2	43.9	43.4	----	-----	1288249.6	62.6
279	9/10/2025	13:27:13	00d	01:00.0	60.4	78.2	68.8	42	-:-	67.7	66.6	52.1	42.8	42.3	----	-----	1096478.2	62.6
280	9/10/2025	13:28:13	00d	01:00.0	65.2	83	77.2	43.3	-:-	71.1	68.7	57.6	45.2	43.7	----	-----	3311311.2	62.6
281	9/10/2025	13:29:13	00d	01:00.0	60.5	78.3	72.6	41.9	-:-	70	64.3	48.7	43.2	42.1	----	-----	1122018.5	62.4
282	9/10/2025	13:30:13	00d	01:00.0	60.9	78.7	70.7	40.5	-:-	70.3	67.2	43.9	40.8	40.5	----	-----	1230268.8	62.5
283	9/10/2025	13:31:13	00d	01:00.0	59.8	77.6	70.6	39.3	-:-	68.3	66.4	47.6	39.7	39.6	----	-----	954992.6	62.5
284	9/10/2025	13:32:13	00d	01:00.0	61.7	79.5	69.3	42.7	-:-	69.1	67.7	51.8	44.1	43.1	----	-----	1479108.4	62.5
285	9/10/2025	13:33:13	00d	01:00.0	62.1	79.9	68.6	43.8	-:-	68.1	67.6	57.1	44	43.9	----	-----	1621810.1	62.4
286	9/10/2025	13:34:13	00d	01:00.0	65.2	83	75.1	40.3	-:-	73.1	68.9	54.7	41.6	40.9	----	-----	3311311.2	62.4
287	9/10/2025	13:35:13	00d	01:00.0	60.3	78.1	69.1	41.9	-:-	67.6	66.8	46.6	42.1	42	----	-----	1071519.3	62.4
288	9/10/2025	13:36:13	00d	01:00.0	61.8	79.6	72.6	39.8	-:-	70.6	67.4	45.2	40.2	39.9	----	-----	1513561.2	62.4
289	9/10/2025	13:37:13	00d	01:00.0	60.2	78	66.6	42.2	-:-	66.3	65.5	55.3	44	43.1	----	-----	1047128.5	62.4
290	9/10/2025	13:38:13	00d	01:00.0	62.4	80.2	73	43.3	-:-	67.9	66.5	55.8	44.2	43.9	----	-----	1737800.8	62.4
291	9/10/2025	13:39:13	00d	01:00.0	66.7	84.5	78.2	50.8	-:-	72.3	69.9	60.3	51.7	51.4	----	-----	4677351.4	62.5
292	9/10/2025	13:40:13	00d	01:00.0	69.8	87.6	82.5	47	-:-	77.5	71.8	58.5	47.9	47.4	----	-----	9549925.9	62.3
293	9/10/2025	13:41:13	00d	01:00.0	56.1	73.9	64.1	43	-:-	62.9	62.4	49.5	43.2	42.7	----	-----	407380.3	61.9
294	9/10/2025	13:42:13	00d	01:00.0	61.1	78.9	71.1	44	-:-	69	65.9	51.7	45.1	44.9	----	-----	1288249.6	62.0
295	9/10/2025	13:43:13	00d	01:00.0	58.3	76.1	65.4	43.1	-:-	65.4	64.8	50.4	44.5	43.9	----	-----	676083.0	62.0
296	9/10/2025	13:44:13	00d	01:00.0	62.6	80.4	70.4	44	-:-	69.4	68.6	53.9	45	44.2	----	-----	1819700.9	62.0
297	9/10/2025	13:45:13	00d	01:00.0	59.4	77.2	70.7	43.3	-:-	67.2	64.6	49.7	44.1	43.9	----	-----	870963.6	61.9
298	9/10/2025	13:46:13	00d	01:00.0	64.4	82.2	74.9	43.7	-:-	72.4	69.2	54.2	46.1	45.1	----	-----	2754228.7	62.0
299	9/10/2025	13:47:13	00d	01:00.0	58.7	76.5	69	40.6	-:-	68.2	64.5	44.9	41	40.9	----	-----	741310.2	61.9
300	9/10/2025	13:48:13	00d	01:00.0	61.5	79.3	69.4	45.1	-:-	69.4	67.8	52.2	46.4	45.5	----	-----	1412537.5	61.9
301	9/10/2025	13:49:13	00d	01:00.0	63.2	81	68.7	46.5	-:-	68.1	67.4	58.9	47.6	47	----	-----	2089296.1	62.0
302	9/10/2025	13:50:13	00d	01:00.0	62	79.8	70.6	43.1	-:-	69.4	66.9	54	45.3	43.7	----	-----	1584893.2	62.0
303	9/10/2025	13:51:13	00d	01:00.0	60.3	78.1	67.9	43.2	-:-	68.3	65.7	52.5	43.3	43.1	----	-----	1071519.3	62.2
304	9/10/2025	13:52:13	00d	01:00.0	60.5	78.3	68.1	43.6	-:-	67.5	66.5	53.8	44.5	43.9	----	-----	1122018.5	62.2
305	9/10/2025	13:53:13	00d	01:00.0	62.6	80.4	69.2	44.7	-:-	68.5	66.5	59.8	45.6	45.4	----	-----	1819700.9	62.2
306	9/10/2025	13:54:13	00d	01:00.0	62.2	80	74	43.2	-:-	70.6	65.5	53.6	44.4	43.4	----	-----	1659586.9	62.2
307	9/10/2025	13:55:13	00d	01:00.0	62	79.8	72.3	42.4	-:-	69.1	66.9	52.1	44.9	43.3	----	-----	1584893.2	62.2
308	9/10/2025	13:56:13	00d	01:00.0	62.1	79.9	68.9	44	-:-	67.8	67.2	58	44.8	44.1	----	-----	1621810.1	62.2
309	9/10/2025	13:57:13	00d	01:00.0	63.5	81.3	75.9	42.8	-:-	68.4	66.3	54	45.4	44.3	----	-----	2238721.1	62.2
310	9/10/2025	13:58:13	00d	01:00.0	60.9	78.7	71.4	45.4	-:-	66.1	64.4	54.7	46.6	45.8	----	-----	1230268.8	62.2
311	9/10/2025	13:59:13	00d	01:00.0	59.6	77.4	68.1	40.2	-:-	67.5	66.1	50.5	41	40.7	----	-----	912010.8	62.2
312	9/10/2025	14:00:13	00d	01:00.0	54	71.8	66.7	40.3	-:-	63.3	53.5	42.3	41.1	40.7	----	-----	251188.6	62.2
313	9/10/2025	14:01:13	00d	01:00.0	58.2	76	67.7	41.6	-:-	66	62.7	49.6	42.4	42.1	----	-----	660693.4	62.2
314	9/10/2025	14:02:13	00d	01:00.0	63.5	81.3	73.6	46.1	-:-	71.4	68.4	54	46.7	46.3	----	-----	2238721.1	62.2
315	9/10/2025	14:03:13	00d	01:00.0	60.9	78.7	70.6	42.9	-:-	67.3	66.4	54.8	45.8	43.7	----	-----	1230268.8	62.2
316	9/10/2025	14:04:13	00d	01:00.0	63.7	81.5	72.9	43.7	-:-	71	70.1	51.4	44.3	43.9	----	-----	2344228.8	62.2
317	9/10/2025	14:05:13	00d	01:00.0	60.7	78.5	72	46.9	-:-	68.5	66.2	50.6	47.6	47.4	----	-----	1174897.6	62.2
318	9/10/2025	14:06:13	00d	01:00.0	65.9	83.7	75.2	42.7	-:-	74.5	72	54.2	43.1	42.9	----	-----	3890451.4	62.2
319	9/10/2025	14:07:13	00d	01:00.0	62.1	79.9	69.7	45.7	-:-	68.2	67.7	54	46.2	45.9	----	-----	1621810.1	62.1
320	9/10/2025	14:08:13	00d	01:00.0	57.3	75.1	66.1	41.4	-:-	64.2	63.8	46.5	41.7	41.5	----	-----	537031.8	62.2
321	9/10/2025	14:09:13	00d	01:00.0	65.7	83.5	73.6	41.2	-:-	72.4	71.4	58.8	44.4	41.9	----	-----	3715352.3	62.3
322	9/10/2025	14:10:13	00d	01:00.0	63.6	81.4	70.5	48	-:-	70	68.1	59.3	50.2	49.6	----	-----	2290867.7	62.1
323	9/10/2025	14:11:13	00d	01:00.0	64.5	82.3	73.2	44.7	-:-	71.1	70.4	56.3	46.7	45.9	----	-----	2818382.9	62.1
324	9/10/2025	14:12:13	00d	01:00.0	60.8	78.6	69.1	40.8	-:-	69.1	68	47.7	41.4	41.2	----	-----	1202264.4	62.0

325	9/10/2025	14:13:13	00d	01:00.0	58.8	76.6	67.5	39.1	-:-	66.6	65	48.4	39.6	39.4	----	-----	758577.6	62.0
326	9/10/2025	14:14:13	00d	01:00.0	63.4	81.2	73	42.1	-:-	72.7	69.2	49.8	43.6	42.7	----	-----	2187761.6	62.1
327	9/10/2025	14:15:13	00d	01:00.0	62.3	80.1	73.2	40.6	-:-	72.2	66.6	45.3	41.7	41.3	----	-----	1698243.7	62.1
328	9/10/2025	14:16:13	00d	01:00.0	61.5	79.3	71.8	40.8	-:-	69.5	67.8	50.7	42.2	41.2	----	-----	1412537.5	62.1
329	9/10/2025	14:17:13	00d	01:00.0	60.3	78.1	68.7	44.9	-:-	67.8	65.6	50.8	46	45.8	----	-----	1071519.3	62.1
330	9/10/2025	14:18:13	00d	01:00.0	64.1	81.9	74.3	40.9	-:-	72.1	69	51.4	43	41.9	----	-----	2570395.8	62.1
331	9/10/2025	14:19:13	00d	01:00.0	61	78.8	68.1	40	-:-	67.8	66.1	50.8	40.6	40.3	----	-----	1258925.4	62.0
332	9/10/2025	14:20:13	00d	01:00.0	57	74.8	66.1	41.3	-:-	64.4	63.7	47.6	42.1	41.4	----	-----	501187.2	62.0
333	9/10/2025	14:21:13	00d	01:00.0	60.5	78.3	67.6	42	-:-	67.5	66.6	49.3	43.3	42.7	----	-----	1122018.5	62.0
334	9/10/2025	14:22:13	00d	01:00.0	69.1	86.9	82.1	41.3	-:-	77.2	71.6	46.1	42.4	41.5	----	-----	8128305.2	62.1
335	9/10/2025	14:23:13	00d	01:00.0	60.7	78.5	70.1	41.9	-:-	69.2	65.6	46.4	42.2	42	----	-----	1174897.6	61.8
336	9/10/2025	14:24:13	00d	01:00.0	58.4	76.2	67.6	40.4	-:-	65.7	64.4	44.3	41.8	40.4	----	-----	691831.0	61.9
337	9/10/2025	14:25:13	00d	01:00.0	60.6	78.4	69.5	41.7	-:-	67.7	66.4	51	42.3	41.9	----	-----	1148153.6	61.9
338	9/10/2025	14:26:13	00d	01:00.0	58.3	76.1	67	43.9	-:-	66	64	49	44.8	44.4	----	-----	676083.0	61.9
339	9/10/2025	14:27:13	00d	01:00.0	60.5	78.3	68.6	44.1	-:-	67.4	65	55.5	45.7	45	----	-----	1122018.5	62.1
340	9/10/2025	14:28:13	00d	01:00.0	59.1	76.9	66.9	41.6	-:-	66.3	65.6	52.6	43.7	42.6	----	-----	812830.5	62.1
341	9/10/2025	14:29:13	00d	01:00.0	56.1	73.9	65.8	39.5	-:-	65.3	62.4	45.3	40.6	40.1	----	-----	407380.3	62.2
342	9/10/2025	14:30:13	00d	01:00.0	63.7	81.5	75.8	42.7	-:-	72.5	66.7	48.4	43.4	43.1	----	-----	2344228.8	62.2
343	9/10/2025	14:31:13	00d	01:00.0	60.9	78.7	68.6	44.8	-:-	67.4	65.6	58.5	47.2	45.7	----	-----	1230268.8	62.2
344	9/10/2025	14:32:13	00d	01:00.0	56.9	74.7	68.2	39.1	-:-	66.2	62.8	42.4	39.5	39.3	----	-----	489778.8	62.2
345	9/10/2025	14:33:13	00d	01:00.0	59.5	77.3	69	39.5	-:-	67.5	66	48.9	40.6	40.1	----	-----	891250.9	62.3
346	9/10/2025	14:34:13	00d	01:00.0	62.1	79.9	72.2	41.9	-:-	68.8	66.9	51.6	43.1	42.6	----	-----	1621810.1	62.3
347	9/10/2025	14:35:13	00d	01:00.0	60.3	78.1	68.2	41.2	-:-	66.3	65.7	50.4	42.1	41.9	----	-----	1071519.3	62.3
348	9/10/2025	14:36:13	00d	01:00.0	63.2	81	70.2	45.8	-:-	69.8	69.2	56.2	46.8	46.2	----	-----	2089296.1	62.4
349	9/10/2025	14:37:13	00d	01:00.0	61.3	79.1	70	43.1	-:-	68.7	67	51.6	45.2	44.3	----	-----	1348962.9	62.3
350	9/10/2025	14:38:13	00d	01:00.0	55.9	73.7	66.4	39.5	-:-	66	60.3	45.1	39.9	39.6	----	-----	389045.1	62.4
351	9/10/2025	14:39:13	00d	01:00.0	67.2	85	78.2	49.1	-:-	73.5	70.5	59.6	50.3	49.4	----	-----	5248074.6	62.5
352	9/10/2025	14:40:13	00d	01:00.0	58.9	76.7	67.1	39.7	-:-	67.1	63.5	51	41.7	40.6	----	-----	776247.1	62.3
353	9/10/2025	14:41:13	00d	01:00.0	54	71.8	66.7	39	-:-	64.4	53.9	41.5	39.4	39.2	----	-----	251188.6	62.4
354	9/10/2025	14:42:13	00d	01:00.0	59	76.8	66.9	38.8	-:-	66.9	64.9	47.2	39	38.9	----	-----	794328.2	62.5
355	9/10/2025	14:43:13	00d	01:00.0	62.9	80.7	68.6	41.5	-:-	68.5	67.2	60.4	45.5	42.2	----	-----	1949844.6	62.5
356	9/10/2025	14:44:13	00d	01:00.0	56.8	74.6	66.6	39.3	-:-	66.4	62.3	44.1	39.6	39.5	----	-----	478630.1	62.9
357	9/10/2025	14:45:13	00d	01:00.0	60.3	78.1	69.3	40.9	-:-	68.5	66.3	49	41.5	41.3	----	-----	1071519.3	63.0
358	9/10/2025	14:46:13	00d	01:00.0	61.6	79.4	70.2	41	-:-	69.5	67.8	51.4	41.4	41.2	----	-----	1445439.8	63.1
359	9/10/2025	14:47:13	00d	01:00.0	60.8	78.6	68.6	40.8	-:-	68.2	67.1	53.9	41.5	41.2	----	-----	1202264.4	63.1
360	9/10/2025	14:48:13	00d	01:00.0	60.2	78	68	41.4	-:-	68	65.8	53.9	42.5	41.9	----	-----	1047128.5	63.2
361	9/10/2025	14:49:13	00d	01:00.0	65	82.8	72.6	46.1	-:-	70.7	69.3	61.1	49.7	47.1	----	-----	3162277.7	63.3
362	9/10/2025	14:50:13	00d	01:00.0	62.3	80.1	68.8	47.7	-:-	68.8	66.8	56.6	49.8	48.6	----	-----	1698243.7	63.2
363	9/10/2025	14:51:13	00d	01:00.0	68.9	86.7	81.5	41.6	-:-	72.9	70.6	60.1	42.8	42.4	----	-----	7762471.2	63.2
364	9/10/2025	14:52:13	00d	01:00.0	59.9	77.7	66.8	40.9	-:-	66.7	65.7	50	41.3	41.1	----	-----	977237.2	63.1
365	9/10/2025	14:53:13	00d	01:00.0	60.7	78.5	68.5	42.5	-:-	68	65.8	53.1	43.6	43.3	----	-----	1174897.6	63.1
366	9/10/2025	14:54:13	00d	01:00.0	62.8	80.6	69.9	43.1	-:-	68.2	67.2	57.7	45.8	44.4	----	-----	1905460.7	63.2
367	9/10/2025	14:55:13	00d	01:00.0	56.5	74.3	67.2	40.5	-:-	65.2	61.1	45.7	40.9	40.7	----	-----	446683.6	63.2
368	9/10/2025	14:56:13	00d	01:00.0	58.2	76	67.4	44.1	-:-	66	65	48.5	44.9	44.7	----	-----	660693.4	63.2
369	9/10/2025	14:57:13	00d	01:00.0	61.8	79.6	71.5	41.5	-:-	69.1	67	53	42	41.8	----	-----	1513561.2	63.3
370	9/10/2025	14:58:13	00d	01:00.0	65	82.8	73.2	50.5	-:-	71.5	70.3	59.1	51	50.1	----	-----	3162277.7	63.3
371	9/10/2025	14:59:13	00d	01:00.0	61	78.8	68.2	44.7	-:-	66.6	66.3	55.4	45.9	45.5	----	-----	1258925.4	63.2
372	9/10/2025	15:00:13	00d	01:00.0	53.2	71	64.5	41.2	-:-	64.1	55	43	41.4	41.3	----	-----	208929.6	63.3
373	9/10/2025	15:01:13	00d	01:00.0	62.4	80.2	68.5	44.6	-:-	67.5	66.7	60.7	48.4	46.3	----	-----	1737800.8	63.3
374	9/10/2025	15:02:13	00d	01:00.0	59.3	77.1	68.5	40.8	-:-	66.9	65.9	46.4	41.8	41.4	----	-----	851138.0	63.3
375	9/10/2025	15:03:13	00d	01:00.0	62	79.8	70.5	47.8	-:-	69.6	68.4	54.2	48.4	47.9	----	-----	1584893.2	63.5
376	9/10/2025	15:04:13	00d	01:00.0	63	80.8	70.1	47.6	-:-	69	67.8	60.7	49	48.1	----	-----	1995262.3	63.5
377	9/10/2025	15:05:13	00d	01:00.0	59.4	77.2	68.9	41.4	-:-	68	64.8	48.3	42.1	41.7	----	-----	870963.6	63.4
378	9/10/2025	15:06:13	00d	01:00.0	61.9	79.7	71.5	43.5	-:-	67.5	66.6	57.1	45.1	43.9	----	-----	1548816.6	63.5
379	9/10/2025	15:07:13	00d	01:00.0	63.3	81.1	72.3	46	-:-	70.4	67.6	58.2	47	46.4	----	-----	2137962.1	63.5
380	9/10/2025	15:08:13	00d	01:00.0	65.9	83.7	78.1	43.5	-:-	73.9	68.4	59.3	44.8	44.1	----	-----	3890451.4	63.6
381	9/10/2025	15:09:13	00d	01:00.0	62.2	80	68.5	42.3	-:-	68.3	66.8	54.5	43.9	42.8	----	-----	1659586.9	63.5
382	9/10/2025	15:10:13	00d	01:00.0	53.2	71	65.7	38.7	-:-	63.7	55.3	40.7	39.1	39	----	-----	208929.6	63.5
383	9/10/2025	15:11:13	00d	01:00.0	63.1	80.9	70.5	42.6	-:-	68.9	67.9	58.3	46.9	46.3	----	-----	2041737.9	63.6
384	9/10/2025	15:12:13	00d	01:00.0	60.7	78.5	70.7	41.9	-:-	68.4	66	51.1	43.9	42.3	----	-----	1174897.6	63.6
385	9/10/2025	15:13:13	00d	01:00.0	61.7	79.5	70	44	-:-	68.8	67.5	54	47.1	46	----	-----	1479108.4	63.6
386	9/10/2025	15:14:13	00d	01:00.0	64.1	81.9	74.3	45.4	-:-	71.7	69	56.1	47	45.5	----	-----	2570395.8	63.6
387	9/10/2025	15:15:13	00d	01:00.0	60.3	78.1	70.2	45.1	-:-	66.5	64.3	55.5	46.6	45.8	----	-----	1071519.3	63.5
388	9/10/2025	15:16:13	00d	01:00.0	62.1	79.9	71	43.4	-:-	70.1	68.5	52.3	44.5	43.7	----	-----	1621810.1	63.6
389	9/10/2025	15:17:13	00d	01:00.0	63.5	81.3	68.5	46.4	-:-	68.2	67.4	60	52.1	50.1	----	-----	2238721.1	63.5
390	9/10/2025	15:18:13	00d	01:00.0	62	79.8	70.1	44.6	-:-	69	66.9	54.4	45.7	45	----	-----	1584893.2	63.5
391	9/10/2025	15:19:13	00d	01:00.0	56.4	74.2	68.2	40.6	-:-	65.1	59.1	42.8	41	40.8	----	-----	436515.8	63.5
392	9/10/2025	15:20:13	00d	01:00.0	59	76.8	67.3	41.6	-:-	65.8	64	52.1	44.5	43.6	----	-----	794328.2	63.6
393	9/10/2025	15:21:13	00d	01:00.0	59.5	77.3	67.7	40.8	-:-	67	66.2	47.6	41.2	41.1	----	-----	891250.9	63.6
394	9/10/2025	15:22:13	00d	01:00.0	63.6	81.4	71.4	45.1	-:-	69.1	67.4	59.6	45.7	45.3	----	-----	2290867.7	63.7
395	9/10/2025	15:23:13	00d	01:00.0	60.8	78.6	69	43.3	-:-	68.4	66.9	49.9	43.9	43.3	----	-----	1202264.4	63.8
396	9/10/2025	15:24:13	00d	01:00.0	64.8	82.6	71.9	48.7	-:-	71.2	69.1	62.6	50.3	48.5	----	-----	3019951.7	64.2
397	9/10/2025	15:25:13	00d	01:00.0	60.1	77.9	69.9	41.4	-:-	68.3	66.4	49.4	41.9	41.8	----	-----	1023293.0	64.2
398	9/10/2025	15:26:13	00d	01:00.0	59.8	77.6	68.4	41.3	-:-	67.5	65.7	47.7	41.7	41.6	----	-----	954992.6	64.2
399	9/10/2025	15:27:13	00d	01:00.0	68.3	86.1	80.4	45.7	-:-	72.8	71	60.5	48	46.7	----	-----	6760829.8	64.3
400	9/10/2025	15:28:13	00d	01:00.0	60.6	78.4	69.1	44	-:-	69	66.7	49.6	44.8	44.7	----	-----	1148153.6	64.2
401	9/10/2025	15:29:13	00d	01:00.0	63.3	81.1	70.4	44.2	-:-	70.2	68.3	57	47	45.2	----	-----	2137962.1	64.2
402	9/10/2025	15:30:13	00d	01:00.0	58.6	76.4	67	43.7	-:-	65.5	63.6	52.5	44.4	44	----	-----	724436.0	64.2
403	9/10/2025	15:31:13	00d	01:00.0	62.8	80.6	70.9	44.2	-:-	69.3	68.2	56.7	46	45	----	-----	1905460.7	64.2
404	9/10/2025	15:32:13	00d	01:00.0	63.5	81.3	72.6	44.5	-:-	69.4	67.8	57.4	46.4	45.9	----	-----	2238721.1	64.2
405	9/10/2025	15:33:13	00d	01:00.0	61	78.8	69.6	41.3	-:-	68.6	66	46.1	41.4	41.3	----	-----	1258925.4	64.2
406	9/10/2025	15:34:13	00d	01:00.0	61.7	79.5	67.8	44.2	-:-	67.4	66.5	56.4	45.5	44.4	----	-----	1479108.4	64.3
407	9/10/2025	15:35:13	00d	01:00.0	64.7	82.5	74.3	45.6	-:-	71.5	68.7	56.4	50	48.9	----	-----	2951209.2	64.3
408	9/10/2025	15:36:13	00d	01:00.0	63.1	80.9	74.1	42.6	-:-	71.7	67.4	53.1	43.5	42.8	----	-----	2041737.9	64.3
409	9/10/2025	15:37:13	00d	01:00.0	59.6	77.4	67.8	41	-:-	67.4	65.4	48.2	42	41.2	----	-----	912010.8	64.3
410	9/10/2025	15:38:13	00d	01:00.0	64.5	82.3	75.9	41.4	-:-	71.4	68.3	55.7	43.4	42.3	----	-----	2818382.9	64.4
411	9/10/2025	15:39:13	00d	01:00.0	63.9	81.7	71.4	42.4	-:-	69.6	68.3	59.2	45.1	44.7	----	-----	2454708.9	64.3
412	9/10/2025	15:40:13	00d	01:00.0	62.5	80.3	72.3	43.6	-:-	68.4	68	54.6	45.9	44.5	----	-----	1778279.4	64.4
413	9/10/2025	15:41:13	00d	01:00.0	63.5	81.3	71.9	46.2	-:-	70.6	68.5	55.1	49.2	46.5	----	-----	2238721.1	64.5
414	9/10/2025	15:42:13	00d	01:00.0	64.9	82.7	71.3	46	-:-	70.3	69.3	62.5	47.7	46.4	----	-----	3090295.4	64.5
415	9/10/2025	15:43:13	00d	01:00.0	61.3	79.1	68.6	41.3	-:-	68.7	67.8	52.1	42.2	41.6	----	-----	1348962.9	64.5
416	9/10/2025	15:44:13	00d	01:00.0	70.8	88.6	84.5	52	-:-	73.8	73	62.8	53.3	52	----	-----	12022644.3	64.5
417	9/10/2025	15:45:13	00d	01:00.0	64.1	81.9	72	42.8	-:-	71.6	71.2	53.9	46.3	43.6	----	-----	2570395.8	64.2
418	9/10/2025	15:46:13	00d	01:00.0	66.5	84.3	73.6	46.9	-:-	73.2	72.5	58.5	47.7	47.2	----	-----	4466835.9	64.2
419	9/10/2025	15:47:13	00d	01:00.0	62	79.8	72.9	40.9	-:-	69.7	65.7	51	41.5	41.2	----	-----	1584893.2	64.2
420	9/10/2025	15:48:13	00d	01:00.0	66.7	84.5	75.9	49.4	-:-	75.4	71.7	60.1	50	49.4	----	-----	4677351.4	64.2
421	9/10/2025	15:49:13	00d	01:00.0	63.6	81.4	70.2	49.7	-:-	70.3	68.5	59.7	50.7	50	----	-----	2290867.7	64.1
422	9/10/2025	15:50:13	00d	01:00.0	63.1	80.9	69.6	52.7	-:-	68.3	67.8	60.1	53.3	52.8	----	-----	2041737.9	64.1
423	9/10/2025	15:51:13	00d	01:00.0	62.7	80.5	69.9	48.1	-:-	69.4	66.7	58.9	49.7	48.2	----	-----	1862087.1	64.1
424	9/10/2025	15:52:13	00d	01:00.0	63.9	81.7	72.1	51.1	-:-	70.7	68.3	58.8	51.5	51	----	-----	2454708.9	64.0
425	9/10/2025	15:53:13	00d	01:00.0	59.9	77.7	68.2	46.3	-:-	66.7	64.5	51.3	47	46.4	----	-----	977237.2	64.0
426	9/10/2025	15:54:13	00d	01:00.0	66.1	83.9	75.5	47.8	-:-	72.3	70.1	61.3	49.8	48.4	----	-----	4073802.8	64.0
427	9/10/2025	15:55:13	00d	01:00.0	63.2	81	68.6	46.8	-:-	68.2	67.7	60	49	48.2	----	-----	2089296.1	63.9
428	9/10/2025	15:56:13	00d	01:00.0	63.6	81.4	71.8	43.2	-:-	71.5	69.2	55.1	44.7	43.6	----	-----	2290867.7	63.9
429	9/10/2025	15:57:13	00d	01:00.0	62.6	80.4	70.2	44.9	-:-	70	66.9	54.6	45.9	44.9	----	-----	1819700.9	63.9
430	9/10/2025	15:58:13	00d	01:00.0	61.2	79	70.8	39.7	-:-	68.9	67.4	43.9	40.1	39.8	----	-----	1318256.7	63.9
431	9/10/2025	15:59:13	00d	01:00.0	62.9	80.7	73.4	44.3	-:-	71.1	67	53.1	44.8	44.6	----	-----	1949844.6	63.9
432	9/10/2025	16:00:13	00d	01:00.0	64.1	81.9	74.5	44.4	-:-	70.4	68	58.3	50.7	47.4	----	-----	2570395.8	63.9
433	9/10/2025	16:01:13	00d	01:00.0	61.8	79.6	73.9	40.7	-:-	70.4	65.4	49.8	42.8	41.3	----	-----	1513561.2	64.0

434	9/10/2025	16:02:13	00d	01:00.0	64.4	82.2	70.7	49	-:-	70.1	68.1	63.5	49.6	49.4	----	-----	2754228.7	64.0
435	9/10/2025	16:03:13	00d	01:00.0	66.9	84.7	77.2	47.2	-:-	72.5	70.9	60.4	50.3	49.4	----	-----	4897788.2	64.0
436	9/10/2025	16:04:13	00d	01:00.0	59.2	77	68.3	40.2	-:-	67.5	63.9	47.8	40.9	40.4	----	-----	831763.8	63.9
437	9/10/2025	16:05:13	00d	01:00.0	62.2	80	69	47.2	-:-	67.7	66.5	60.1	49.2	48	----	-----	1659586.9	64.0
438	9/10/2025	16:06:13	00d	01:00.0	63.3	81.1	69.9	44.4	-:-	70	68.7	56.8	45.1	44.5	----	-----	2137962.1	64.0
439	9/10/2025	16:07:13	00d	01:00.0	63.7	81.5	71	44.3	-:-	69.3	68.5	59.4	46.4	44.8	----	-----	2344228.8	64.0
440	9/10/2025	16:08:13	00d	01:00.0	65.7	83.5	76.1	45.6	-:-	69.8	69.1	62.8	46.6	46.3	----	-----	3715352.3	64.0
441	9/10/2025	16:09:13	00d	01:00.0	64.7	82.5	72.5	50.9	-:-	68.4	68	64.9	53.4	52	----	-----	2951209.2	64.0
442	9/10/2025	16:10:13	00d	01:00.0	61.5	79.3	68.4	46.3	-:-	67.1	65.9	58.8	47.8	46.9	----	-----	1412537.5	64.0
443	9/10/2025	16:11:13	00d	01:00.0	62.4	80.2	73.1	44.8	-:-	69.7	66.9	54.5	45.7	45.1	----	-----	1737800.8	64.0
444	9/10/2025	16:12:13	00d	01:00.0	63.4	81.2	71.5	42.2	-:-	70.6	68.6	55.3	43.1	42.6	----	-----	2187761.6	64.0
445	9/10/2025	16:13:13	00d	01:00.0	58.1	75.9	69.9	41.8	-:-	67.2	62.7	45.8	43.4	42.2	----	-----	645654.2	64.0
446	9/10/2025	16:14:13	00d	01:00.0	61.8	79.6	68.2	42.6	-:-	68.2	66.5	58.6	44.2	43.5	----	-----	1513561.2	64.0
447	9/10/2025	16:15:13	00d	01:00.0	62	79.8	73.5	47.2	-:-	68.4	65.8	53	47.8	47	----	-----	1584893.2	64.0
448	9/10/2025	16:16:13	00d	01:00.0	63.3	81.1	74.2	48	-:-	69.2	67	57.7	48.1	47.6	----	-----	2137962.1	63.9
449	9/10/2025	16:17:13	00d	01:00.0	61	78.8	67.6	43	-:-	67.2	66.6	54.6	44.4	43.6	----	-----	1258925.4	63.9
450	9/10/2025	16:18:13	00d	01:00.0	63.2	81	73.6	42.6	-:-	71.8	68.7	49.8	43.9	43.2	----	-----	2089296.1	64.0
451	9/10/2025	16:19:13	00d	01:00.0	60.6	78.4	68.4	41.2	-:-	68.3	67.7	51.3	41.9	41.6	----	-----	1148153.6	63.9
452	9/10/2025	16:20:13	00d	01:00.0	62.5	80.3	71.5	40.1	-:-	70.3	68.3	53.6	40.8	40.3	----	-----	1778279.4	64.0
453	9/10/2025	16:21:13	00d	01:00.0	64	81.8	71.3	46.6	-:-	70.9	68.5	60.9	49.6	47.6	----	-----	2511886.4	64.0
454	9/10/2025	16:22:13	00d	01:00.0	63.8	81.6	71.5	49.8	-:-	70.4	68.6	59	50.8	50.3	----	-----	2398832.9	64.0
455	9/10/2025	16:23:13	00d	01:00.0	68.3	86.1	79.4	50.5	-:-	76.3	71.3	65.1	52	50.6	----	-----	6760829.8	64.0
456	9/10/2025	16:24:13	00d	01:00.0	71.9	89.7	83.8	46.7	-:-	80	77.3	58.5	49.2	47.4	----	-----	15488166.2	63.8
457	9/10/2025	16:25:13	00d	01:00.0	63.9	81.7	70.1	42.6	-:-	70.1	68.2	61.4	43.2	43	----	-----	2454708.9	63.4
458	9/10/2025	16:26:13	00d	01:00.0	64.6	82.4	72.6	46.6	-:-	71	68.9	61.1	53.3	51.2	----	-----	2884031.5	63.3
459	9/10/2025	16:27:13	00d	01:00.0	63.8	81.6	70.4	47.2	-:-	69.8	68	61.5	49.2	47.8	----	-----	2398832.9	63.3
460	9/10/2025	16:28:13	00d	01:00.0	63.8	81.6	73	46.5	-:-	69.5	67	60.9	47.2	46.6	----	-----	2398832.9	63.3
461	9/10/2025	16:29:13	00d	01:00.0	63.7	81.5	69.1	46.8	-:-	69.4	68.6	61.9	49.1	47.3	----	-----	2344228.8	63.2
462	9/10/2025	16:30:13	00d	01:00.0	63.3	81.1	70.2	42.8	-:-	69.2	67.8	60.1	45	43.8	----	-----	2137962.1	63.2
463	9/10/2025	16:31:13	00d	01:00.0	61.1	78.9	68.6	44.2	-:-	68.1	66.9	53.1	46	44.6	----	-----	1288249.6	63.1
464	9/10/2025	16:32:13	00d	01:00.0	63.4	81.2	69.3	42.2	-:-	69.1	68.2	56.6	44.2	43.3	----	-----	2187761.6	63.1
465	9/10/2025	16:33:13	00d	01:00.0	64.5	82.3	71.5	48.3	-:-	70.8	69.3	59.1	49.9	48.6	----	-----	2818382.9	63.1
466	9/10/2025	16:34:13	00d	01:00.0	64.7	82.5	77.1	44.4	-:-	71.2	67.7	54.5	46.4	45.1	----	-----	2951209.2	63.0
467	9/10/2025	16:35:13	00d	01:00.0	63.9	81.7	69.6	46.2	-:-	69.4	68.8	61.6	48.8	46.7	----	-----	2454708.9	63.0
468	9/10/2025	16:36:13	00d	01:00.0	64.2	82	73	42.8	-:-	70.8	69.6	59.7	44.3	43.5	----	-----	2630268.0	62.9
469	9/10/2025	16:37:13	00d	01:00.0	65.1	82.9	71.1	46.4	-:-	70.5	69.3	61.7	48.3	47	----	-----	3235936.6	62.9
470	9/10/2025	16:38:13	00d	01:00.0	62.8	80.6	71	40	-:-	70	68.7	50.9	42.3	40.4	----	-----	1905460.7	62.9
471	9/10/2025	16:39:13	00d	01:00.0	62.9	80.7	70.8	41.3	-:-	70.4	67.8	53.7	45.8	44.4	----	-----	1949844.6	62.8
472	9/10/2025	16:40:13	00d	01:00.0	68.1	85.9	79.3	50	-:-	76.4	69.3	63.6	52.4	50.8	----	-----	6456542.3	62.8
473	9/10/2025	16:41:13	00d	01:00.0	66.2	84	72.1	55.5	-:-	71.4	70.1	64.2	56.1	55.1	----	-----	4168693.8	62.6
474	9/10/2025	16:42:13	00d	01:00.0	64.3	82.1	70.9	45.4	-:-	69.4	68.2	61.9	47.2	45.6	----	-----	2691534.8	62.5
475	9/10/2025	16:43:13	00d	01:00.0	60.3	78.1	67.6	41	-:-	67	65.1	55.9	42.3	41.7	----	-----	1071519.3	62.5
476	9/10/2025	16:44:13	00d	01:00.0	63.4	81.2	69.8	42.3	-:-	69.9	68.2	59.7	46.7	46.1	----	-----	2187761.6	62.6
477	9/10/2025	16:45:13	00d	01:00.0	63.7	81.5	71.3	48.6	-:-	69.8	67.7	59.6	48.5	48.4	----	-----	2344228.8	62.6
478	9/10/2025	16:46:13	00d	01:00.0	62.6	80.4	68.6	45.7	-:-	67.7	66.4	61.1	47.4	46.8	----	-----	1819700.9	62.6
479	9/10/2025	16:47:13	00d	01:00.0	65	82.8	71.2	45.4	-:-	70.3	69.4	62.5	49.6	47.9	----	-----	3162277.7	62.6
480	9/10/2025	16:48:13	00d	01:00.0	60.4	78.2	69	41.9	-:-	67.6	66.4	52.8	44.6	43.2	----	-----	1096478.2	62.5
481	9/10/2025	16:49:13	00d	01:00.0	63.9	81.7	68.4	51.7	-:-	68.5	67.5	62	54.9	52.6	----	-----	2454708.9	62.5
482	9/10/2025	16:50:13	00d	01:00.0	61	78.8	71.3	46.3	-:-	66.9	64.5	56.8	46.8	46.6	----	-----	1258925.4	62.5
483	9/10/2025	16:51:13	00d	01:00.0	62.9	80.7	75.3	45.2	-:-	71.4	65.7	52.2	45.7	45.4	----	-----	1949844.6	62.5
484	9/10/2025	16:52:13	00d	01:00.0	59	76.8	69	41.3	-:-	66.8	65.2	45.5	42.3	41.5	----	-----	794328.2	62.5
485	9/10/2025	16:53:13	00d	01:00.0	60.3	78.1	71	41.3	-:-	68.5	66.1	50.3	42	41.4	----	-----	1071519.3	62.6
486	9/10/2025	16:54:13	00d	01:00.0	61.1	78.9	70.2	45.1	-:-	68.8	67.5	52.4	45.7	45.4	----	-----	1288249.6	62.7
487	9/10/2025	16:55:13	00d	01:00.0	60.9	78.7	69.2	46.8	-:-	66.8	65.9	53.2	47.7	46.9	----	-----	1230268.8	62.7
488	9/10/2025	16:56:13	00d	01:00.0	61.7	79.5	69.1	41.8	-:-	68.4	67.9	52.3	42.6	41.9	----	-----	1479108.4	62.6
489	9/10/2025	16:57:13	00d	01:00.0	62.8	80.6	72.7	45.5	-:-	68.7	67.4	56.7	47.7	46.8	----	-----	1905460.7	62.6
490	9/10/2025	16:58:13	00d	01:00.0	63.2	81	70.2	49.9	-:-	68.5	67.2	59.7	51.2	49.2	----	-----	2089296.1	62.7
491	9/10/2025	16:59:13	00d	01:00.0	62.7	80.5	67.9	48.6	-:-	67.7	67.5	59.7	49.8	49	----	-----	1862087.1	62.7
492	9/10/2025	17:00:13	00d	01:00.0	64.7	82.5	73.3	52.2	-:-	69.5	68.4	61.6	52.6	51.9	----	-----	2951209.2	62.6
493	9/10/2025	17:01:13	00d	01:00.0	65.1	82.9	76	44.5	-:-	72.3	70.5	55.3	47.1	46.1	----	-----	3235936.6	62.6
494	9/10/2025	17:02:13	00d	01:00.0	65.1	82.9	75.9	42.6	-:-	72.1	68.5	55.1	46	43.4	----	-----	3235936.6	62.5
495	9/10/2025	17:03:13	00d	01:00.0	65.3	83.1	73	47.3	-:-	72.1	68.9	63.1	49.9	47.8	----	-----	3388441.6	62.4
496	9/10/2025	17:04:13	00d	01:00.0	57.9	75.7	69.6	41.5	-:-	68.1	61.7	45	42.4	42.2	----	-----	616595.0	62.3
497	9/10/2025	17:05:13	00d	01:00.0	64	81.8	72.5	45.8	-:-	70.3	67.9	61.2	47.5	46.3	----	-----	2511886.4	62.4
498	9/10/2025	17:06:13	00d	01:00.0	64.1	81.9	70.8	47.6	-:-	70.4	69.9	58.3	48.5	48.2	----	-----	2570395.8	62.4
499	9/10/2025	17:07:13	00d	01:00.0	65.9	83.7	76.9	49.4	-:-	72.5	68.5	61.6	50.6	49.3	----	-----	3890451.4	62.3
500	9/10/2025	17:08:13	00d	01:00.0	63.9	81.7	71.8	48.7	-:-	70.5	68.5	59.8	50.9	49.3	----	-----	2454708.9	62.3
501	9/10/2025	17:09:13	00d	01:00.0	63.3	81.1	69.4	44.7	-:-	69.6	68	57	45.3	45	----	-----	2137962.1	62.2
502	9/10/2025	17:10:13	00d	01:00.0	62.7	80.5	71.1	45.1	-:-	69.1	67.8	54.9	45.5	45.1	----	-----	1862087.1	62.2
503	9/10/2025	17:11:13	00d	01:00.0	64.1	81.9	70.9	45.4	-:-	70.8	69.6	58.5	47.8	46.2	----	-----	2570395.8	62.1
504	9/10/2025	17:12:13	00d	01:00.0	61.6	79.4	67.9	47.8	-:-	67.6	66.7	54.6	48.3	47.8	----	-----	1445439.8	62.0
505	9/10/2025	17:13:13	00d	01:00.0	61.6	79.4	70.1	42.9	-:-	69.7	67.4	51.4	43.9	43	----	-----	1445439.8	62.0
506	9/10/2025	17:14:13	00d	01:00.0	62	79.8	70.4	44.2	-:-	69.3	66.2	57.7	45.1	44.1	----	-----	1584893.2	62.0
507	9/10/2025	17:15:13	00d	01:00.0	60.2	78	69.4	45.2	-:-	66.6	66	51.8	46.2	45.7	----	-----	1047128.5	62.0
508	9/10/2025	17:16:13	00d	01:00.0	56.4	74.2	67.6	41.6	-:-	64.9	62.1	47.3	42.1	41.8	----	-----	436515.8	62.1
509	9/10/2025	17:17:13	00d	01:00.0	62	79.8	71.7	43.2	-:-	69.1	66.5	51.8	43.9	43.5	----	-----	1584893.2	62.1
510	9/10/2025	17:18:13	00d	01:00.0	63.2	81	71.8	48.5	-:-	69	67.1	58.8	50.2	49.3	----	-----	2089296.1	62.2
511	9/10/2025	17:19:13	00d	01:00.0	62.5	80.3	70	46.2	-:-	69	68.7	56.2	47.2	46.6	----	-----	1778279.4	62.1
512	9/10/2025	17:20:13	00d	01:00.0	62.8	80.6	70.1	47.4	-:-	69.5	66.8	60.3	49.4	48.4	----	-----	1905460.7	62.1
513	9/10/2025	17:21:13	00d	01:00.0	62.4	80.2	72.7	42.2	-:-	69.6	68.4	53.6	43.4	43	----	-----	1737800.8	62.1
514	9/10/2025	17:22:13	00d	01:00.0	63	80.8	73.2	47.7	-:-	69.2	68	59	49	48.4	----	-----	1995262.3	62.0
515	9/10/2025	17:23:13	00d	01:00.0	66.1	83.9	72.5	44.6	-:-	72.2	71.4	61.3	46.8	45.1	----	-----	4073802.8	62.0
516	9/10/2025	17:24:13	00d	01:00.0	60.7	78.5	69.7	44.1	-:-	69.1	64.8	53.2	46	44.8	----	-----	1174897.6	61.9
517	9/10/2025	17:25:13	00d	01:00.0	61	78.8	67.8	43.8	-:-	67.3	66.9	55.2	45.4	44.4	----	-----	1258925.4	61.9
518	9/10/2025	17:26:13	00d	01:00.0	59.6	77.4	67.6	41.9	-:-	67.8	65.3	44.3	42.7	42.5	----	-----	912010.8	62.0
519	9/10/2025	17:27:13	00d	01:00.0	60	77.8	66.7	45.8	-:-	66.8	65.6	50.8	46.9	46.3	----	-----	1000000.0	62.0
520	9/10/2025	17:28:13	00d	01:00.0	61.5	79.3	69	45.3	-:-	67.3	66.8	56.3	46	45.7	----	-----	1412537.5	62.1
521	9/10/2025	17:29:13	00d	01:00.0	59.1	76.9	67.3	42	-:-	67.2	65.6	46.1	42.4	42.1	----	-----	812830.5	62.1
522	9/10/2025	17:30:13	00d	01:00.0	60.5	78.3	66.9	49.1	-:-	66.2	65	57.8	49.1	48.7	----	-----	1122018.5	62.1
523	9/10/2025	17:31:13	00d	01:00.0	59.6	77.4	67	46.2	-:-	66.1	64.5	55.5	47.9	47.1	----	-----	912010.8	62.1
524	9/10/2025	17:32:13	00d	01:00.0	60.9	78.7	68.4	45.6	-:-	67.2	66.2	52.7	46.3	46	----	-----	1230268.8	62.1
525	9/10/2025	17:33:13	00d	01:00.0	62.3	80.1	68.3	47.4	-:-	67.8	67.4	57.4	48.6	47.8	----	-----	1698243.7	62.1
526	9/10/2025	17:34:13	00d	01:00.0	60.5	78.3	68	46.1	-:-	67.1	65.7	57	47.2	46.6	----	-----	1122018.5	62.1
527	9/10/2025	17:35:13	00d	01:00.0	58.3	76.1	67.4	43.2	-:-	66.7	64.8	48.9	44.2	43.7	----	-----	676083.0	62.0
528	9/10/2025	17:36:13	00d	01:00.0	61.3	79.1	68.2	46	-:-	68	66.8	54.5	47.5	46.5	----	-----	1348962.9	62.1
529	9/10/2025	17:37:13	00d	01:00.0	59.6	77.4	67.2	42.9	-:-	65.7	65.1	54.6	43.9	43.2	----	-----	912010.8	62.1
530	9/10/2025	17:38:13	00d	01:00.0	65.5	83.3	77.5	48.5	-:-	71	68.2	57.4	49.8	49.3	----	-----	3548133.9	62.1
531	9/10/2025	17:39:13	00d	01:00.0	61.6	79.4	70.5	42.6	-:-	68.6	66.6	54.3	43.2	43	----	-----	1445439.8	62.0
532	9/10/2025	17:40:13	00d	01:00.0	59.5	77.3	67.6	43.4	-:-	66.5	65.2	51.1	44.6	43.8	----	-----	891250.9	62.0
533	9/10/2025	17:41:13	00d	01:00.0	61.4	79.2	68.2	44.5	-:-	67.9	67.5	55.8	45.7	45.3	----	-----	1380384.3	62.0
534	9/10/2025	17:42:13	00d	01:00.0	60.6	78.4	69.6	43.1	-:-	68.9	67	51.7	44.1	43.6	----	-----	1148153.6	61.9
535	9/10/2025	17:43:13	00d	01:00.0	65.6	83.4	74.6	46.7	-:-	72.6	69.7	63	48	47.5	----	-----	3630780.5	61.9
536	9/10/2025	17:44:13	00d	01:00.0	65	82.8	73.6	53.4	-:-	71.4	68.6	61.2	54.1	53.1	----	-----	3162277.7	61.8
537	9/10/2025	17:45:13	00d	01:00.0	64.8	82.6	70.6	49	-:-	69.8	69.1	63.2	51.1	49.3	----	-----	3019951.7	61.7
538	9/10/2025	17:46:13	00d	01:00.0	62.6	80.4	68.8	46.2	-:-	67.9	67.7	55.8	48.1	47.6	----	-----	1819700.9	61.6
539	9/10/2025	17:47:13	00d	01:00.0	55.8	73.6	68.5	44.9	-:-	64.4	62	48.1	45.6	45	----	-----	380189.4	61.6
540	9/10/2025	17:48:13	00d	01:00.0	59.1	76.9	69.4	41.8	-:-	68.6	66.7	43.7	42.4	42.1	----	-----	812830.5	61.6
541	9/10/2025	17:49:13	00d	01:00.0	62.7	80.5	72.2	43.6	-:-	71.6	68.6	53.7	44.7	44.4	----	-----	1862087.1	61.5
542	9/10/2025	17:50:13	00d	01:00.0	65.3	83.1	73.9	50.9	-:-	71.4	70.2	60.3	51.9	51	----	-----	3388441.6	61.5

543	9/10/2025	17:51:13	00d	01:00.0	59.6	77.4	70.2	43.4	-:-	67.2	64.6	51	44.4	43.6	----	-----	912010.8	61.4
544	9/10/2025	17:52:13	00d	01:00.0	61.8	79.6	68.8	44.3	-:-	68.7	67.1	55.7	46.5	44.8	----	-----	1513561.2	61.4
545	9/10/2025	17:53:13	00d	01:00.0	65.2	83	77.5	43.1	-:-	73.3	69.6	52.2	44.7	43.6	----	-----	3311311.2	61.4
546	9/10/2025	17:54:13	00d	01:00.0	64.4	82.2	72.2	49.2	-:-	70.6	68.6	59.2	49.7	49.4	----	-----	2754228.7	61.2
547	9/10/2025	17:55:13	00d	01:00.0	57.8	75.6	65.7	43.4	-:-	65.6	64	50.4	45.5	45.2	----	-----	602559.6	61.1
548	9/10/2025	17:56:13	00d	01:00.0	57.7	75.5	67.3	43	-:-	66.5	63.4	45.8	43.5	43.1	----	-----	588843.7	61.1
549	9/10/2025	17:57:13	00d	01:00.0	61.2	79	68.2	46.5	-:-	67.2	66.2	57.1	48.2	47.4	----	-----	1318256.7	61.1
550	9/10/2025	17:58:13	00d	01:00.0	64.7	82.5	70.4	48.1	-:-	69.8	68.8	61.1	50.4	48.7	----	-----	2951209.2	61.1
551	9/10/2025	17:59:13	00d	01:00.0	63.3	81.1	71.7	43.5	-:-	69.6	67.9	56.9	46.7	44	----	-----	2137962.1	61.0
552	9/10/2025	18:00:13	00d	01:00.0	59.9	77.7	67.7	42.2	-:-	66.9	65.1	51.9	42.4	42.3	----	-----	977237.2	60.9
553	9/10/2025	18:01:13	00d	01:00.0	62.2	80	69.4	44.8	-:-	69.3	68.2	55.1	47.9	46.2	----	-----	1659586.9	61.0
554	9/10/2025	18:02:13	00d	01:00.0	58.7	76.5	67.4	44.6	-:-	66.3	64.3	52.8	46	45.6	----	-----	741310.2	61.0
555	9/10/2025	18:03:13	00d	01:00.0	62.2	80	69.1	47.7	-:-	67.2	66.6	59.6	49.9	48	----	-----	1659586.9	61.0
556	9/10/2025	18:04:13	00d	01:00.0	61.7	79.5	71.7	44.3	-:-	67.2	66.5	55.8	46.6	45	----	-----	1479108.4	61.0
557	9/10/2025	18:05:13	00d	01:00.0	64	81.8	74.4	42.9	-:-	71.7	70.1	51.3	43.9	43.2	----	-----	2511886.4	61.0
558	9/10/2025	18:06:13	00d	01:00.0	63.8	81.6	74.7	42.6	-:-	68.6	67.4	56.9	45.7	43.4	----	-----	2398832.9	60.9
559	9/10/2025	18:07:13	00d	01:00.0	60.1	77.9	70.2	45	-:-	68.6	64.9	50.1	46.1	45.3	----	-----	1023293.0	60.8
560	9/10/2025	18:08:13	00d	01:00.0	63.2	81	74.9	41.3	-:-	70.7	67.9	50.4	42.1	41.8	----	-----	2089296.1	60.8
561	9/10/2025	18:09:13	00d	01:00.0	54.4	72.2	65.2	43.1	-:-	62.3	58.7	47.9	44.1	43.3	----	-----	275422.9	60.8
562	9/10/2025	18:10:13	00d	01:00.0	62.3	80.1	71.9	44.5	-:-	70.1	67.5	51	45.3	45	----	-----	1698243.7	60.8
563	9/10/2025	18:11:13	00d	01:00.0	58.1	75.9	68.7	43.3	-:-	66.3	64	48.2	43.8	43.7	----	-----	645654.2	60.8
564	9/10/2025	18:12:13	00d	01:00.0	61.2	79	69.8	47.3	-:-	68.1	66.9	54.4	47.8	47.1	----	-----	1318256.7	60.8
565	9/10/2025	18:13:13	00d	01:00.0	60.5	78.3	68.7	44.2	-:-	68.2	66.8	49.4	44.8	44.6	----	-----	1122018.5	60.9
566	9/10/2025	18:14:13	00d	01:00.0	58	75.8	68.2	43.3	-:-	67.5	63.4	48.2	43.8	43.5	----	-----	630957.3	60.8
567	9/10/2025	18:15:13	00d	01:00.0	62.2	80	71.2	45.7	-:-	69.4	66.8	56.2	46.5	46.1	----	-----	1659586.9	60.8
568	9/10/2025	18:16:13	00d	01:00.0	64.4	82.2	70.6	48.8	-:-	69.5	69	61.9	50.6	49.7	----	-----	2754228.7	60.8
569	9/10/2025	18:17:13	00d	01:00.0	61.5	79.3	69	44.1	-:-	68.4	66.8	50.9	44.7	44.4	----	-----	1412537.5	60.7
570	9/10/2025	18:18:13	00d	01:00.0	63.9	81.7	71.9	48.2	-:-	70.6	68.3	59	51.2	48.9	----	-----	2454708.9	60.7
571	9/10/2025	18:19:13	00d	01:00.0	56.5	74.3	66.4	43	-:-	65.9	63.5	45	43.4	43.3	----	-----	446683.6	60.5
572	9/10/2025	18:20:13	00d	01:00.0	62.5	80.3	69.7	45	-:-	68.4	67.7	55.5	45.7	45.3	----	-----	1778279.4	60.6
573	9/10/2025	18:21:13	00d	01:00.0	61.8	79.6	70.8	45.3	-:-	69.2	67.7	55.3	46.5	45.5	----	-----	1513561.2	60.5
574	9/10/2025	18:22:13	00d	01:00.0	60.9	78.7	68.7	46	-:-	67.5	66.6	54.4	46.7	46.3	----	-----	1230268.8	60.5
575	9/10/2025	18:23:13	00d	01:00.0	60.6	78.4	68.1	47.7	-:-	67.1	66.1	56.9	49.1	48.2	----	-----	1148153.6	60.5
576	9/10/2025	18:24:13	00d	01:00.0	61.3	79.1	69.6	44.3	-:-	68.9	66.4	53.9	45.3	44.5	----	-----	1348962.9	60.4
577	9/10/2025	18:25:13	00d	01:00.0	61.4	79.2	68.1	44.5	-:-	68.1	67.4	57.9	47.7	45.5	----	-----	1380384.3	60.4
578	9/10/2025	18:26:13	00d	01:00.0	64.9	82.7	74.9	49.6	-:-	71.7	68.5	60	50.8	49.8	----	-----	3090295.4	60.4
579	9/10/2025	18:27:13	00d	01:00.0	62.1	79.9	69.7	48.2	-:-	69	67.2	54.8	49.2	48.1	----	-----	1621810.1	60.3
580	9/10/2025	18:28:13	00d	01:00.0	63.3	81.1	75.3	46	-:-	70.7	67	49.1	47	46.7	----	-----	2137962.1	60.3
581	9/10/2025	18:29:13	00d	01:00.0	61.5	79.3	69.5	44	-:-	68	67.2	54.6	44.8	44.5	----	-----	1412537.5	60.2
582	9/10/2025	18:30:13	00d	01:00.0	57.9	75.7	67.5	45.3	-:-	66.2	62.8	50.9	45.7	45.5	----	-----	616595.0	60.2
583	9/10/2025	18:31:13	00d	01:00.0	62.3	80.1	71	45.5	-:-	70.6	66.8	57.5	47.8	46.2	----	-----	1698243.7	60.3
584	9/10/2025	18:32:13	00d	01:00.0	58.6	76.4	67.4	43.5	-:-	67.7	61.8	51.6	43.8	43.5	----	-----	724436.0	60.2
585	9/10/2025	18:33:13	00d	01:00.0	62.6	80.4	73.8	44.5	-:-	70.7	66.7	49.7	46.2	45.7	----	-----	1819700.9	60.3
586	9/10/2025	18:34:13	00d	01:00.0	59.4	77.2	68	44.5	-:-	66.6	65.2	48.5	45.6	45.2	----	-----	870963.6	60.2
587	9/10/2025	18:35:13	00d	01:00.0	59.3	77.1	68.5	44.8	-:-	66.3	65.9	49.8	45.4	45.1	----	-----	851138.0	60.2
588	9/10/2025	18:36:13	00d	01:00.0	63	80.8	74.1	50.5	-:-	68.8	66.8	55	51	49.8	----	-----	1995262.3	60.2
589	9/10/2025	18:37:13	00d	01:00.0	59.1	76.9	69.7	41.2	-:-	67	66.1	48.3	41.8	41.4	----	-----	812830.5	60.1
590	9/10/2025	18:38:13	00d	01:00.0	62.3	80.1	72.7	45.2	-:-	71	68	52.8	46.5	46.2	----	-----	1698243.7	60.2
591	9/10/2025	18:39:13	00d	01:00.0	59.2	77	68.1	44.4	-:-	67.5	65.6	50.3	45.1	44.7	----	-----	831763.8	60.1
592	9/10/2025	18:40:13	00d	01:00.0	59.6	77.4	68.7	44.9	-:-	67.9	65.4	50.8	46.4	45.7	----	-----	912010.8	60.1
593	9/10/2025	18:41:13	00d	01:00.0	60.8	78.6	68.2	44.9	-:-	67.3	66.8	52.7	47.2	46.2	----	-----	1202264.4	60.1
594	9/10/2025	18:42:13	00d	01:00.0	55.2	73	67.7	42.9	-:-	65.4	55.6	45.1	43.1	43	----	-----	331131.1	60.2
595	9/10/2025	18:43:13	00d	01:00.0	56.8	74.6	66.7	43.1	-:-	65.9	61.8	46.3	43.7	43.5	----	-----	478630.1	60.2
596	9/10/2025	18:44:13	00d	01:00.0	59.8	77.6	71.5	43.2	-:-	67	64.8	48.6	43.7	43.5	----	-----	954992.6	60.3
597	9/10/2025	18:45:13	00d	01:00.0	61.2	79	69.6	46.8	-:-	68.8	66.3	56	48.9	48.2	----	-----	1318256.7	60.4
598	9/10/2025	18:46:13	00d	01:00.0	56.1	73.9	65.7	44	-:-	64.4	62.1	47	44.3	44.2	----	-----	407380.3	60.3
599	9/10/2025	18:47:13	00d	01:00.0	61.9	79.7	68.9	45.5	-:-	68.5	67	54.8	46.2	45.8	----	-----	1548816.6	60.4
600	9/10/2025	18:48:13	00d	01:00.0	56	73.8	68.4	44.7	-:-	62.8	59.7	51.2	45.5	44.5	----	-----	398107.2	60.3
601	9/10/2025	18:49:13	00d	01:00.0	57.1	74.9	67.4	44.5	-:-	65.1	62.6	49.4	45	44.8	----	-----	512861.4	60.4
602	9/10/2025	18:50:13	00d	01:00.0	60	77.8	66.1	44.4	-:-	65.5	65	52.6	44.7	44.5	----	-----	1000000.0	60.4
603	9/10/2025	18:51:13	00d	01:00.0	63.7	81.5	69.9	48.7	-:-	69.3	68.1	60.5	49.5	49.1	----	-----	2344228.8	60.4
604	9/10/2025	18:52:13	00d	01:00.0	53.7	71.5	65.6	43.5	-:-	60.1	57.9	47.1	44.3	44.1	----	-----	234422.9	60.3
605	9/10/2025	18:53:13	00d	01:00.0	60.7	78.5	67.7	44.2	-:-	67.6	67.1	53.3	47.1	44.6	----	-----	1174897.6	60.3
606	9/10/2025	18:54:13	00d	01:00.0	44.9	62.7	52.3	42.9	-:-	46.7	45.9	44	43.3	43.1	----	-----	30903.0	60.3
607	9/10/2025	18:55:13	00d	01:00.0	60.7	78.5	71.2	43.6	-:-	69.8	65.9	47.9	44.3	43.9	----	-----	1174897.6	60.3
608	9/10/2025	18:56:13	00d	01:00.0	59.5	77.3	68	45.1	-:-	67.4	64.9	50.8	45.8	45.1	----	-----	891250.9	60.2
609	9/10/2025	18:57:13	00d	01:00.0	57.1	74.9	65.9	44.8	-:-	64.9	60	53.9	45.5	45	----	-----	512861.4	60.2
610	9/10/2025	18:58:13	00d	01:00.0	61.5	79.3	71.5	46.7	-:-	68.1	67.6	52.1	47.5	47.1	----	-----	1412537.5	60.3
611	9/10/2025	18:59:13	00d	01:00.0	57.4	75.2	68.9	42.8	-:-	68	59.6	45.7	43.2	42.9	----	-----	549540.9	60.2
612	9/10/2025	19:00:13	00d	01:00.0	59.4	77.2	69.3	45.2	-:-	68.4	63.7	50	46.2	45.4	----	-----	870963.6	60.3
613	9/10/2025	19:01:13	00d	01:00.0	62.2	80	69.6	43.8	-:-	68.1	67.6	56.9	44.1	43.9	----	-----	1659586.9	60.3
614	9/10/2025	19:02:13	00d	01:00.0	62.5	80.3	69.2	49.8	-:-	68.7	68.1	56.1	50.6	50.1	----	-----	1778279.4	60.2
615	9/10/2025	19:03:13	00d	01:00.0	56.8	74.6	66.2	45	-:-	65.6	64.4	47.2	45.3	45.2	----	-----	478630.1	60.2
616	9/10/2025	19:04:13	00d	01:00.0	61.5	79.3	69.5	44.9	-:-	69.3	67.8	49	45.8	45.5	----	-----	1412537.5	60.2
617	9/10/2025	19:05:13	00d	01:00.0	62.1	79.9	73.1	47.4	-:-	68.6	66.2	52.4	47.9	47.7	----	-----	1621810.1	60.2
618	9/10/2025	19:06:13	00d	01:00.0	60.2	78	67.8	45.2	-:-	67.1	64.9	55.5	46	45.7	----	-----	1047128.5	60.3
619	9/10/2025	19:07:13	00d	01:00.0	51.9	69.7	60.8	44	-:-	59.7	58.3	45.5	44.2	44.1	----	-----	154881.7	60.3
620	9/10/2025	19:08:13	00d	01:00.0	60.3	78.1	67.3	45.9	-:-	65.8	65.4	55.2	47.2	46.1	----	-----	1071519.3	60.3
621	9/10/2025	19:09:13	00d	01:00.0	63.5	81.3	70.4	47.6	-:-	69.8	67.9	57.3	49.7	48.1	----	-----	2238721.1	60.3
622	9/10/2025	19:10:13	00d	01:00.0	60.7	78.5	70.9	44.5	-:-	69.6	67	48.6	44.7	44.5	----	-----	1174897.6	60.2
623	9/10/2025	19:11:13	00d	01:00.0	62.6	80.4	70.7	43.8	-:-	70.4	68.9	55	44.4	43.9	----	-----	1819700.9	60.1
624	9/10/2025	19:12:13	00d	01:00.0	59.7	77.5	69.1	44.5	-:-	68.3	65.7	48.1	45.3	44.5	----	-----	933254.3	60.0
625	9/10/2025	19:13:13	00d	01:00.0	62.3	80.1	68.9	45.4	-:-	68	67.1	58.3	46.2	45.8	----	-----	1698243.7	60.0
626	9/10/2025	19:14:13	00d	01:00.0	56.8	74.6	67	40.9	-:-	65.8	64.5	45.3	41.4	41.2	----	-----	478630.1	60.0
627	9/10/2025	19:15:13	00d	01:00.0	59.3	77.1	67.5	44.1	-:-	64.8	64.1	51.6	46.6	45.5	----	-----	851138.0	60.0
628	9/10/2025	19:16:13	00d	01:00.0	60.2	78	68.3	43.4	-:-	67.9	66.4	50.4	44.2	43.9	----	-----	1047128.5	60.0
629	9/10/2025	19:17:13	00d	01:00.0	58.5	76.3	68.5	42.6	-:-	68.1	64.7	45	43.1	43	----	-----	707945.8	59.9
630	9/10/2025	19:18:13	00d	01:00.0	61.8	79.6	72.7	46	-:-	69.6	66.8	53.1	47.7	47	----	-----	1513561.2	59.9
631	9/10/2025	19:19:13	00d	01:00.0	54	71.8	63.4	43.4	-:-	61.3	58.6	48.8	45.8	43.7	----	-----	251188.6	59.9
632	9/10/2025	19:20:13	00d	01:00.0	58.1	75.9	68.3	43.4	-:-	65.2	64.6	47.6	44	43.6	----	-----	645654.2	59.9
633	9/10/2025	19:21:13	00d	01:00.0	59.1	76.9	68.4	43.6	-:-	67.4	65.3	49	44.4	44.3	----	-----	812830.5	59.9
634	9/10/2025	19:22:13	00d	01:00.0	62.5	80.3	70.4	48.3	-:-	70.2	67.4	54.9	48.8	48.4	----	-----	1778279.4	60.0
635	9/10/2025	19:23:13	00d	01:00.0	59.5	77.3	71.9	44	-:-	67.2	64	48.8	45.1	44.6	----	-----	891250.9	60.0
636	9/10/2025	19:24:13	00d	01:00.0	45.3	63.1	48.6	42.6	-:-	48.2	47.8	44.5	43.2	43	----	-----	33884.4	60.0
637	9/10/2025	19:25:13	00d	01:00.0	56.9	74.7	66.3	41.9	-:-	65.2	63.4	48.2	42.7	42.5	----	-----	489778.8	60.1
638	9/10/2025	19:26:13	00d	01:00.0	63.3	81.1	69.3	46.9	-:-	69.3	68.4	58.1	47.9	47.1	----	-----	2137962.1	60.2
639	9/10/2025	19:27:13	00d	01:00.0	62.5	80.3	70.9	47.1	-:-	68.3	66.6	58.7	48.7	47.3	----	-----	1778279.4	60.2
640	9/10/2025	19:28:13	00d	01:00.0	59.5	77.3	68.4	46	-:-	68.2	64	52.5	46.7	46.6	----	-----	891250.9	60.1
641	9/10/2025	19:29:13	00d	01:00.0	60.2	78	67.8	47.9	-:-	66.8	65.9	54.3	49.1	48.8	----	-----	1047128.5	60.2
642	9/10/2025	19:30:13	00d	01:00.0	62.8	80.6	73.9	46	-:-	69.9	68.4	51.3	46.3	46.1	----	-----	1905460.7	60.2
643	9/10/2025	19:31:13	00d	01:00.0	61.5	79.3	69.6	45.5	-:-	68	67.2	53	45.8	45.7	----	-----	1412537.5	60.1
644	9/10/2025	19:32:13	00d	01:00.0	59.4	77.2	68.5	45.6	-:-	68	66.4	49.1	46.2	46.1	----	-----	870963.6	60.1
645	9/10/2025	19:33:13	00d	01:00.0	59.7	77.5	68.9	46.9	-:-	67.6	66.4	48.4	47.2	47.1	----	-----	933254.3	60.2
646	9/10/2025	19:34:13	00d	01:00.0	57.5	75.3	67.5	45.8	-:-	65.7	64.5	49.5	46.6	46.3	----	-----	562341.3	60.1
647	9/10/2025	19:35:13	00d	01:00.0	61	78.8	70.5	46.5	-:-	68.5	66.2	51.4	48.1	46.9	----	-----	1258925.4	60.2
648	9/10/2025	19:36:13	00d	01:00.0	59.6	77.4	70.1	47	-:-	69.3	65.8	48.4	47.4	47.4	----	-----	912010.8	60.2
649	9/10/2025	19:37:13	00d	01:00.0	58.8	76.6	68.4	47.1	-:-	68.1	63.8	51.1	47.7	47.4	----	-----	758577.6	60.2
650	9/10/2025	19:38:13	00d	01:00.0	62.2	80	71.9	49	-:-	69.8	66.6	53.5	49.4	49	----	-----	1659586.9	60.2
651	9/10/2025	19:39:13	00d	01:00.0	60.4	78.2	70.4	46.8	-:-	67.5	67	50.7	47.3	47.1	----	-----	1096478.2	60.1

652	9/10/2025	19:40:13	00d	01:00.0	57.6	75.4	67.3	46.9	-:-	65	62.3	50.8	47.4	47.3	----	-----	575439.9	60.0
653	9/10/2025	19:41:13	00d	01:00.0	61.2	79	69.1	47.8	-:-	67.6	66.3	53.7	48.5	48.2	----	-----	1318256.7	60.1
654	9/10/2025	19:42:13	00d	01:00.0	61.3	79.1	67.3	48.4	-:-	67.1	66.6	56	49	48.6	----	-----	1348962.9	60.0
655	9/10/2025	19:43:13	00d	01:00.0	60.6	78.4	68.9	49.7	-:-	67.7	66.4	53.4	50.3	49.9	----	-----	1148153.6	59.9
656	9/10/2025	19:44:13	00d	01:00.0	62.8	80.6	71.2	48.2	-:-	69.2	67.9	57	48.6	48.4	----	-----	1905460.7	59.8
657	9/10/2025	19:45:13	00d	01:00.0	63.2	81	69	49.3	-:-	68.6	67.7	59.6	50.7	49.9	----	-----	2089296.1	59.8
658	9/10/2025	19:46:13	00d	01:00.0	58.5	76.3	68.1	48.2	-:-	65.1	62.5	52.3	48.9	48.7	----	-----	707945.8	59.6
659	9/10/2025	19:47:13	00d	01:00.0	61.2	79	70.7	47.9	-:-	69.5	67.3	52.9	48.2	48.1	----	-----	1318256.7	59.6
660	9/10/2025	19:48:13	00d	01:00.0	55.3	73.1	65.5	47.4	-:-	65.1	58.4	49.1	47.8	47.5	----	-----	338844.2	59.5
661	9/10/2025	19:49:13	00d	01:00.0	61.4	79.2	71.2	47.9	-:-	69.8	67.3	50.1	48.3	48.2	----	-----	1380384.3	59.6
662	9/10/2025	19:50:13	00d	01:00.0	60.3	78.1	70.8	46.5	-:-	69.1	66.6	48.2	47.2	46.8	----	-----	1071519.3	59.5
663	9/10/2025	19:51:13	00d	01:00.0	59.5	77.3	70.1	47.3	-:-	67.5	64.8	49	47.6	47.5	----	-----	891250.9	59.4
664	9/10/2025	19:52:13	00d	01:00.0	51.3	69.1	60.2	47	-:-	58.4	54.5	48.4	47.6	47.4	----	-----	134896.3	59.4
665	9/10/2025	19:53:13	00d	01:00.0	59.9	77.7	69.9	47.8	-:-	69.1	65.1	50.5	48.2	48	----	-----	977237.2	59.6
666	9/10/2025	19:54:13	00d	01:00.0	55.5	73.3	67.3	47.3	-:-	65.5	56.8	48.6	47.8	47.8	----	-----	354813.4	59.5
667	9/10/2025	19:55:13	00d	01:00.0	55.7	73.5	67.6	47.5	-:-	65.6	57.2	48.8	47.9	47.6	----	-----	371535.2	59.6
668	9/10/2025	19:56:13	00d	01:00.0	57.1	74.9	64	47.9	-:-	64	62.8	52.3	48.3	48.2	----	-----	512861.4	59.6
669	9/10/2025	19:57:13	00d	01:00.0	52.6	70.4	62.2	46.9	-:-	60.6	56.8	49.3	47.4	47.2	----	-----	181970.1	59.5
670	9/10/2025	19:58:13	00d	01:00.0	61.8	79.6	68.9	47.9	-:-	67.6	66.9	54.6	48.6	48.3	----	-----	1513561.2	59.6
671	9/10/2025	19:59:13	00d	01:00.0	60.9	78.7	69.1	48.4	-:-	67.8	67.3	52.9	49.1	48.7	----	-----	1230268.8	59.5
672	9/10/2025	20:00:13	00d	01:00.0	60.3	78.1	67.1	49.2	-:-	66.8	66.1	53	49.9	49.5	----	-----	1071519.3	59.4
673	9/10/2025	20:01:13	00d	01:00.0	61.5	79.3	71.4	49.4	-:-	69.5	66.1	52.4	49.7	49.5	----	-----	1412537.5	59.4
674	9/10/2025	20:02:13	00d	01:00.0	56.4	74.2	65.4	47.5	-:-	64.1	61.5	50.3	47.7	47.6	----	-----	436515.8	59.3
675	9/10/2025	20:03:13	00d	01:00.0	59.2	77	69.3	47.1	-:-	67.6	64.3	50.4	47.5	47.3	----	-----	831763.8	59.3
676	9/10/2025	20:04:13	00d	01:00.0	58.6	76.4	68	46.8	-:-	67.1	65.3	50.1	47.3	47.1	----	-----	724436.0	59.3
677	9/10/2025	20:05:13	00d	01:00.0	61.6	79.4	71.9	47.1	-:-	68	67.4	48.1	47.4	47.3	----	-----	1445439.8	59.2
678	9/10/2025	20:06:13	00d	01:00.0	64.8	82.6	72.5	48	-:-	72.1	68.8	61.2	50.4	49.8	----	-----	3019951.7	59.2
679	9/10/2025	20:07:13	00d	01:00.0	57.9	75.7	68.5	46.8	-:-	66.3	64.7	49.3	47.1	47	----	-----	616595.0	58.9
680	9/10/2025	20:08:13	00d	01:00.0	58.6	76.4	68.1	47.2	-:-	66.3	64.3	52.3	48	47.5	----	-----	724436.0	58.9
681	9/10/2025	20:09:13	00d	01:00.0	59.9	77.7	70.1	48.6	-:-	67.5	65.4	53.8	49.1	49	----	-----	977237.2	58.8
682	9/10/2025	20:10:13	00d	01:00.0	59.2	77	66.5	48.6	-:-	66.8	64.1	52.9	48.9	48.8	----	-----	831763.8	58.8
683	9/10/2025	20:11:13	00d	01:00.0	55.2	73	67.2	47.5	-:-	64.4	54.2	48.6	47.9	47.8	----	-----	331131.1	58.7
684	9/10/2025	20:12:13	00d	01:00.0	56.7	74.5	67.7	47.6	-:-	63.8	61.8	48.3	47.8	47.8	----	-----	467735.1	58.8
685	9/10/2025	20:13:13	00d	01:00.0	58.6	76.4	68	47.6	-:-	67.3	65.6	49.5	47.9	47.8	----	-----	724436.0	58.8
686	9/10/2025	20:14:13	00d	01:00.0	60.1	77.9	69.2	48.5	-:-	66.6	65.3	53	48.9	48.8	----	-----	1023293.0	58.8
687	9/10/2025	20:15:13	00d	01:00.0	59.1	76.9	69.1	48.3	-:-	67.5	66.4	50.5	48.7	48.5	----	-----	812830.5	58.7
688	9/10/2025	20:16:13	00d	01:00.0	57.4	75.2	67.2	47.9	-:-	65.8	64.2	50.3	48.7	48.4	----	-----	549540.9	58.7
689	9/10/2025	20:17:13	00d	01:00.0	56.6	74.4	65.4	48.6	-:-	65.2	62.3	49.9	48.9	48.8	----	-----	457088.2	58.7
690	9/10/2025	20:18:13	00d	01:00.0	57.6	75.4	67.2	48.4	-:-	65.7	63.7	49.8	48.6	48.5	----	-----	575439.9	58.8
691	9/10/2025	20:19:13	00d	01:00.0	56.1	73.9	64.9	47	-:-	63.4	62.1	48.4	47.8	47.5	----	-----	407380.3	58.7
692	9/10/2025	20:20:13	00d	01:00.0	54.8	72.6	65.1	47.2	-:-	63.9	59.3	48.4	47.8	47.6	----	-----	301995.2	58.7
693	9/10/2025	20:21:13	00d	01:00.0	62.9	80.7	71.2	47.6	-:-	70.9	69.1	52.9	48.6	48.1	----	-----	1949844.6	58.7
694	9/10/2025	20:22:13	00d	01:00.0	60.5	78.3	69.5	47.8	-:-	67.4	66.5	52.6	48	47.9	----	-----	1122018.5	58.7
695	9/10/2025	20:23:13	00d	01:00.0	63	80.8	74.4	47.5	-:-	72.4	66.9	49.6	47.8	47.5	----	-----	1995262.3	58.6
696	9/10/2025	20:24:13	00d	01:00.0	61.3	79.1	70.8	47.4	-:-	70.1	66.3	51.2	48	47.8	----	-----	1348962.9	58.4
697	9/10/2025	20:25:13	00d	01:00.0	61.9	79.7	72.3	47.3	-:-	68.6	67.2	49	47.6	47.5	----	-----	1548816.6	58.3
698	9/10/2025	20:26:13	00d	01:00.0	63.5	81.3	72.5	48.1	-:-	70.5	69	57.7	48.9	48.5	----	-----	2238721.1	58.1
699	9/10/2025	20:27:13	00d	01:00.0	60.3	78.1	69.6	47.9	-:-	69.5	65.4	49.9	48.1	48	----	-----	1071519.3	57.9
700	9/10/2025	20:28:13	00d	01:00.0	61.4	79.2	72.1	48.1	-:-	68.7	66.5	50.6	48.9	48.5	----	-----	1380384.3	57.8
701	9/10/2025	20:29:13	00d	01:00.0	60.8	78.6	69.7	48.7	-:-	67.7	65.5	53.6	49.6	49.1	----	-----	1202264.4	57.7
702	9/10/2025	20:30:13	00d	01:00.0	60.8	78.6	69.8	48.4	-:-	69	67.6	49.8	48.7	48.6	----	-----	1202264.4	57.6
703	9/10/2025	20:31:13	00d	01:00.0	61.6	79.4	72.5	49.1	-:-	70.2	66.3	52.9	49.6	49.4	----	-----	1445439.8	57.5
704	9/10/2025	20:32:13	00d	01:00.0	57.9	75.7	68.4	47.9	-:-	67.3	62	49.8	48.6	48.5	----	-----	616595.0	57.4
705	9/10/2025	20:33:13	00d	01:00.0	62.7	80.5	70.5	48.4	-:-	69.9	68.8	51.1	48.5	48.5	----	-----	1862087.1	57.4
706	9/10/2025	20:34:13	00d	01:00.0	58.3	76.1	67.1	47.7	-:-	66.7	63.8	51.4	48.4	47.9	----	-----	676083.0	57.2
707	9/10/2025	20:35:13	00d	01:00.0	61.3	79.1	68.6	48.9	-:-	67.7	66.7	54.6	49.8	49.3	----	-----	1348962.9	57.2
708	9/10/2025	20:36:13	00d	01:00.0	58.7	76.5	69.1	47.7	-:-	67.5	64.8	48.8	48.1	48	----	-----	741310.2	57.1
709	9/10/2025	20:37:13	00d	01:00.0	60.8	78.6	69.2	48.3	-:-	69	66.4	52.2	48.6	48.5	----	-----	1202264.4	57.0
710	9/10/2025	20:38:13	00d	01:00.0	59.6	77.4	68.5	47.4	-:-	68.1	65.5	51.2	48.2	47.7	----	-----	912010.8	56.9
711	9/10/2025	20:39:13	00d	01:00.0	47.9	65.7	48.8	47.2	-:-	48.8	48.5	47.9	47.4	47.3	----	-----	61659.5	56.7
712	9/10/2025	20:40:13	00d	01:00.0	55	72.8	66.6	47.4	-:-	65.1	56.5	48.6	47.9	47.9	----	-----	316227.8	56.8
713	9/10/2025	20:41:13	00d	01:00.0	60.8	78.6	70	47.9	-:-	68.1	67.5	52.2	48.6	48.2	----	-----	1202264.4	56.8
714	9/10/2025	20:42:13	00d	01:00.0	53.8	71.6	61.9	47.6	-:-	60.4	59.2	49.4	48	47.8	----	-----	239883.3	56.7
715	9/10/2025	20:43:13	00d	01:00.0	47.9	65.7	49.8	47.1	-:-	48.3	48.2	47.8	47.4	47.2	----	-----	61659.5	56.7
716	9/10/2025	20:44:13	00d	01:00.0	56	73.8	65.5	46.5	-:-	65.1	61.3	48	47.3	47.2	----	-----	398107.2	56.8
717	9/10/2025	20:45:13	00d	01:00.0	58	75.8	70.5	46.2	-:-	66.2	58.3	47.8	47.4	46.5	----	-----	630957.3	56.8
718	9/10/2025	20:46:13	00d	01:00.0	58.3	76.1	67.7	47.6	-:-	65.7	64.4	50.5	48.1	47.8	----	-----	676083.0	56.7
719	9/10/2025	20:47:13	00d	01:00.0	57.1	74.9	65.5	47.7	-:-	65.5	63.8	50.4	48	47.8	----	-----	512861.4	56.7
720	9/10/2025	20:48:13	00d	01:00.0	54.4	72.2	64.8	47	-:-	64.7	57.6	48.1	47.5	47.4	----	-----	275422.9	56.8
721	9/10/2025	20:49:13	00d	01:00.0	56.6	74.4	68.7	46.6	-:-	64.4	58.7	47.8	47.2	47.1	----	-----	457088.2	56.8
722	9/10/2025	20:50:13	00d	01:00.0	58.5	76.3	66.6	46.9	-:-	65.8	65.2	48.5	47.5	47.3	----	-----	707945.8	56.8
723	9/10/2025	20:51:13	00d	01:00.0	48.1	65.9	51.4	47	-:-	49.8	48.7	47.9	47.6	47.3	----	-----	64565.4	56.7
724	9/10/2025	20:52:13	00d	01:00.0	60.5	78.3	69.4	48.3	-:-	68.7	65.9	53.3	48.6	48.5	----	-----	1122018.5	56.8
725	9/10/2025	20:53:13	00d	01:00.0	62	79.8	68.3	47.5	-:-	68.3	67.6	55.7	48.5	48.1	----	-----	1584893.2	56.6
726	9/10/2025	20:54:13	00d	01:00.0	58.6	76.4	69.5	47.2	-:-	66.6	65.5	48.1	47.6	47.4	----	-----	724436.0	56.4
727	9/10/2025	20:55:13	00d	01:00.0	60.1	77.9	68.8	47.1	-:-	68.7	67.7	49.4	47.7	47.6	----	-----	1023293.0	56.4
728	9/10/2025	20:56:13	00d	01:00.0	47.8	65.6	53.3	46.8	-:-	48.8	48.6	47.8	47.4	47.3	----	-----	60256.0	56.3
729	9/10/2025	20:57:13	00d	01:00.0	55.2	73	67.1	46.9	-:-	65	55.9	47.8	47.4	47.1	----	-----	331131.1	56.4
730	9/10/2025	20:58:13	00d	01:00.0	55.9	73.7	67.6	47	-:-	66	56.4	48.2	47.7	47.3	----	-----	389045.1	56.3
731	9/10/2025	20:59:13	00d	01:00.0	54	71.8	65	46.7	-:-	62.6	56.8	47.6	47.1	46.9	----	-----	251188.6	56.3
732	9/10/2025	21:00:13	00d	01:00.0	60.1	77.9	70.3	47.3	-:-	70	63.9	49	47.7	47.6	----	-----	1023293.0	56.2
733	9/10/2025	21:01:13	00d	01:00.0	54.4	72.2	65.2	46.7	-:-	62.8	58.7	47.8	47.4	47.3	----	-----	275422.9	56.1
734	9/10/2025	21:02:13	00d	01:00.0	54.8	72.6	66.5	46.8	-:-	63.1	54.6	47.7	47.3	47.1	----	-----	301995.2	56.1
735	9/10/2025	21:03:13	00d	01:00.0	55	72.8	66.2	47	-:-	65.3	56.2	47.9	47.4	47.1	----	-----	316227.8	56.2
736	9/10/2025	21:04:13	00d	01:00.0	58.3	76.1	69.1	47.1	-:-	66.6	63.1	48.6	47.6	47.4	----	-----	676083.0	56.1
737	9/10/2025	21:05:13	00d	01:00.0	56.9	74.7	66.6	47.8	-:-	63.1	61.1	50.4	48.3	48.2	----	-----	489778.8	56.0
738	9/10/2025	21:06:13	00d	01:00.0	55.7	73.5	67.4	47.3	-:-	65.2	56.8	48.7	47.6	47.6	----	-----	371535.2	55.9
739	9/10/2025	21:07:13	00d	01:00.0	57.9	75.7	69.3	47.2	-:-	68.3	60.5	48.4	47.7	47.6	----	-----	616595.0	55.9
740	9/10/2025	21:08:13	00d	01:00.0	47.4	65.2	47.9	46.4	-:-	47.9	47.8	47.5	46.9	46.7	----	-----	54954.1	55.9
741	9/10/2025	21:09:13	00d	01:00.0	47.2	65	48	45.5	-:-	47.9	47.7	47.2	46.6	46.1	----	-----	52480.7	56.0
742	9/10/2025	21:10:13	00d	01:00.0	56.1	73.9	69.9	46.3	-:-	63	51.6	47.5	46.9	46.8	----	-----	407380.3	56.3
743	9/10/2025	21:11:13	00d	01:00.0	54.9	72.7	69.8	46.6	-:-	61.3	58.2	48.7	47.1	46.8	----	-----	309029.5	56.3
744	9/10/2025	21:12:13	00d	01:00.0	58.1	75.9	68	46.1	-:-	66.9	64.9	48.5	47	46.5	----	-----	645654.2	56.2
745	9/10/2025	21:13:13	00d	01:00.0	56.1	73.9	66.7	47	-:-	63.9	59.6	48.1	47.5	47.5	----	-----	407380.3	56.2
746	9/10/2025	21:14:13	00d	01:00.0	58.6	76.4	67.8	47.4	-:-	67.7	63.3	50.8	47.7	47.5	----	-----	724436.0	56.2
747	9/10/2025	21:15:13	00d	01:00.0	59.8	77.6	67.4	47.1	-:-	66.1	64.8	53.6	47.5	47.2	----	-----	954992.6	56.2
748	9/10/2025	21:16:13	00d	01:00.0	47.1	64.9	50.1	45.5	-:-	49.6	47.7	46.7	46.4	46.3	----	-----	51286.1	56.0
749	9/10/2025	21:17:13	00d	01:00.0	58.4	76.2	69.1	46.5	-:-	65.1	63.5	48.1	47.3	47.1	----	-----	691831.0	56.0
750	9/10/2025	21:18:13	00d	01:00.0	60.6	78.4	69.8	47.3	-:-	68.3	66	52.6	47.6	47.4	----	-----	1148153.6	56.0
751	9/10/2025	21:19:13	00d	01:00.0	56.2	74	68.1	45.8	-:-	65.8	57.6	48	46.9	46.5	----	-----	416869.4	55.9
752	9/10/2025	21:20:13	00d	01:00.0	47.6	65.4	50.9	46.6	-:-	49.3	47.8	47.4	46.9	46.7	----	-----	57544.0	55.8
753	9/10/2025	21:21:13	00d	01:00.0	55.3	73.1	66.9	46.7	-:-	65	58.8	47.8	47.3	46.8	----	-----	338844.2	55.8
754	9/10/2025	21:22:13	00d	01:00.0	62.3	80.1	72.4	47.6	-:-	71.4	68.4	50.1	47.9	47.8	----	-----	1698243.7	55.8
755	9/10/2025	21:23:13	00d	01:00.0	55.1	72.9	64.6	45.7	-:-	64	60.9	47.8	46.4	46	----	-----	323593.7	55.8
756	9/10/2025	21:24:13	00d	01:00.0	46.7	64.5	47.2	45.8	-:-	47	47	46.7	46.4	46.1	----	-----	46773.5	55.8
757	9/10/2025	21:25:13	00d	01:00.0	46.7	64.5	47.3	45.3	-:-	47.2	47.2	46.9	46.1	45.7	----	-----	46773.5	55.9
758	9/10/2025	21:26:13	00d	01:00.0	46.8	64.6	47.3	46	-:-	47.3	47.2	46.9	46.5	46.1	----	-----	47863.0	55.9
759	9/10/2025	21:27:13	00d	01:00.0	55.3	73.1	66.9	45.6	-:-	65.8	57.8	46.8	46.2	45.8	----	-----	338844.2	56.1
760	9/10/2025	21:28:13	00d	01:00.0	46.4	64.2	47	45.3	-:-	46.9	46.8	46.5	45.7	45.4	----	-----	43651.6	56.0

761	9/10/2025	21:29:13	00d	01:00.0	58.5	76.3	69.6	45.7	-:-	66.2	65.2	48.6	46.7	46	----	-----	707945.8	56.1
762	9/10/2025	21:30:13	00d	01:00.0	58.5	76.3	67.1	46.8	-:-	67.3	64.9	50.6	47.5	47.2	----	-----	707945.8	56.0
763	9/10/2025	21:31:13	00d	01:00.0	54.8	72.6	65	45.7	-:-	63.2	59.1	47.3	46.6	46.3	----	-----	301995.2	55.9
764	9/10/2025	21:32:13	00d	01:00.0	58.7	76.5	67.4	46.2	-:-	67.2	64.6	47.5	46.5	46.4	----	-----	741310.2	55.9
765	9/10/2025	21:33:13	00d	01:00.0	54.2	72	65.8	45.5	-:-	64.8	56.2	46.8	46.3	46.1	----	-----	263026.8	55.8
766	9/10/2025	21:34:13	00d	01:00.0	53.5	71.3	64.9	44.9	-:-	62.9	55.6	46.7	45.9	45.3	----	-----	223872.1	55.8
767	9/10/2025	21:35:13	00d	01:00.0	60.3	78.1	71.2	45.9	-:-	70.3	65.1	49.1	46.7	46.4	----	-----	1071519.3	55.8
768	9/10/2025	21:36:13	00d	01:00.0	50.9	68.7	60.8	45.5	-:-	58.8	54.6	46.9	46.2	45.8	----	-----	123026.9	55.6
769	9/10/2025	21:37:13	00d	01:00.0	57.9	75.7	68.1	44.4	-:-	66.5	64	47.2	45.7	44.7	----	-----	616595.0	55.8
770	9/10/2025	21:38:13	00d	01:00.0	46.3	64.1	46.9	45.3	-:-	46.8	46.8	46.4	45.5	45.3	----	-----	42658.0	55.7
771	9/10/2025	21:39:13	00d	01:00.0	46	63.8	46.9	44.4	-:-	46.6	46.6	46.2	45.2	44.7	----	-----	39810.7	55.7
772	9/10/2025	21:40:13	00d	01:00.0	55.3	73.1	66.9	45.3	-:-	65.2	57.3	46.7	45.9	45.6	----	-----	338844.2	55.7
773	9/10/2025	21:41:13	00d	01:00.0	58.3	76.1	69.2	46.1	-:-	66.9	64.9	47.9	46.7	46.3	----	-----	676083.0	55.7
774	9/10/2025	21:42:13	00d	01:00.0	46.3	64.1	47.1	44.7	-:-	47	46.9	46.5	45.2	44.8	----	-----	42658.0	55.7
775	9/10/2025	21:43:13	00d	01:00.0	56.1	73.9	67.6	44.6	-:-	66.8	58.9	46.9	45	44.9	----	-----	407380.3	55.7
776	9/10/2025	21:44:13	00d	01:00.0	59.2	77	69.7	45.6	-:-	67.6	64.8	47.9	46.7	46.4	----	-----	831763.8	55.7
777	9/10/2025	21:45:13	00d	01:00.0	46.9	64.7	47.6	46.1	-:-	47.3	47.2	46.9	46.6	46.4	----	-----	48977.9	55.6
778	9/10/2025	21:46:13	00d	01:00.0	53.9	71.7	65.1	45.6	-:-	64.7	56.1	46.6	46.1	45.8	----	-----	245470.9	55.7
779	9/10/2025	21:47:13	00d	01:00.0	59.2	77	69.7	45	-:-	66.9	65.7	49.6	46	45.4	----	-----	831763.8	55.6
780	9/10/2025	21:48:13	00d	01:00.0	61	78.8	73	45.4	-:-	70.3	63.1	46.9	46.1	45.8	----	-----	1258925.4	55.5
781	9/10/2025	21:49:13	00d	01:00.0	54.6	72.4	66.8	45.9	-:-	63.1	54	46.9	46.3	46.2	----	-----	288403.2	55.2
782	9/10/2025	21:50:13	00d	01:00.0	54.7	72.5	66.6	45.5	-:-	64.7	55.9	46.5	45.6	45.4	----	-----	295120.9	55.2
783	9/10/2025	21:51:13	00d	01:00.0	54.4	72.2	66.3	45.3	-:-	63.5	56.8	46.5	45.6	45.5	----	-----	275422.9	55.4
784	9/10/2025	21:52:13	00d	01:00.0	54	71.8	65.5	45.5	-:-	63.2	54.7	46.6	46.2	46	----	-----	251188.6	55.3
785	9/10/2025	21:53:13	00d	01:00.0	47.7	65.5	57.2	44.5	-:-	51.6	48	46.5	45.3	44.6	----	-----	58884.4	55.3
786	9/10/2025	21:54:13	00d	01:00.0	57.5	75.3	68.8	45.6	-:-	66.8	61.7	46.9	46.1	45.8	----	-----	562341.3	55.3
787	9/10/2025	21:55:13	00d	01:00.0	56	73.8	65.9	45.5	-:-	63.4	62.6	47.7	46.3	46.1	----	-----	398107.2	55.2
788	9/10/2025	21:56:13	00d	01:00.0	57.5	75.3	67.1	45.4	-:-	66.5	64.3	46.7	45.7	45.6	----	-----	562341.3	55.1
789	9/10/2025	21:57:13	00d	01:00.0	56.1	73.9	67.7	45.6	-:-	64.8	58.4	47.1	46	45.7	----	-----	407380.3	55.0
790	9/10/2025	21:58:13	00d	01:00.0	46	63.8	46.4	45.2	-:-	46.4	46.4	46	45.6	45.4	----	-----	39810.7	55.1
791	9/10/2025	21:59:13	00d	01:00.0	45.8	63.6	46.3	45	-:-	46.3	46.2	46	45.2	45.1	----	-----	38018.9	55.1
792	9/10/2025	22:00:13	00d	01:00.0	45.7	63.5	46.3	44.8	-:-	46.2	46.1	45.8	45.1	45.1	----	-----	37153.5	55.1
793	9/10/2025	22:01:13	00d	01:00.0	54.9	72.7	66.4	45.2	-:-	65.4	55.9	46.4	45.7	45.6	----	-----	309029.5	55.1
794	9/10/2025	22:02:13	00d	01:00.0	45.9	63.7	46.5	45.1	-:-	46.4	46.3	46	45.3	45.2	----	-----	38904.5	55.1
795	9/10/2025	22:03:13	00d	01:00.0	59.6	77.4	71.5	45.5	-:-	69.8	64.6	47.1	46.1	45.9	----	-----	912010.8	55.1
796	9/10/2025	22:04:13	00d	01:00.0	48.2	66	65.3	45.8	-:-	52	49.5	46.8	46.1	46	----	-----	66069.3	54.9
797	9/10/2025	22:05:13	00d	01:00.0	45.9	63.7	47.1	44.4	-:-	46.9	46.7	46.1	44.9	44.6	----	-----	38904.5	54.9
798	9/10/2025	22:06:13	00d	01:00.0	46.2	64	47	45.1	-:-	46.8	46.6	46.3	45.3	45.2	----	-----	41686.9	54.9
799	9/10/2025	22:07:13	00d	01:00.0	54.5	72.3	66.7	45.7	-:-	63.5	55.4	46.8	46	45.8	----	-----	281838.3	54.9
800	9/10/2025	22:08:13	00d	01:00.0	57.2	75	69.2	44.5	-:-	68.2	60.1	46	44.8	44.7	----	-----	524807.5	54.8
801	9/10/2025	22:09:13	00d	01:00.0	56.7	74.5	66.2	44.2	-:-	66.1	64.8	45.5	44.5	44.4	----	-----	467735.1	54.7
802	9/10/2025	22:10:13	00d	01:00.0	63	80.8	74.9	45.8	-:-	71.3	64.3	49.2	46.5	46.4	----	-----	1995262.3	54.7
803	9/10/2025	22:11:13	00d	01:00.0	54.2	72	66.5	46.1	-:-	64.4	53.6	46.8	46.3	46.2	----	-----	263026.8	54.2
804	9/10/2025	22:12:13	00d	01:00.0	46.2	64	46.8	45.4	-:-	46.7	46.5	46.2	45.8	45.7	----	-----	41686.9	54.3
805	9/10/2025	22:13:13	00d	01:00.0	54.6	72.4	66.4	46.1	-:-	64.6	55.3	46.6	46.2	46.2	----	-----	288403.2	54.4
806	9/10/2025	22:14:13	00d	01:00.0	58.2	76	69.4	45.3	-:-	66.3	64.7	47.3	46.2	45.9	----	-----	660693.4	54.4
807	9/10/2025	22:15:13	00d	01:00.0	57.8	75.6	70.6	46.4	-:-	65	58	48.1	46.6	46.5	----	-----	602559.6	54.2
808	9/10/2025	22:16:13	00d	01:00.0	45.9	63.7	46.9	45.2	-:-	46.5	46.4	45.9	45.4	45.2	----	-----	38904.5	54.0
809	9/10/2025	22:17:13	00d	01:00.0	46	63.8	46.5	44.8	-:-	46.5	46.4	46.1	45.7	45.4	----	-----	39810.7	54.0
810	9/10/2025	22:18:13	00d	01:00.0	58.1	75.9	70	45.6	-:-	66.3	60.8	46.7	46	45.9	----	-----	645654.2	54.0
811	9/10/2025	22:19:13	00d	01:00.0	52.5	70.3	70	44.9	-:-	60.6	51.4	46	45.5	45.5	----	-----	177827.9	53.9
812	9/10/2025	22:20:13	00d	01:00.0	45.7	63.5	46.2	44.7	-:-	46.2	46	45.7	45.3	45.2	----	-----	37153.5	53.8
813	9/10/2025	22:21:13	00d	01:00.0	46.1	63.9	47.9	45.2	-:-	47.6	46.9	46	45.6	45.4	----	-----	40738.0	53.9
814	9/10/2025	22:22:13	00d	01:00.0	55.9	73.7	68.1	45.4	-:-	62.8	57.4	46.7	46	45.9	----	-----	389045.1	53.9
815	9/10/2025	22:23:13	00d	01:00.0	62.5	80.3	72	46.4	-:-	69.6	68.7	48.6	46.9	46.7	----	-----	1778279.4	53.8
816	9/10/2025	22:24:13	00d	01:00.0	56	73.8	72	46	-:-	63.5	60.5	47.7	46.4	46.2	----	-----	398107.2	53.3
817	9/10/2025	22:25:13	00d	01:00.0	54.6	72.4	66.6	45.9	-:-	65.1	56	46.8	46.3	46	----	-----	288403.2	53.2
818	9/10/2025	22:26:13	00d	01:00.0	49.3	67.1	60.2	45.5	-:-	54.7	48.6	46.6	46.1	45.6	----	-----	85113.8	53.1
819	9/10/2025	22:27:13	00d	01:00.0	60.8	78.6	71.5	45.8	-:-	69.7	67.8	47.6	46.4	46.3	----	-----	1202264.4	53.1
820	9/10/2025	22:28:13	00d	01:00.0	51	68.8	60	46	-:-	58.6	56.1	46.9	46.2	46.1	----	-----	125892.5	52.8
821	9/10/2025	22:29:13	00d	01:00.0	47.2	65	55.3	45.7	-:-	50.3	47.2	46.4	46	45.9	----	-----	52480.7	52.9
822	9/10/2025	22:30:13	00d	01:00.0	54.2	72	66.2	45.5	-:-	63.6	52.8	46.4	46	45.5	----	-----	263026.8	53.0
823	9/10/2025	22:31:13	00d	01:00.0	55.9	73.7	68.4	45.5	-:-	65.7	56.9	46.6	46	45.6	----	-----	389045.1	52.9
824	9/10/2025	22:32:13	00d	01:00.0	55.6	73.4	67.6	45.8	-:-	63.2	58.1	46.5	46	46	----	-----	363078.1	52.8
825	9/10/2025	22:33:13	00d	01:00.0	52.4	70.2	64	45.4	-:-	61.4	53.3	46.3	46	45.7	----	-----	173780.1	52.7
826	9/10/2025	22:34:13	00d	01:00.0	55.2	73	67.2	45.2	-:-	65.5	56.4	46.4	45.6	45.6	----	-----	331131.1	52.9
827	9/10/2025	22:35:13	00d	01:00.0	54.3	72.1	65.6	45.2	-:-	63	56.9	46.5	45.7	45.6	----	-----	269153.5	52.8
828	9/10/2025	22:36:13	00d	01:00.0	45.9	63.7	46.5	45.1	-:-	46.3	46.2	46	45.5	45.2	----	-----	38904.5	52.7
829	9/10/2025	22:37:13	00d	01:00.0	60.8	78.6	70.7	45.5	-:-	70.4	67.5	48	46.2	45.9	----	-----	1202264.4	52.9
830	9/10/2025	22:38:13	00d	01:00.0	46.6	64.4	60.7	45.1	-:-	49.9	47	46.1	45.6	45.4	----	-----	45708.8	52.4
831	9/10/2025	22:39:13	00d	01:00.0	45.9	63.7	46.5	45.1	-:-	46.4	46.3	46	45.4	45.3	----	-----	38904.5	52.5
832	9/10/2025	22:40:13	00d	01:00.0	45.6	63.4	46.6	43.9	-:-	46.4	46.2	45.8	44.4	44.1	----	-----	36307.8	52.5
833	9/10/2025	22:41:13	00d	01:00.0	45.7	63.5	46.4	44.5	-:-	46.4	46.3	45.8	45	44.7	----	-----	37153.5	52.5
834	9/10/2025	22:42:13	00d	01:00.0	57.7	75.5	70.1	45.4	-:-	66.7	59.8	46.3	45.9	45.7	----	-----	588843.7	52.5
835	9/10/2025	22:43:13	00d	01:00.0	46.2	64	47.8	45.5	-:-	46.8	46.7	46.2	45.8	45.6	----	-----	41686.9	52.3
836	9/10/2025	22:44:13	00d	01:00.0	56.6	74.4	65.9	46	-:-	64.2	61.8	48.6	46.5	46.5	----	-----	457088.2	52.3
837	9/10/2025	22:45:13	00d	01:00.0	56.9	74.7	69.1	45.3	-:-	67.1	56	46.7	46	45.8	----	-----	489778.8	52.1
838	9/10/2025	22:46:13	00d	01:00.0	54.2	72	65	45.6	-:-	63.6	57.9	46.6	46.2	46	----	-----	263026.8	51.9
839	9/10/2025	22:47:13	00d	01:00.0	46.7	64.5	48.1	45.4	-:-	48	47.8	46.5	46	45.7	----	-----	46773.5	51.8
840	9/10/2025	22:48:13	00d	01:00.0	47.4	65.2	48	44.5	-:-	48	47.9	47.6	46.4	45.7	----	-----	54954.1	52.0
841	9/10/2025	22:49:13	00d	01:00.0	46.5	64.3	47.8	45	-:-	47.7	47.6	46.3	45.6	45.3	----	-----	44668.4	52.2
842	9/10/2025	22:50:13	00d	01:00.0	56.1	73.9	68.1	44.2	-:-	66.2	58.5	46.2	45.2	44.5	----	-----	407380.3	52.2
843	9/10/2025	22:51:13	00d	01:00.0	59.6	77.4	68.9	45.8	-:-	67.7	65.2	49.6	46.8	46.6	----	-----	912010.8	52.0
844	9/10/2025	22:52:13	00d	01:00.0	46.4	64.2	47.3	44.9	-:-	47.1	47.1	46.6	45.3	45.2	----	-----	43651.6	51.9
845	9/10/2025	22:53:13	00d	01:00.0	46.8	64.6	47.4	46.1	-:-	47.3	47.3	46.9	46.4	46.3	----	-----	47863.0	51.9
846	9/10/2025	22:54:13	00d	01:00.0	46.9	64.7	47.3	46.1	-:-	47.3	47.2	47	46.4	46.2	----	-----	48977.9	51.9
847	9/10/2025	22:55:13	00d	01:00.0	55.6	73.4	67.8	45.6	-:-	65.2	56.2	47.4	46.1	45.9	----	-----	363078.1	51.8
848	9/10/2025	22:56:13	00d	01:00.0	46.8	64.6	47.6	45.7	-:-	47.5	47.3	46.9	46.2	46.1	----	-----	47863.0	51.7
849	9/10/2025	22:57:13	00d	01:00.0	47.8	65.6	50.7	46.1	-:-	49.9	49.5	47.4	46.8	46.2	----	-----	60256.0	51.7
850	9/10/2025	22:58:13	00d	01:00.0	58.6	76.4	71	45.9	-:-	67.8	60.5	47.7	46.8	46.3	----	-----	724436.0	51.7
851	9/10/2025	22:59:13	00d	01:00.0	46.8	64.6	47.3	45.3	-:-	47.2	47.2	46.9	46	45.8	----	-----	47863.0	51.3
852	9/10/2025	23:00:13	00d	01:00.0	46.9	64.7	47.5	44.7	-:-	47.4	47.3	47	46.4	46.1	----	-----	48977.9	51.3
853	9/10/2025	23:01:13	00d	01:00.0	46.8	64.6	47.2	45.9	-:-	47.2	47.1	46.9	46.4	46.3	----	-----	47863.0	51.3
854	9/10/2025	23:02:13	00d	01:00.0	46.7	64.5	47.3	45.6	-:-	47.2	47.1	46.9	45.8	45.8	----	-----	46773.5	51.3
855	9/10/2025	23:03:13	00d	01:00.0	45.5	63.3	46.3	44.5	-:-	46.1	46	45.6	44.9	44.6	----	-----	35481.3	51.3
856	9/10/2025	23:04:13	00d	01:00.0	45.3	63.1	46	44.3	-:-	45.9	45.8	45.4	44.9	44.6	----	-----	33884.4	51.3
857	9/10/2025	23:05:13	00d	01:00.0	53.5	71.3	65	44.8	-:-	62.6	56.2	46.1	45.2	45	----	-----	223872.1	51.4
858	9/10/2025	23:06:13	00d	01:00.0	45.2	63	47.8	43.7	-:-	46.9	46.1	45.4	44	43.9	----	-----	33113.1	51.4
859	9/10/2025	23:07:13	00d	01:00.0	45.8	63.6	46.3	45.1	-:-	46.2	46.2	45.8	45.4	45.2	----	-----	38018.9	51.9
860	9/10/2025	23:08:13	00d	01:00.0	45.8	63.6	46.2	45.2	-:-	46.2	46	45.8	45.5	45.3	----	-----	38018.9	52.1
861	9/10/2025	23:09:13	00d	01:00.0	45.8	63.6	46.5	45	-:-	46.3	46.2	45.9	45.2	45.2	----	-----	38018.9	52.1
862	9/10/2025	23:10:13	00d	01:00.0	56.7	74.5	68.3	43.8	-:-	67.9	58.7	46	44.4	44	----	-----	467735.1	52.2
863	9/10/2025	23:11:13	00d	01:00.0	43.3	61.1	45.6	42.2	-:-	44.6	44	43.3	42.5	42.4	----	-----	21379.6	52.0
864	9/10/2025	23:12:13	00d	01:00.0	57.9	75.7	67.5	43.2	-:-	66.4	62.4	47.4	44	43.3	----	-----	616595.0	52.1
865	9/10/2025	23:13:13	00d	01:00.0	54.5	72.3	66.2	43.6	-:-	63.2	56.8	44.9	43.8	43.7	----	-----	281838.3	51.9
866	9/10/2025	23:14:13	00d	01:00.0	54.8	72.6	66.3	42.6	-:-	65.5	56	43.9	43.3	43.1	----	-----	301995.2	51.8
867	9/10/2025	23:15:13	00d	01:00.0	43.7	61.5	45.2	42.7	-:-	44.4	44.2	43.8	43.4	42.8	----	-----	23442.3	51.6
868	9/10/2025	23:16:13	00d	01:00.0	43.4	61.2	44.1	42.2	-:-	43.9	43.9	43.4	43	42.8	----	-----	21877.6	51.6
869	9/10/2025	23:17:13	00d	01:00.0	44.2	62	46	42.3	-:-	46	45.9	43.6	42.9	42.6	----	-----	26302.7	51.7

870	9/10/2025	23:18:13	00d	01:00.0	45.7	63.5	46	44.9	-:-	45.9	45.9	45.7	45.5	45.3	----	-----	37153.5	51.7
871	9/10/2025	23:19:13	00d	01:00.0	44.5	62.3	45.7	42.5	-:-	45.6	45.6	44.8	43	42.8	----	-----	28183.8	51.7
872	9/10/2025	23:20:13	00d	01:00.0	46.3	64.1	52.7	44.8	-:-	50.4	47.4	45.5	45.1	45	----	-----	42658.0	51.7
873	9/10/2025	23:21:13	00d	01:00.0	54.2	72	66	44.6	-:-	65.6	56.3	45.6	45.4	44.8	----	-----	263026.8	51.7
874	9/10/2025	23:22:13	00d	01:00.0	45.3	63.1	46.1	43.5	-:-	45.8	45.7	45.5	44.9	44.5	----	-----	33884.4	51.5
875	9/10/2025	23:23:13	00d	01:00.0	45	62.8	45.8	43.3	-:-	45.7	45.5	45.2	43.9	43.6	----	-----	31622.8	51.5
876	9/10/2025	23:24:13	00d	01:00.0	55.1	72.9	67.5	44.3	-:-	63.7	56.8	45.8	45	44.8	----	-----	323593.7	51.5
877	9/10/2025	23:25:13	00d	01:00.0	45.2	63	46.2	44.2	-:-	45.6	45.6	45.2	44.5	44.3	----	-----	33113.1	51.4
878	9/10/2025	23:26:13	00d	01:00.0	45.1	62.9	45.6	43.9	-:-	45.6	45.5	45.2	44.7	44.5	----	-----	32359.4	51.4
879	9/10/2025	23:27:13	00d	01:00.0	45.1	62.9	45.8	43.6	-:-	45.7	45.6	45.2	44.5	44.3	----	-----	32359.4	51.4
880	9/10/2025	23:28:13	00d	01:00.0	56.3	74.1	68	43.7	-:-	65.6	57.4	44.9	44	43.7	----	-----	426579.5	51.3
881	9/10/2025	23:29:13	00d	01:00.0	55.6	73.4	67.4	42.5	-:-	64	57.4	45.7	44.8	42.9	----	-----	363078.1	51.1
882	9/10/2025	23:30:13	00d	01:00.0	54.6	72.4	66.3	44.6	-:-	64.2	56.7	45.5	44.8	44.7	----	-----	288403.2	50.9
883	9/10/2025	23:31:13	00d	01:00.0	44.7	62.5	45.5	43.6	-:-	45.3	45.2	44.8	43.9	43.6	----	-----	29512.1	50.8
884	9/10/2025	23:32:13	00d	01:00.0	47.4	65.2	59.3	43.4	-:-	52.4	47.7	44.7	43.7	43.5	----	-----	54954.1	50.8
885	9/10/2025	23:33:13	00d	01:00.0	54	71.8	65.5	41.8	-:-	64.5	55.5	45.1	43.2	42.5	----	-----	251188.6	50.7
886	9/10/2025	23:34:13	00d	01:00.0	58.2	76	68.7	43.5	-:-	68.3	62.8	45.7	43.9	43.6	----	-----	660693.4	50.6
887	9/10/2025	23:35:13	00d	01:00.0	45.4	63.2	57.5	42.3	-:-	49.4	48	44.7	43.1	42.9	----	-----	34673.7	50.2
888	9/10/2025	23:36:13	00d	01:00.0	44.3	62.1	45	41.7	-:-	45	44.8	44.6	43.3	42.6	----	-----	26915.3	50.4
889	9/10/2025	23:37:13	00d	01:00.0	56.9	74.7	69.1	42.2	-:-	67.5	58.1	45.7	44.3	43.6	----	-----	489778.8	50.4
890	9/10/2025	23:38:13	00d	01:00.0	44.4	62.2	45.1	43.2	-:-	45	44.8	44.5	43.6	43.4	----	-----	27542.3	50.0
891	9/10/2025	23:39:13	00d	01:00.0	54.7	72.5	66.1	42.7	-:-	65.6	57	44.7	43.5	43.1	----	-----	295120.9	50.0
892	9/10/2025	23:40:13	00d	01:00.0	44.2	62	44.7	42.9	-:-	44.7	44.6	44.3	43.4	43.2	----	-----	26302.7	49.8
893	9/10/2025	23:41:13	00d	01:00.0	44.1	61.9	44.6	42.8	-:-	44.6	44.5	44.3	43	42.9	----	-----	25704.0	50.1
894	9/10/2025	23:42:13	00d	01:00.0	44	61.8	44.8	41.1	-:-	44.8	44.7	44.3	42.9	41.5	----	-----	25118.9	50.1
895	9/10/2025	23:43:13	00d	01:00.0	44.2	62	45.2	41.6	-:-	45.1	45	44.4	43.3	42.2	----	-----	26302.7	50.1
896	9/10/2025	23:44:13	00d	01:00.0	44.3	62.1	45.2	41.9	-:-	45.1	45	44.4	42.9	42.4	----	-----	26915.3	50.1
897	9/10/2025	23:45:13	00d	01:00.0	44.3	62.1	46.1	43	-:-	45.8	44.8	44.4	43.2	42.9	----	-----	26915.3	50.0
898	9/10/2025	23:46:13	00d	01:00.0	44	61.8	44.8	41.5	-:-	44.7	44.6	44.3	43	42.2	----	-----	25118.9	50.0
899	9/10/2025	23:47:13	00d	01:00.0	44.3	62.1	45.5	43.1	-:-	45.3	45	44.4	43.3	43	----	-----	26915.3	50.5
900	9/10/2025	23:48:13	00d	01:00.0	57.3	75.1	69.9	44.4	-:-	65.5	58	45.6	44.7	44.6	----	-----	537031.8	50.5
901	9/10/2025	23:49:13	00d	01:00.0	56.3	74.1	68.4	43.4	-:-	65.7	57.8	45	43.7	43.6	----	-----	426579.5	50.1
902	9/10/2025	23:50:13	00d	01:00.0	44.2	62	44.9	43.1	-:-	44.9	44.7	44.4	43.3	43.2	----	-----	26302.7	49.8
903	9/10/2025	23:51:13	00d	01:00.0	46.8	64.6	57.5	43	-:-	53	46.4	44.4	43.2	43.1	----	-----	47863.0	49.8
904	9/10/2025	23:52:13	00d	01:00.0	57.8	75.6	70.7	43.1	-:-	66.5	57.3	45	43.9	43.6	----	-----	602559.6	49.8
905	9/10/2025	23:53:13	00d	01:00.0	44.6	62.4	45.3	43.4	-:-	45.3	45.2	44.8	43.7	43.6	----	-----	28840.3	49.3
906	9/10/2025	23:54:13	00d	01:00.0	44.7	62.5	45.2	43.6	-:-	45.2	45.1	44.9	43.8	43.7	----	-----	29512.1	49.3
907	9/10/2025	23:55:13	00d	01:00.0	44.7	62.5	45.2	43.7	-:-	45.1	45.1	44.8	44.1	43.9	----	-----	29512.1	49.3
908	9/10/2025	23:56:13	00d	01:00.0	44.7	62.5	45.3	43.8	-:-	45.2	45.2	44.9	44	43.8	----	-----	29512.1	49.2
909	9/10/2025	23:57:13	00d	01:00.0	44.7	62.5	45.4	42.6	-:-	45.4	45.4	44.9	43.9	42.8	----	-----	29512.1	49.7
910	9/10/2025	23:58:13	00d	01:00.0	44.7	62.5	45.5	43.2	-:-	45.4	45.3	44.9	43.9	43.5	----	-----	29512.1	49.7
911	9/10/2025	23:59:13	00d	01:00.0	44.5	62.3	45.3	43.2	-:-	45	44.9	44.7	43.6	43.4	----	-----	28183.8	49.7
912	9/11/2025	0:00:13	00d	01:00.0	44.8	62.6	45.5	43.8	-:-	45.4	45.3	44.9	44.1	43.9	----	-----	30199.5	50.2
913	9/11/2025	0:01:13	00d	01:00.0	44.6	62.4	45.2	43.5	-:-	45.2	45.1	44.8	43.7	43.6	----	-----	28840.3	50.2
914	9/11/2025	0:02:13	00d	01:00.0	44.5	62.3	45.3	42.4	-:-	45.2	45	44.8	43.4	42.6	----	-----	28183.8	50.2
915	9/11/2025	0:03:13	00d	01:00.0	44.8	62.6	46.3	42.6	-:-	46	45.7	45	43.7	42.6	----	-----	30199.5	50.5
916	9/11/2025	0:04:13	00d	01:00.0	51.9	69.7	62.6	43.2	-:-	62.4	54.9	44.7	43.7	43.4	----	-----	154881.7	50.6
917	9/11/2025	0:05:13	00d	01:00.0	49.9	67.7	63	42.4	-:-	54	46.9	44.9	43.1	42.5	----	-----	97723.7	50.5
918	9/11/2025	0:06:13	00d	01:00.0	53.6	71.4	67.2	43.7	-:-	58.6	50.7	44.9	43.9	43.8	----	-----	229086.8	50.7
919	9/11/2025	0:07:13	00d	01:00.0	60.1	77.9	73.3	43.7	-:-	68.4	59.7	45.2	44.1	43.9	----	-----	1023293.0	50.6
920	9/11/2025	0:08:13	00d	01:00.0	58.1	75.9	69.3	43.9	-:-	67.5	62.4	45.7	44.5	44.1	----	-----	645654.2	49.9
921	9/11/2025	0:09:13	00d	01:00.0	44.6	62.4	45.3	43.6	-:-	45.1	45	44.7	43.8	43.6	----	-----	28840.3	49.4
922	9/11/2025	0:10:13	00d	01:00.0	54.1	71.9	65.7	43.5	-:-	62.9	56.9	45.1	44.1	43.9	----	-----	257039.6	49.4
923	9/11/2025	0:11:13	00d	01:00.0	44.4	62.2	45.2	42.4	-:-	45.1	45	44.7	43.7	42.6	----	-----	27542.3	49.2
924	9/11/2025	0:12:13	00d	01:00.0	54.5	72.3	66.4	42.3	-:-	64.5	54.2	45.1	42.9	42.5	----	-----	281838.3	49.2
925	9/11/2025	0:13:13	00d	01:00.0	44.5	62.3	45.3	42.9	-:-	45.1	45	44.6	43.9	43.8	----	-----	28183.8	48.9
926	9/11/2025	0:14:13	00d	01:00.0	43.5	61.3	45	41.5	-:-	44.9	44.8	43.8	41.9	41.8	----	-----	22387.2	48.9
927	9/11/2025	0:15:13	00d	01:00.0	41.3	59.1	42.1	40.7	-:-	42	41.8	41.3	40.9	40.8	----	-----	13489.6	49.1
928	9/11/2025	0:16:13	00d	01:00.0	42.6	60.4	47.3	41.2	-:-	46.3	44.8	42	41.6	41.5	----	-----	18197.0	49.1
929	9/11/2025	0:17:13	00d	01:00.0	52.4	70.2	63.2	42.2	-:-	62.7	56.7	43.3	42.7	42.6	----	-----	173780.1	49.1
930	9/11/2025	0:18:13	00d	01:00.0	42.6	60.4	43.2	42	-:-	43.1	43	42.7	42.3	42.2	----	-----	18197.0	49.3
931	9/11/2025	0:19:13	00d	01:00.0	42.2	60	42.8	41.5	-:-	42.6	42.5	42.2	41.9	41.7	----	-----	16595.9	49.3
932	9/11/2025	0:20:13	00d	01:00.0	41.9	59.7	42.5	41	-:-	42.5	42.4	42	41.4	41.2	----	-----	15488.2	49.6
933	9/11/2025	0:21:13	00d	01:00.0	42.3	60.1	42.8	41.6	-:-	42.7	42.6	42.3	42.1	42	----	-----	16982.4	49.6
934	9/11/2025	0:22:13	00d	01:00.0	42.2	60	42.6	41.6	-:-	42.6	42.5	42.2	41.8	41.7	----	-----	16595.9	49.6
935	9/11/2025	0:23:13	00d	01:00.0	42.4	60.2	43	41.3	-:-	43	42.9	42.4	42	41.8	----	-----	17378.0	49.6
936	9/11/2025	0:24:13	00d	01:00.0	42.7	60.5	43.7	42.1	-:-	43.7	43.1	42.6	42.3	42.2	----	-----	18620.9	49.6
937	9/11/2025	0:25:13	00d	01:00.0	43.2	61	44.9	42.3	-:-	44.2	43.9	43.2	42.6	42.6	----	-----	20893.0	49.5
938	9/11/2025	0:26:13	00d	01:00.0	42.6	60.4	44.1	41.7	-:-	43.8	42.9	42.5	42.1	41.8	----	-----	18197.0	49.5
939	9/11/2025	0:27:13	00d	01:00.0	42.5	60.3	43.2	42	-:-	43.1	43.1	42.5	42.1	42.1	----	-----	17782.8	49.8
940	9/11/2025	0:28:13	00d	01:00.0	42.5	60.3	43.1	41.7	-:-	42.8	42.8	42.5	42.1	42	----	-----	17782.8	49.8
941	9/11/2025	0:29:13	00d	01:00.0	41.9	59.7	42.7	40.9	-:-	42.6	42.4	42.1	41.1	41	----	-----	15488.2	49.8
942	9/11/2025	0:30:13	00d	01:00.0	42.3	60.1	43.2	41.7	-:-	43.1	42.6	42.3	41.9	41.9	----	-----	16982.4	49.8
943	9/11/2025	0:31:13	00d	01:00.0	41.4	59.2	42.3	40.1	-:-	42.2	41.9	41.5	40.5	40.3	----	-----	13803.8	49.8
944	9/11/2025	0:32:13	00d	01:00.0	42.1	59.9	42.7	41.3	-:-	42.7	42.6	42.2	41.7	41.5	----	-----	16218.1	49.8
945	9/11/2025	0:33:13	00d	01:00.0	42	59.8	42.8	41.3	-:-	42.6	42.4	41.9	41.7	41.5	----	-----	15848.9	49.8
946	9/11/2025	0:34:13	00d	01:00.0	41.6	59.4	42.5	39.8	-:-	42.4	42.3	41.7	40.8	40.6	----	-----	14454.4	49.8
947	9/11/2025	0:35:13	00d	01:00.0	42.1	59.9	42.8	41.6	-:-	42.6	42.5	42.1	41.8	41.7	----	-----	16218.1	49.8
948	9/11/2025	0:36:13	00d	01:00.0	55.4	73.2	67.7	41.1	-:-	65.5	56.8	43.1	41.9	41.4	----	-----	346736.9	49.8
949	9/11/2025	0:37:13	00d	01:00.0	40.7	58.5	41.7	40	-:-	41.4	41.2	40.6	40.1	40.1	----	-----	11749.0	49.5
950	9/11/2025	0:38:13	00d	01:00.0	40.2	58	40.7	39.7	-:-	40.6	40.6	40.2	40	39.9	----	-----	10471.3	49.5
951	9/11/2025	0:39:13	00d	01:00.0	40.1	57.9	40.7	39.7	-:-	40.7	40.5	40.1	39.8	39.7	----	-----	10232.9	49.5
952	9/11/2025	0:40:13	00d	01:00.0	40.2	58	41	39.7	-:-	40.7	40.7	40.2	39.9	39.9	----	-----	10471.3	50.1
953	9/11/2025	0:41:13	00d	01:00.0	55.8	73.6	67.7	39.6	-:-	65.8	57.9	40.5	39.8	39.8	----	-----	380189.4	50.5
954	9/11/2025	0:42:13	00d	01:00.0	41.2	59	49.2	39.8	-:-	44.7	43.6	40.3	39.9	39.9	----	-----	13182.6	50.3
955	9/11/2025	0:43:13	00d	01:00.0	40	57.8	40.5	39.6	-:-	40.5	40.4	40.1	39.7	39.7	----	-----	10000.0	50.3
956	9/11/2025	0:44:13	00d	01:00.0	40	57.8	40.5	39.5	-:-	40.5	40.4	40	39.7	39.7	----	-----	10000.0	50.3
957	9/11/2025	0:45:13	00d	01:00.0	41.2	59	42.4	39.8	-:-	42.1	41.8	41.2	40.5	40.3	----	-----	13182.6	50.3
958	9/11/2025	0:46:13	00d	01:00.0	40.6	58.4	41.4	39.9	-:-	41.2	41.1	40.6	40.2	39.9	----	-----	11481.5	50.3
959	9/11/2025	0:47:13	00d	01:00.0	58.2	76	71.6	39.8	-:-	69.2	56.2	40.9	39.9	39.8	----	-----	660693.4	50.3
960	9/11/2025	0:48:13	00d	01:00.0	41.6	59.4	55.8	39.3	-:-	48	43.2	39.8	39.4	39.3	----	-----	14454.4	50.0
961	9/11/2025	0:49:13	00d	01:00.0	40.2	58	41.6	39.2	-:-	41.2	41.1	40.1	39.5	39.4	----	-----	10471.3	50.0
962	9/11/2025	0:50:13	00d	01:00.0	40.5	58.3	41.4	39.9	-:-	41.2	41	40.4	40	40	----	-----	11220.2	50.0
963	9/11/2025	0:51:13	00d	01:00.0	40.5	58.3	43.4	39.5	-:-	42.3	41.6	40.3	39.6	39.5	----	-----	11220.2	50.0
964	9/11/2025	0:52:13	00d	01:00.0	39.7	57.5	41.4	38.8	-:-	40.7	40.3	39.8	39.1	38.9	----	-----	9332.5	50.0
965	9/11/2025	0:53:13	00d	01:00.0	39.9	57.7	41	39.5	-:-	40.8	40.6	39.9	39.5	39.5	----	-----	9772.4	50.0
966	9/11/2025	0:54:13	00d	01:00.0	40.2	58	41.8	39.5	-:-	41	40.9	40	39.7	39.5	----	-----	10471.3	50.5
967	9/11/2025	0:55:13	00d	01:00.0	40.3	58.1	41.5	39.3	-:-	41.1	41	40.4	39.6	39.6	----	-----	10715.2	50.5
968	9/11/2025	0:56:13	00d	01:00.0	39.9	57.7	41.1	38.8	-:-	41	40.8	39.8	39.1	39	----	-----	9772.4	50.5
969	9/11/2025	0:57:13	00d	01:00.0	57.9	75.7	70.4	39.4	-:-	66.4	59.9	42.9	39.7	39.5	----	-----	616595.0	50.7
970	9/11/2025	0:58:13	00d	01:00.0	40.3	58.1	41.7	39.1	-:-	41.1	40.8	40.3	39.8	39.6	----	-----	10715.2	50.3
971	9/11/2025	0:59:13	00d	01:00.0	40	57.8	40.6	39.1	-:-	40.5	40.4	40	39.5	39.4	----	-----	10000.0	50.6
972	9/11/2025	1:00:13	00d	01:00.0	58.4	76.2	71.6	39.9	-:-	67	57.8	42.7	40.7	40.3	----	-----	691831.0	50.6
973	9/11/2025	1:01:13	00d	01:00.0	40.6	58.4	52	38.7	-:-	46.4	42	39.3	38.9	38.9	----	-----	11481.5	50.1
974	9/11/2025	1:02:13	00d	01:00.0	45.5	63.3	58.6	39.1	-:-	52.5	45.2	40.2	39.2	39.2	----	-----	35481.3	50.1
975	9/11/2025	1:03:13	00d	01:00.0	57.7	75.5	70.9	39	-:-	67	56.4	40	39.3	39.2	----	-----	588843.7	50.1
976	9/11/2025	1:04:13	00d	01:00.0	51.5	69.3	62.7	39.4	-:-	61.7	55.8	40.5	39.7	39.4	----	-----	141253.8	49.7
977	9/11/2025	1:05:13	00d	01:00.0	39.6	57.4	40.3	39	-:-	40.3	40	39.5	39.1	39.1	----	-----	9120.1	49.5
978	9/11/2025	1:06:13	00d	01:00.0	56.5	74.3	68.2	39.4	-:-	66.4	59.7	41	39.6	39.6	----	-----	446683.6	50.0

979	9/11/2025	1:07:13	00d	01:00.0	39.6	57.4	41	38.9	-:-	40.5	40.3	39.5	39.1	39	----	-----	9120.1	49.7
980	9/11/2025	1:08:13	00d	01:00.0	39.9	57.7	40.5	39.3	-:-	40.5	40.3	39.9	39.5	39.4	----	-----	9772.4	50.0
981	9/11/2025	1:09:13	00d	01:00.0	40.3	58.1	41.5	38.9	-:-	41.4	41	40.4	39.4	39.2	----	-----	10715.2	50.0
982	9/11/2025	1:10:13	00d	01:00.0	40.9	58.7	42.1	39.5	-:-	42.1	41.8	40.8	40.1	39.8	----	-----	12302.7	50.0
983	9/11/2025	1:11:13	00d	01:00.0	40.7	58.5	42.8	39.5	-:-	41.9	41.5	40.6	40	39.7	----	-----	11749.0	50.0
984	9/11/2025	1:12:13	00d	01:00.0	41.9	59.7	46.5	39.2	-:-	45.7	44.4	40.4	39.4	39.3	----	-----	15488.2	50.0
985	9/11/2025	1:13:13	00d	01:00.0	40	57.8	41.3	39.1	-:-	40.9	40.7	40	39.5	39.4	----	-----	10000.0	50.2
986	9/11/2025	1:14:13	00d	01:00.0	40.1	57.9	41	38.9	-:-	40.9	40.9	40	39.4	39.3	----	-----	10232.9	50.2
987	9/11/2025	1:15:13	00d	01:00.0	53.5	71.3	65.5	39.9	-:-	62.5	56.2	41.6	40.5	40.4	----	-----	223872.1	50.2
988	9/11/2025	1:16:13	00d	01:00.0	40.9	58.7	42.5	40.2	-:-	42.3	41.6	40.7	40.4	40.3	----	-----	12302.7	50.0
989	9/11/2025	1:17:13	00d	01:00.0	42.6	60.4	45.2	41	-:-	45.1	44.4	42	41.3	41.2	----	-----	18197.0	50.0
990	9/11/2025	1:18:13	00d	01:00.0	55.6	73.4	67.9	40.5	-:-	66.4	56.7	41.4	40.8	40.7	----	-----	363078.1	50.0
991	9/11/2025	1:19:13	00d	01:00.0	40.6	58.4	44.4	39.5	-:-	42.7	41.5	40.2	39.9	39.8	----	-----	11481.5	49.9
992	9/11/2025	1:20:13	00d	01:00.0	56	73.8	68.2	40.1	-:-	65.5	57.6	42.2	40.4	40.3	----	-----	398107.2	49.9
993	9/11/2025	1:21:13	00d	01:00.0	40	57.8	40.9	39.5	-:-	40.6	40.5	40	39.7	39.6	----	-----	10000.0	49.6
994	9/11/2025	1:22:13	00d	01:00.0	39.6	57.4	40.3	38.7	-:-	40.1	40.1	39.7	39	38.9	----	-----	9120.1	49.6
995	9/11/2025	1:23:13	00d	01:00.0	39.1	56.9	39.7	38.5	-:-	39.6	39.6	39	38.7	38.6	----	-----	8128.3	49.6
996	9/11/2025	1:24:13	00d	01:00.0	39.2	57	39.7	38.7	-:-	39.7	39.6	39.3	38.9	38.8	----	-----	8317.6	49.6
997	9/11/2025	1:25:13	00d	01:00.0	39.3	57.1	40.1	38.4	-:-	39.9	39.6	39.3	39	38.9	----	-----	8511.4	49.6
998	9/11/2025	1:26:13	00d	01:00.0	39.3	57.1	39.9	38.7	-:-	39.9	39.7	39.4	39	38.8	----	-----	8511.4	49.6
999	9/11/2025	1:27:13	00d	01:00.0	56.2	74	68.9	38.9	-:-	66.8	52.4	40.7	39.3	39.1	----	-----	416869.4	49.6
1000	9/11/2025	1:28:13	00d	01:00.0	44.4	62.2	67.3	38.2	-:-	52.4	46.2	38.8	38.4	38.3	----	-----	27542.3	49.2
1001	9/11/2025	1:29:13	00d	01:00.0	38.9	56.7	39.8	38.3	-:-	39.6	39.5	39	38.5	38.4	----	-----	7762.5	50.0
1002	9/11/2025	1:30:13	00d	01:00.0	38.6	56.4	39.2	38.1	-:-	39.2	39	38.6	38.3	38.3	----	-----	7244.4	50.0
1003	9/11/2025	1:31:13	00d	01:00.0	38.7	56.5	39.4	38.1	-:-	39.2	39.1	38.7	38.5	38.4	----	-----	7413.1	50.0
1004	9/11/2025	1:32:13	00d	01:00.0	39.2	57	40.7	38.2	-:-	40.1	39.7	39.3	38.7	38.5	----	-----	8317.6	50.0
1005	9/11/2025	1:33:13	00d	01:00.0	38.9	56.7	39.8	38.2	-:-	39.7	39.4	38.9	38.5	38.5	----	-----	7762.5	50.0
1006	9/11/2025	1:34:13	00d	01:00.0	38.9	56.7	39.5	38.6	-:-	39.3	39.2	38.9	38.7	38.6	----	-----	7762.5	50.0
1007	9/11/2025	1:35:13	00d	01:00.0	38.9	56.7	40.2	38.3	-:-	39.4	39.2	38.9	38.5	38.4	----	-----	7762.5	50.0
1008	9/11/2025	1:36:13	00d	01:00.0	39.4	57.2	41.1	38.3	-:-	40.2	39.8	39.4	39	38.7	----	-----	8709.6	50.0
1009	9/11/2025	1:37:13	00d	01:00.0	39.1	56.9	39.7	38.5	-:-	39.6	39.4	39.2	38.8	38.7	----	-----	8128.3	50.0
1010	9/11/2025	1:38:13	00d	01:00.0	38.8	56.6	39.7	38.2	-:-	39.6	39.2	38.7	38.4	38.3	----	-----	7585.8	50.0
1011	9/11/2025	1:39:13	00d	01:00.0	38.6	56.4	40.1	38.1	-:-	39.6	39.3	38.5	38.2	38.2	----	-----	7244.4	50.0
1012	9/11/2025	1:40:13	00d	01:00.0	58.9	76.7	71.7	38.4	-:-	67.8	60.9	41.1	38.7	38.6	----	-----	776247.1	50.0
1013	9/11/2025	1:41:13	00d	01:00.0	58	75.8	70.8	38.5	-:-	66.5	59.2	42.2	38.9	38.9	----	-----	630957.3	49.4
1014	9/11/2025	1:42:13	00d	01:00.0	38.9	56.7	39.7	38	-:-	39.6	39.5	39	38.3	38.2	----	-----	7762.5	48.8
1015	9/11/2025	1:43:13	00d	01:00.0	38.6	56.4	39.3	38.1	-:-	39.1	39	38.6	38.3	38.2	----	-----	7244.4	48.8
1016	9/11/2025	1:44:13	00d	01:00.0	38.3	56.1	38.8	37.7	-:-	38.8	38.7	38.4	38.1	37.9	----	-----	6760.8	48.8
1017	9/11/2025	1:45:13	00d	01:00.0	38.6	56.4	39.4	37.9	-:-	39.2	39.1	38.6	38.1	38.1	----	-----	7244.4	48.8
1018	9/11/2025	1:46:13	00d	01:00.0	38.5	56.3	39.1	37.8	-:-	39.1	39	38.5	38	38	----	-----	7079.5	48.8
1019	9/11/2025	1:47:13	00d	01:00.0	38.3	56.1	38.8	37.7	-:-	38.6	38.5	38.3	38	37.9	----	-----	6760.8	48.8
1020	9/11/2025	1:48:13	00d	01:00.0	54.8	72.6	66.8	38.1	-:-	66.4	56.9	40.6	38.4	38.3	----	-----	301995.2	48.8
1021	9/11/2025	1:49:13	00d	01:00.0	38.4	56.2	39.2	37.8	-:-	39.2	38.8	38.3	38.1	37.9	----	-----	6918.3	48.9
1022	9/11/2025	1:50:13	00d	01:00.0	38.4	56.2	38.8	38.1	-:-	38.8	38.7	38.4	38.2	38.1	----	-----	6918.3	48.9
1023	9/11/2025	1:51:13	00d	01:00.0	38.3	56.1	39.6	37.5	-:-	38.9	38.9	38.4	37.8	37.8	----	-----	6760.8	48.9
1024	9/11/2025	1:52:13	00d	01:00.0	38.2	56	39.9	37.5	-:-	38.8	38.5	38.2	37.8	37.8	----	-----	6606.9	48.9
1025	9/11/2025	1:53:13	00d	01:00.0	38.5	56.3	40	37.6	-:-	39.8	39.5	38.3	37.8	37.7	----	-----	7079.5	48.9
1026	9/11/2025	1:54:13	00d	01:00.0	58.8	76.6	70.9	38.1	-:-	68.9	61.5	47.3	38.7	38.3	----	-----	758577.6	48.9
1027	9/11/2025	1:55:13	00d	01:00.0	37.7	55.5	38.2	37.1	-:-	38.1	38.1	37.8	37.3	37.2	----	-----	5888.4	48.5
1028	9/11/2025	1:56:13	00d	01:00.0	37.4	55.2	37.7	37	-:-	37.7	37.6	37.4	37.1	37.1	----	-----	5495.4	48.5
1029	9/11/2025	1:57:13	00d	01:00.0	55.4	73.2	67.4	37.1	-:-	65.8	58.6	41.9	38.1	37.7	----	-----	346736.9	48.5
1030	9/11/2025	1:58:13	00d	01:00.0	38.2	56	38.9	37.4	-:-	38.7	38.6	38.2	37.6	37.6	----	-----	6606.9	48.1
1031	9/11/2025	1:59:13	00d	01:00.0	55.9	73.7	68.7	37.3	-:-	66.4	57.1	38.8	37.6	37.4	----	-----	389045.1	48.1
1032	9/11/2025	2:00:13	00d	01:00.0	39.5	57.3	50.8	37.5	-:-	45.3	40.9	38.2	37.7	37.6	----	-----	8912.5	47.7
1033	9/11/2025	2:01:13	00d	01:00.0	38	55.8	38.4	37.6	-:-	38.3	38.2	38	37.8	37.8	----	-----	6309.6	47.7
1034	9/11/2025	2:02:13	00d	01:00.0	38.4	56.2	39.3	37.8	-:-	39.1	39	38.4	38	37.9	----	-----	6918.3	47.7
1035	9/11/2025	2:03:13	00d	01:00.0	38.9	56.7	39.3	38.5	-:-	39.3	39.2	39	38.7	38.5	----	-----	7762.5	47.7
1036	9/11/2025	2:04:13	00d	01:00.0	38.3	56.1	39.1	37.8	-:-	39	38.8	38.2	37.9	37.9	----	-----	6760.8	47.7
1037	9/11/2025	2:05:13	00d	01:00.0	38.2	56	38.8	37.8	-:-	38.7	38.6	38.2	38	37.9	----	-----	6606.9	47.7
1038	9/11/2025	2:06:13	00d	01:00.0	58.1	75.9	70.6	38.8	-:-	67.3	60.8	40.7	39.4	39.2	----	-----	645654.2	47.7
1039	9/11/2025	2:07:13	00d	01:00.0	39.8	57.6	44.1	37.8	-:-	42.5	41.4	39.2	38.2	37.9	----	-----	9549.9	46.8
1040	9/11/2025	2:08:13	00d	01:00.0	56.1	73.9	68.4	38.9	-:-	64.8	58.1	42.4	39.9	38.9	----	-----	407380.3	46.8
1041	9/11/2025	2:09:13	00d	01:00.0	38.4	56.2	39.4	37.7	-:-	38.9	38.9	38.4	37.9	37.9	----	-----	6918.3	46.2
1042	9/11/2025	2:10:13	00d	01:00.0	37.9	55.7	38.2	37.6	-:-	38.1	38.1	37.9	37.7	37.6	----	-----	6166.0	46.2
1043	9/11/2025	2:11:13	00d	01:00.0	38.1	55.9	38.8	37.7	-:-	38.7	38.6	38	37.8	37.8	----	-----	6456.5	46.2
1044	9/11/2025	2:12:13	00d	01:00.0	38.4	56.2	42.6	37.8	-:-	39.7	38.7	38.1	37.9	37.8	----	-----	6918.3	46.2
1045	9/11/2025	2:13:13	00d	01:00.0	54.4	72.2	66.2	38.4	-:-	65	57.8	39.7	38.6	38.6	----	-----	275422.9	46.4
1046	9/11/2025	2:14:13	00d	01:00.0	38.3	56.1	38.9	37.7	-:-	38.8	38.7	38.3	37.9	37.8	----	-----	6760.8	46.0
1047	9/11/2025	2:15:13	00d	01:00.0	38.7	56.5	40.2	37.7	-:-	40	39.7	38.5	38	37.9	----	-----	7413.1	46.5
1048	9/11/2025	2:16:13	00d	01:00.0	38.3	56.1	40	37.6	-:-	39.4	39.1	38.1	37.7	37.7	----	-----	6760.8	46.5
1049	9/11/2025	2:17:13	00d	01:00.0	39.6	57.4	43.7	37.7	-:-	43.1	42.4	38.6	38	37.9	----	-----	9120.1	46.5
1050	9/11/2025	2:18:13	00d	01:00.0	38	55.8	39.1	37.5	-:-	38.4	38.3	38	37.6	37.6	----	-----	6309.6	46.5
1051	9/11/2025	2:19:13	00d	01:00.0	53.3	71.1	65.3	37.7	-:-	64.1	54.4	40.3	37.8	37.8	----	-----	213796.2	46.5
1052	9/11/2025	2:20:13	00d	01:00.0	38	55.8	39	37.4	-:-	38.6	38.5	38	37.7	37.6	----	-----	6309.6	46.2
1053	9/11/2025	2:21:13	00d	01:00.0	38.4	56.2	39.2	37.8	-:-	39.1	38.9	38.3	38	37.9	----	-----	6918.3	46.7
1054	9/11/2025	2:22:13	00d	01:00.0	38.3	56.1	38.9	37.4	-:-	38.9	38.7	38.4	37.6	37.5	----	-----	6760.8	46.7
1055	9/11/2025	2:23:13	00d	01:00.0	38.3	56.1	38.8	37.9	-:-	38.7	38.7	38.3	38	38	----	-----	6760.8	46.7
1056	9/11/2025	2:24:13	00d	01:00.0	38	55.8	38.4	37.6	-:-	38.4	38.3	38.1	37.7	37.7	----	-----	6309.6	46.7
1057	9/11/2025	2:25:13	00d	01:00.0	38.7	56.5	40.1	37.9	-:-	39.6	39.6	38.6	38.1	38	----	-----	7413.1	47.8
1058	9/11/2025	2:26:13	00d	01:00.0	39.4	57.2	41.9	38.4	-:-	40.5	40.3	39.3	38.6	38.5	----	-----	8709.6	47.8
1059	9/11/2025	2:27:13	00d	01:00.0	38.1	55.9	38.6	37.6	-:-	38.5	38.5	38.1	37.8	37.8	----	-----	6456.5	47.9
1060	9/11/2025	2:28:13	00d	01:00.0	37.6	55.4	38.4	36.9	-:-	38.1	38	37.7	37.1	37	----	-----	5754.4	49.2
1061	9/11/2025	2:29:13	00d	01:00.0	59.8	77.6	70.8	37	-:-	69.4	65.8	41.9	37.4	37.3	----	-----	954992.6	49.2
1062	9/11/2025	2:30:13	00d	01:00.0	38.6	56.4	40.3	37.4	-:-	40	39.9	38.3	37.7	37.6	----	-----	7244.4	48.4
1063	9/11/2025	2:31:13	00d	01:00.0	39.6	57.4	42.7	37.6	-:-	42.3	42	38.6	37.8	37.8	----	-----	9120.1	48.4
1064	9/11/2025	2:32:13	00d	01:00.0	37.7	55.5	38.8	37.2	-:-	38.5	38.2	37.6	37.4	37.3	----	-----	5888.4	48.4
1065	9/11/2025	2:33:13	00d	01:00.0	37.8	55.6	38.4	36.9	-:-	38.4	38.3	37.8	37.1	37	----	-----	6025.6	48.4
1066	9/11/2025	2:34:13	00d	01:00.0	37.6	55.4	38.4	36.8	-:-	38.4	38.3	37.6	37	37	----	-----	5754.4	48.4
1067	9/11/2025	2:35:13	00d	01:00.0	38.4	56.2	41.9	37.2	-:-	40.9	39.7	38	37.6	37.4	----	-----	6918.3	48.4
1068	9/11/2025	2:36:13	00d	01:00.0	37.2	55	38	36.7	-:-	37.8	37.8	37.2	36.9	36.8	----	-----	5248.1	48.4
1069	9/11/2025	2:37:13	00d	01:00.0	37.3	55.1	37.9	36.7	-:-	37.8	37.7	37.2	37	36.9	----	-----	5370.3	48.4
1070	9/11/2025	2:38:13	00d	01:00.0	37.1	54.9	37.4	36.8	-:-	37.4	37.4	37.1	36.9	36.8	----	-----	5128.6	48.4
1071	9/11/2025	2:39:13	00d	01:00.0	37.5	55.3	37.9	36.6	-:-	38	37.9	37.6	37	36.8	----	-----	5623.4	48.4
1072	9/11/2025	2:40:13	00d	01:00.0	37.4	55.2	38.2	36.6	-:-	38	37.8	37.4	36.9	36.8	----	-----	5495.4	48.8
1073	9/11/2025	2:41:13	00d	01:00.0	37	54.8	37.6	36.6	-:-	37.4	37.3	37	36.8	36.7	----	-----	5011.9	48.8
1074	9/11/2025	2:42:13	00d	01:00.0	36.8	54.6	37.2	36.4	-:-	37.1	37	36.8	36.5	36.5	----	-----	4786.3	48.8
1075	9/11/2025	2:43:13	00d	01:00.0	37	54.8	37.5	36.5	-:-	37.3	37.3	37	36.7	36.7	----	-----	5011.9	49.1
1076	9/11/2025	2:44:13	00d	01:00.0	37.1	54.9	38	36.4	-:-	37.9	37.6	37.1	36.7	36.6	----	-----	5128.6	49.1
1077	9/11/2025	2:45:13	00d	01:00.0	36.7	54.5	38.6	36.2	-:-	37.2	37.1	36.7	36.4	36.3	----	-----	4677.4	49.4
1078	9/11/2025	2:46:13	00d	01:00.0	36.9	54.7	37.9	36.3	-:-	37.7	37.3	36.9	36.6	36.5	----	-----	4897.8	49.5
1079	9/11/2025	2:47:13	00d	01:00.0	37	54.8	38.3	36.4	-:-	37.9	37.8	36.8	36.5	36.4	----	-----	5011.9	49.5
1080	9/11/2025	2:48:13	00d	01:00.0	37.5	55.3	38.6	36.6	-:-	38.5	38.4	37.6	36.9	36.9	----	-----	5623.4	49.5
1081	9/11/2025	2:49:13	00d	01:00.0	55.9	73.7	68.7	37.7	-:-	65.1	56.4	41.2	38.2	38	----	-----	389045.1	49.5
1082	9/11/2025	2:50:13	00d	01:00.0	37.1	54.9	37.9	36.5	-:-	37.6	37.5	37.2	36.7	36.7	----	-----	5128.6	49.1
1083	9/11/2025	2:51:13	00d	01:00.0	37.5	55.3	38.7	36.6	-:-	38.6	38.5	37.4	36.8	36.6	----	-----	5623.4	49.7
1084	9/11/2025	2:52:13	00d	01:00.0	37.7	55.5	41.2	36.8	-:-	39.6	38.3	37.5	37	36.9	----	-----	5888.4	50.3
1085	9/11/2025	2:53:13	00d	01:00.0	37.5	55.3	38.2	36.8	-:-	38	37.9	37.5	37.1	37.1	----	-----	5623.4	50.3
1086	9/11/2025	2:54:13	00d	01:00.0	38.7	56.5	41.2	37.3	-:-	40.9	40.6	38.6	37.6	37.6	----	-----	7413.1	50.3
1087	9/11/2025	2:55:13	00d	01:00.0	55.6	73.4	68.8	37	-:-	64.1	55.2	37.9	37.2	37.1	----	-----	363078.1	50.3

1088	9/11/2025	2:56:13	00d	01:00.0	38.4	56.2	42.2	37	-:-	40.3	39.8	38	37.4	37.1	----	-----	6918.3	50.0
1089	9/11/2025	2:57:13	00d	01:00.0	37.4	55.2	38.8	36.8	-:-	38.5	37.8	37.3	37	37	----	-----	5495.4	50.0
1090	9/11/2025	2:58:13	00d	01:00.0	37.4	55.2	38.4	36.8	-:-	38.2	37.8	37.3	37	36.9	----	-----	5495.4	50.2
1091	9/11/2025	2:59:13	00d	01:00.0	37.5	55.3	39.6	36.8	-:-	38.8	37.9	37.4	37	37	----	-----	5623.4	50.4
1092	9/11/2025	3:00:13	00d	01:00.0	40.9	58.7	46.3	36.9	-:-	44.8	44	40.3	37.4	37.2	----	-----	12302.7	50.5
1093	9/11/2025	3:01:13	00d	01:00.0	37.7	55.5	40	36.9	-:-	38.4	38.4	37.8	37.1	37	----	-----	5888.4	50.5
1094	9/11/2025	3:02:13	00d	01:00.0	38.2	56	41.9	37.4	-:-	39.8	38.9	37.9	37.6	37.6	----	-----	6606.9	50.5
1095	9/11/2025	3:03:13	00d	01:00.0	37.7	55.5	39.2	37.1	-:-	38.4	38.2	37.7	37.3	37.3	----	-----	5888.4	50.5
1096	9/11/2025	3:04:13	00d	01:00.0	36.8	54.6	37.5	36.1	-:-	37.4	37.4	36.8	36.2	36.2	----	-----	4786.3	50.6
1097	9/11/2025	3:05:13	00d	01:00.0	37	54.8	37.6	36.4	-:-	37.6	37.4	36.9	36.6	36.6	----	-----	5011.9	50.8
1098	9/11/2025	3:06:13	00d	01:00.0	38.7	56.5	41.2	36.8	-:-	40.9	40.2	38.3	37.7	37.4	----	-----	7413.1	50.8
1099	9/11/2025	3:07:13	00d	01:00.0	37.5	55.3	38.8	36.6	-:-	38.4	38.4	37.5	36.7	36.7	----	-----	5623.4	51.0
1100	9/11/2025	3:08:13	00d	01:00.0	36.6	54.4	37.5	35.9	-:-	37.4	37	36.6	36.1	36.1	----	-----	4570.9	51.0
1101	9/11/2025	3:09:13	00d	01:00.0	36.6	54.4	37.1	36	-:-	37.1	37	36.6	36.1	36.1	----	-----	4570.9	51.0
1102	9/11/2025	3:10:13	00d	01:00.0	36.5	54.3	37.3	36.1	-:-	37.2	36.9	36.5	36.1	36.1	----	-----	4466.8	51.0
1103	9/11/2025	3:11:13	00d	01:00.0	36.4	54.2	37.8	35.6	-:-	37.6	37.5	36.2	35.8	35.7	----	-----	4365.2	51.5
1104	9/11/2025	3:12:13	00d	01:00.0	37.4	55.2	43.5	35.5	-:-	42	39.1	36.2	35.7	35.6	----	-----	5495.4	52.0
1105	9/11/2025	3:13:13	00d	01:00.0	51.5	69.3	63.4	35.7	-:-	61.5	55.5	37.7	36.1	35.8	----	-----	141253.8	52.0
1106	9/11/2025	3:14:13	00d	01:00.0	38.7	56.5	39.7	37.5	-:-	39.5	39.2	38.6	38.4	38.3	----	-----	7413.1	52.2
1107	9/11/2025	3:15:13	00d	01:00.0	55.5	73.3	67.9	37.3	-:-	66.3	57.1	39.8	38.4	37.8	----	-----	354813.4	52.3
1108	9/11/2025	3:16:13	00d	01:00.0	39.4	57.2	44.6	37.8	-:-	40.5	39.9	39.3	38.4	38.1	----	-----	8709.6	52.2
1109	9/11/2025	3:17:13	00d	01:00.0	38.3	56.1	39.6	36.2	-:-	39.5	39.4	38.7	36.4	36.3	----	-----	6760.8	52.2
1110	9/11/2025	3:18:13	00d	01:00.0	39	56.8	39.5	37.6	-:-	39.4	39.3	39.1	38.4	37.9	----	-----	7943.3	52.2
1111	9/11/2025	3:19:13	00d	01:00.0	39	56.8	40.1	37.7	-:-	39.6	39.5	39.1	37.9	37.8	----	-----	7943.3	52.2
1112	9/11/2025	3:20:13	00d	01:00.0	40.4	58.2	42.7	38.1	-:-	42.1	41.5	40.3	39.1	38.6	----	-----	10964.8	52.4
1113	9/11/2025	3:21:13	00d	01:00.0	55.1	72.9	68	39.2	-:-	64.1	54.6	41.7	39.5	39.4	----	-----	323593.7	52.4
1114	9/11/2025	3:22:13	00d	01:00.0	40.8	58.6	43.5	36.7	-:-	43.3	43.1	41.3	37	36.9	----	-----	12022.6	52.3
1115	9/11/2025	3:23:13	00d	01:00.0	37.3	55.1	41.3	36.4	-:-	38.3	37.8	37.3	36.6	36.5	----	-----	5370.3	52.5
1116	9/11/2025	3:24:13	00d	01:00.0	39.1	56.9	40.4	37.1	-:-	40.3	40.1	39.3	37.6	37.4	----	-----	8128.3	53.0
1117	9/11/2025	3:25:13	00d	01:00.0	58.9	76.7	71.4	38.1	-:-	69.6	60.3	41.6	39.4	38.9	----	-----	776247.1	53.0
1118	9/11/2025	3:26:13	00d	01:00.0	40.5	58.3	41.6	38.5	-:-	41.4	41.3	40.9	38.9	38.5	----	-----	11220.2	52.8
1119	9/11/2025	3:27:13	00d	01:00.0	51.4	69.2	66.4	39.4	-:-	56.4	46.5	41.4	41	40.6	----	-----	138038.4	52.9
1120	9/11/2025	3:28:13	00d	01:00.0	61	78.8	71.9	40.9	-:-	70.5	66.1	42.1	41.6	41.3	----	-----	1258925.4	52.8
1121	9/11/2025	3:29:13	00d	01:00.0	40.2	58	41.9	37.1	-:-	41.8	41.6	40.9	37.9	37.3	----	-----	10471.3	52.4
1122	9/11/2025	3:30:13	00d	01:00.0	52.7	70.5	64.4	35.9	-:-	63.9	55.7	37.8	36.1	36	----	-----	186208.7	52.5
1123	9/11/2025	3:31:13	00d	01:00.0	37.4	55.2	45	36	-:-	40	39.2	36.9	36.3	36.2	----	-----	5495.4	52.7
1124	9/11/2025	3:32:13	00d	01:00.0	36.3	54.1	37.1	35.7	-:-	36.9	36.8	36.2	35.9	35.8	----	-----	4265.8	52.8
1125	9/11/2025	3:33:13	00d	01:00.0	36.5	54.3	41.7	35.4	-:-	38.4	38	35.9	35.5	35.5	----	-----	4466.8	52.8
1126	9/11/2025	3:34:13	00d	01:00.0	35.3	53.1	36.1	34.9	-:-	36	35.8	35.3	35	35	----	-----	3388.4	53.0
1127	9/11/2025	3:35:13	00d	01:00.0	35.8	53.6	36.4	35.3	-:-	36.3	36.2	35.8	35.4	35.4	----	-----	3801.9	53.2
1128	9/11/2025	3:36:13	00d	01:00.0	36.2	54	37	35.3	-:-	36.8	36.8	36.2	35.6	35.4	----	-----	4168.7	53.2
1129	9/11/2025	3:37:13	00d	01:00.0	36.9	54.7	37.7	36.1	-:-	37.6	37.4	36.9	36.5	36.3	----	-----	4897.8	53.2
1130	9/11/2025	3:38:13	00d	01:00.0	36.7	54.5	37.5	35.6	-:-	37.6	37.4	36.8	36.1	36	----	-----	4677.4	53.3
1131	9/11/2025	3:39:13	00d	01:00.0	38.3	56.1	43.1	36.2	-:-	41	40.9	37.2	36.5	36.3	----	-----	6760.8	53.3
1132	9/11/2025	3:40:13	00d	01:00.0	56.3	74.1	65.7	35.6	-:-	66	62.4	43.4	35.9	35.7	----	-----	426579.5	53.6
1133	9/11/2025	3:41:13	00d	01:00.0	39.7	57.5	50.7	36	-:-	45.3	42.2	37.4	36.3	36.2	----	-----	9332.5	53.4
1134	9/11/2025	3:42:13	00d	01:00.0	36.8	54.6	37.8	36.2	-:-	37.6	37.5	36.6	36.4	36.4	----	-----	4786.3	53.6
1135	9/11/2025	3:43:13	00d	01:00.0	55.1	72.9	67.8	35.2	-:-	65.1	56.2	38	35.7	35.5	----	-----	323593.7	53.6
1136	9/11/2025	3:44:13	00d	01:00.0	39.4	57.2	40.8	36.4	-:-	40.7	40.7	39.9	37.5	37	----	-----	8709.6	53.6
1137	9/11/2025	3:45:13	00d	01:00.0	55.7	73.5	67.9	38.7	-:-	64.4	56.1	40.9	40.3	39.9	----	-----	371535.2	53.7
1138	9/11/2025	3:46:13	00d	01:00.0	43	60.8	56.9	37.9	-:-	49.3	45	41.4	40.3	39.2	----	-----	19952.6	53.6
1139	9/11/2025	3:47:13	00d	01:00.0	39.8	57.6	41.2	35.5	-:-	41	41	40.6	36	35.8	----	-----	9549.9	54.0
1140	9/11/2025	3:48:13	00d	01:00.0	38.9	56.7	41.6	36.3	-:-	41.3	41.2	38	36.6	36.5	----	-----	7762.5	54.0
1141	9/11/2025	3:49:13	00d	01:00.0	36.3	54.1	37.8	35.7	-:-	37.3	37	36.3	35.9	35.9	----	-----	4265.8	54.1
1142	9/11/2025	3:50:13	00d	01:00.0	36.3	54.1	37.2	35.8	-:-	36.8	36.6	36.3	35.9	35.9	----	-----	4265.8	54.5
1143	9/11/2025	3:51:13	00d	01:00.0	58.4	76.2	70.9	36.2	-:-	69.9	60.6	40	36.4	36.3	----	-----	691831.0	54.6
1144	9/11/2025	3:52:13	00d	01:00.0	59.1	76.9	72.8	37.6	-:-	68.9	57.2	43.3	39.6	38.5	----	-----	812830.5	54.6
1145	9/11/2025	3:53:13	00d	01:00.0	36.8	54.6	38.4	35.7	-:-	38.4	37.6	36.8	36	35.8	----	-----	4786.3	54.4
1146	9/11/2025	3:54:13	00d	01:00.0	37.8	55.6	40.3	36.8	-:-	39.7	38.9	37.5	37	36.9	----	-----	6025.6	54.4
1147	9/11/2025	3:55:13	00d	01:00.0	40.1	57.9	46.2	36.6	-:-	45.8	44.2	37.6	37.1	36.8	----	-----	10232.9	54.4
1148	9/11/2025	3:56:13	00d	01:00.0	39.1	56.9	44.4	35.8	-:-	43.8	42	36.7	36	36	----	-----	8128.3	54.4
1149	9/11/2025	3:57:13	00d	01:00.0	36.3	54.1	37.6	35.5	-:-	37.3	37.1	36.2	35.7	35.6	----	-----	4265.8	54.4
1150	9/11/2025	3:58:13	00d	01:00.0	52.9	70.7	64.7	37.6	-:-	63	55.5	40	38.1	38	----	-----	194984.5	54.4
1151	9/11/2025	3:59:13	00d	01:00.0	56.3	74.1	68.8	36.6	-:-	65.7	56.1	38.5	36.9	36.7	----	-----	426579.5	54.6
1152	9/11/2025	4:00:13	00d	01:00.0	45.1	62.9	64.6	37.6	-:-	51.1	46.1	39.8	38.9	38.4	----	-----	32359.4	54.5
1153	9/11/2025	4:01:13	00d	01:00.0	36.5	54.3	38.8	35.2	-:-	38.5	38.1	36.3	35.5	35.5	----	-----	4466.8	54.6
1154	9/11/2025	4:02:13	00d	01:00.0	37.5	55.3	39.8	35.7	-:-	39.6	38.9	37.2	36.1	36	----	-----	5623.4	54.6
1155	9/11/2025	4:03:13	00d	01:00.0	38	55.8	41	35.8	-:-	40.6	40.2	37.5	36.2	36	----	-----	6309.6	55.0
1156	9/11/2025	4:04:13	00d	01:00.0	53.5	71.3	68.7	35.8	-:-	55.8	50	36.7	36.1	36	----	-----	223872.1	55.1
1157	9/11/2025	4:05:13	00d	01:00.0	55.4	73.2	69.9	35.9	-:-	64.5	50.8	38.3	36.1	36	----	-----	346736.9	55.1
1158	9/11/2025	4:06:13	00d	01:00.0	36.3	54.1	37.2	35.2	-:-	37.2	37	36.4	35.5	35.4	----	-----	4265.8	55.0
1159	9/11/2025	4:07:13	00d	01:00.0	55.2	73	67.4	35.6	-:-	65.8	56.8	39	35.8	35.6	----	-----	331131.1	55.0
1160	9/11/2025	4:08:13	00d	01:00.0	36.2	54	36.7	35.6	-:-	36.7	36.6	36.2	36	35.9	----	-----	4168.7	55.1
1161	9/11/2025	4:09:13	00d	01:00.0	36.3	54.1	37.8	35.3	-:-	37.4	36.9	36.3	35.8	35.7	----	-----	4265.8	55.6
1162	9/11/2025	4:10:13	00d	01:00.0	37.7	55.5	41.7	35.3	-:-	41	40	37.3	35.6	35.5	----	-----	5888.4	55.6
1163	9/11/2025	4:11:13	00d	01:00.0	59.4	77.2	70.2	35.9	-:-	69.1	66.3	40.9	36.5	36.1	----	-----	870963.6	55.7
1164	9/11/2025	4:12:13	00d	01:00.0	60.3	78.1	73.3	35.7	-:-	68.1	61.6	44.5	36.8	36.1	----	-----	1071519.3	55.5
1165	9/11/2025	4:13:13	00d	01:00.0	40.9	58.7	47.6	36.3	-:-	47.3	45.3	38.8	36.4	36.4	----	-----	12302.7	55.6
1166	9/11/2025	4:14:13	00d	01:00.0	57.5	75.3	70	37.5	-:-	65.1	59	40.2	37.7	37.5	----	-----	562341.3	55.7
1167	9/11/2025	4:15:13	00d	01:00.0	55.6	73.4	67.7	36.4	-:-	66.1	58.6	40.6	36.8	36.6	----	-----	363078.1	55.7
1168	9/11/2025	4:16:13	00d	01:00.0	37.3	55.1	39.4	36.2	-:-	38.2	37.9	37.2	36.7	36.5	----	-----	5370.3	55.7
1169	9/11/2025	4:17:13	00d	01:00.0	36.8	54.6	38.1	36.1	-:-	37.9	37.7	36.7	36.3	36.2	----	-----	4786.3	56.0
1170	9/11/2025	4:18:13	00d	01:00.0	37.9	55.7	39.1	36.5	-:-	38.9	38.7	37.8	37.2	36.8	----	-----	6166.0	56.0
1171	9/11/2025	4:19:13	00d	01:00.0	38.5	56.3	42.1	36.3	-:-	41.7	40.4	38	36.7	36.7	----	-----	7079.5	56.3
1172	9/11/2025	4:20:13	00d	01:00.0	58.1	75.9	71.1	37.4	-:-	68.1	56	40.4	38.6	38	----	-----	645654.2	56.9
1173	9/11/2025	4:21:13	00d	01:00.0	46.3	64.1	69.1	36.6	-:-	53.8	50.3	39.3	37	36.8	----	-----	42658.0	57.0
1174	9/11/2025	4:22:13	00d	01:00.0	37.3	55.1	38.9	36.7	-:-	38	37.7	37.3	36.9	36.8	----	-----	5370.3	57.0
1175	9/11/2025	4:23:13	00d	01:00.0	57.4	75.2	69.9	37.4	-:-	67.5	59.5	40.9	38.2	37.9	----	-----	549540.9	57.1
1176	9/11/2025	4:24:13	00d	01:00.0	61.4	79.2	72.9	37.6	-:-	70.2	67.4	42.3	38.6	38.1	----	-----	1380384.3	57.0
1177	9/11/2025	4:25:13	00d	01:00.0	37.8	55.6	39.1	36.3	-:-	38.8	38.7	37.8	36.8	36.6	----	-----	6025.6	57.0
1178	9/11/2025	4:26:13	00d	01:00.0	36.9	54.7	37.9	36.5	-:-	37.7	37.2	36.9	36.6	36.6	----	-----	4897.8	57.1
1179	9/11/2025	4:27:13	00d	01:00.0	55.3	73.1	67.7	36.4	-:-	65.7	56.1	37.9	36.9	36.7	----	-----	338844.2	57.2
1180	9/11/2025	4:28:13	00d	01:00.0	37.3	55.1	44.6	36.6	-:-	39.2	38.2	37	36.7	36.6	----	-----	5370.3	57.2
1181	9/11/2025	4:29:13	00d	01:00.0	53	70.8	64.5	37	-:-	63.2	57.2	41.1	37.8	37.3	----	-----	199526.2	57.3
1182	9/11/2025	4:30:13	00d	01:00.0	54.4	72.2	66.6	38.1	-:-	65.3	54	39.9	38.6	38.2	----	-----	275422.9	57.5
1183	9/11/2025	4:31:13	00d	01:00.0	58	75.8	70.8	37.9	-:-	67.2	57	39.9	38	38	----	-----	630957.3	57.5
1184	9/11/2025	4:32:13	00d	01:00.0	53.5	71.3	65.8	38.1	-:-	64.4	51.7	39.6	38.3	38.2	----	-----	223872.1	57.5
1185	9/11/2025	4:33:13	00d	01:00.0	52.6	70.4	63.2	40.8	-:-	60.1	57.9	45.3	41.5	41.1	----	-----	181970.1	57.4
1186	9/11/2025	4:34:13	00d	01:00.0	56.8	74.6	69.4	37	-:-	67.2	57.4	40.9	37.6	37.2	----	-----	478630.1	57.5
1187	9/11/2025	4:35:13	00d	01:00.0	57.6	75.4	70.2	37.2	-:-	68.7	58.9	40.2	37.5	37.3	----	-----	575439.9	57.6
1188	9/11/2025	4:36:13	00d	01:00.0	36.8	54.6	38	35.9	-:-	37.7	37.6	36.8	36.2	36.1	----	-----	4786.3	57.7
1189	9/11/2025	4:37:13	00d	01:00.0	36.7	54.5	38.1	35.7	-:-	37.8	37.5	36.7	36	35.9	----	-----	4677.4	57.9
1190	9/11/2025	4:38:13	00d	01:00.0	54.3	72.1	67	36.5	-:-	64.2	54.9	38.7	36.8	36.6	----	-----	269153.5	57.9
1191	9/11/2025	4:39:13	00d	01:00.0	39.2	57	46.4	36.5	-:-	44.1	41.5	37.5	36.7	36.7	----	-----	8317.6	58.0
1192	9/11/2025	4:40:13	00d	01:00.0	58.9	76.7	71.5	40.6	-:-	67.9	60	46	42.1	41.7	----	-----	776247.1	58.1
1193	9/11/2025	4:41:13	00d	01:00.0	39.6	57.4	41.3	38.6	-:-	41	40.4	39.5	39	38.8	----	-----	9120.1	58.1
1194	9/11/2025	4:42:13	00d	01:00.0	56.9	74.7	69.6	38.2	-:-	68.1	55.2	41.3	39.4	38.9	----	-----	489778.8	58.5
1195	9/11/2025	4:43:13	00d	01:00.0	38.9	56.7	42.1	37	-:-	40.6	40	38.5	37.6	37.2	----	-----	7762.5	58.5
1196	9/11/2025	4:44:13	00d	01:00.0	55.1	72.9	68.2	38.4	-:-	65.5	53.5	40.6	38.8	38.7	----	-----	323593.7	58.7

1197	9/11/2025	4:45:13	00d	01:00.0	55.3	73.1	68.2	37.9	-:-	65.5	54.7	39.1	38.2	38	----	-----	338844.2	58.9
1198	9/11/2025	4:46:13	00d	01:00.0	41.2	59	53.9	36.9	-:-	44.6	42.1	41.1	37.8	37	----	-----	13182.6	59.0
1199	9/11/2025	4:47:13	00d	01:00.0	61.5	79.3	73.2	38.9	-:-	69	67.2	48.3	40.9	39	----	-----	1412537.5	59.3
1200	9/11/2025	4:48:13	00d	01:00.0	41.9	59.7	45.8	39.2	-:-	45	44.7	40.4	39.7	39.3	----	-----	15488.2	59.3
1201	9/11/2025	4:49:13	00d	01:00.0	55	72.8	68	39.9	-:-	63.1	54.7	41.7	40.1	40.1	----	-----	316227.8	59.4
1202	9/11/2025	4:50:13	00d	01:00.0	62.1	79.9	72.9	43	-:-	71.2	67.5	50.1	44.3	43.7	----	-----	1621810.1	59.4
1203	9/11/2025	4:51:13	00d	01:00.0	57	74.8	69.6	40.7	-:-	66.5	56.9	42.5	41.4	41	----	-----	501187.2	59.3
1204	9/11/2025	4:52:13	00d	01:00.0	56.2	74	69.2	37.1	-:-	67.3	55.9	38.8	37.4	37.2	----	-----	416869.4	59.3
1205	9/11/2025	4:53:13	00d	01:00.0	39.7	57.5	43.1	37.9	-:-	42.7	41.6	39.1	38.5	38.1	----	-----	9332.5	59.4
1206	9/11/2025	4:54:13	00d	01:00.0	39.4	57.2	41.4	38	-:-	40.8	40.5	39.3	38.4	38.3	----	-----	8709.6	59.5
1207	9/11/2025	4:55:13	00d	01:00.0	53.7	71.5	66.7	36.9	-:-	62.7	53.8	39.2	37.3	37	----	-----	234422.9	59.5
1208	9/11/2025	4:56:13	00d	01:00.0	38.7	56.5	39.9	36.7	-:-	39.9	39.7	38.7	37.1	37	----	-----	7413.1	59.6
1209	9/11/2025	4:57:13	00d	01:00.0	40.1	57.9	43.6	37.9	-:-	43.1	42.7	39.3	38.3	38	----	-----	10232.9	59.6
1210	9/11/2025	4:58:13	00d	01:00.0	45.3	63.1	51.7	41	-:-	51.3	47.7	44	41.6	41.4	----	-----	33884.4	59.7
1211	9/11/2025	4:59:13	00d	01:00.0	60.1	77.9	73.4	40.1	-:-	67.9	58.6	43.2	40.8	40.5	----	-----	1023293.0	59.7
1212	9/11/2025	5:00:13	00d	01:00.0	39.5	57.3	42.7	37.8	-:-	40.9	40.5	39.5	38.6	38.2	----	-----	8912.5	59.7
1213	9/11/2025	5:01:13	00d	01:00.0	56.3	74.1	69.4	38.6	-:-	66.7	55	40.6	38.9	38.9	----	-----	426579.5	59.7
1214	9/11/2025	5:02:13	00d	01:00.0	40.9	58.7	46.5	39	-:-	44.6	42.8	40	39.4	39.1	----	-----	12302.7	59.7
1215	9/11/2025	5:03:13	00d	01:00.0	61.5	79.3	71.8	39.5	-:-	70.5	67.6	45.2	39.9	39.7	----	-----	1412537.5	59.7
1216	9/11/2025	5:04:13	00d	01:00.0	57.4	75.2	70.2	37.7	-:-	68.6	56	41.1	38.8	38.2	----	-----	549540.9	59.7
1217	9/11/2025	5:05:13	00d	01:00.0	53.6	71.4	66.6	37.7	-:-	64	54.6	40.7	38.7	38.5	----	-----	229086.8	59.7
1218	9/11/2025	5:06:13	00d	01:00.0	39.7	57.5	41.5	38.3	-:-	40.8	40.6	39.8	38.6	38.5	----	-----	9332.5	59.7
1219	9/11/2025	5:07:13	00d	01:00.0	39.7	57.5	42.8	38	-:-	41.3	41	39.4	38.4	38.1	----	-----	9332.5	59.8
1220	9/11/2025	5:08:13	00d	01:00.0	58.9	76.7	72.1	41.2	-:-	66.8	57.8	47.1	42.1	41.6	----	-----	776247.1	59.8
1221	9/11/2025	5:09:13	00d	01:00.0	64.1	81.9	75.8	43.3	-:-	74.4	68.2	48.4	44.2	43.7	----	-----	2570395.8	59.8
1222	9/11/2025	5:10:13	00d	01:00.0	42.3	60.1	45.2	38.8	-:-	44.9	44.3	42.7	39.4	39	----	-----	16982.4	59.6
1223	9/11/2025	5:11:13	00d	01:00.0	53.6	71.4	65.3	40.5	-:-	61.4	54.6	43.7	41.9	41.1	----	-----	229086.8	59.7
1224	9/11/2025	5:12:13	00d	01:00.0	42.4	60.2	49.5	39.4	-:-	47	45.7	40.6	39.7	39.5	----	-----	17378.0	59.8
1225	9/11/2025	5:13:13	00d	01:00.0	61.4	79.2	73	37.1	-:-	72.6	62.4	39.5	37.3	37.2	----	-----	1380384.3	59.9
1226	9/11/2025	5:14:13	00d	01:00.0	57.1	74.9	70.1	37.1	-:-	68.2	55.4	39.1	37.8	37.5	----	-----	512861.4	59.8
1227	9/11/2025	5:15:13	00d	01:00.0	58.5	76.3	71	37.5	-:-	68.4	61.1	39.7	37.8	37.7	----	-----	707945.8	60.1
1228	9/11/2025	5:16:13	00d	01:00.0	57	74.8	69.8	41.3	-:-	66.3	58.5	43.9	42.5	42	----	-----	501187.2	60.2
1229	9/11/2025	5:17:13	00d	01:00.0	61.2	79	73	37.5	-:-	70.1	66.9	41	37.9	37.8	----	-----	1318256.7	60.2
1230	9/11/2025	5:18:13	00d	01:00.0	54.4	72.2	66.6	38.6	-:-	64.9	53.8	42.6	40.2	39.5	----	-----	275422.9	60.1
1231	9/11/2025	5:19:13	00d	01:00.0	62.3	80.1	75.8	40.2	-:-	69.2	61.5	44.7	41	40.3	----	-----	1698243.7	60.2
1232	9/11/2025	5:20:13	00d	01:00.0	65.9	83.7	77.4	44.8	-:-	73.4	70.7	54.6	47.1	46.2	----	-----	3890451.4	60.3
1233	9/11/2025	5:21:13	00d	01:00.0	61	78.8	71.1	39.6	-:-	70.5	66.8	44.7	40	39.8	----	-----	1258925.4	60.1
1234	9/11/2025	5:22:13	00d	01:00.0	55.1	72.9	67.5	37.8	-:-	65.2	54.6	41.2	39	38.3	----	-----	323593.7	60.0
1235	9/11/2025	5:23:13	00d	01:00.0	52	69.8	63	38.1	-:-	60.9	57.5	42.1	39.1	38.7	----	-----	158489.3	60.0
1236	9/11/2025	5:24:13	00d	01:00.0	54.3	72.1	66.3	39.7	-:-	62.9	57.4	42.8	40.1	40	----	-----	269153.5	60.1
1237	9/11/2025	5:25:13	00d	01:00.0	60.8	78.6	70.2	41.2	-:-	69.8	67.5	48.3	41.8	41.5	----	-----	1202264.4	60.2
1238	9/11/2025	5:26:13	00d	01:00.0	59.5	77.3	69.6	40.1	-:-	68.9	66.3	46	41.2	40.5	----	-----	891250.9	60.2
1239	9/11/2025	5:27:13	00d	01:00.0	57.7	75.5	70.6	39.5	-:-	67.6	55.9	42.3	40.2	39.7	----	-----	588843.7	60.2
1240	9/11/2025	5:28:13	00d	01:00.0	57.7	75.5	70.8	41.7	-:-	66.6	56.6	46.2	44.3	43.4	----	-----	588843.7	60.2
1241	9/11/2025	5:29:13	00d	01:00.0	58.9	76.7	69.8	40.7	-:-	69.4	64.1	43.2	41.4	41.1	----	-----	776247.1	60.2
1242	9/11/2025	5:30:13	00d	01:00.0	61.4	79.2	73.2	38.9	-:-	69.6	66.9	41.8	39.3	39	----	-----	1380384.3	60.3
1243	9/11/2025	5:31:13	00d	01:00.0	58.1	75.9	67.8	38.2	-:-	67.8	64.6	45.7	38.6	38.5	----	-----	645654.2	60.2
1244	9/11/2025	5:32:13	00d	01:00.0	38.7	56.5	39.6	37.9	-:-	39.7	39.3	38.7	38.2	38	----	-----	7413.1	60.3
1245	9/11/2025	5:33:13	00d	01:00.0	39.5	57.3	42.8	38	-:-	42.4	40.3	39.1	38.6	38.3	----	-----	8912.5	60.5
1246	9/11/2025	5:34:13	00d	01:00.0	58.4	76.2	69.1	38.9	-:-	67.7	64.4	46	39.4	39.1	----	-----	691831.0	60.5
1247	9/11/2025	5:35:13	00d	01:00.0	60.4	78.2	72	40	-:-	69.4	66.6	45	40.1	40.1	----	-----	1096478.2	60.5
1248	9/11/2025	5:36:13	00d	01:00.0	62	79.8	74	40	-:-	71.9	68.4	42.4	40.4	40.2	----	-----	1584893.2	60.6
1249	9/11/2025	5:37:13	00d	01:00.0	62.9	80.7	75.4	38.8	-:-	71.6	68	39.9	39.1	39	----	-----	1949844.6	60.7
1250	9/11/2025	5:38:13	00d	01:00.0	47	64.8	69.6	38.7	-:-	54.1	50.1	40.3	39	38.9	----	-----	50118.7	60.6
1251	9/11/2025	5:39:13	00d	01:00.0	57.9	75.7	68.7	39.4	-:-	68.2	62.7	41.7	39.7	39.5	----	-----	616595.0	60.7
1252	9/11/2025	5:40:13	00d	01:00.0	60.6	78.4	70.4	39.4	-:-	69.3	66.6	49.2	40.9	40.2	----	-----	1148153.6	60.8
1253	9/11/2025	5:41:13	00d	01:00.0	59	76.8	68.4	42.8	-:-	67.7	66	47.7	43.8	43.4	----	-----	794328.2	60.8
1254	9/11/2025	5:42:13	00d	01:00.0	65.5	83.3	73.1	44.5	-:-	72.7	71.3	56.8	45.7	45.1	----	-----	3548133.9	60.8
1255	9/11/2025	5:43:13	00d	01:00.0	56	73.8	68.2	39.4	-:-	66.2	53.9	41.6	39.8	39.6	----	-----	398107.2	60.7
1256	9/11/2025	5:44:13	00d	01:00.0	63.5	81.3	71.1	40.4	-:-	70.8	69.7	52.8	41.4	41	----	-----	2238721.1	60.7
1257	9/11/2025	5:45:13	00d	01:00.0	64	81.8	73.7	40.4	-:-	72.4	69.1	51.9	42	41	----	-----	2511886.4	60.6
1258	9/11/2025	5:46:13	00d	01:00.0	62.2	80	74.5	40.7	-:-	71.9	66.8	49.9	41.7	41.2	----	-----	1659586.9	60.5
1259	9/11/2025	5:47:13	00d	01:00.0	64.8	82.6	75.8	42	-:-	73.5	68.6	54.1	42.7	42.3	----	-----	3019951.7	60.5
1260	9/11/2025	5:48:13	00d	01:00.0	61.2	79	70.4	39.8	-:-	68.9	67.3	50.4	40.1	40.1	----	-----	1318256.7	60.3
1261	9/11/2025	5:49:13	00d	01:00.0	63	80.8	69.9	44.9	-:-	70.1	68.5	54.6	46.7	45.3	----	-----	1995262.3	60.3
1262	9/11/2025	5:50:13	00d	01:00.0	52.9	70.7	65.7	38.7	-:-	61.5	56.1	39.8	39	38.8	----	-----	194984.5	60.2
1263	9/11/2025	5:51:13	00d	01:00.0	55.8	73.6	68.5	38.5	-:-	64.9	55.4	40.1	39.1	38.9	----	-----	380189.4	60.4
1264	9/11/2025	5:52:13	00d	01:00.0	39.8	57.6	48.5	38.2	-:-	43.4	40.8	39.2	38.5	38.4	----	-----	9549.9	60.5
1265	9/11/2025	5:53:13	00d	01:00.0	63.6	81.4	75.3	39.5	-:-	72.8	69.9	45	39.8	39.7	----	-----	2290867.7	60.6
1266	9/11/2025	5:54:13	00d	01:00.0	56.5	74.3	70.3	37.7	-:-	61.2	50.8	38.7	37.9	37.8	----	-----	446683.6	60.6
1267	9/11/2025	5:55:13	00d	01:00.0	53.4	71.2	70.1	39.8	-:-	62.4	58.6	42	40.4	40.1	----	-----	218776.2	60.8
1268	9/11/2025	5:56:13	00d	01:00.0	61.2	79	69.8	41.9	-:-	69.8	68.4	51.6	46.2	43.8	----	-----	1318256.7	61.0
1269	9/11/2025	5:57:13	00d	01:00.0	57.4	75.2	70.2	38.6	-:-	68.4	55.5	42.8	39.1	38.8	----	-----	549540.9	61.1
1270	9/11/2025	5:58:13	00d	01:00.0	60.9	78.7	72.1	42.5	-:-	68.3	66.5	48.4	43.4	43.2	----	-----	1230268.8	61.3
1271	9/11/2025	5:59:13	00d	01:00.0	53.8	71.6	66.2	37.8	-:-	65.4	54.3	41.2	38.2	38.1	----	-----	239883.3	61.5
1272	9/11/2025	6:00:13	00d	01:00.0	53.7	71.5	64.9	38.7	-:-	63.6	59.1	43.3	40	39.3	----	-----	234422.9	61.5
1273	9/11/2025	6:01:13	00d	01:00.0	59.2	77	71.2	39.8	-:-	67.6	64.2	44.4	40.1	40	----	-----	831763.8	61.8
1274	9/11/2025	6:02:13	00d	01:00.0	41.3	59.1	60.1	37.7	-:-	48.9	43.3	38.6	38	37.9	----	-----	13489.6	61.9
1275	9/11/2025	6:03:13	00d	01:00.0	58.3	76.1	67.7	38.1	-:-	67.6	66.4	44	38.6	38.3	----	-----	676083.0	61.9
1276	9/11/2025	6:04:13	00d	01:00.0	59.6	77.4	71.1	41	-:-	69	63.6	46.4	41.7	41.4	----	-----	912010.8	61.9
1277	9/11/2025	6:05:13	00d	01:00.0	58.4	76.2	71.2	38.5	-:-	68.8	61.9	42	39.3	38.9	----	-----	691831.0	62.0
1278	9/11/2025	6:06:13	00d	01:00.0	57.2	75	70	39.7	-:-	67	56.8	43.7	40.2	39.9	----	-----	524807.5	62.0
1279	9/11/2025	6:07:13	00d	01:00.0	53.7	71.5	65.5	38.1	-:-	64	54.6	43.2	38.6	38.3	----	-----	234422.9	62.0
1280	9/11/2025	6:08:13	00d	01:00.0	53.5	71.3	66.7	39.6	-:-	61.9	52.4	41.5	40.1	39.7	----	-----	223872.1	62.2
1281	9/11/2025	6:09:13	00d	01:00.0	57.8	75.6	69.7	41.6	-:-	67.6	62.2	45.5	42.4	41.9	----	-----	602559.6	62.2
1282	9/11/2025	6:10:13	00d	01:00.0	57.4	75.2	66.3	39.7	-:-	66.2	64.5	44.1	40.2	39.9	----	-----	549540.9	62.3
1283	9/11/2025	6:11:13	00d	01:00.0	60.5	78.3	71.9	39.4	-:-	71.8	62	45.1	40.1	39.8	----	-----	1122018.5	62.3
1284	9/11/2025	6:12:13	00d	01:00.0	61.6	79.4	72.2	43.3	-:-	70	67.1	51.6	44.1	43.8	----	-----	1445439.8	62.3
1285	9/11/2025	6:13:13	00d	01:00.0	60.6	78.4	70	42.8	-:-	67.2	66.2	53.7	44.6	42.9	----	-----	1148153.6	62.3
1286	9/11/2025	6:14:13	00d	01:00.0	58.3	76.1	68.8	41.2	-:-	68.1	62.8	47.2	42.9	41.6	----	-----	676083.0	62.3
1287	9/11/2025	6:15:13	00d	01:00.0	67.1	84.9	76.2	43.6	-:-	75.9	74.8	50.6	44	43.9	----	-----	5128613.8	62.3
1288	9/11/2025	6:16:13	00d	01:00.0	62.9	80.7	74.7	41.7	-:-	72.2	69.2	47.3	42	41.7	----	-----	1949844.6	62.2
1289	9/11/2025	6:17:13	00d	01:00.0	49.5	67.3	60.8	39.9	-:-	58.4	50.5	41.4	40.4	40.3	----	-----	89125.1	62.2
1290	9/11/2025	6:18:13	00d	01:00.0	57.7	75.5	68.9	40.7	-:-	66.9	62.2	43.4	41.2	41.1	----	-----	588843.7	62.3
1291	9/11/2025	6:19:13	00d	01:00.0	59.6	77.4	71.5	40.7	-:-	69.3	64.5	45.6	41.5	41.2	----	-----	912010.8	62.3
1292	9/11/2025	6:20:13	00d	01:00.0	64.8	82.6	77.7	40.9	-:-	74.3	66.7	47.3	44.1	42.7	----	-----	3019951.7	62.3
1293	9/11/2025	6:21:13	00d	01:00.0	60.2	78	68.3	40.8	-:-	68	66.7	49.7	42.5	41.4	----	-----	1047128.5	62.2
1294	9/11/2025	6:22:13	00d	01:00.0	55.8	73.6	68.5	40.3	-:-	65.6	55.5	42.8	41.1	40.7	----	-----	380189.4	62.2
1295	9/11/2025	6:23:13	00d	01:00.0	55.4	73.2	67.7	40.7	-:-	65.7	56.4	43.5	41.1	40.9	----	-----	346736.9	62.3
1296	9/11/2025	6:24:13	00d	01:00.0	62.8	80.6	73	40.1	-:-	72.9	70.2	44.3	40.9	40.6	----	-----	1905460.7	62.3
1297	9/11/2025	6:25:13	00d	01:00.0	58.8	76.6	71.3	42.7	-:-	68.2	60.5	45.3	43.4	43.3	----	-----	758577.6	62.3
1298	9/11/2025	6:26:13	00d	01:00.0	61.4	79.2	71	42.4	-:-	69.2	67.4	51.1	43.4	42.8	----	-----	1380384.3	62.4
1299	9/11/2025	6:27:13	00d	01:00.0	58	75.8	69.4	40.7	-:-	67.5	64.9	44.9	41	40.8	----	-----	630957.3	62.4
1300	9/11/2025	6:28:13	00d	01:00.0	60	77.8	70.3	41	-:-	69.2	66.1	49.6	42.4	42	----	-----	1000000.0	62.5
1301	9/11/2025	6:29:13	00d	01:00.0	59.7	77.5	69.6	41.6	-:-	68.8	66.5	46.9	42.4	42.1	----	-----	933254.3	62.7
1302	9/11/2025	6:30:13	00d	01:00.0	60.8	78.6	71.3	42.3	-:-	69	66.2	48.8	44	43.3	----	-----	1202264.4	62.7
1303	9/11/2025	6:31:13	00d	01:00.0	58	75.8	70.3	41.2	-:-	68.6	59.8	45.4	41.7	41.5	----	-----	630957.3	62.8
1304	9/11/2025	6:32:13	00d	01:00.0	62.5	80.3	71	44.6	-:-	70.5	69.7	54.1	46.8	45.2	----	-----	1778279.4	62.8
1305	9/11/2025	6:33:13	00d	01:00.0	65.4	83.2	75.9	43.3	-:-	73.6	71.9	50.2	44.2	43.7	----	-----	3467368.5	62.8

1306	9/11/2025	6:34:13	00d	01:00.0	57.7	75.5	71.1	42.2	-:-	65.4	57.6	44.4	42.7	42.4	----	-----	588843.7	62.8
1307	9/11/2025	6:35:13	00d	01:00.0	57.3	75.1	70.2	40.6	-:-	66.6	58.3	42	40.9	40.7	----	-----	537031.8	62.9
1308	9/11/2025	6:36:13	00d	01:00.0	62	79.8	71.9	41	-:-	70.2	66.5	43.5	41.4	41.3	----	-----	1584893.2	63.0
1309	9/11/2025	6:37:13	00d	01:00.0	66.4	84.2	75.4	48.3	-:-	71.9	70.5	64.2	50.6	49.1	----	-----	4365158.3	63.0
1310	9/11/2025	6:38:13	00d	01:00.0	57.1	74.9	70.1	41.9	-:-	67.8	56.3	45.1	42.2	42	----	-----	512861.4	63.0
1311	9/11/2025	6:39:13	00d	01:00.0	61.9	79.7	71.9	42.6	-:-	70.3	67.7	53.8	43.1	42.8	----	-----	1548816.6	63.0
1312	9/11/2025	6:40:13	00d	01:00.0	61.9	79.7	71.9	43.4	-:-	70.8	67.5	51.5	44.3	43.7	----	-----	1548816.6	63.0
1313	9/11/2025	6:41:13	00d	01:00.0	62.7	80.5	74	44	-:-	70.4	68.2	53	44.5	44.3	----	-----	1862087.1	63.1
1314	9/11/2025	6:42:13	00d	01:00.0	58.3	76.1	69.2	45.5	-:-	68.5	61.8	47.8	45.7	45.4	----	-----	676083.0	63.0
1315	9/11/2025	6:43:13	00d	01:00.0	59.7	77.5	69.4	45.8	-:-	68.2	65.8	52.4	46.4	46.1	----	-----	933254.3	63.0
1316	9/11/2025	6:44:13	00d	01:00.0	58.4	76.2	68.7	43.6	-:-	67	61.5	47.8	43.9	43.7	----	-----	691831.0	63.1
1317	9/11/2025	6:45:13	00d	01:00.0	58.3	76.1	68.8	44.8	-:-	68	64.9	49.1	47.5	46.7	----	-----	676083.0	63.1
1318	9/11/2025	6:46:13	00d	01:00.0	59.7	77.5	69.5	44.5	-:-	68.1	64.4	49.8	45.1	44.7	----	-----	933254.3	63.1
1319	9/11/2025	6:47:13	00d	01:00.0	61.5	79.3	71.1	45.1	-:-	70.8	67.5	50.5	46.1	46	----	-----	1412537.5	63.2
1320	9/11/2025	6:48:13	00d	01:00.0	57.4	75.2	67.2	44	-:-	66.7	62.4	50.3	45.7	45.2	----	-----	549540.9	63.2
1321	9/11/2025	6:49:13	00d	01:00.0	58.2	76	67.8	44.2	-:-	65.2	64.6	48.6	45	44.7	----	-----	660693.4	63.3
1322	9/11/2025	6:50:13	00d	01:00.0	62	79.8	73.3	45.3	-:-	71.1	67.6	49	45.9	45.5	----	-----	1584893.2	63.4
1323	9/11/2025	6:51:13	00d	01:00.0	64.8	82.6	76.4	45.9	-:-	71.4	69.3	53.4	48.1	46.9	----	-----	3019951.7	63.4
1324	9/11/2025	6:52:13	00d	01:00.0	62.7	80.5	70.6	46.9	-:-	70.3	68.9	55.1	47.5	47	----	-----	1862087.1	63.4
1325	9/11/2025	6:53:13	00d	01:00.0	58.4	76.2	71	45.7	-:-	68.2	58.4	49.2	46.2	45.9	----	-----	691831.0	63.5
1326	9/11/2025	6:54:13	00d	01:00.0	63.9	81.7	75	47.8	-:-	71.3	69.2	54.5	48.6	48.3	----	-----	2454708.9	63.5
1327	9/11/2025	6:55:13	00d	01:00.0	65.7	83.5	74.4	48.2	-:-	74	70.1	54.7	49.1	48.7	----	-----	3715352.3	63.5
1328	9/11/2025	6:56:13	00d	01:00.0	66.5	84.3	75	45.9	-:-	72.8	71.8	55.1	47.3	46.4	----	-----	4466835.9	63.4
1329	9/11/2025	6:57:13	00d	01:00.0	65.2	83	75.3	45.3	-:-	72.4	70	53.4	45.9	45.4	----	-----	3311311.2	63.3
1330	9/11/2025	6:58:13	00d	01:00.0	64.4	82.2	75.9	45.2	-:-	72.1	71.1	50.8	45.9	45.7	----	-----	2754228.7	63.2
1331	9/11/2025	6:59:13	00d	01:00.0	67	84.8	74.2	48.6	-:-	74.1	72	61.7	50.2	49.1	----	-----	5011872.3	63.2
1332	9/11/2025	7:00:13	00d	01:00.0	62.5	80.3	72.5	44	-:-	70.4	69.4	50	44.4	44.1	----	-----	1778279.4	63.2
1333	9/11/2025	7:01:13	00d	01:00.0	67.4	85.2	75.8	45.6	-:-	75.7	72.9	56.3	46.6	46	----	-----	5495408.7	63.1
1334	9/11/2025	7:02:13	00d	01:00.0	64.6	82.4	73.8	47.7	-:-	72.3	70.5	53.9	48.3	47.9	----	-----	2884031.5	63.0
1335	9/11/2025	7:03:13	00d	01:00.0	60.5	78.3	71.7	43.7	-:-	70.8	65.6	47.4	44.1	44	----	-----	1122018.5	63.0
1336	9/11/2025	7:04:13	00d	01:00.0	58.1	75.9	66.8	43.1	-:-	65.7	63.7	49.6	43.7	43.4	----	-----	645654.2	63.0
1337	9/11/2025	7:05:13	00d	01:00.0	62.1	79.9	69.4	44.9	-:-	68.6	66.9	57.7	45.7	45.2	----	-----	1621810.1	63.1
1338	9/11/2025	7:06:13	00d	01:00.0	61.8	79.6	72.8	45.7	-:-	71.6	67.2	51.1	46.7	46	----	-----	1513561.2	63.1
1339	9/11/2025	7:07:13	00d	01:00.0	61.4	79.2	71.3	43.3	-:-	69.3	66.3	53.4	44.1	43.6	----	-----	1380384.3	63.0
1340	9/11/2025	7:08:13	00d	01:00.0	65.2	83	75.5	44.5	-:-	73.3	69.6	57	47.1	46.9	----	-----	3311311.2	63.1
1341	9/11/2025	7:09:13	00d	01:00.0	60.7	78.5	69.5	44.7	-:-	69.4	66.2	53.1	45.1	45	----	-----	1174897.6	63.0
1342	9/11/2025	7:10:13	00d	01:00.0	63	80.8	70.3	44.8	-:-	69.4	67.4	56.5	46.2	45.6	----	-----	1995262.3	63.1
1343	9/11/2025	7:11:13	00d	01:00.0	61	78.8	71.4	44.6	-:-	68.7	66.2	49.2	45.8	45.2	----	-----	1258925.4	63.0
1344	9/11/2025	7:12:13	00d	01:00.0	58.7	76.5	68.2	44	-:-	66.5	64.7	49.9	45.5	44.5	----	-----	741310.2	63.0
1345	9/11/2025	7:13:13	00d	01:00.0	60.7	78.5	70	43.5	-:-	68.6	67.3	52	44.1	43.9	----	-----	1174897.6	63.1
1346	9/11/2025	7:14:13	00d	01:00.0	62.3	80.1	70.1	45.6	-:-	69.2	67.7	52.2	47.3	46.7	----	-----	1698243.7	63.0
1347	9/11/2025	7:15:13	00d	01:00.0	59.9	77.7	68.9	46.7	-:-	67.3	66.2	51.6	47.1	47	----	-----	977237.2	63.0
1348	9/11/2025	7:16:13	00d	01:00.0	64.1	81.9	73.3	44.4	-:-	70	69	54.7	45.4	44.9	----	-----	2570395.8	63.0
1349	9/11/2025	7:17:13	00d	01:00.0	63.2	81	73.5	45	-:-	71.2	68.4	52	45.4	45.2	----	-----	2089296.1	62.9
1350	9/11/2025	7:18:13	00d	01:00.0	61.7	79.5	73.2	45.5	-:-	67.8	67.1	54.3	46.5	45.6	----	-----	1479108.4	63.0
1351	9/11/2025	7:19:13	00d	01:00.0	54.6	72.4	66.6	42.9	-:-	65.1	53.2	45.5	43.1	43	----	-----	288403.2	63.2
1352	9/11/2025	7:20:13	00d	01:00.0	61.9	79.7	67.7	49.5	-:-	67.3	66.4	59.7	50.8	49.7	----	-----	1548816.6	63.4
1353	9/11/2025	7:21:13	00d	01:00.0	60.5	78.3	71.2	43.1	-:-	67.2	65.7	51.6	44	43.7	----	-----	1122018.5	63.4
1354	9/11/2025	7:22:13	00d	01:00.0	62.7	80.5	70.1	43.8	-:-	69.6	68.5	57.9	45.3	44.4	----	-----	1862087.1	63.4
1355	9/11/2025	7:23:13	00d	01:00.0	63.7	81.5	71.8	42.3	-:-	71	69.7	54.9	43	42.8	----	-----	2344228.8	63.4
1356	9/11/2025	7:24:13	00d	01:00.0	59.8	77.6	67.8	42.9	-:-	67.7	67.2	51.5	45.5	43.8	----	-----	954992.6	63.4
1357	9/11/2025	7:25:13	00d	01:00.0	53.6	71.4	65.3	42.7	-:-	63.3	56.7	44.4	43.1	42.9	----	-----	229086.8	63.4
1358	9/11/2025	7:26:13	00d	01:00.0	64.3	82.1	71.7	46.1	-:-	72.2	70	57.3	48.8	46.9	----	-----	2691534.8	63.5
1359	9/11/2025	7:27:13	00d	01:00.0	62.4	80.2	69	42.6	-:-	68.2	68.1	55.5	43.3	42.9	----	-----	1737800.8	63.5
1360	9/11/2025	7:28:13	00d	01:00.0	64.3	82.1	76.2	44.6	-:-	71.3	67.4	52.7	45.9	45.1	----	-----	2691534.8	63.7
1361	9/11/2025	7:29:13	00d	01:00.0	68.5	86.3	77.5	47.3	-:-	74.6	73.1	64.3	48.8	48.3	----	-----	7079457.8	63.7
1362	9/11/2025	7:30:13	00d	01:00.0	62.8	80.6	72.2	44.8	-:-	69.4	68.9	55.1	46.4	45.5	----	-----	1905460.7	63.6
1363	9/11/2025	7:31:13	00d	01:00.0	63.9	81.7	71.3	47.7	-:-	71.3	68.9	57.2	48.8	48.2	----	-----	2454708.9	63.6
1364	9/11/2025	7:32:13	00d	01:00.0	60.7	78.5	69.1	45.4	-:-	69	67.8	50.7	46.9	46.2	----	-----	1174897.6	63.5
1365	9/11/2025	7:33:13	00d	01:00.0	64.9	82.7	75.9	43.5	-:-	73	70.1	51.7	44.2	43.6	----	-----	3090295.4	63.5
1366	9/11/2025	7:34:13	00d	01:00.0	64.6	82.4	72	47.3	-:-	71.4	70.2	55.9	49.2	48.8	----	-----	2884031.5	63.5
1367	9/11/2025	7:35:13	00d	01:00.0	64.3	82.1	73.1	46.9	-:-	71.4	70.3	54.6	48.5	47.9	----	-----	2691534.8	63.5
1368	9/11/2025	7:36:13	00d	01:00.0	64.7	82.5	71.5	46.5	-:-	71.5	69.9	60.4	48.1	47.1	----	-----	2951209.2	63.4
1369	9/11/2025	7:37:13	00d	01:00.0	63.7	81.5	71.6	52.4	-:-	71.2	68.8	57.4	52.9	52.6	----	-----	2344228.8	63.4
1370	9/11/2025	7:38:13	00d	01:00.0	65	82.8	73	48.8	-:-	72.7	71.1	59.4	50	49.2	----	-----	3162277.7	63.3
1371	9/11/2025	7:39:13	00d	01:00.0	63.5	81.3	70.9	47.7	-:-	70.9	68.5	58.1	47.8	47.4	----	-----	2238721.1	63.3
1372	9/11/2025	7:40:13	00d	01:00.0	62.6	80.4	72.3	46.5	-:-	70.8	68.9	54.4	48.7	47.8	----	-----	1819700.9	63.3
1373	9/11/2025	7:41:13	00d	01:00.0	63.7	81.5	72.4	45.4	-:-	71	68.9	58.4	47	45.6	----	-----	2344228.8	63.3
1374	9/11/2025	7:42:13	00d	01:00.0	59.5	77.3	69.2	42.2	-:-	67.9	64.7	45.6	43.2	43	----	-----	891250.9	63.2
1375	9/11/2025	7:43:13	00d	01:00.0	59.6	77.4	66.5	44.9	-:-	67	64.6	54.2	46.4	46.2	----	-----	912010.8	63.2
1376	9/11/2025	7:44:13	00d	01:00.0	61.5	79.3	69.1	45.1	-:-	68.7	66.1	56	45.6	45.2	----	-----	1412537.5	63.2
1377	9/11/2025	7:45:13	00d	01:00.0	61.5	79.3	68.9	44.9	-:-	68.7	67.1	51.8	46	45.3	----	-----	1412537.5	63.2
1378	9/11/2025	7:46:13	00d	01:00.0	63.7	81.5	70.5	45.5	-:-	70.4	68.8	56.4	46	45.9	----	-----	2344228.8	63.2
1379	9/11/2025	7:47:13	00d	01:00.0	62.9	80.7	69.7	44.1	-:-	69.6	68.4	54.9	45.6	44.2	----	-----	1949844.6	63.2
1380	9/11/2025	7:48:13	00d	01:00.0	63.5	81.3	69.7	47.1	-:-	69.1	68.2	60.6	49.6	48.7	----	-----	2238721.1	63.1
1381	9/11/2025	7:49:13	00d	01:00.0	64.3	82.1	72.3	47.1	-:-	71.7	70.8	54	48	47.4	----	-----	2691534.8	63.1
1382	9/11/2025	7:50:13	00d	01:00.0	64.5	82.3	71.6	48.4	-:-	71	69.7	59.4	49.1	48.1	----	-----	2818382.9	63.0
1383	9/11/2025	7:51:13	00d	01:00.0	66.1	83.9	77	49.7	-:-	72.9	69.1	61.3	51.9	50	----	-----	4073802.8	63.0
1384	9/11/2025	7:52:13	00d	01:00.0	63.2	81	69.4	45.4	-:-	68.9	68.6	54.6	46.6	45.5	----	-----	2089296.1	62.9
1385	9/11/2025	7:53:13	00d	01:00.0	66.7	84.5	75.6	52.5	-:-	71.2	70.4	64.2	53.8	51.9	----	-----	4677351.4	62.9
1386	9/11/2025	7:54:13	00d	01:00.0	55.3	73.1	67.5	42.5	-:-	66.2	55.3	46.1	42.8	42.7	----	-----	338844.2	62.8
1387	9/11/2025	7:55:13	00d	01:00.0	63.7	81.5	72.2	48.6	-:-	71	69	55.8	48.8	48.6	----	-----	2344228.8	62.9
1388	9/11/2025	7:56:13	00d	01:00.0	60.8	78.6	68.9	44.6	-:-	69	67.1	50.9	45.1	44.9	----	-----	1202264.4	62.9
1389	9/11/2025	7:57:13	00d	01:00.0	60.9	78.7	68.2	42.6	-:-	67.7	66.8	50.7	43.3	43.1	----	-----	1230268.8	62.9
1390	9/11/2025	7:58:13	00d	01:00.0	61.8	79.6	70.6	44.1	-:-	69.9	67.6	53.4	47.5	45.1	----	-----	1513561.2	62.9
1391	9/11/2025	7:59:13	00d	01:00.0	63.7	81.5	72.4	44.4	-:-	72	69.4	51.7	45.3	44.7	----	-----	2344228.8	62.9
1392	9/11/2025	8:00:13	00d	01:00.0	66.2	84	78.2	47.5	-:-	73.6	68.4	57.2	48.8	47.7	----	-----	4168693.8	62.9
1393	9/11/2025	8:01:13	00d	01:00.0	57.6	75.4	71.3	39.9	-:-	68.1	55.9	43	40.2	40.2	----	-----	575439.9	62.8
1394	9/11/2025	8:02:13	00d	01:00.0	61.7	79.5	72.6	40.9	-:-	69.8	67.3	49.1	41.5	41.4	----	-----	1479108.4	62.9
1395	9/11/2025	8:03:13	00d	01:00.0	64.8	82.6	72.7	46.4	-:-	70	68.9	59.9	50.1	47.9	----	-----	3019951.7	62.9
1396	9/11/2025	8:04:13	00d	01:00.0	62.8	80.6	70.1	46.7	-:-	69.1	68.4	56.6	49	47.2	----	-----	1905460.7	62.9
1397	9/11/2025	8:05:13	00d	01:00.0	62.3	80.1	72.6	40.3	-:-	70.1	68.6	47.5	40.6	40.5	----	-----	1698243.7	62.9
1398	9/11/2025	8:06:13	00d	01:00.0	62.3	80.1	72.7	44.4	-:-	69.1	66.5	54	45.7	44.8	----	-----	1698243.7	62.9
1399	9/11/2025	8:07:13	00d	01:00.0	53.5	71.3	65.1	40.7	-:-	64.9	56.1	42.8	41.3	41.2	----	-----	223872.1	62.9
1400	9/11/2025	8:08:13	00d	01:00.0	64.6	82.4	72.7	46	-:-	71.2	70	55.2	47.2	46.8	----	-----	2884031.5	63.0
1401	9/11/2025	8:09:13	00d	01:00.0	55.8	73.6	67.7	40.3	-:-	65.4	60.4	45.4	40.9	40.7	----	-----	380189.4	62.9
1402	9/11/2025	8:10:13	00d	01:00.0	65.2	83	74.1	47.6	-:-	72.1	70.4	59.3	48.5	47.3	----	-----	3311311.2	63.0
1403	9/11/2025	8:11:13	00d	01:00.0	61.4	79.2	68.5	42.3	-:-	68.7	67.3	52.9	44.8	43.5	----	-----	1380384.3	62.9
1404	9/11/2025	8:12:13	00d	01:00.0	58.1	75.9	69.2	42	-:-	67.2	63.2	44.8	42.8	42.3	----	-----	645654.2	63.0
1405	9/11/2025	8:13:13	00d	01:00.0	63.8	81.6	72.6	46.6	-:-	70.4	69.3	55.2	48.3	47.5	----	-----	2398832.9	63.0
1406	9/11/2025	8:14:13	00d	01:00.0	55.9	73.7	68.3	39.8	-:-	64.2	57.3	42.8	40.5	40.4	----	-----	389045.1	63.0
1407	9/11/2025	8:15:13	00d	01:00.0	58.7	76.5	69	38.9	-:-	68.2	65	42.7	39.3	39	----	-----	741310.2	63.1
1408	9/11/2025	8:16:13	00d	01:00.0	58.5	76.3	67.3	40.4	-:-	66	65.2	48.4	43.3	42	----	-----	707945.8	63.2
1409	9/11/2025	8:17:13	00d	01:00.0	58.8	76.6	68	39.4	-:-	66.8	65.8	42.2	39.6	39.5	----	-----	758577.6	63.3
1410	9/11/2025	8:18:13	00d	01:00.0	67	84.8	73.9	43.2	-:-	73.6	71.6	64	44.5	43.9	----	-----	5011872.3	63.4
1411	9/11/2025	8:19:13	00d	01:00.0	67.7	85.5	74.9	54.2	-:-	73.8	72.4	64.9	55	54.4	----	-----	5888436.6	63.2
1412	9/11/2025	8:20:13	00d	01:00.0	67.5	85.3	72.6	49.8	-:-	72.8	72.5	65	53.6	50.4	----	-----	5623413.3	62.9
1413	9/11/2025	8:21:13	00d	01:00.0	60.9	78.7	70.5	43.5	-:-	68.6	66.7	51.5	45.3	43.9	----	-----	1230268.8	62.6
1414	9/11/2025	8:22:13	00d	01:00.0	62	79.8	69.9	42.7	-:-	69.8	68	53.3	42.9	42.8	----	-----	1584893.2	62.7

1415	9/11/2025	8:23:13	00d	01:00.0	64.3	82.1	71.8	44.2	-.-	71.7	70.6	57.8	45.1	44.8	----	-----	2691534.8	62.7
1416	9/11/2025	8:24:13	00d	01:00.0	60.8	78.6	71.8	42.8	-.-	67.9	65.6	50.1	44	43.4	----	-----	1202264.4	62.6
1417	9/11/2025	8:25:13	00d	01:00.0	64.5	82.3	72.4	43.5	-.-	70	68.9	60.7	48.7	47.6	----	-----	2818382.9	62.7
1418	9/11/2025	8:26:13	00d	01:00.0	62.1	79.9	70.6	41	-.-	69.8	68.7	49.4	41.5	41.2	----	-----	1621810.1	62.6
1419	9/11/2025	8:27:13	00d	01:00.0	66.7	84.5	73.8	49.8	-.-	73	71.4	63.2	51	50	----	-----	4677351.4	62.6
1420	9/11/2025	8:28:13	00d	01:00.0	68.2	86	75.9	45	-.-	74.9	74.4	60.5	46.8	45.7	----	-----	6606934.5	62.3
1421	9/11/2025	8:29:13	00d	01:00.0	61.7	79.5	70.1	44.1	-.-	67.9	66.6	55.4	45.6	45.1	----	-----	1479108.4	61.6
1422	9/11/2025	8:30:13	00d	01:00.0	67.1	84.9	79.5	48	-.-	75	70.6	58	49.3	48.6	----	-----	5128613.8	61.6
1423	9/11/2025	8:31:13	00d	01:00.0	62.3	80.1	73.5	40.1	-.-	72.2	66.3	51.5	42.3	41.6	----	-----	1698243.7	61.0
1424	9/11/2025	8:32:13	00d	01:00.0	61	78.8	68.7	38.7	-.-	68.2	67.6	48.9	39	38.8	----	-----	1258925.4	60.9
1425	9/11/2025	8:33:13	00d	01:00.0	56	73.8	67	38.2	-.-	66.2	59.6	42.5	39.3	39	----	-----	398107.2	60.9
1426	9/11/2025	8:34:13	00d	01:00.0	62.8	80.6	70.7	43.1	-.-	70.2	67.9	56.2	45.7	43.7	----	-----	1905460.7	61.1
1427	9/11/2025	8:35:13	00d	01:00.0	63.6	81.4	73.2	50.8	-.-	70.8	67.5	60	52.8	51.5	----	-----	2290867.7	61.0
1428	9/11/2025	8:36:13	00d	01:00.0	61.9	79.7	71.6	44.6	-.-	68.7	67.6	52.5	45.3	44.7	----	-----	1548816.6	60.7
1429	9/11/2025	8:37:13	00d	01:00.0	61.5	79.3	71.4	37.4	-.-	70	68.5	50.4	39	37.9	----	-----	1412537.5	60.6
1430	9/11/2025	8:38:13	00d	01:00.0	59.7	77.5	71	37	-.-	66.1	64.3	46.5	37.4	37.2	----	-----	933254.3	60.5
1431	9/11/2025	8:39:13	00d	01:00.0	65.3	83.1	76.8	42.6	-.-	73.5	68.6	55	45.5	45.3	----	-----	3388441.6	60.6
1432	9/11/2025	8:40:13	00d	01:00.0	59.6	77.4	68	42.1	-.-	67.8	66	49.8	43.2	42.8	----	-----	912010.8	59.7
1433	9/11/2025	8:41:13	00d	01:00.0	56.7	74.5	69.8	38.8	-.-	66.9	54.7	41.5	39	38.8	----	-----	467735.1	59.7
1434	9/11/2025	8:42:13	00d	01:00.0	61	78.8	68.6	39.6	-.-	68.2	67.3	47.9	41.2	40.4	----	-----	1258925.4	59.9
1435	9/11/2025	8:43:13	00d	01:00.0	60.9	78.7	69.1	39.9	-.-	68.8	67.5	47.1	40.9	40.5	----	-----	1230268.8	59.7
1436	9/11/2025	8:44:13	00d	01:00.0	53.6	71.4	66.9	39	-.-	63.5	57.3	44.2	39.6	39.2	----	-----	229086.8	59.5
1437	9/11/2025	8:45:13	00d	01:00.0	62.1	79.9	72.2	38.1	-.-	71.1	67.5	49.7	39.2	38.6	----	-----	1621810.1	60.1
1438	9/11/2025	8:46:13	00d	01:00.0	61	78.8	69.9	38.2	-.-	69.9	66.1	52.2	39.6	38.6	----	-----	1258925.4	59.4
1439	9/11/2025	8:47:13	00d	01:00.0	60.3	78.1	71.6	38.9	-.-	69.4	64.8	50.7	39.8	39.3	----	-----	1071519.3	58.8
1440	9/11/2025	8:48:13	00d	01:00.0	60.3	78.1	71.1	42.7	-.-	68.8	64.6	53	44.9	43.1	----	-----	1071519.3	57.8
1441	9/11/2025	8:49:13	00d	00:02.4	50.8	54.6	51.4	50.1	-.-	51.1	51.1	51.1	49.6	49.6	----	-----	120226.4	50.8

Address	Start Time	Measurement Time		Leq	LE	LMAX	LMIN	Ly	LN1	LN2	LN3	LN4	LN5	Over	Under	Inverse Log	Overall Leq	Rolling 24 Hour	Rolling Hour Avg
M-04																			
1	9/10/2025	7:50:25	00d 01:00.0	56	73.8	60.8	47	-:-	60.4	59.8	54.3	49.3	47.4	----	-----	398107.2	55.2	56.6	55.3
2	9/10/2025	7:51:25	00d 01:00.0	63	80.8	73.5	44.7	-:-	68.1	67.7	60.3	46	44.7	----	-----	1995262.3		56.6	Hourly
3	9/10/2025	7:52:25	00d 01:00.0	56.5	74.3	62.2	43	-:-	61.6	61.3	54.1	45.8	43	----	-----	446683.6		56.4	
4	9/10/2025	7:53:25	00d 01:00.0	57.3	75.1	63.5	48.2	-:-	62.8	61.4	55.4	49.5	48.5	----	-----	537031.8		56.4	
5	9/10/2025	7:54:25	00d 01:00.0	59.1	76.9	61.7	54.2	-:-	61.4	61	58.8	56.7	55.4	----	-----	812830.5		56.4	
6	9/10/2025	7:55:25	00d 01:00.0	58.2	76	63.8	48.8	-:-	63.3	62.2	56.9	51	49.6	----	-----	660693.4		56.3	
7	9/10/2025	7:56:25	00d 01:00.0	56.9	74.7	63.9	48.3	-:-	61.6	60.6	55.8	49.9	48.8	----	-----	489778.8		56.4	
8	9/10/2025	7:57:25	00d 01:00.0	58.7	76.5	60.8	53.6	-:-	60.8	60.7	59	56.2	56	----	-----	741310.2		56.4	
9	9/10/2025	7:58:25	00d 01:00.0	53.3	71.1	58.1	41.8	-:-	57.7	57.3	52.1	43.3	42.4	----	-----	213796.2		56.4	
10	9/10/2025	7:59:25	00d 01:00.0	55.3	73.1	60.4	45.6	-:-	60.3	58.8	53	46.9	46.1	----	-----	338844.2		56.4	
11	9/10/2025	8:00:25	00d 01:00.0	53.6	71.4	59.4	39.9	-:-	59	58.8	49.3	40.3	40.1	----	-----	229086.8		56.4	
12	9/10/2025	8:01:25	00d 01:00.0	57.8	75.6	61.2	43.5	-:-	61.1	60.4	58	51.7	47.2	----	-----	602559.6		56.5	
13	9/10/2025	8:02:25	00d 01:00.0	48.7	66.5	55.2	40.3	-:-	54.5	54.3	42.8	40.8	40.6	----	-----	74131.0		56.4	
14	9/10/2025	8:03:25	00d 01:00.0	52.6	70.4	58.5	39.8	-:-	58.4	57.1	50.3	41.3	40.6	----	-----	181970.1		56.4	
15	9/10/2025	8:04:25	00d 01:00.0	40.9	58.7	47.9	38.7	-:-	45.8	42.7	39.6	38.9	38.8	----	-----	12302.7		56.5	
16	9/10/2025	8:05:25	00d 01:00.0	57.8	75.6	60.6	47.9	-:-	60.4	59.9	58.3	51.6	50.4	----	-----	602559.6		56.5	
17	9/10/2025	8:06:25	00d 01:00.0	53	70.8	59.5	38.8	-:-	59.4	58.8	50.2	40.1	39.5	----	-----	199526.2		56.5	
18	9/10/2025	8:07:25	00d 01:00.0	38.2	56	39.6	37.2	-:-	39	38.9	38.1	37.5	37.5	----	-----	6606.9		56.6	
19	9/10/2025	8:08:25	00d 01:00.0	50.7	68.5	58.6	39.6	-:-	58	55.7	44.8	41.2	40.6	----	-----	117489.8		56.6	
20	9/10/2025	8:09:25	00d 01:00.0	51.3	69.1	56	40	-:-	55.6	53.9	51.3	41.4	40.3	----	-----	134896.3		56.7	
21	9/10/2025	8:10:25	00d 01:00.0	56.4	74.2	61.1	47.7	-:-	60.5	60	54.6	49.9	48	----	-----	436515.8		56.7	
22	9/10/2025	8:11:25	00d 01:00.0	57.8	75.6	61.9	47.2	-:-	61.8	60.7	56.8	48.6	47.5	----	-----	602559.6		56.7	
23	9/10/2025	8:12:25	00d 01:00.0	58.2	76	61.7	50.4	-:-	61.5	61.4	57.3	51.1	50.7	----	-----	660693.4		56.7	
24	9/10/2025	8:13:25	00d 01:00.0	56.2	74	59.6	49.9	-:-	59	58.6	56.1	51.7	50.8	----	-----	416869.4		56.6	
25	9/10/2025	8:14:25	00d 01:00.0	56.5	74.3	60.4	45.2	-:-	60.2	59.8	56.3	46	45.4	----	-----	446683.6		56.6	
26	9/10/2025	8:15:25	00d 01:00.0	57.8	75.6	63.7	48.1	-:-	63.3	62.5	56	49.2	48.6	----	-----	602559.6		56.6	
27	9/10/2025	8:16:25	00d 01:00.0	60.5	78.3	68.7	45.8	-:-	68.3	66.4	56.7	47.3	46.7	----	-----	1122018.5		56.6	
28	9/10/2025	8:17:25	00d 01:00.0	52.5	70.3	61.4	43.2	-:-	56.2	55.5	51.6	44	43.2	----	-----	177827.9		56.4	
29	9/10/2025	8:18:25	00d 01:00.0	58.5	76.3	64.4	48.3	-:-	63.1	62.1	57.5	50.3	48.9	----	-----	707945.8		56.6	
30	9/10/2025	8:19:25	00d 01:00.0	52.7	70.5	59.6	41	-:-	59.3	56.8	49.8	41.8	41.5	----	-----	186208.7		56.5	
31	9/10/2025	8:20:25	00d 01:00.0	59.5	77.3	63	51.4	-:-	62.2	61.6	59.4	56.7	55.3	----	-----	891250.9		56.5	
32	9/10/2025	8:21:25	00d 01:00.0	57.1	74.9	61.8	48.3	-:-	61	60.5	56.9	50.9	49.4	----	-----	512861.4		56.5	
33	9/10/2025	8:22:25	00d 01:00.0	56.6	74.4	63.5	46.9	-:-	62.6	60.2	55.9	48.8	47.2	----	-----	457088.2		56.5	
34	9/10/2025	8:23:25	00d 01:00.0	58.8	76.6	64.1	48.6	-:-	64	63.6	58.1	49.4	49.3	----	-----	758577.6		56.4	
35	9/10/2025	8:24:25	00d 01:00.0	57.4	75.2	60.6	50	-:-	60.2	60	56.7	51.5	50.3	----	-----	549540.9		56.4	
36	9/10/2025	8:25:25	00d 01:00.0	56	73.8	60.3	48.1	-:-	60	59.2	54.7	48.6	48.3	----	-----	398107.2		56.3	
37	9/10/2025	8:26:25	00d 01:00.0	54.6	72.4	59	43.8	-:-	58.7	58.3	53.2	44.5	44.2	----	-----	288403.2		56.3	
38	9/10/2025	8:27:25	00d 01:00.0	54.3	72.1	58.2	42.9	-:-	58	57.4	54.8	43.9	43.2	----	-----	269153.5		56.3	
39	9/10/2025	8:28:25	00d 01:00.0	55.9	73.7	60.7	43.1	-:-	60.5	59.7	53.9	44.4	43.8	----	-----	389045.1		56.4	
40	9/10/2025	8:29:25	00d 01:00.0	54.8	72.6	59.9	42.2	-:-	59.6	59.4	52.9	43.4	41.7	----	-----	301995.2		56.3	
41	9/10/2025	8:30:25	00d 01:00.0	57.8	75.6	62.1	47.6	-:-	61.8	61.4	57.2	49.4	48.2	----	-----	602559.6		56.3	
42	9/10/2025	8:31:25	00d 01:00.0	54.3	72.1	60.3	42.3	-:-	60.1	58.7	51.8	43.1	42.6	----	-----	269153.5		56.3	
43	9/10/2025	8:32:25	00d 01:00.0	57	74.8	61.1	44.3	-:-	61	60.5	55.8	45.4	44.7	----	-----	501187.2		56.5	
44	9/10/2025	8:33:25	00d 01:00.0	55.6	73.4	61.7	45.6	-:-	61.1	60.3	52.9	46.8	45.9	----	-----	363078.1		56.4	
45	9/10/2025	8:34:25	00d 01:00.0	51.9	69.7	58.5	41.6	-:-	58.3	56.9	46.3	41.9	41.7	----	-----	154881.7		56.4	
46	9/10/2025	8:35:25	00d 01:00.0	57.6	75.4	61.8	47.5	-:-	61.5	60.9	57.1	51.3	50.4	----	-----	575439.9		56.5	
47	9/10/2025	8:36:25	00d 01:00.0	52.6	70.4	58.1	42.2	-:-	58.1	57.6	48.8	43.5	42.6	----	-----	181970.1		56.5	
48	9/10/2025	8:37:25	00d 01:00.0	57.5	75.3	62.6	49	-:-	62.5	61.8	54.8	49.3	49.1	----	-----	562341.3		56.5	
49	9/10/2025	8:38:25	00d 01:00.0	57.5	75.3	63.7	43.3	-:-	63.2	61.8	57	43.6	43.5	----	-----	562341.3		56.5	
50	9/10/2025	8:39:25	00d 01:00.0	55.1	72.9	60.1	40.9	-:-	60	59.4	53.5	42	41.4	----	-----	323593.7		56.7	
51	9/10/2025	8:40:25	00d 01:00.0	54.6	72.4	60	43	-:-	59.8	58.9	52.1	47.4	46.6	----	-----	288403.2		56.7	
52	9/10/2025	8:41:25	00d 01:00.0	57.6	75.4	61.5	49	-:-	61.4	60.9	56.8	50.9	50.2	----	-----	575439.9		56.8	
53	9/10/2025	8:42:25	00d 01:00.0	57.1	74.9	63.6	48.9	-:-	63.1	61.5	54.8	49.3	48.9	----	-----	512861.4		56.7	
54	9/10/2025	8:43:25	00d 01:00.0	56.8	74.6	61.5	42	-:-	61.1	59.3	57.1	44.7	43	----	-----	478630.1		56.7	
55	9/10/2025	8:44:25	00d 01:00.0	53.4	71.2	60.8	41.6	-:-	60.3	57.2	51	43.7	42.1	----	-----	218776.2		56.7	
56	9/10/2025	8:45:25	00d 01:00.0	59.8	77.6	63.5	49.3	-:-	63.4	62.4	59.5	54.1	51.6	----	-----	954992.6		56.7	
57	9/10/2025	8:46:25	00d 01:00.0	56.1	73.9	62.9	47.3	-:-	61.9	60.7	54.5	49	48.1	----	-----	407380.3		56.6	
58	9/10/2025	8:47:25	00d 01:00.0	53.1	70.9	58.9	44.5	-:-	58.9	57.1	49.6	45.4	44.9	----	-----	204173.8		56.6	
59	9/10/2025	8:48:25	00d 01:00.0	57.7	75.5	64.7	44.1	-:-	64	61.6	55.6	45.2	44.5	----	-----	588843.7		56.7	
60	9/10/2025	8:49:25	00d 01:00.0	55.8	73.6	59.7	45.8	-:-	59.7	57.8	56.3	47.2	46.2	----	-----	380189.4		56.6	
61	9/10/2025	8:50:25	00d 01:00.0	55.1	72.9	59.4	47.3	-:-	59	58.5	54.2	50.7	48.6	----	-----	323593.7		56.7	
62	9/10/2025	8:51:25	00d 01:00.0	57.6	75.4	62.2	47.6	-:-	61.7	60.3	57.4	49.3	48.9	----	-----	575439.9		56.7	
63	9/10/2025	8:52:25	00d 01:00.0	54	71.8	58.6	44.3	-:-	57.9	57.8	52	45.7	44.7	----	-----	251188.6		56.7	
64	9/10/2025	8:53:25	00d 01:00.0	58.8	76.6	61.9	52.9	-:-	61.2	60.7	58.9	54.7	54	----	-----	758577.6		56.8	
65	9/10/2025	8:54:25	00d 01:00.0	56.4	74.2	64	42.4	-:-	63.5	62.5	52	42.8	42.5	----	-----	436515.8		56.7	
66	9/10/2025	8:55:25	00d 01:00.0	55.9	73.7	59.7	45.4	-:-	59.7	59.4	55.5	46.3	45.8	----	-----	389045.1		56.7	
67	9/10/2025	8:56:25	00d 01:00.0	60	77.8	68	51	-:-	67.6	63.7	56.7	51.5	51.2	----	-----	1000000.0		56.8	
68	9/10/2025	8:57:25	00d 01:00.0	58.3	76.1	62.4	50.9	-:-	61.8	60.9	57.9	53.1	51.3	----	-----	676083.0		56.8	
69	9/10/2025	8:58:25	00d 01:00.0	55.9	73.7	60.2	47.7	-:-	60.1	59.5	55.4	49.6	48.5	----	-----	389045.1		56.7	
70	9/10/2025	8:59:25	00d 01:00.0	55	72.8	59.7	46.3	-:-	59.1	57.5	54.5	48.7	47	----	-----	316227.8		56.7	
71	9/10/2025	9:00:25	00d 01:00.0	52.3	70.1	56.9	43.1	-:-	56.8	56	51.3	43.4	43.2	----	-----	169824.4		56.7	
72	9/10/2025	9:01:25	00d 01:00.0	59.5	77.3	68.2	51	-:-	66.7	64.8	55.5	51.7	51.2	----	-----	891250.9		56.8	
73	9/10/2025	9:02:25	00d 01:00.0	52.9	70.7	58.1	44.7	-:-	57.9	57.1	49.9	45.4	45.2	----	-----	194984.5		56.7	
74	9/10/2025	9:03:25	00d 01:00.0	54.1	71.9	58.3	41.6	-:-	58.3	58.2	51.3	42.2	41.8	----	-----	257039.6		56.7	
75	9/10/2025	9:04:25	00d 01:00.0	57.6	75.4	62.3	40.2	-:-	62.3	61.2	57.4	41.8	40.7	----	-----	575439.9		56.8	
76	9/10/2025	9:05:25	00d 01:00.0	54.4	72.2	60.6	39.6	-:-	60.2	59.2	45	39.8	39.7	----	-----	275422.9		56.7	
77	9/10/2025	9:06:25	00d 01:00.0	56.8	74.6	60.6	47	-:-	60.5	60.1	56.6	48.1	47.3	----	-----	478630.1		56.7	
78	9/10/2025	9:07:25	00d 01:00.0	57.5	75.3	63.1	44.3	-:-	62.6	61.8	55.2	45	44.5	----	-----	562341.3		56.7	
79	9/10/2025	9:08:25	00d 01:00.0	54.2	72	60.3	44.1	-:-	59.1	57.9	53	46.2	44.9	----	-----	263026.8		56.7	
80	9/10/2025	9:09:25	00d 01:00.0	56.1	73.9	60.6	49.7	-:-	60	59.4	55.6	50.6	50.2	----	-----	407380.3		56.7	
81	9/10/2025	9:10:25	00d 01:00.0	57.9	75.7	62.5	41.1	-:-	62	60.7	58	44.3	42.2	----	-----	616595.0		56.6	
82	9/10/2025	9:11:25	00d 01:00.0	55.6	73.4	60.6	40.1	-:-	60.3	59.9	54.4	40.4	40.2	----	-----	363078.1		56.6	
83	9/10/2025	9:12:25	00d 01:00.0	54.2	72	58.2	44.3	-:-	58.2	57.3	53.8	45.8	44.5	----	-----	263026.8		56.6	
84	9/10/2025	9:13:25	00d 01:00.0	56.6	74.4	61.5	42.8	-:-	61.3	60.6	55.8	43.9	43	----	-----	457088.2		56.6	
85	9/10/2025	9:14:25	00d 01:00.0	54.4	72.2	60.5	45.2	-:-	60	58.3	51.7	46.2	45.6	----	-----	275422.9		56.6	
86	9/10/2025	9:15:25	00d 01:00.0	54.5	72.3	62.7	39.5	-:-	61.7	58.7	47.9	40.6	40.2	----	-----	281838.3		56.6	
87	9/10/2025	9:16:25	00d 01:00.0	57.7	75.5	64.3	45.9	-:-	64.2	63.6	54.5	46.8	46.3	----	-----	588843.7		56.6	
88	9/10/2025	9:17:25	00d 01:00.0	54.6	72.4	58.4	41.3	-:-	58.2	57.7	55.6	42.5	41.6	----	-----	288403.2		56.6	
89	9/10/2025	9:18:25	00d 01:00.0	59.4	77.2	65	49.6	-:-	64.6	62.7	58.5	50.7	50.5	----	-----	870963.6		56.6	
90	9/10/2025	9:19:25	00d 01:00.0	55.9	73.7	60.6	42.4	-:-	60.4	59.9	53.8	44.1	42.6	----	-----	389045.1		56.6	
91	9/10/2025	9:20:25	00d 01:00.0	56.5	74.3	60.2	42.9	-:-	60	58.7	56.4	51.3	47.5	----	-----	446683.6		56.5	
92	9/10/2025	9:21:25	00d 01:00.0	57	74.8	60.6	46.9	-:-	60.6	60.4	55.6	50.1	48	----	-----	501187.2		56.5	
93	9/10/2025	9:22:25	00d 01:00.0	55.6	73.4	59.8	46.5	-:-	59.6	59.4	54.5	49.2	47.9	----	-----	363078.1		56.5	
94	9/10/2025	9:23:25	00d 01:00.0	55.6	73.4	59.6	48.3	-:-	59.4	58.7	55.1	50.7	48.6	----	-----	363078.1		56.5	
95	9/10/2025	9:24:25	00d 01:00.0	54.5	72.3	59.5	42.4	-:-	59.2	58.8	52.9	43.9	42.8	----	-----	281838.3		56.5	
96	9/10/2025	9:25:25	00d 01:00.0	54.5	72.3	58.8	45.4	-:-	58.5	58.1	51.7	46.5	45.8	----	-----	281838.3		56.5	
97	9/10/2025	9:26:25	00d 01:00.0	52	69.8	57.4	44.1	-:-	56.4	56	50.1	45.4	44.4	----	-----	158489.3		56.5	
98	9/10/2025	9:27:25	00d 01:00.0	55.1	72.9	58.5	49.1	-:-	58.4	58.1	53.7	49.7	49.3	----	-----	323593.7		56.6	
99	9/10/2025	9:28:25	00d 01:00.0	58.6	76.4	65	45.7	-:-	64.9	63.3	56.9	46.9	46.1	----	-----	724436.0		56.6	
100	9/10/2025	9:29:25	00d 01:00.0	53.8	71.6	59.9	39.4	-:-	59.7	58.8	45.5	39.8	39.6	----	-----	239883.3		56.6	
101	9/10/2025	9:30:25	00d 01:00.0	48.7	66.5	58.2	39.9	-:-	56.1	54.2	42.6	40.3	40.1	----	-----	74131.0		56.6	
102	9/10/2025	9:31:25	00d 01:00.0	58.7	76.5	64.9	48.6	-:-	64.1	62.6	57.3	49.7	48.8	----	-----	741310.2		56.7	
103	9/10/2025	9:32:25	00d 01:00.0	61.5	79.3	71.9	48.7	-:-	69.3	67.1	54.9	51.2	50.7	----	-----	1412537.5		56.6	
104	9/10/2025	9:33:25	00d 01:00.0	49.5	67.3	56	40	-:-	55.5	54.6	45.1	40.3	40.2	----	-----	89125.1		56.4	
105	9/10/2025	9:34:25	00d 01:00.0	55.1	72.9	62.3	40.4	-:-	61.4	60.2	50.6	43.1	41.9	----	-----	323593.7		56.5	
106	9/10/2025	9:35:25	00d 01:00.0	57.6	75.4	63.6	44	-:-	63.4	61.2	57.3	44.5	44.3	----	-----	575439.9		56.5	

107	9/10/2025	9:36:25	00d	01:00.0	54.5	72.3	58.9	40.5	-:-	58.3	57.7	54.3	42.7	40.7	----	-----	281838.3	56.5
108	9/10/2025	9:37:25	00d	01:00.0	57.1	74.9	66.3	39.3	-:-	64.2	61.2	53.9	40.2	39.7	----	-----	512861.4	56.5
109	9/10/2025	9:38:25	00d	01:00.0	58.1	75.9	60.4	48.8	-:-	60	59	58.1	56.6	56	----	-----	645654.2	56.5
110	9/10/2025	9:39:25	00d	01:00.0	61.9	79.7	69.4	47.7	-:-	69.3	66.2	58.5	48.3	47.9	----	-----	1548816.6	56.4
111	9/10/2025	9:40:25	00d	01:00.0	57.8	75.6	62.3	47	-:-	62.1	61.4	57.1	49.3	48.2	----	-----	602559.6	56.2
112	9/10/2025	9:41:25	00d	01:00.0	57.1	74.9	61.3	43.8	-:-	61.2	60.6	57.9	44.8	44.2	----	-----	512861.4	56.2
113	9/10/2025	9:42:25	00d	01:00.0	56.8	74.6	60.2	51.5	-:-	60	58.5	56.8	52.4	51.8	----	-----	478630.1	56.2
114	9/10/2025	9:43:25	00d	01:00.0	54.1	71.9	61.3	44.7	-:-	60.9	59.2	50.3	45.5	45.1	----	-----	257039.6	56.2
115	9/10/2025	9:44:25	00d	01:00.0	55.4	73.2	59	46.4	-:-	58.6	58.4	54.9	47.8	46.9	----	-----	346736.9	56.3
116	9/10/2025	9:45:25	00d	01:00.0	54.2	72	59	42.2	-:-	58.9	58.4	52.1	44	43	----	-----	263026.8	56.3
117	9/10/2025	9:46:25	00d	01:00.0	56.5	74.3	63	46.8	-:-	62.9	61.8	54.1	48.5	47.5	----	-----	446683.6	56.3
118	9/10/2025	9:47:25	00d	01:00.0	58.1	75.9	62.4	51.1	-:-	62	61.4	57.7	52.3	51.7	----	-----	645654.2	56.4
119	9/10/2025	9:48:25	00d	01:00.0	57.1	74.9	61.3	44.3	-:-	61	60.2	57.6	48.9	46.4	----	-----	512861.4	56.3
120	9/10/2025	9:49:25	00d	01:00.0	53.9	71.7	57.7	41.5	-:-	57.4	57.3	53.8	42	41.9	----	-----	245470.9	56.2
121	9/10/2025	9:50:25	00d	01:00.0	57	74.8	62.1	43.9	-:-	61.2	60.6	56.1	46	44.2	----	-----	501187.2	56.2
122	9/10/2025	9:51:25	00d	01:00.0	55.5	73.3	59.7	44	-:-	59.3	58.6	55	49.4	46.6	----	-----	354813.4	56.2
123	9/10/2025	9:52:25	00d	01:00.0	57.8	75.6	66.2	44	-:-	65.3	62.8	53.5	45.4	44.5	----	-----	602559.6	56.3
124	9/10/2025	9:53:25	00d	01:00.0	60.8	78.6	68	52.9	-:-	66.4	63.7	59.3	54.8	54.3	----	-----	1202264.4	56.3
125	9/10/2025	9:54:25	00d	01:00.0	53.6	71.4	58.4	41.4	-:-	58.4	57.7	52.1	42.5	41.7	----	-----	229086.8	56.2
126	9/10/2025	9:55:25	00d	01:00.0	55.3	73.1	63.7	48.2	-:-	60.6	58.2	53.4	49.2	48.7	----	-----	338844.2	56.2
127	9/10/2025	9:56:25	00d	01:00.0	59.4	77.2	66.3	42.1	-:-	65.6	64.5	55.4	43.1	42.3	----	-----	870963.6	56.2
128	9/10/2025	9:57:25	00d	01:00.0	58.7	76.5	64.3	53.5	-:-	63.7	61.8	57.5	54.8	54	----	-----	741310.2	56.1
129	9/10/2025	9:58:25	00d	01:00.0	55.2	73	59.4	45.6	-:-	59.3	58.9	53.7	47.3	45.6	----	-----	331131.1	56.1
130	9/10/2025	9:59:25	00d	01:00.0	57.6	75.4	61.9	48.8	-:-	61.9	61.5	56.4	53.4	52	----	-----	575439.9	56.1
131	9/10/2025	10:00:25	00d	01:00.0	50.2	68	58.6	37.1	-:-	58.2	55.7	43.9	38	37.4	----	-----	104712.9	56.1
132	9/10/2025	10:01:25	00d	01:00.0	58.6	76.4	63.4	45.1	-:-	62.3	60.5	58.6	54.9	52.4	----	-----	724436.0	56.2
133	9/10/2025	10:02:25	00d	01:00.0	56.7	74.5	60.2	49	-:-	60	59.1	56.1	51.4	49.6	----	-----	467735.1	56.1
134	9/10/2025	10:03:25	00d	01:00.0	55.6	73.4	59.4	43.5	-:-	59.1	58.7	55.8	45.5	44.4	----	-----	363078.1	56.1
135	9/10/2025	10:04:25	00d	01:00.0	56.8	74.6	61	49.1	-:-	60.7	59.8	56.5	50.4	50	----	-----	478630.1	56.1
136	9/10/2025	10:05:25	00d	01:00.0	53.7	71.5	60.8	44.6	-:-	59.5	58.6	50.7	46.3	45	----	-----	234422.9	56.2
137	9/10/2025	10:06:25	00d	01:00.0	55.3	73.1	58.1	45.3	-:-	58	57.9	55.7	46.4	45.8	----	-----	338844.2	56.2
138	9/10/2025	10:07:25	00d	01:00.0	56.8	74.6	59.7	48.6	-:-	59.2	58.9	57.3	50.3	49.2	----	-----	478630.1	56.2
139	9/10/2025	10:08:25	00d	01:00.0	54.6	72.4	59.2	39.8	-:-	59.2	58.7	53.8	41.2	40	----	-----	288403.2	56.2
140	9/10/2025	10:09:25	00d	01:00.0	53	70.8	56.9	41.6	-:-	56.5	55.5	53.1	45.4	44.8	----	-----	199526.2	56.1
141	9/10/2025	10:10:25	00d	01:00.0	52	69.8	57.5	40.7	-:-	57.2	56.8	48.8	41.9	41	----	-----	158489.3	56.4
142	9/10/2025	10:11:25	00d	01:00.0	50.4	68.2	57.5	40.1	-:-	57.2	55.1	47	41.2	40.5	----	-----	109647.8	56.4
143	9/10/2025	10:12:25	00d	01:00.0	54.5	72.3	57.4	41.7	-:-	57.3	57.3	54.3	43.6	42.1	----	-----	281838.3	56.5
144	9/10/2025	10:13:25	00d	01:00.0	57.3	75.1	63.8	41.7	-:-	62.5	60.9	56.2	46.1	43.4	----	-----	537031.8	56.5
145	9/10/2025	10:14:25	00d	01:00.0	55.4	73.2	59.1	52	-:-	58.1	57.7	54.3	52.8	52.2	----	-----	346736.9	56.5
146	9/10/2025	10:15:25	00d	01:00.0	55.8	73.6	61.2	43.7	-:-	60.4	59.6	53.7	44.4	44	----	-----	380189.4	56.5
147	9/10/2025	10:16:25	00d	01:00.0	57.5	75.3	64	43.9	-:-	61.8	60.7	55.5	45.5	43.9	----	-----	562341.3	56.5
148	9/10/2025	10:17:25	00d	01:00.0	55.1	72.9	58.7	46.1	-:-	58.1	57.8	54.5	48.6	46.6	----	-----	323593.7	56.5
149	9/10/2025	10:18:25	00d	01:00.0	56.6	74.4	62.6	47	-:-	61.7	60.3	55.1	48.3	47.3	----	-----	457088.2	56.5
150	9/10/2025	10:19:25	00d	01:00.0	57.1	74.9	60	50.8	-:-	59.9	59.6	56.9	52.4	51.2	----	-----	512861.4	56.5
151	9/10/2025	10:20:25	00d	01:00.0	49.4	67.2	58.9	36.6	-:-	57.8	55.9	39.2	37.1	36.8	----	-----	87096.4	56.5
152	9/10/2025	10:21:25	00d	01:00.0	57.1	74.9	60.3	49.9	-:-	60.1	59.7	57.1	51.8	50.5	----	-----	512861.4	56.6
153	9/10/2025	10:22:25	00d	01:00.0	55.7	73.5	59.9	50.2	-:-	59.5	59	54.4	51.6	51.1	----	-----	371535.2	56.6
154	9/10/2025	10:23:25	00d	01:00.0	55.8	73.6	59.2	48.6	-:-	58.7	58.3	55.1	50.9	49.4	----	-----	380189.4	56.5
155	9/10/2025	10:24:25	00d	01:00.0	53.9	71.7	59.4	45.6	-:-	59.1	57.1	53.1	46	45.8	----	-----	245470.9	56.5
156	9/10/2025	10:25:25	00d	01:00.0	57.2	75	61.8	51.2	-:-	61.2	60.2	56.6	52	51.3	----	-----	524807.5	56.5
157	9/10/2025	10:26:25	00d	01:00.0	54.2	72	59.2	42.1	-:-	59.3	58.7	51.6	43.5	42.8	----	-----	263026.8	56.5
158	9/10/2025	10:27:25	00d	01:00.0	57.9	75.7	61.8	54.9	-:-	61.3	59.7	57.5	55.7	55	----	-----	616595.0	56.5
159	9/10/2025	10:28:25	00d	01:00.0	54.7	72.5	60.4	47.6	-:-	60.3	57.3	53.7	48.6	47.9	----	-----	295120.9	56.5
160	9/10/2025	10:29:25	00d	01:00.0	57.7	75.5	60.2	53.2	-:-	60.2	59.9	57.8	53.9	53.8	----	-----	588843.7	56.5
161	9/10/2025	10:30:25	00d	01:00.0	56.9	74.7	61.4	50.1	-:-	61	60.4	55.8	52.3	51.1	----	-----	489778.8	56.5
162	9/10/2025	10:31:25	00d	01:00.0	57.4	75.2	62.6	48.1	-:-	62.2	61.6	56.1	49.7	48.7	----	-----	549540.9	56.5
163	9/10/2025	10:32:25	00d	01:00.0	53.8	71.6	58.3	39.8	-:-	58	57.6	52.7	40.4	40.1	----	-----	239883.3	56.4
164	9/10/2025	10:33:25	00d	01:00.0	55.6	73.4	61.2	39.3	-:-	60.8	59.6	55.3	39.8	39.7	----	-----	363078.1	56.4
165	9/10/2025	10:34:25	00d	01:00.0	55	72.8	60	46.5	-:-	59.8	59.5	52.4	47.6	46.8	----	-----	316227.8	56.5
166	9/10/2025	10:35:25	00d	01:00.0	56.4	74.2	59.7	49	-:-	59.5	59	56.4	51.9	49.9	----	-----	436515.8	56.5
167	9/10/2025	10:36:25	00d	01:00.0	56	73.8	60.5	48.6	-:-	60.2	58.6	55	50	49.4	----	-----	398107.2	56.5
168	9/10/2025	10:37:25	00d	01:00.0	56.5	74.3	60.2	48.4	-:-	60	59.2	56.5	49.8	48.6	----	-----	446683.6	56.6
169	9/10/2025	10:38:25	00d	01:00.0	55.3	73.1	60.1	43.9	-:-	59.5	59.3	53.4	45.1	44.3	----	-----	338844.2	56.6
170	9/10/2025	10:39:25	00d	01:00.0	56.5	74.3	60.4	46.4	-:-	59.8	58.7	56.9	48.9	47.8	----	-----	446683.6	56.6
171	9/10/2025	10:40:25	00d	01:00.0	53.9	71.7	58.2	41.3	-:-	58.1	57.8	52.2	42.3	42	----	-----	245470.9	56.6
172	9/10/2025	10:41:25	00d	01:00.0	58	75.8	63.5	42.5	-:-	62.6	61.3	58	43.8	42.7	----	-----	630957.3	56.7
173	9/10/2025	10:42:25	00d	01:00.0	56.5	74.3	60.9	42.5	-:-	60.3	59.9	56.4	46.5	43.9	----	-----	446683.6	56.6
174	9/10/2025	10:43:25	00d	01:00.0	57	74.8	59.9	52.8	-:-	59.7	59.3	56.8	53.8	53.1	----	-----	501187.2	56.6
175	9/10/2025	10:44:25	00d	01:00.0	56.5	74.3	62.5	43.5	-:-	61.9	60.3	54.8	44.6	43.8	----	-----	446683.6	56.7
176	9/10/2025	10:45:25	00d	01:00.0	56.9	74.7	62.4	41	-:-	62.2	62	53	42.7	41.5	----	-----	489778.8	56.7
177	9/10/2025	10:46:25	00d	01:00.0	55.5	73.3	61.6	45	-:-	61	60.7	52.6	45.8	45.2	----	-----	354813.4	56.7
178	9/10/2025	10:47:25	00d	01:00.0	59.4	77.2	62	54.2	-:-	61.8	61.3	59.2	56.5	54.9	----	-----	870963.6	56.7
179	9/10/2025	10:48:25	00d	01:00.0	52.2	70	61.2	36.5	-:-	59.2	56.6	48.8	37.8	37.2	----	-----	165958.7	56.8
180	9/10/2025	10:49:25	00d	01:00.0	53.3	71.1	58.2	44.3	-:-	58.2	57.8	50.4	45.8	45.1	----	-----	213796.2	56.8
181	9/10/2025	10:50:25	00d	01:00.0	54.2	72	58.3	47.1	-:-	57.4	56.9	53.8	49.9	47.8	----	-----	263026.8	56.8
182	9/10/2025	10:51:25	00d	01:00.0	57.6	75.4	62	46.3	-:-	61.9	61	57.7	47.4	47.1	----	-----	575439.9	56.8
183	9/10/2025	10:52:25	00d	01:00.0	57.7	75.5	62.7	40	-:-	62.2	61.3	56	44.7	41.3	----	-----	588843.7	56.8
184	9/10/2025	10:53:25	00d	01:00.0	56.4	74.2	61.5	38.2	-:-	61.2	60.5	53	38.9	38.4	----	-----	436515.8	56.8
185	9/10/2025	10:54:25	00d	01:00.0	57.6	75.4	63.2	46.1	-:-	63	61.7	56.9	47.6	47	----	-----	575439.9	56.8
186	9/10/2025	10:55:25	00d	01:00.0	57.3	75.1	61.5	46.3	-:-	61.3	60.6	56.4	48.2	46.6	----	-----	537031.8	56.8
187	9/10/2025	10:56:25	00d	01:00.0	55.1	72.9	59.6	47	-:-	59.3	58.7	53.5	49	47.5	----	-----	323593.7	56.7
188	9/10/2025	10:57:25	00d	01:00.0	56.1	73.9	59.4	48.9	-:-	59.4	59.2	55.8	50.6	49.2	----	-----	407380.3	56.8
189	9/10/2025	10:58:25	00d	01:00.0	56.4	74.2	64	43.6	-:-	63.5	59.7	53	45.4	44.1	----	-----	436515.8	56.7
190	9/10/2025	10:59:25	00d	01:00.0	56.8	74.6	62	42.5	-:-	61.6	61.2	55.1	43.1	42.8	----	-----	478630.1	56.7
191	9/10/2025	11:00:25	00d	01:00.0	56.9	74.7	61.5	40.8	-:-	61.1	60.6	56.4	42	41.1	----	-----	489778.8	56.7
192	9/10/2025	11:01:25	00d	01:00.0	58.5	76.3	65.7	51.5	-:-	65.4	61.4	56.5	52.7	52.4	----	-----	707945.8	56.8
193	9/10/2025	11:02:25	00d	01:00.0	56.4	74.2	60.1	51.1	-:-	59.1	58.8	56.2	53.8	52	----	-----	436515.8	56.7
194	9/10/2025	11:03:25	00d	01:00.0	55.4	73.2	60.6	39.5	-:-	60.5	59.4	55.5	41.8	40.4	----	-----	346736.9	56.7
195	9/10/2025	11:04:25	00d	01:00.0	57	74.8	60.7	47.3	-:-	60.4	60	57.2	48.5	48.2	----	-----	501187.2	56.7
196	9/10/2025	11:05:25	00d	01:00.0	60.2	78	66.9	48	-:-	66	63	59.5	54.2	51.6	----	-----	1047128.5	56.6
197	9/10/2025	11:06:25	00d	01:00.0	52.8	70.6	59.6	40.7	-:-	59	58.2	48.4	42	41.2	----	-----	190546.1	56.6
198	9/10/2025	11:07:25	00d	01:00.0	49.8	67.6	58.9	38	-:-	58.6	57.4	39.4	38.3	38.1	----	-----	95499.3	56.6
199	9/10/2025	11:08:25	00d	01:00.0	54.7	72.5	59	38.9	-:-	58.9	58.5	54.1	41.5	40.8	----	-----	295120.9	56.8
200	9/10/2025	11:09:25	00d	01:00.0	53.3	71.1	57.6	39.2	-:-	57.4	56.6	53.4	39.5	39.4	----	-----	213796.2	56.7
201	9/10/2025	11:10:25	00d	01:00.0	62.3	80.1	68.8	55.9	-:-	68.4	66.7	61	58.5	58.2	----	-----	1698243.7	56.8
202	9/10/2025	11:11:25	00d	01:00.0	55.1	72.9	59.8	42.4	-:-	59.7	58.5	54	43.9	43.1	----	-----	323593.7	56.6
203	9/10/2025	11:12:25	00d	01:00.0	56.9	74.7	61.4	47.5	-:-	61.3	60.5	56.5	49.2	48.1	----	-----	489778.8	56.6
204	9/10/2025	11:13:25	00d	01:00.0	55.6	73.4	60.2	41	-:-	59.8	59.3	54.4	42.9	41.8	----	-----	363078.1	56.6
205	9/10/2025	11:14:25	00d	01:00.0	56.1	73.9	59.5	41.2	-:-	59.3	59	56.3	43.7	42.1	----	-----	407380.3	56.6
206	9/10/2025	11:15:25	00d	01:00.0	58.3	76.1	69.7	40.5	-:-	62.8	60.8	55.2	42.5	41.4	----	-----	676083.0	56.6
207	9/10/2025	11:16:25	00d	01:00.0	53.5	71.3	61.6	38.8	-:-	60.8	58.8	46.1	39.4	39.1	----	-----	223872.1	56.6
208	9/10/2025	11:17:25	00d	01:00.0	56.8	74.6	62	44.7	-:-	61.7	61.1	55.7	47.4	46.1	----	-----	478630.1	56.7
209	9/10/2025	11:18:25	00d	01:00.0	53.8	71.6	58.9	42.1	-:-	58	57.7	51.9	44.3	43	----	-----	239883.3	56.6
210	9/10/2025	11:19:25	00d	01:00.0	59.2	77	63.1	40.1	-:-	62.8	62.5	58.7	42.6	40.6	----	-----	831763.8	56.7
211	9/10/2025	11:20:25	00d	01:00.0	56.8	74.6	63.2	39.5	-:-	62.4	60.6	56.1	40.9	40	----	-----	478630.1	56.6
212	9/10/2025	11:21:25	00d	01:00.0	53.7	71.5	59	39.5	-:-	58.3	58	51	40.8	39.6	----	-----	234422.9	56.6
213	9/10/2025	11:22:25	00d	01:00.0	57.5	75.3	61.5	43.5	-:-	61.2	60.8	56.6	49.7	49.2	----	-----	562341.3	56.6
214	9/10/2025	11:23:25	00d	01:00.0	54.3	72.1	58.7	44.2	-:-	58.4	58	53.3	47.5	46.6	----	-----	269153.5	56.6
215	9/10/2025	11:24:25	00d	01:00.0	55.7	73.5	60.2	39.6	-:-	59.6	59.5	55.3	41.1	39.9	----	-----	371535.2	56.6

216	9/10/2025	11:25:25	00d	01:00.0	54.3	72.1	59.7	37.3	-:-	59.5	58.7	47.1	37.8	37.6	----	-----	269153.5	56.6
217	9/10/2025	11:26:25	00d	01:00.0	55.5	73.3	59.4	42.5	-:-	59.1	58.7	54.2	48.5	47	----	-----	354813.4	56.6
218	9/10/2025	11:27:25	00d	01:00.0	56.5	74.3	60.9	45.1	-:-	60.6	60	56.2	47.5	45.9	----	-----	446683.6	56.6
219	9/10/2025	11:28:25	00d	01:00.0	55.5	73.3	60.3	48.5	-:-	60	58.2	54.8	49.7	49	----	-----	354813.4	56.6
220	9/10/2025	11:29:25	00d	01:00.0	52.1	69.9	57.8	42.9	-:-	57.3	56.5	50	44	43.2	----	-----	162181.0	56.6
221	9/10/2025	11:30:25	00d	01:00.0	58.1	75.9	64	43.2	-:-	63	61.6	57.5	48.9	45.6	----	-----	645654.2	56.7
222	9/10/2025	11:31:25	00d	01:00.0	56.5	74.3	62.8	46.5	-:-	62.5	60.5	55.1	48.3	46.8	----	-----	446683.6	56.7
223	9/10/2025	11:32:25	00d	01:00.0	53.6	71.4	60.8	43.3	-:-	58.6	57.6	51.7	45.4	44.1	----	-----	229086.8	56.7
224	9/10/2025	11:33:25	00d	01:00.0	49.3	67.1	55.3	37.3	-:-	54.9	53.9	45.7	38.3	37.8	----	-----	85113.8	56.7
225	9/10/2025	11:34:25	00d	01:00.0	58.9	76.7	67	42	-:-	65.9	62.9	56.5	43.9	42.8	----	-----	776247.1	56.8
226	9/10/2025	11:35:25	00d	01:00.0	58	75.8	61.6	51.7	-:-	61.3	60.8	57.6	54	53.2	----	-----	630957.3	56.7
227	9/10/2025	11:36:25	00d	01:00.0	51.1	68.9	56.8	42.8	-:-	56.2	54.6	49.1	43.4	43.3	----	-----	128825.0	56.7
228	9/10/2025	11:37:25	00d	01:00.0	59.9	77.7	66.4	48.4	-:-	65.6	64	59.3	50.2	49.5	----	-----	977237.2	56.7
229	9/10/2025	11:38:25	00d	01:00.0	57.3	75.1	63.4	48.3	-:-	62.9	60.9	54.8	49.6	48.8	----	-----	537031.8	56.6
230	9/10/2025	11:39:25	00d	01:00.0	55.1	72.9	60.6	36.7	-:-	60.2	59.1	55	37.6	36.9	----	-----	323593.7	56.7
231	9/10/2025	11:40:25	00d	01:00.0	58.5	76.3	64.1	43.5	-:-	63.3	61.8	57.5	52.5	51.1	----	-----	707945.8	56.7
232	9/10/2025	11:41:25	00d	01:00.0	56.8	74.6	61.2	49.8	-:-	60.8	60.1	56.1	51.5	51.1	----	-----	478630.1	56.6
233	9/10/2025	11:42:25	00d	01:00.0	55.2	73	57.6	49.3	-:-	57.6	57.4	55.3	50.7	50	----	-----	331131.1	56.7
234	9/10/2025	11:43:25	00d	01:00.0	58.3	76.1	63.7	46.3	-:-	63.2	61.4	57.4	48.3	46.6	----	-----	676083.0	56.7
235	9/10/2025	11:44:25	00d	01:00.0	58	75.8	65.7	41.5	-:-	65.5	63.3	55	42	41.6	----	-----	630957.3	56.6
236	9/10/2025	11:45:25	00d	01:00.0	55.2	73	63.6	42	-:-	61.2	59.9	50.6	43.7	42.8	----	-----	331131.1	56.6
237	9/10/2025	11:46:25	00d	01:00.0	59.2	77	61.9	52.2	-:-	61.3	61.1	59.1	55.9	53.4	----	-----	831763.8	56.6
238	9/10/2025	11:47:25	00d	01:00.0	55.7	73.5	62.1	39.8	-:-	61.9	61.3	52.9	40.2	40.1	----	-----	371535.2	56.6
239	9/10/2025	11:48:25	00d	01:00.0	60.7	78.5	66.9	54.5	-:-	66.3	62.6	59.6	57	56.8	----	-----	1174897.6	56.6
240	9/10/2025	11:49:25	00d	01:00.0	56.2	74	59.9	49.1	-:-	60	59.4	55.7	51.3	49.8	----	-----	416869.4	56.5
241	9/10/2025	11:50:25	00d	01:00.0	56	73.8	60.3	43.3	-:-	60.1	59.3	55.8	44.9	44	----	-----	398107.2	56.5
242	9/10/2025	11:51:25	00d	01:00.0	52	69.8	56.6	40.4	-:-	56	55.1	51	42	40.8	----	-----	158489.3	56.4
243	9/10/2025	11:52:25	00d	01:00.0	56.7	74.5	60.9	49.6	-:-	60.4	60.2	56.4	51.2	50.7	----	-----	467735.1	56.5
244	9/10/2025	11:53:25	00d	01:00.0	56.5	74.3	60.3	51	-:-	59.8	58.6	56.1	52.3	51.5	----	-----	446683.6	56.5
245	9/10/2025	11:54:25	00d	01:00.0	55.9	73.7	59.8	42.9	-:-	59.6	59.4	55.9	44.8	43.4	----	-----	389045.1	56.5
246	9/10/2025	11:55:25	00d	01:00.0	59.4	77.2	66	48.2	-:-	65.4	63.4	57.5	50.1	48.9	----	-----	870963.6	56.5
247	9/10/2025	11:56:25	00d	01:00.0	50.3	68.1	57.5	38.9	-:-	57.2	55	47.4	39.9	39.7	----	-----	107151.9	56.4
248	9/10/2025	11:57:25	00d	01:00.0	56.4	74.2	60.5	43.5	-:-	60.3	59.5	56.6	45.1	43.8	----	-----	436515.8	56.4
249	9/10/2025	11:58:25	00d	01:00.0	51.7	69.5	57.9	38	-:-	57.6	56.2	50.4	39.4	38.8	----	-----	147910.8	56.4
250	9/10/2025	11:59:25	00d	01:00.0	57.6	75.4	61.1	45.6	-:-	60.9	60.9	57.9	47.7	46.1	----	-----	575439.9	56.4
251	9/10/2025	12:00:25	00d	01:00.0	55.8	73.6	60.2	39.1	-:-	60	59.4	55.4	39.9	39.4	----	-----	380189.4	56.4
252	9/10/2025	12:01:25	00d	01:00.0	59.1	76.9	64.6	44.4	-:-	64.6	62.7	58.4	50.5	49.8	----	-----	812830.5	56.3
253	9/10/2025	12:02:25	00d	01:00.0	55.5	73.3	60.2	43.9	-:-	59.9	59.8	53.4	46	44.7	----	-----	354813.4	56.3
254	9/10/2025	12:03:25	00d	01:00.0	53.5	71.3	59.1	43.5	-:-	58.8	57.6	51.8	44.2	43.5	----	-----	223872.1	56.3
255	9/10/2025	12:04:25	00d	01:00.0	54.7	72.5	57.9	42.6	-:-	57.4	57.1	55.4	44.6	42.9	----	-----	295120.9	56.3
256	9/10/2025	12:05:25	00d	01:00.0	54.9	72.7	61	39.6	-:-	60.3	59	50.8	40.9	40.4	----	-----	309029.5	56.4
257	9/10/2025	12:06:25	00d	01:00.0	56.7	74.5	60.5	41.8	-:-	60.2	59.9	56.5	42.4	42	----	-----	467735.1	56.4
258	9/10/2025	12:07:25	00d	01:00.0	57.7	75.5	61.6	52.4	-:-	61.2	60.5	56.4	53.2	52.6	----	-----	588843.7	56.5
259	9/10/2025	12:08:25	00d	01:00.0	60.1	77.9	67.9	44.5	-:-	67.6	64.9	57.5	47	45.2	----	-----	1023293.0	57.0
260	9/10/2025	12:09:25	00d	01:00.0	51.4	69.2	57.2	42	-:-	56.6	55.2	49.8	43.6	42.6	----	-----	138038.4	56.9
261	9/10/2025	12:10:25	00d	01:00.0	58.6	76.4	66.5	50.6	-:-	66.3	61.9	55.5	52.1	51.5	----	-----	724436.0	56.9
262	9/10/2025	12:11:25	00d	01:00.0	57	74.8	60.9	43.3	-:-	60.9	60.7	56.4	44.2	43.9	----	-----	501187.2	56.9
263	9/10/2025	12:12:25	00d	01:00.0	55.7	73.5	60.5	48.5	-:-	60.1	59.2	54.7	49.8	49.1	----	-----	371535.2	56.8
264	9/10/2025	12:13:25	00d	01:00.0	55.8	73.6	59	47.3	-:-	58.9	58.5	55.6	48.3	47.9	----	-----	380189.4	56.8
265	9/10/2025	12:14:25	00d	01:00.0	54.6	72.4	60.3	41.6	-:-	59.9	58.5	52.7	42.8	42	----	-----	288403.2	56.8
266	9/10/2025	12:15:25	00d	01:00.0	57.9	75.7	61.5	45.8	-:-	61.2	60.7	58.1	48	46.7	----	-----	616595.0	56.9
267	9/10/2025	12:16:25	00d	01:00.0	58.3	76.1	61.1	54.8	-:-	60.8	60.4	57.9	55.7	55.2	----	-----	676083.0	56.9
268	9/10/2025	12:17:25	00d	01:00.0	54.9	72.7	60.8	45	-:-	60.4	59.6	53.7	47.9	46.7	----	-----	309029.5	56.8
269	9/10/2025	12:18:25	00d	01:00.0	55.3	73.1	60.8	40.7	-:-	60.7	59.1	53.9	42.9	41.2	----	-----	338844.2	56.8
270	9/10/2025	12:19:25	00d	01:00.0	55.9	73.7	59.1	48.4	-:-	58.7	58.4	55.2	51	50.1	----	-----	389045.1	56.8
271	9/10/2025	12:20:25	00d	01:00.0	55.6	73.4	60.6	37.9	-:-	60.5	60	55.8	39.2	38.9	----	-----	363078.1	56.8
272	9/10/2025	12:21:25	00d	01:00.0	57.4	75.2	64	50.8	-:-	63.2	61.9	55.4	51.5	51	----	-----	549540.9	56.8
273	9/10/2025	12:22:25	00d	01:00.0	52.5	70.3	59.1	37.7	-:-	58.5	57.2	47.2	38.3	37.8	----	-----	177827.9	56.8
274	9/10/2025	12:23:25	00d	01:00.0	57.1	74.9	60.1	50.3	-:-	60	59.2	57.1	51.9	50.4	----	-----	512861.4	56.8
275	9/10/2025	12:24:25	00d	01:00.0	56.1	73.9	60.2	50.2	-:-	59.7	59.6	55	51.7	51.1	----	-----	407380.3	56.8
276	9/10/2025	12:25:25	00d	01:00.0	56.1	73.9	60.9	43.7	-:-	60.4	59.6	55.4	45	44.3	----	-----	407380.3	56.8
277	9/10/2025	12:26:25	00d	01:00.0	56.2	74	63.1	44.4	-:-	62.2	59.7	55.5	46.3	44.8	----	-----	416869.4	56.8
278	9/10/2025	12:27:25	00d	01:00.0	56.8	74.6	61.6	48.5	-:-	60.3	59.4	56.5	51	49.4	----	-----	478630.1	56.8
279	9/10/2025	12:28:25	00d	01:00.0	53.5	71.3	58.7	39.7	-:-	58.4	57.5	51.5	42.8	40.9	----	-----	223872.1	56.8
280	9/10/2025	12:29:25	00d	01:00.0	56.5	74.3	61.8	39.3	-:-	61.3	61.1	51.6	42.2	41.5	----	-----	446683.6	56.9
281	9/10/2025	12:30:25	00d	01:00.0	58.3	76.1	64	48	-:-	63.3	62.2	56.9	51.1	50.1	----	-----	676083.0	56.9
282	9/10/2025	12:31:25	00d	01:00.0	56.5	74.3	60.4	49.2	-:-	60.2	59.5	56.2	50	49.6	----	-----	446683.6	56.8
283	9/10/2025	12:32:25	00d	01:00.0	55.4	73.2	59.8	46.9	-:-	59.3	58.8	54.9	47.9	47.4	----	-----	346736.9	56.8
284	9/10/2025	12:33:25	00d	01:00.0	55.9	73.7	58.9	46.3	-:-	58.8	58.4	55.5	49	46.9	----	-----	389045.1	56.8
285	9/10/2025	12:34:25	00d	01:00.0	58.3	76.1	64.3	47.5	-:-	63.7	62.4	57	50.9	50	----	-----	676083.0	56.8
286	9/10/2025	12:35:25	00d	01:00.0	54.8	72.6	59	44.6	-:-	58.5	57.7	54.4	45.7	45.2	----	-----	301995.2	56.9
287	9/10/2025	12:36:25	00d	01:00.0	56.4	74.2	60.5	46.4	-:-	60.2	59.5	56	51.2	50.2	----	-----	436515.8	56.9
288	9/10/2025	12:37:25	00d	01:00.0	56.3	74.1	63.1	44	-:-	61.4	59.3	55.3	47	44.9	----	-----	426579.5	56.9
289	9/10/2025	12:38:25	00d	01:00.0	56.5	74.3	60.2	50.8	-:-	59.9	59.8	55.4	51.5	51	----	-----	446683.6	56.9
290	9/10/2025	12:39:25	00d	01:00.0	58.6	76.4	63.6	50.6	-:-	63.6	62.4	57	51.3	50.8	----	-----	724436.0	56.8
291	9/10/2025	12:40:25	00d	01:00.0	56.9	74.7	61.9	50.7	-:-	61.4	60.2	56	52.8	52	----	-----	489778.8	56.8
292	9/10/2025	12:41:25	00d	01:00.0	55.3	73.1	60.2	41.4	-:-	60.1	59.6	53.6	44.7	41.5	----	-----	338844.2	56.8
293	9/10/2025	12:42:25	00d	01:00.0	58.1	75.9	60.7	51.7	-:-	60.5	60.2	58	54.9	53.1	----	-----	645654.2	57.0
294	9/10/2025	12:43:25	00d	01:00.0	56.8	74.6	60.6	48.1	-:-	60.6	59.4	56.6	50.2	49	----	-----	478630.1	56.9
295	9/10/2025	12:44:25	00d	01:00.0	53.8	71.6	59.7	38.3	-:-	58.7	57.5	51.5	39.3	39.2	----	-----	239883.3	56.9
296	9/10/2025	12:45:25	00d	01:00.0	57.1	74.9	60.8	41.1	-:-	60.3	59.7	57.6	45.1	43.4	----	-----	512861.4	56.9
297	9/10/2025	12:46:25	00d	01:00.0	54.5	72.3	60.6	43.2	-:-	60.5	59.8	51.9	44.9	44.3	----	-----	281838.3	56.9
298	9/10/2025	12:47:25	00d	01:00.0	58.6	76.4	62.5	46.9	-:-	62.1	61.4	58.8	48.8	47.5	----	-----	724436.0	56.9
299	9/10/2025	12:48:25	00d	01:00.0	58.1	75.9	61.1	54.3	-:-	60.5	59.8	58	55.2	54.4	----	-----	645654.2	56.9
300	9/10/2025	12:49:25	00d	01:00.0	55.9	73.7	61	47.4	-:-	60.9	58.4	55	49.7	48.1	----	-----	389045.1	56.9
301	9/10/2025	12:50:25	00d	01:00.0	52.4	70.2	59.3	39.9	-:-	59.2	56.9	49.2	42.8	42.1	----	-----	173780.1	56.8
302	9/10/2025	12:51:25	00d	01:00.0	54.9	72.7	59.3	39.3	-:-	58.9	57.8	54.1	46.1	42.4	----	-----	309029.5	56.9
303	9/10/2025	12:52:25	00d	01:00.0	55.4	73.2	59.7	47.6	-:-	59.1	58.2	54.8	49	47.8	----	-----	346736.9	56.9
304	9/10/2025	12:53:25	00d	01:00.0	57.1	74.9	60.3	48.5	-:-	60.1	59.9	57.5	49.5	48.9	----	-----	512861.4	57.0
305	9/10/2025	12:54:25	00d	01:00.0	56.1	73.9	60.8	46.4	-:-	60.4	58.9	55.6	50.7	47.5	----	-----	407380.3	56.9
306	9/10/2025	12:55:25	00d	01:00.0	55.1	72.9	59.5	43.6	-:-	59.2	58.1	54.2	49.9	47.2	----	-----	323593.7	56.9
307	9/10/2025	12:56:25	00d	01:00.0	55.7	73.5	61.1	43.6	-:-	60.6	59.5	54.7	45.6	44.6	----	-----	371535.2	57.0
308	9/10/2025	12:57:25	00d	01:00.0	54.5	72.3	60.2	46.5	-:-	59.8	59	52.8	48.5	47.2	----	-----	281838.3	57.0
309	9/10/2025	12:58:25	00d	01:00.0	55.2	73	61.1	43.3	-:-	60.6	59.6	54	46.1	45.2	----	-----	331131.1	57.1
310	9/10/2025	12:59:25	00d	01:00.0	52.3	70.1	57.9	42.3	-:-	57.8	56.3	51.2	43.7	43	----	-----	169824.4	57.1
311	9/10/2025	13:00:25	00d	01:00.0	55.6	73.4	61.3	39.8	-:-	61.2	60.5	53.3	46.5	44.1	----	-----	363078.1	57.2
312	9/10/2025	13:01:25	00d	01:00.0	54.5	72.3	59.9	39.7	-:-	59.4	58.9	49.3	41.1	40.3	----	-----	281838.3	57.2
313	9/10/2025	13:02:25	00d	01:00.0	56.1	73.9	62.8	44.2	-:-	61.7	59.9	54.3	47.2	46.1	----	-----	407380.3	57.2
314	9/10/2025	13:03:25	00d	01:00.0	58	75.8	64.2	49.5	-:-	61.6	61.1	57.7	52.2	50.8	----	-----	630957.3	57.2
315	9/10/2025	13:04:25	00d	01:00.0	53.1	70.9	59.5	39.4	-:-	59.4	57.9	50.9	41	39.2	----	-----	204173.8	57.1
316	9/10/2025	13:05:25	00d	01:00.0	58.4	76.2	64.7	49.4	-:-	64.1	63	55.1	51.3	50	----	-----	691831.0	57.1
317	9/10/2025	13:06:25	00d	01:00.0	57.2	75	66	47.6	-:-	64.4	60.1	55	50.1	47.9	----	-----	524807.5	57.1
318	9/10/2025	13:07:25	00d	01:00.0	58.9	76.7	66	47	-:-	64.8	63.3	57	49.4	47.6	----	-----	776247.1	57.1
319	9/10/2025	13:08:25	00d	01:00.0	65.9	83.7	74.8	52.4	-:-	74	72.6	58.5	53.7	52.6	----	-----	3890451.4	57.1
320	9/10/2025	13:09:25	00d	01:00.0	55	72.8	60.3	42.7	-:-	59.3	58.5	53.5	46.2	43.9	----	-----	316227.8	56.6
321	9/10/2025	13:10:25	00d	01:00.0	57.5	75.3	61.8	42.7	-:-	61.6	61.5	55.9	43.8	43.2	----	-----	562341.3	56.6
322	9/10/2025	13:11:25	00d	01:00.0	55.4	73.2	60.7	43.6	-:-	60.5	59.2	54.7	44.7	44.3	----	-----	346736.9	56.6
323	9/10/2025	13:12:25	00d	01:00.0	53.8	71.6	60.8	44.4	-:-	59.4	58.5	50.6	45	44.7	----	-----	239883.3	56.7
324	9/10/2025	13:13:25	00d	01:00.0	55.3	73.1	61.6	43.7	-:-	61.4	61.1	53.9	45.7	43.8	----	-----	338844.2	56.7

325	9/10/2025	13:14:25	00d	01:00.0	56.7	74.5	61.6	43.1	-:-	61.2	60.5	56.2	44.9	43.6	----	-----	467735.1	56.7
326	9/10/2025	13:15:25	00d	01:00.0	57.3	75.1	64.4	45.2	-:-	63.8	61.2	54.9	47.3	46.2	----	-----	537031.8	56.7
327	9/10/2025	13:16:25	00d	01:00.0	56.6	74.4	60.9	42.3	-:-	60.7	60.1	55.8	45.5	42.7	----	-----	457088.2	56.7
328	9/10/2025	13:17:25	00d	01:00.0	52.7	70.5	58.9	39.7	-:-	58.4	56.5	50.9	40.9	39.8	----	-----	186208.7	56.6
329	9/10/2025	13:18:25	00d	01:00.0	55.2	73	62.7	50.4	-:-	60.1	57.8	53.2	51.3	51.1	----	-----	331131.1	56.7
330	9/10/2025	13:19:25	00d	01:00.0	56.3	74.1	60.6	42.6	-:-	59.9	59.8	56.7	44	43.3	----	-----	426579.5	56.7
331	9/10/2025	13:20:25	00d	01:00.0	55.2	73	60.5	42.6	-:-	60.1	58.7	53.9	45.8	44.3	----	-----	331131.1	56.7
332	9/10/2025	13:21:25	00d	01:00.0	56.6	74.4	60.8	48.7	-:-	60.6	59.6	56.2	50.6	49.5	----	-----	457088.2	56.7
333	9/10/2025	13:22:25	00d	01:00.0	55.4	73.2	60.4	46.8	-:-	60.3	59.9	55	48.1	47.1	----	-----	346736.9	56.7
334	9/10/2025	13:23:25	00d	01:00.0	53	70.8	58.8	37.6	-:-	58.6	58.1	47.7	38.7	38.1	----	-----	199526.2	56.9
335	9/10/2025	13:24:25	00d	01:00.0	55.7	73.5	63.5	42.5	-:-	62.7	59.7	50.9	43.3	42.7	----	-----	371535.2	56.9
336	9/10/2025	13:25:25	00d	01:00.0	59.5	77.3	63.1	53.9	-:-	63	62.9	58.4	54.8	54.4	----	-----	891250.9	56.9
337	9/10/2025	13:26:25	00d	01:00.0	57.1	74.9	60.6	47.2	-:-	60.4	60.3	57	48	47.8	----	-----	512861.4	56.8
338	9/10/2025	13:27:25	00d	01:00.0	54.1	71.9	58.7	39.6	-:-	58.6	57.7	53.2	41.2	40.3	----	-----	257039.6	56.8
339	9/10/2025	13:28:25	00d	01:00.0	58	75.8	63.1	47.4	-:-	62.6	61.7	56.6	49.2	48.5	----	-----	630957.3	56.8
340	9/10/2025	13:29:25	00d	01:00.0	55.1	72.9	59.9	45.4	-:-	59.8	59.4	52.2	46.8	46.1	----	-----	323593.7	56.9
341	9/10/2025	13:30:25	00d	01:00.0	58.3	76.1	61.9	48.6	-:-	61.2	61	58.2	51.4	50	----	-----	676083.0	56.9
342	9/10/2025	13:31:25	00d	01:00.0	51.8	69.6	58.8	37.1	-:-	58.3	56	48.2	38.4	37.7	----	-----	151356.1	56.9
343	9/10/2025	13:32:25	00d	01:00.0	55.1	72.9	58.5	47.8	-:-	58.4	58.2	54.7	49.5	48	----	-----	323593.7	57.0
344	9/10/2025	13:33:25	00d	01:00.0	57.5	75.3	66.6	42.5	-:-	65	61.1	55.8	44.2	43.1	----	-----	562341.3	57.0
345	9/10/2025	13:34:25	00d	01:00.0	57.2	75	65.9	51.4	-:-	60	59.6	56.6	54.4	52.4	----	-----	524807.5	57.0
346	9/10/2025	13:35:25	00d	01:00.0	59.3	77.1	67.1	38.8	-:-	66.3	66	55.8	42.1	39.7	----	-----	851138.0	57.0
347	9/10/2025	13:36:25	00d	01:00.0	57.3	75.1	61.1	41.4	-:-	61	60.4	56.9	50.6	47.6	----	-----	537031.8	56.9
348	9/10/2025	13:37:25	00d	01:00.0	50.7	68.5	55.8	41.4	-:-	55.7	54.4	48.6	42.2	41.8	----	-----	117489.8	56.9
349	9/10/2025	13:38:25	00d	01:00.0	57.4	75.2	60.4	53.5	-:-	59.9	59.6	57	54.3	53.6	----	-----	549540.9	56.9
350	9/10/2025	13:39:25	00d	01:00.0	52.9	70.7	58.6	40.8	-:-	58.3	58.3	48.2	43.4	41.1	----	-----	194984.5	56.9
351	9/10/2025	13:40:25	00d	01:00.0	56.7	74.5	59.4	48.7	-:-	59.3	58.7	56.8	51.4	49.2	----	-----	467735.1	56.9
352	9/10/2025	13:41:25	00d	01:00.0	57.3	75.1	61.9	50.8	-:-	61.1	60.1	56.6	51.7	50.9	----	-----	537031.8	56.9
353	9/10/2025	13:42:25	00d	01:00.0	61.2	79	68.5	49.1	-:-	68	66.5	58.3	50.2	49.6	----	-----	1318256.7	56.8
354	9/10/2025	13:43:25	00d	01:00.0	54.4	72.2	62.2	43.6	-:-	62	58.4	51	46.7	44.5	----	-----	275422.9	56.7
355	9/10/2025	13:44:25	00d	01:00.0	58.3	76.1	63.1	43.7	-:-	62.9	62.1	57.3	45.8	44.2	----	-----	676083.0	56.7
356	9/10/2025	13:45:25	00d	01:00.0	51.5	69.3	55.4	41.6	-:-	55.1	54.9	50.6	44	43.1	----	-----	141253.8	56.8
357	9/10/2025	13:46:25	00d	01:00.0	56.2	74	62.4	37.6	-:-	61.8	60.2	55.8	38.9	38	----	-----	416869.4	56.8
358	9/10/2025	13:47:25	00d	01:00.0	56.3	74.1	59.4	51.3	-:-	59.2	59	55.7	52.6	51.8	----	-----	426579.5	56.8
359	9/10/2025	13:48:25	00d	01:00.0	58.8	76.6	67.2	44.5	-:-	66.2	61.6	55.6	46	44.6	----	-----	758577.6	56.8
360	9/10/2025	13:49:25	00d	01:00.0	53.4	71.2	58.3	42.3	-:-	57.6	57.2	52.3	43.2	42.9	----	-----	218776.2	56.7
361	9/10/2025	13:50:25	00d	01:00.0	54.4	72.2	58.6	41	-:-	58.6	58.3	53.8	42	41.6	----	-----	275422.9	56.7
362	9/10/2025	13:51:25	00d	01:00.0	59.1	76.9	67.2	41.5	-:-	66.2	65.3	53.3	43.9	43.6	----	-----	812830.5	56.7
363	9/10/2025	13:52:25	00d	01:00.0	54.7	72.5	64.6	42.4	-:-	59.8	59	52.9	43.5	43	----	-----	295120.9	56.7
364	9/10/2025	13:53:25	00d	01:00.0	57.8	75.6	63.4	39.1	-:-	63.1	61.9	56.5	43.7	41.3	----	-----	602559.6	56.7
365	9/10/2025	13:54:25	00d	01:00.0	54.9	72.7	60.1	35.7	-:-	59.7	58.8	52.6	37.2	36.6	----	-----	309029.5	56.8
366	9/10/2025	13:55:25	00d	01:00.0	53	70.8	58.3	34.3	-:-	58.1	57.5	51.7	36.6	34.6	----	-----	199526.2	56.8
367	9/10/2025	13:56:25	00d	01:00.0	58.5	76.3	67.8	41.6	-:-	67	63.3	53.9	47.4	46.7	----	-----	707945.8	56.8
368	9/10/2025	13:57:25	00d	01:00.0	59.2	77	67.2	41.6	-:-	66.6	63.3	57.6	43.7	41.7	----	-----	831763.8	56.8
369	9/10/2025	13:58:25	00d	01:00.0	59	76.8	64.3	51	-:-	63.2	61.7	57.9	52.9	51.1	----	-----	794328.2	56.7
370	9/10/2025	13:59:25	00d	01:00.0	56.4	74.2	60.3	42.8	-:-	59.2	59.2	56.5	43.6	43.1	----	-----	436515.8	56.7
371	9/10/2025	14:00:25	00d	01:00.0	56.7	74.5	60.5	43.4	-:-	60	59.7	56.7	51	48	----	-----	467735.1	56.7
372	9/10/2025	14:01:25	00d	01:00.0	54.4	72.2	59.4	45.3	-:-	58.9	58.5	53.1	47.3	46.2	----	-----	275422.9	56.7
373	9/10/2025	14:02:25	00d	01:00.0	56	73.8	59.2	46.5	-:-	58.7	58.5	56.1	49.2	47.3	----	-----	398107.2	56.7
374	9/10/2025	14:03:25	00d	01:00.0	55.8	73.6	60.2	50.5	-:-	60	59.6	54.3	51.1	51	----	-----	380189.4	56.7
375	9/10/2025	14:04:25	00d	01:00.0	56.4	74.2	58.6	51.8	-:-	58.5	58.2	56.6	53.3	52.7	----	-----	436515.8	56.7
376	9/10/2025	14:05:25	00d	01:00.0	54.4	72.2	58.8	41.5	-:-	58.2	58	52	42.9	41.6	----	-----	275422.9	56.7
377	9/10/2025	14:06:25	00d	01:00.0	56.5	74.3	60.4	38.5	-:-	60.5	59.9	56.7	39.5	38.7	----	-----	446683.6	56.8
378	9/10/2025	14:07:25	00d	01:00.0	58.7	76.5	65.5	46	-:-	65.3	63.6	56.7	48.5	46.9	----	-----	741310.2	56.8
379	9/10/2025	14:08:25	00d	01:00.0	57.9	75.7	61.1	50.9	-:-	60.7	60.2	57.8	52.8	51.5	----	-----	616595.0	56.7
380	9/10/2025	14:09:25	00d	01:00.0	53.3	71.1	58.9	46.5	-:-	58.1	56.6	51.4	48.1	46.6	----	-----	213796.2	56.7
381	9/10/2025	14:10:25	00d	01:00.0	57.9	75.7	61.1	46.3	-:-	60.9	60.8	57.5	49.6	47.1	----	-----	616595.0	56.8
382	9/10/2025	14:11:25	00d	01:00.0	58.3	76.1	63.1	47.7	-:-	63	62.3	55.8	51	48.4	----	-----	676083.0	56.7
383	9/10/2025	14:12:25	00d	01:00.0	56.5	74.3	66.9	46.9	-:-	63.3	58.4	54	48.9	48.4	----	-----	446683.6	56.7
384	9/10/2025	14:13:25	00d	01:00.0	55.8	73.6	62.3	39.9	-:-	62.2	60.5	53.3	43.1	42.2	----	-----	380189.4	56.7
385	9/10/2025	14:14:25	00d	01:00.0	55.9	73.7	59.9	39.5	-:-	59.8	59	55.4	50.5	44.5	----	-----	389045.1	56.8
386	9/10/2025	14:15:25	00d	01:00.0	56.8	74.6	61.4	44.3	-:-	60.9	60.9	55.8	45.9	44.5	----	-----	478630.1	56.8
387	9/10/2025	14:16:25	00d	01:00.0	54.3	72.1	58.3	44.9	-:-	58.1	57.5	53.1	46.9	45.6	----	-----	269153.5	56.8
388	9/10/2025	14:17:25	00d	01:00.0	52.6	70.4	59	35.6	-:-	58.8	58.4	43.5	36	36	----	-----	181970.1	56.9
389	9/10/2025	14:18:25	00d	01:00.0	56.5	74.3	59.7	39.5	-:-	59.6	59.3	55.9	44.5	41.6	----	-----	446683.6	56.9
390	9/10/2025	14:19:25	00d	01:00.0	56.5	74.3	60.3	41.8	-:-	60.2	59.9	55.9	43.3	42	----	-----	446683.6	56.9
391	9/10/2025	14:20:25	00d	01:00.0	57.4	75.2	60.9	51.8	-:-	60.7	59.9	57.2	53.3	52.5	----	-----	549540.9	56.9
392	9/10/2025	14:21:25	00d	01:00.0	51.8	69.6	57.6	42.3	-:-	57.1	55.2	50.6	44.7	42.6	----	-----	151356.1	56.9
393	9/10/2025	14:22:25	00d	01:00.0	56	73.8	58.7	53.1	-:-	58.2	57.9	55.7	54.3	53.6	----	-----	398107.2	56.9
394	9/10/2025	14:23:25	00d	01:00.0	62.4	80.2	70.2	50.3	-:-	69	67.1	59.8	56.2	54.7	----	-----	1737800.8	56.9
395	9/10/2025	14:24:25	00d	01:00.0	52.3	70.1	57.5	40.4	-:-	57.1	56.2	51	42	40.7	----	-----	169824.4	56.8
396	9/10/2025	14:25:25	00d	01:00.0	57.3	75.1	61	47.1	-:-	60.9	60.5	56.7	52.4	49.5	----	-----	537031.8	56.8
397	9/10/2025	14:26:25	00d	01:00.0	54.9	72.7	58.8	45.3	-:-	58.7	58	55.2	46.5	45.8	----	-----	309029.5	56.8
398	9/10/2025	14:27:25	00d	01:00.0	58.7	76.5	62.9	53	-:-	62.5	61.9	58	53.8	53.5	----	-----	741310.2	56.8
399	9/10/2025	14:28:25	00d	01:00.0	55.6	73.4	60.7	43.8	-:-	60.6	59.4	54.8	45.9	44.4	----	-----	363078.1	56.8
400	9/10/2025	14:29:25	00d	01:00.0	60.9	78.7	67.7	48.4	-:-	67.1	66.6	58	49.9	48.9	----	-----	1230268.8	56.7
401	9/10/2025	14:30:25	00d	01:00.0	56.1	73.9	59.6	40.9	-:-	59.4	58.9	56.9	42.9	41.1	----	-----	407380.3	56.6
402	9/10/2025	14:31:25	00d	01:00.0	57.8	75.6	61.6	54.9	-:-	61.3	60.2	57.1	55.2	55	----	-----	602559.6	56.6
403	9/10/2025	14:32:25	00d	01:00.0	55.3	73.1	59.2	42.9	-:-	58.6	58.3	55.2	44.6	43.8	----	-----	338844.2	56.6
404	9/10/2025	14:33:25	00d	01:00.0	57.2	75	63	48.4	-:-	61.9	61.4	56.1	49.1	48.6	----	-----	524807.5	56.6
405	9/10/2025	14:34:25	00d	01:00.0	57.6	75.4	61.3	51.7	-:-	60.9	60.5	57	52.8	52.5	----	-----	575439.9	56.6
406	9/10/2025	14:35:25	00d	01:00.0	56.4	74.2	59.6	51	-:-	59.4	59.1	56.2	52.6	51.7	----	-----	436515.8	56.6
407	9/10/2025	14:36:25	00d	01:00.0	56.2	74	63.5	45	-:-	63.2	60.1	53.8	46.8	45.6	----	-----	416869.4	56.7
408	9/10/2025	14:37:25	00d	01:00.0	52.1	69.9	58.5	39.9	-:-	57.5	56.9	49	40.9	40.7	----	-----	162181.0	56.7
409	9/10/2025	14:38:25	00d	01:00.0	58	75.8	62.2	49	-:-	62	61.3	57.5	51.6	51.2	----	-----	630957.3	56.8
410	9/10/2025	14:39:25	00d	01:00.0	50.4	68.2	54.7	37.2	-:-	54.6	54.1	49.9	39.2	37.4	----	-----	109647.8	56.7
411	9/10/2025	14:40:25	00d	01:00.0	55.5	73.3	61.8	36.2	-:-	61.7	61.1	52.4	38.3	36.6	----	-----	354813.4	56.8
412	9/10/2025	14:41:25	00d	01:00.0	54.3	72.1	60.1	41.9	-:-	59.9	59.3	52.4	43.7	42.1	----	-----	269153.5	56.8
413	9/10/2025	14:42:25	00d	01:00.0	56.2	74	60.7	44.8	-:-	60.6	59.9	55.7	48	46.3	----	-----	416869.4	56.9
414	9/10/2025	14:43:25	00d	01:00.0	57.2	75	64.1	39.6	-:-	63.2	62.1	55.2	40.7	39.9	----	-----	524807.5	56.9
415	9/10/2025	14:44:25	00d	01:00.0	52.6	70.4	58	41.2	-:-	57.9	56.5	50.7	42.8	41.7	----	-----	181970.1	56.9
416	9/10/2025	14:45:25	00d	01:00.0	59.6	77.4	64.6	48.3	-:-	64.3	62.9	58.8	53.8	51	----	-----	912010.8	57.0
417	9/10/2025	14:46:25	00d	01:00.0	56.9	74.7	60.2	45.4	-:-	60.1	60	56.9	48	46.1	----	-----	489778.8	56.9
418	9/10/2025	14:47:25	00d	01:00.0	52.1	69.9	57.4	46.1	-:-	56.6	54.5	51.4	47.4	47.3	----	-----	162181.0	56.9
419	9/10/2025	14:48:25	00d	01:00.0	56.9	74.7	60	43.4	-:-	60	59.8	57.1	44.9	43.9	----	-----	489778.8	57.0
420	9/10/2025	14:49:25	00d	01:00.0	56.4	74.2	61	41.4	-:-	61	60.9	54.6	43.7	41.8	----	-----	436515.8	57.0
421	9/10/2025	14:50:25	00d	01:00.0	54.8	72.6	59.5	42.6	-:-	59.2	58.5	53.7	44.4	43.1	----	-----	301995.2	57.0
422	9/10/2025	14:51:25	00d	01:00.0	52.7	70.5	58.8	43.6	-:-	58.2	55.3	50.7	45.7	43.9	----	-----	186208.7	57.1
423	9/10/2025	14:52:25	00d	01:00.0	58.5	76.3	61.4	49.7	-:-	61.4	61.2	58.6	51.5	50.2	----	-----	707945.8	57.1
424	9/10/2025	14:53:25	00d	01:00.0	57.1	74.9	61.6	45.7	-:-	60.7	60.1	56.9	47.3	45.9	----	-----	512861.4	57.1
425	9/10/2025	14:54:25	00d	01:00.0	58.2	76	61.4	51.7	-:-	61.1	60.5	58.3	53.7	52.4	----	-----	660693.4	57.1
426	9/10/2025	14:55:25	00d	01:00.0	56.2	74	60.5	44.2	-:-	60.4	60	55.5	46.4	44.7	----	-----	416869.4	57.1
427	9/10/2025	14:56:25	00d	01:00.0	57.3	75.1	61.7	49.7	-:-	61.2	60.3	56	50.9	50.2	----	-----	537031.8	57.1
428	9/10/2025	14:57:25	00d	01:00.0	54.5	72.3	59.8	38.9	-:-	58.7	58.2	51.8	40.8	39.2	----	-----	281838.3	57.1
429	9/10/2025	14:58:25	00d	01:00.0	57.2	75	63	45.2	-:-	62.1	61.1	54.7	46.8	45.4	----	-----	524807.5	57.1
430	9/10/2025	14:59:25	00d	01:00.0	58.5	76.3	63.1	47.4	-:-	63.1	61.5	57.4	53.5	50.1	----	-----	707945.8	57.0
431	9/10/2025	15:00:25	00d	01:00.0	52.5	70.3	58.6	41.6	-:-	58.5	57.4	49.5	42.8	42	----	-----	177827.9	57.0
432	9/10/2025	15:01:25	00d	01:00.0	57.2	75	60.9	49.9	-:-	60.2	60	56	51.1	50	----	-----	524807.5	57.0
433	9/10/2025	15:02:25	00d	01:00.0	57.7	75.5	64	44	-:-	62	61.1	57.1	45.9	45	----	-----	588843.7	57.0

434	9/10/2025	15:03:25	00d	01:00.0	57.3	75.1	63.3	43.5	-:-	63.2	62.2	55.9	47.8	45.9	----	-----	537031.8	57.0
435	9/10/2025	15:04:25	00d	01:00.0	53.3	71.1	59.1	41.2	-:-	59.2	57.7	51.8	42.1	41.8	----	-----	213796.2	57.1
436	9/10/2025	15:05:25	00d	01:00.0	57.8	75.6	61.8	44.2	-:-	61.2	61	57.3	45.9	44.6	----	-----	602559.6	57.1
437	9/10/2025	15:06:25	00d	01:00.0	56.4	74.2	63	44.2	-:-	62.1	59.8	55.7	48	46.6	----	-----	436515.8	57.1
438	9/10/2025	15:07:25	00d	01:00.0	58.2	76	64.2	40.3	-:-	64	60.5	58.6	41.2	40.7	----	-----	660693.4	57.1
439	9/10/2025	15:08:25	00d	01:00.0	56.8	74.6	63.6	49	-:-	63.2	60	54.5	50.7	50	----	-----	478630.1	57.1
440	9/10/2025	15:09:25	00d	01:00.0	56.4	74.2	61.2	47.6	-:-	60.7	59.7	56.1	49.6	48.4	----	-----	436515.8	57.1
441	9/10/2025	15:10:25	00d	01:00.0	57	74.8	61.7	42.1	-:-	61.7	60.8	56.8	46.8	43.4	----	-----	501187.2	57.2
442	9/10/2025	15:11:25	00d	01:00.0	56.9	74.7	61.1	42.1	-:-	61	60.7	54.9	46.5	45.8	----	-----	489778.8	57.1
443	9/10/2025	15:12:25	00d	01:00.0	58.1	75.9	63.7	47.7	-:-	63	60	57.6	53.3	49.1	----	-----	645654.2	57.2
444	9/10/2025	15:13:25	00d	01:00.0	55.7	73.5	63.4	44.7	-:-	60.6	59.6	53.1	46.6	45.4	----	-----	371535.2	57.2
445	9/10/2025	15:14:25	00d	01:00.0	58.6	76.4	64.8	47.4	-:-	64.8	62.1	57.6	49.6	47.9	----	-----	724436.0	57.2
446	9/10/2025	15:15:25	00d	01:00.0	53.5	71.3	57.7	42.7	-:-	57.6	57.5	53.4	44.5	43.2	----	-----	223872.1	57.2
447	9/10/2025	15:16:25	00d	01:00.0	58.8	76.6	62.3	53.9	-:-	62.1	60.7	58.5	56.4	56.2	----	-----	758577.6	57.2
448	9/10/2025	15:17:25	00d	01:00.0	59	76.8	65	52.1	-:-	64	62.9	57.2	52.8	52.3	----	-----	794328.2	57.2
449	9/10/2025	15:18:25	00d	01:00.0	57.3	75.1	61.8	46.1	-:-	61.8	61.1	55.6	47.9	47	----	-----	537031.8	57.1
450	9/10/2025	15:19:25	00d	01:00.0	56.2	74	61.8	39.6	-:-	61.5	59.9	55.7	41.4	40.4	----	-----	416869.4	57.2
451	9/10/2025	15:20:25	00d	01:00.0	54.9	72.7	60.8	39.1	-:-	60.6	60	53.2	40.3	39.8	----	-----	309029.5	57.2
452	9/10/2025	15:21:25	00d	01:00.0	56	73.8	60.4	41.6	-:-	60	59.5	55.1	42.2	41.9	----	-----	398107.2	57.3
453	9/10/2025	15:22:25	00d	01:00.0	57.7	75.5	60.5	52.2	-:-	60.2	59.5	57.7	52.8	52.6	----	-----	588843.7	57.7
454	9/10/2025	15:23:25	00d	01:00.0	54.8	72.6	59.5	43.1	-:-	59.3	59	52.7	43.6	43.2	----	-----	301995.2	57.7
455	9/10/2025	15:24:25	00d	01:00.0	57.1	74.9	59.8	50.5	-:-	59.4	59	57.2	54.6	54.1	----	-----	512861.4	57.7
456	9/10/2025	15:25:25	00d	01:00.0	55.8	73.6	60.2	49.9	-:-	60	58.8	54.8	50.1	49.9	----	-----	380189.4	57.7
457	9/10/2025	15:26:25	00d	01:00.0	55.4	73.2	60.2	42.4	-:-	59.4	58.6	55.6	43.9	43.5	----	-----	346736.9	57.7
458	9/10/2025	15:27:25	00d	01:00.0	58.9	76.7	63.9	53.3	-:-	62.6	61.4	58.7	55.5	54.8	----	-----	776247.1	57.8
459	9/10/2025	15:28:25	00d	01:00.0	54.5	72.3	59.4	43.1	-:-	59.2	58.9	53.1	44.7	43.6	----	-----	281838.3	57.7
460	9/10/2025	15:29:25	00d	01:00.0	54.1	71.9	58.5	44.4	-:-	58.1	57.3	53.1	46.4	44.9	----	-----	257039.6	57.7
461	9/10/2025	15:30:25	00d	01:00.0	57.4	75.2	62.7	43	-:-	62.5	62	55.4	44.8	43.7	----	-----	549540.9	57.8
462	9/10/2025	15:31:25	00d	01:00.0	55.8	73.6	61.8	39.2	-:-	61.3	60.3	54.2	41.7	39.7	----	-----	380189.4	57.8
463	9/10/2025	15:32:25	00d	01:00.0	55.1	72.9	60.6	39.2	-:-	60.2	59.2	52.1	46.9	42.5	----	-----	323593.7	57.8
464	9/10/2025	15:33:25	00d	01:00.0	57.3	75.1	63	44.7	-:-	62.5	61.4	55.5	46.4	45.2	----	-----	537031.8	57.8
465	9/10/2025	15:34:25	00d	01:00.0	55	72.8	59.5	44.8	-:-	59.1	57.9	54.3	45.8	45	----	-----	316227.8	57.8
466	9/10/2025	15:35:25	00d	01:00.0	56.8	74.6	68.1	41.8	-:-	61.9	60.2	50.8	43.8	42.4	----	-----	478630.1	57.8
467	9/10/2025	15:36:25	00d	01:00.0	60.9	78.7	68.9	50.5	-:-	66.4	63.4	60	51.7	50.7	----	-----	1230268.8	57.8
468	9/10/2025	15:37:25	00d	01:00.0	58.6	76.4	63.3	48.6	-:-	62.7	62.2	57.5	51.2	49.1	----	-----	724436.0	57.7
469	9/10/2025	15:38:25	00d	01:00.0	58.1	75.9	63	45.6	-:-	60.2	59.9	58.2	51.1	47.8	----	-----	645654.2	57.7
470	9/10/2025	15:39:25	00d	01:00.0	52.5	70.3	57.4	42.9	-:-	57.2	56.6	50.5	43.8	43.3	----	-----	177827.9	57.6
471	9/10/2025	15:40:25	00d	01:00.0	57.4	75.2	61.2	46.9	-:-	61.1	60.7	57.3	48	47.3	----	-----	549540.9	57.7
472	9/10/2025	15:41:25	00d	01:00.0	56.4	74.2	61.8	42.3	-:-	61.4	61	55	43	42.8	----	-----	436515.8	57.7
473	9/10/2025	15:42:25	00d	01:00.0	58.1	75.9	61.9	45.4	-:-	61.7	61.6	57.3	52.8	51.6	----	-----	645654.2	57.7
474	9/10/2025	15:43:25	00d	01:00.0	58.6	76.4	60.9	48.4	-:-	60.8	60.7	59.5	50.1	48.8	----	-----	724436.0	57.7
475	9/10/2025	15:44:25	00d	01:00.0	57.6	75.4	60.6	48.3	-:-	60.4	60.3	58.3	49.5	48.6	----	-----	575439.9	57.7
476	9/10/2025	15:45:25	00d	01:00.0	56.8	74.6	60.7	45.5	-:-	60.4	60.1	55.7	48.9	46	----	-----	478630.1	57.7
477	9/10/2025	15:46:25	00d	01:00.0	57.9	75.7	62	45.9	-:-	61.8	61.4	57.4	51.8	50.6	----	-----	616595.0	57.7
478	9/10/2025	15:47:25	00d	01:00.0	57.3	75.1	61	49.7	-:-	60.9	60.3	57.2	51.5	50.4	----	-----	537031.8	57.7
479	9/10/2025	15:48:25	00d	01:00.0	56.2	74	61.1	45	-:-	60.9	60.3	55	47.4	45.4	----	-----	416869.4	57.7
480	9/10/2025	15:49:25	00d	01:00.0	57.5	75.3	61.3	43.8	-:-	61.1	60.3	57.5	47.6	44.3	----	-----	562341.3	57.7
481	9/10/2025	15:50:25	00d	01:00.0	58.7	76.5	67.2	43.9	-:-	65.8	61.7	56.8	48.9	48.2	----	-----	741310.2	57.7
482	9/10/2025	15:51:25	00d	01:00.0	60	77.8	65.3	55.6	-:-	64.6	62.9	59.1	57.1	56.7	----	-----	1000000.0	57.6
483	9/10/2025	15:52:25	00d	01:00.0	54.5	72.3	59.9	42.5	-:-	59.5	58.1	54	43.3	42.8	----	-----	281838.3	57.6
484	9/10/2025	15:53:25	00d	01:00.0	58.2	76	63.8	47.6	-:-	63.6	63	56.7	49.4	48	----	-----	660693.4	57.6
485	9/10/2025	15:54:25	00d	01:00.0	52.5	70.3	58.5	39.9	-:-	57.8	56.9	49.8	42.3	40.5	----	-----	177827.9	57.6
486	9/10/2025	15:55:25	00d	01:00.0	58.7	76.5	60.9	53.4	-:-	60.9	60.8	58.8	55.8	54.6	----	-----	741310.2	57.7
487	9/10/2025	15:56:25	00d	01:00.0	53.8	71.6	58.9	40.6	-:-	58.3	57.9	51.2	41.8	41.2	----	-----	239883.3	57.6
488	9/10/2025	15:57:25	00d	01:00.0	57.7	75.5	61.4	52.5	-:-	61.2	60.8	56.5	53.7	53.1	----	-----	588843.7	57.6
489	9/10/2025	15:58:25	00d	01:00.0	50	67.8	57.1	42.5	-:-	54.4	53.7	48.4	43.9	43.2	----	-----	100000.0	57.6
490	9/10/2025	15:59:25	00d	01:00.0	55.6	73.4	60.7	45	-:-	60.6	60	54.9	45.4	45.2	----	-----	363078.1	57.6
491	9/10/2025	16:00:25	00d	01:00.0	57.3	75.1	61.5	47.5	-:-	61.2	60.5	56.8	50.8	50.4	----	-----	537031.8	57.7
492	9/10/2025	16:01:25	00d	01:00.0	56.4	74.2	59.6	51	-:-	58.8	58.5	56.5	53.2	51.9	----	-----	436515.8	57.7
493	9/10/2025	16:02:25	00d	01:00.0	55.9	73.7	61.6	41.2	-:-	61	59.4	53.5	42.2	41.5	----	-----	389045.1	57.7
494	9/10/2025	16:03:25	00d	01:00.0	57.8	75.6	60.6	55.3	-:-	60.1	59.5	57.5	55.7	55.5	----	-----	602559.6	57.8
495	9/10/2025	16:04:25	00d	01:00.0	61.4	79.2	65.6	51.9	-:-	65.3	64.6	61.4	53.7	52.4	----	-----	1380384.3	57.7
496	9/10/2025	16:05:25	00d	01:00.0	52.3	70.1	57	42.2	-:-	56.9	56.3	50.9	43.2	42.7	----	-----	169824.4	57.6
497	9/10/2025	16:06:25	00d	01:00.0	57.2	75	60.1	46.9	-:-	59.8	59.2	57.5	53.3	50.2	----	-----	524807.5	57.7
498	9/10/2025	16:07:25	00d	01:00.0	56.8	74.6	60.8	46	-:-	60.7	60.6	57.4	46.9	46.2	----	-----	478630.1	57.7
499	9/10/2025	16:08:25	00d	01:00.0	53.3	71.1	60.4	39.6	-:-	59.3	58.1	51.2	40.2	40	----	-----	213796.2	57.7
500	9/10/2025	16:09:25	00d	01:00.0	60	77.8	61.3	52.3	-:-	61.2	61.1	60.5	57.7	54.1	----	-----	1000000.0	57.8
501	9/10/2025	16:10:25	00d	01:00.0	57.9	75.7	61.9	48.4	-:-	61.5	61.1	57.9	50.9	49.4	----	-----	616595.0	57.7
502	9/10/2025	16:11:25	00d	01:00.0	55	72.8	58	45.8	-:-	57.7	57.6	56.3	46.3	46	----	-----	316227.8	57.7
503	9/10/2025	16:12:25	00d	01:00.0	58.7	76.5	64.9	45.6	-:-	64.4	62.3	58.2	47.9	46.4	----	-----	741310.2	57.7
504	9/10/2025	16:13:25	00d	01:00.0	57.7	75.5	61	47.7	-:-	60.9	60.9	56.5	48.9	48.6	----	-----	588843.7	57.7
505	9/10/2025	16:14:25	00d	01:00.0	56.4	74.2	60.5	50	-:-	59.5	58.8	55.8	51.3	50.2	----	-----	436515.8	57.7
506	9/10/2025	16:15:25	00d	01:00.0	60.1	77.9	62.9	52.1	-:-	62.8	62.6	60	55.3	52.9	----	-----	1023293.0	57.8
507	9/10/2025	16:16:25	00d	01:00.0	54.3	72.1	58.9	46.3	-:-	58.5	58.2	53.7	48.5	46.6	----	-----	269153.5	57.8
508	9/10/2025	16:17:25	00d	01:00.0	57.8	75.6	61.9	49.4	-:-	61	60.6	57.6	51.2	50.1	----	-----	602559.6	57.8
509	9/10/2025	16:18:25	00d	01:00.0	55.7	73.5	61.5	44.9	-:-	61	60.5	53.6	45.7	45.1	----	-----	371535.2	57.8
510	9/10/2025	16:19:25	00d	01:00.0	58.7	76.5	61.2	48.5	-:-	61.2	60.8	58.8	53.5	49.5	----	-----	741310.2	57.8
511	9/10/2025	16:20:25	00d	01:00.0	59.1	76.9	63.7	48.5	-:-	63	62.4	57.7	52	50.9	----	-----	812830.5	57.8
512	9/10/2025	16:21:25	00d	01:00.0	58.5	76.3	62.6	51.9	-:-	62.2	61.3	57.5	55.3	54	----	-----	707945.8	57.7
513	9/10/2025	16:22:25	00d	01:00.0	66	83.8	76.2	44.8	-:-	74.6	70.3	60.7	45.9	45.5	----	-----	3981071.7	57.7
514	9/10/2025	16:23:25	00d	01:00.0	52.1	69.9	61.1	40.8	-:-	59.9	55.4	48.4	42.3	41.3	----	-----	162181.0	57.2
515	9/10/2025	16:24:25	00d	01:00.0	58.4	76.2	62.5	41	-:-	62.2	61.8	58.6	44.4	42.1	----	-----	691831.0	57.3
516	9/10/2025	16:25:25	00d	01:00.0	57.4	75.2	62.5	49.5	-:-	61.7	60.8	56.5	51.8	50.2	----	-----	549540.9	57.4
517	9/10/2025	16:26:25	00d	01:00.0	55.3	73.1	59.7	41.9	-:-	59.4	59.2	54	43.1	42.8	----	-----	338844.2	57.4
518	9/10/2025	16:27:25	00d	01:00.0	59.1	76.9	63.6	52.8	-:-	63.3	62.4	58.3	55.2	53.2	----	-----	812830.5	57.4
519	9/10/2025	16:28:25	00d	01:00.0	53.4	71.2	57.7	45	-:-	57	56.8	52.8	46	45.1	----	-----	218776.2	57.4
520	9/10/2025	16:29:25	00d	01:00.0	57.2	75	60.2	52.7	-:-	59.7	59.3	57.3	53.7	52.8	----	-----	524807.5	57.4
521	9/10/2025	16:30:25	00d	01:00.0	56.6	74.4	64.4	43.9	-:-	64.1	61	53.2	45	44.1	----	-----	457088.2	57.4
522	9/10/2025	16:31:25	00d	01:00.0	57.4	75.2	60.2	49.9	-:-	59.9	59.5	57.5	53.3	51.3	----	-----	549540.9	57.4
523	9/10/2025	16:32:25	00d	01:00.0	55.5	73.3	61	47.6	-:-	60.8	59.9	53.6	48.1	47.6	----	-----	354813.4	57.4
524	9/10/2025	16:33:25	00d	01:00.0	56	73.8	61.7	41.2	-:-	61.2	60.2	52.9	42	41.4	----	-----	398107.2	57.4
525	9/10/2025	16:34:25	00d	01:00.0	56.6	74.4	61.1	46.1	-:-	60.9	59.5	56.7	48.1	46.7	----	-----	457088.2	57.4
526	9/10/2025	16:35:25	00d	01:00.0	57.7	75.5	61.5	49.9	-:-	61.4	60.2	57.6	51.2	50.3	----	-----	588843.7	57.4
527	9/10/2025	16:36:25	00d	01:00.0	55.3	73.1	62.1	41.7	-:-	61.6	61.1	50.3	42.5	42.2	----	-----	338844.2	57.4
528	9/10/2025	16:37:25	00d	01:00.0	57.8	75.6	61.5	44.1	-:-	61.4	61.4	57.8	45.6	44.5	----	-----	602559.6	57.4
529	9/10/2025	16:38:25	00d	01:00.0	56.6	74.4	60.6	45.9	-:-	59.9	59.7	55.8	47.7	46.7	----	-----	457088.2	57.4
530	9/10/2025	16:39:25	00d	01:00.0	56.4	74.2	60.1	46.1	-:-	59.8	59.7	55.2	47.5	46.2	----	-----	436515.8	57.4
531	9/10/2025	16:40:25	00d	01:00.0	56.2	74	59.5	47.2	-:-	59.2	58.9	56.7	49.2	48.3	----	-----	416869.4	57.4
532	9/10/2025	16:41:25	00d	01:00.0	58	75.8	61.8	46.9	-:-	61.6	60.9	58.4	47.8	47.5	----	-----	630957.3	57.4
533	9/10/2025	16:42:25	00d	01:00.0	59.2	77	62.4	51.2	-:-	62.3	61.7	59.1	55.1	53.9	----	-----	831763.8	57.4
534	9/10/2025	16:43:25	00d	01:00.0	58	75.8	63.4	46.6	-:-	63.1	62.7	56.6	48.2	47.2	----	-----	630957.3	57.6
535	9/10/2025	16:44:25	00d	01:00.0	56.4	74.2	60.2	48.5	-:-	59.9	58.8	56.3	49.7	49.1	----	-----	436515.8	57.6
536	9/10/2025	16:45:25	00d	01:00.0	57.7	75.5	60.6	51.5	-:-	60.5	60.5	57.1	54.4	52.1	----	-----	588843.7	57.6
537	9/10/2025	16:46:25	00d	01:00.0	56.4	74.2	60.7	44.2	-:-	60.3	59.6	56.8	45.5	44.5	----	-----	436515.8	57.6
538	9/10/2025	16:47:25	00d	01:00.0	58.9	76.7	63.2	51.9	-:-	62.9	62.5	58.1	53.5	52.9	----	-----	776247.1	57.6
539	9/10/2025	16:48:25	00d	01:00.0	53.9	71.7	60.2	40.4	-:-	59.9	58.9	50	41.8	41.4	----	-----	245470.9	57.6
540	9/10/2025	16:49:25	00d	01:00.0	57.9	75.7	62.1	51.2	-:-	61.4	60.5	57.3	53.9	53.4	----	-----	616595.0	57.6
541	9/10/2025	16:50:25	00d	01:00.0	56	73.8	61.2	44.1	-:-	60.8	60.1	55.3	45	44.6	----	-----	398107.2	57.7
542	9/10/2025	16:51:25	00d	01:00.0	56.2	74	60.4	46.5	-:-	60.1	59.2	55.6	48.3	47	----	-----	416869.4	57.7

543	9/10/2025	16:52:25	00d	01:00.0	55.9	73.7	60.7	41.3	-:-	60.5	59.6	54.2	42.2	41.6	----	-----	389045.1	57.7
544	9/10/2025	16:53:25	00d	01:00.0	59.3	77.1	62.2	54.7	-:-	61.8	61.6	59	56.1	55.6	----	-----	851138.0	57.7
545	9/10/2025	16:54:25	00d	01:00.0	55.5	73.3	59	41.9	-:-	59	58.8	54.7	42.6	42.4	----	-----	354813.4	57.6
546	9/10/2025	16:55:25	00d	01:00.0	57.6	75.4	60.8	45.1	-:-	60.6	60.4	58	47.4	45.8	----	-----	575439.9	57.6
547	9/10/2025	16:56:25	00d	01:00.0	56.3	74.1	60.8	48.1	-:-	60.7	59.5	55.5	50.4	48.5	----	-----	426579.5	57.6
548	9/10/2025	16:57:25	00d	01:00.0	55.5	73.3	60.5	48	-:-	60.2	59.2	54.7	48.4	48.1	----	-----	354813.4	57.6
549	9/10/2025	16:58:25	00d	01:00.0	56.1	73.9	59.8	49.8	-:-	59.6	59.6	55.4	50.3	50.1	----	-----	407380.3	57.6
550	9/10/2025	16:59:25	00d	01:00.0	54.3	72.1	58.9	41.6	-:-	58.6	57.8	53.4	43.2	42.3	----	-----	269153.5	57.7
551	9/10/2025	17:00:25	00d	01:00.0	57.8	75.6	61.9	49.3	-:-	61.2	61	57.6	51	50.2	----	-----	602559.6	57.7
552	9/10/2025	17:01:25	00d	01:00.0	59.9	77.7	62.7	55.6	-:-	62.4	61.7	59.8	57.5	55.7	----	-----	977237.2	57.6
553	9/10/2025	17:02:25	00d	01:00.0	55.5	73.3	61.7	38.5	-:-	61.5	60.8	52.7	39.8	38.7	----	-----	354813.4	57.6
554	9/10/2025	17:03:25	00d	01:00.0	59.2	77	64.1	55.6	-:-	61.1	61	58.7	56.2	55.6	----	-----	831763.8	57.6
555	9/10/2025	17:04:25	00d	01:00.0	55	72.8	58.6	50.3	-:-	58.4	57.5	54.5	51	50.9	----	-----	316227.8	57.6
556	9/10/2025	17:05:25	00d	01:00.0	58.2	76	62.2	52.9	-:-	61.9	60.9	57.9	54.4	53.4	----	-----	660693.4	57.6
557	9/10/2025	17:06:25	00d	01:00.0	59.8	77.6	63.3	55.9	-:-	62.9	61.6	59.5	57.7	56.9	----	-----	954992.6	57.6
558	9/10/2025	17:07:25	00d	01:00.0	56.4	74.2	60.5	46	-:-	60.2	59.9	56	47.3	46.1	----	-----	436515.8	57.5
559	9/10/2025	17:08:25	00d	01:00.0	56.7	74.5	61.4	46	-:-	61.2	60.9	55.1	49.6	48.7	----	-----	467735.1	57.5
560	9/10/2025	17:09:25	00d	01:00.0	58	75.8	62.2	48	-:-	61.9	61.1	58.1	50.2	48.8	----	-----	630957.3	57.5
561	9/10/2025	17:10:25	00d	01:00.0	56.5	74.3	61	49.4	-:-	60.7	59.9	55	50.3	50.1	----	-----	446683.6	57.5
562	9/10/2025	17:11:25	00d	01:00.0	59.5	77.3	65.5	50.8	-:-	64	61.2	59.7	53.6	52.5	----	-----	891250.9	57.5
563	9/10/2025	17:12:25	00d	01:00.0	56.4	74.2	61.2	44.8	-:-	61	60.5	56.1	45.9	45.8	----	-----	436515.8	57.4
564	9/10/2025	17:13:25	00d	01:00.0	56.4	74.2	62	46	-:-	60.8	60.5	55.1	49.5	46.6	----	-----	436515.8	57.4
565	9/10/2025	17:14:25	00d	01:00.0	59	76.8	62.1	46	-:-	61.7	61.5	58.9	52.5	50.4	----	-----	794328.2	57.4
566	9/10/2025	17:15:25	00d	01:00.0	60.8	78.6	63.2	54.2	-:-	63.3	62.8	61	56.1	55	----	-----	1202264.4	57.4
567	9/10/2025	17:16:25	00d	01:00.0	56.2	74	64.2	43.1	-:-	63.4	60.3	53.2	43.5	43.5	----	-----	416869.4	57.3
568	9/10/2025	17:17:25	00d	01:00.0	58.4	76.2	64.8	48.5	-:-	64.6	62.2	57.6	51.3	50.6	----	-----	691831.0	57.3
569	9/10/2025	17:18:25	00d	01:00.0	56.8	74.6	61.6	44.8	-:-	61.4	60.4	54.8	45.6	45.2	----	-----	478630.1	57.3
570	9/10/2025	17:19:25	00d	01:00.0	58.6	76.4	62.3	46.9	-:-	61.8	60.5	59.2	50.1	47.5	----	-----	724436.0	57.3
571	9/10/2025	17:20:25	00d	01:00.0	50.7	68.5	57.8	44.4	-:-	57.3	55.1	46.8	44.9	44.6	----	-----	117489.8	57.3
572	9/10/2025	17:21:25	00d	01:00.0	57.9	75.7	60.4	47.1	-:-	60.3	59.9	58.1	53.4	52.8	----	-----	616595.0	57.4
573	9/10/2025	17:22:25	00d	01:00.0	54.8	72.6	58.2	46.5	-:-	58.2	57.8	54.5	47.6	47.1	----	-----	301995.2	57.4
574	9/10/2025	17:23:25	00d	01:00.0	57.1	74.9	62.1	49.1	-:-	61.8	60.9	55.2	50.5	49.9	----	-----	512861.4	57.4
575	9/10/2025	17:24:25	00d	01:00.0	54.8	72.6	60	46.3	-:-	59.7	58.1	53.2	47.1	46.5	----	-----	301995.2	57.4
576	9/10/2025	17:25:25	00d	01:00.0	62.8	80.6	76.1	49.1	-:-	68	62.9	58.2	54.6	54	----	-----	1905460.7	57.4
577	9/10/2025	17:26:25	00d	01:00.0	58	75.8	60.3	53.2	-:-	60.1	59.9	58.1	55	53.6	----	-----	630957.3	57.2
578	9/10/2025	17:27:25	00d	01:00.0	55.4	73.2	61.9	44.9	-:-	61.3	59.6	50.5	45.9	45.5	----	-----	346736.9	57.2
579	9/10/2025	17:28:25	00d	01:00.0	58.4	76.2	60.6	54.7	-:-	60.3	60	58.2	56.2	55	----	-----	691831.0	57.2
580	9/10/2025	17:29:25	00d	01:00.0	55.4	73.2	61	47	-:-	60.5	59.5	53.7	47.9	47.7	----	-----	346736.9	57.2
581	9/10/2025	17:30:25	00d	01:00.0	54.3	72.1	59.8	45.4	-:-	58.3	58	53.3	46.3	45.7	----	-----	269153.5	57.2
582	9/10/2025	17:31:25	00d	01:00.0	55.2	73	60.9	47.7	-:-	59.5	58.6	53.7	48.6	48	----	-----	331131.1	57.2
583	9/10/2025	17:32:25	00d	01:00.0	57.7	75.5	63.3	46.1	-:-	62.4	61.7	56.3	46.4	46.3	----	-----	588843.7	57.2
584	9/10/2025	17:33:25	00d	01:00.0	56.4	74.2	62.2	47.9	-:-	61.7	61.1	54.5	50.1	49.4	----	-----	436515.8	57.2
585	9/10/2025	17:34:25	00d	01:00.0	57.3	75.1	61.4	49	-:-	60.9	60.3	57	49.5	49.3	----	-----	537031.8	57.2
586	9/10/2025	17:35:25	00d	01:00.0	58	75.8	62.3	47.7	-:-	62.2	62	57.4	49	47.9	----	-----	630957.3	57.2
587	9/10/2025	17:36:25	00d	01:00.0	56.3	74.1	59.9	48.6	-:-	59.7	59.6	55.1	49.6	48.9	----	-----	426579.5	57.1
588	9/10/2025	17:37:25	00d	01:00.0	57.2	75	61.8	51.2	-:-	61.2	60.2	57	51.6	51.4	----	-----	524807.5	57.1
589	9/10/2025	17:38:25	00d	01:00.0	57.2	75	59.8	52.3	-:-	59.8	59.3	57.2	53.4	52.8	----	-----	524807.5	57.1
590	9/10/2025	17:39:25	00d	01:00.0	57.8	75.6	61.5	51.2	-:-	61.1	60.7	57.4	53.2	51.5	----	-----	602559.6	57.1
591	9/10/2025	17:40:25	00d	01:00.0	55.3	73.1	59.6	47.9	-:-	59.4	58.9	54.4	49.1	48.5	----	-----	338844.2	57.0
592	9/10/2025	17:41:25	00d	01:00.0	56.5	74.3	61.4	47.6	-:-	61.2	60.2	55.6	48.3	48	----	-----	446683.6	57.0
593	9/10/2025	17:42:25	00d	01:00.0	58.3	76.1	65.3	50.9	-:-	63.5	60.3	57.2	52.3	51.5	----	-----	676083.0	57.0
594	9/10/2025	17:43:25	00d	01:00.0	62.9	80.7	72.3	49.1	-:-	70.8	64.9	59.1	50.7	49.8	----	-----	1949844.6	57.0
595	9/10/2025	17:44:25	00d	01:00.0	58.1	75.9	62.2	51.6	-:-	61.8	60.5	58.3	54.5	53.9	----	-----	645654.2	56.7
596	9/10/2025	17:45:25	00d	01:00.0	57.8	75.6	61.3	49.8	-:-	61.2	60.7	57	50.7	50.1	----	-----	602559.6	56.7
597	9/10/2025	17:46:25	00d	01:00.0	59	76.8	63.1	51.5	-:-	63	62.2	58.3	55.1	53.8	----	-----	794328.2	56.7
598	9/10/2025	17:47:25	00d	01:00.0	56.6	74.4	62.5	48.3	-:-	62.1	61.4	54.4	48.7	48.5	----	-----	457088.2	56.6
599	9/10/2025	17:48:25	00d	01:00.0	54.6	72.4	59	48	-:-	58.8	58.2	53.8	48.6	48.5	----	-----	288403.2	56.6
600	9/10/2025	17:49:25	00d	01:00.0	55.8	73.6	60.5	46.5	-:-	59.8	59	55.6	47.8	46.7	----	-----	380189.4	56.6
601	9/10/2025	17:50:25	00d	01:00.0	60.8	78.6	65.6	54	-:-	65.1	62.9	60.6	55.3	54.8	----	-----	1202264.4	56.6
602	9/10/2025	17:51:25	00d	01:00.0	57.2	75	59.9	48.2	-:-	59.6	59.2	57.5	53	49.7	----	-----	524807.5	56.5
603	9/10/2025	17:52:25	00d	01:00.0	57.1	74.9	60.9	48.1	-:-	60.8	60.1	57.2	52.4	49.6	----	-----	512861.4	56.4
604	9/10/2025	17:53:25	00d	01:00.0	56.2	74	61.1	46.9	-:-	60.2	59.9	55.2	47.5	47.3	----	-----	416869.4	56.4
605	9/10/2025	17:54:25	00d	01:00.0	56.5	74.3	59.7	50.8	-:-	58.8	58.5	56.5	53.4	51.5	----	-----	446683.6	56.4
606	9/10/2025	17:55:25	00d	01:00.0	50.9	68.7	58.3	45.5	-:-	57.5	54.5	48.2	45.8	45.7	----	-----	123026.9	56.4
607	9/10/2025	17:56:25	00d	01:00.0	58.1	75.9	64.5	51.2	-:-	64.1	59.7	57.7	52.1	51.7	----	-----	645654.2	56.5
608	9/10/2025	17:57:25	00d	01:00.0	53.7	71.5	60.1	46.6	-:-	59.5	57.3	52.9	47.5	46.9	----	-----	234422.9	56.5
609	9/10/2025	17:58:25	00d	01:00.0	57.1	74.9	61.4	48.3	-:-	61.4	60.5	55.6	49.6	48.7	----	-----	512861.4	56.5
610	9/10/2025	17:59:25	00d	01:00.0	58.3	76.1	67.7	45.8	-:-	66.7	63.2	50.5	46.2	45.9	----	-----	676083.0	56.4
611	9/10/2025	18:00:25	00d	01:00.0	57	74.8	62.2	46	-:-	62.2	60.4	55.2	48.4	46.7	----	-----	501187.2	56.3
612	9/10/2025	18:01:25	00d	01:00.0	55.1	72.9	61.3	46.3	-:-	60.8	59.8	52.9	47	46.5	----	-----	323593.7	56.3
613	9/10/2025	18:02:25	00d	01:00.0	57.8	75.6	61.7	49.9	-:-	61.3	60.5	57.8	51.1	50.2	----	-----	602559.6	56.4
614	9/10/2025	18:03:25	00d	01:00.0	54.9	72.7	59.7	45.6	-:-	59.6	59.5	50.4	46	45.8	----	-----	309029.5	56.3
615	9/10/2025	18:04:25	00d	01:00.0	57.4	75.2	62.2	45.9	-:-	61.8	60.8	57.4	46.4	46.3	----	-----	549540.9	56.3
616	9/10/2025	18:05:25	00d	01:00.0	57.3	75.1	63.1	48.8	-:-	62.9	61.7	55.3	51.7	51.5	----	-----	537031.8	56.3
617	9/10/2025	18:06:25	00d	01:00.0	56.6	74.4	62.5	47	-:-	62.3	60.8	54	47.5	47.2	----	-----	457088.2	56.3
618	9/10/2025	18:07:25	00d	01:00.0	57.8	75.6	62.6	47.8	-:-	62.3	61.3	57.7	50.2	49.6	----	-----	602559.6	56.3
619	9/10/2025	18:08:25	00d	01:00.0	55.6	73.4	60	48.7	-:-	60	59.7	54.7	49.5	48.8	----	-----	363078.1	56.2
620	9/10/2025	18:09:25	00d	01:00.0	56.2	74	60.9	51.6	-:-	60.6	59.1	55.1	52	51.8	----	-----	416869.4	56.2
621	9/10/2025	18:10:25	00d	01:00.0	55.3	73.1	59.6	47.5	-:-	59.2	58.6	54.6	49.8	49.2	----	-----	338844.2	56.2
622	9/10/2025	18:11:25	00d	01:00.0	56	73.8	60.4	46.7	-:-	59.4	59	55.8	48.9	48.1	----	-----	398107.2	56.2
623	9/10/2025	18:12:25	00d	01:00.0	57.6	75.4	62.1	50	-:-	60.9	60.4	57.2	53	51.4	----	-----	575439.9	56.2
624	9/10/2025	18:13:25	00d	01:00.0	54.7	72.5	59.2	48.1	-:-	58.5	57.2	54.3	48.8	48.4	----	-----	295120.9	56.2
625	9/10/2025	18:14:25	00d	01:00.0	59	76.8	65.2	53.2	-:-	64.6	61.9	58.2	54.9	53.8	----	-----	794328.2	56.2
626	9/10/2025	18:15:25	00d	01:00.0	54.7	72.5	58.8	46.6	-:-	58.7	58.3	53.2	47	46.7	----	-----	295120.9	56.2
627	9/10/2025	18:16:25	00d	01:00.0	57.5	75.3	60.8	47.2	-:-	60.5	60.2	57.8	52.3	49.9	----	-----	562341.3	56.1
628	9/10/2025	18:17:25	00d	01:00.0	58.6	76.4	64.1	52	-:-	63.4	61.1	58.1	53	52.5	----	-----	724436.0	56.1
629	9/10/2025	18:18:25	00d	01:00.0	57.1	74.9	61.1	51	-:-	61	60.7	56.5	51.7	51.1	----	-----	512861.4	56.1
630	9/10/2025	18:19:25	00d	01:00.0	58.1	75.9	60.9	53.5	-:-	60.6	60.3	58.6	54.6	53.7	----	-----	645654.2	56.0
631	9/10/2025	18:20:25	00d	01:00.0	56.6	74.4	59.1	51.7	-:-	59	58.8	56.8	52.7	52.1	----	-----	457088.2	56.0
632	9/10/2025	18:21:25	00d	01:00.0	58.3	76.1	62.1	51.7	-:-	62	61.5	57.3	52.5	52.1	----	-----	676083.0	56.0
633	9/10/2025	18:22:25	00d	01:00.0	57.9	75.7	61.8	52.1	-:-	61.5	61.2	56.8	53.6	52.6	----	-----	616595.0	56.0
634	9/10/2025	18:23:25	00d	01:00.0	56.9	74.7	61.5	47	-:-	61.4	61	54.7	47.4	47.2	----	-----	489778.8	55.9
635	9/10/2025	18:24:25	00d	01:00.0	55.2	73	59.6	46.9	-:-	59.4	58.8	53.5	47.5	47.3	----	-----	331131.1	55.9
636	9/10/2025	18:25:25	00d	01:00.0	56.3	74.1	61.5	48.2	-:-	61.2	59.9	55.5	49.4	48.5	----	-----	426579.5	55.9
637	9/10/2025	18:26:25	00d	01:00.0	56.7	74.5	59.8	47	-:-	59.6	59.1	56.7	49.5	47.9	----	-----	467735.1	55.9
638	9/10/2025	18:27:25	00d	01:00.0	57.8	75.6	64.8	47	-:-	62.8	60.9	56.3	49.4	47.8	----	-----	602559.6	56.0
639	9/10/2025	18:28:25	00d	01:00.0	56.7	74.5	63.5	49.5	-:-	62	61.1	53.8	50.1	49.8	----	-----	467735.1	55.9
640	9/10/2025	18:29:25	00d	01:00.0	57.7	75.5	60.8	50.2	-:-	60.6	60.1	57.8	54	51.6	----	-----	588843.7	55.9
641	9/10/2025	18:30:25	00d	01:00.0	53.2	71	58.3	45.9	-:-	57.5	57	51.9	47.4	46.3	----	-----	208929.6	55.9
642	9/10/2025	18:31:25	00d	01:00.0	53.2	71	56	46.2	-:-	56	55.7	53.9	47.5	47	----	-----	208929.6	56.0
643	9/10/2025	18:32:25	00d	01:00.0	54.1	71.9	60.2	45.7	-:-	59.9	59.3	49.3	46.1	46	----	-----	257039.6	56.1
644	9/10/2025	18:33:25	00d	01:00.0	58.1	75.9	63	51.1	-:-	62.8	61.8	55.9	52.6	51.4	----	-----	645654.2	56.1
645	9/10/2025	18:34:25	00d	01:00.0	56.3	74.1	61.3	47.8	-:-	61.4	60.6	54	49.9	48.9	----	-----	426579.5	56.0
646	9/10/2025	18:35:25	00d	01:00.0	56.5	74.3	61	48.5	-:-	60.3	60	54.1	49.5	49.2	----	-----	446683.6	56.0
647	9/10/2025	18:36:25	00d	01:00.0	56.1	73.9	59.9	48.1	-:-	59.5	59.1	55.6	50	49	----	-----	407380.3	56.0
648	9/10/2025	18:37:25	00d	01:00.0	53.5	71.3	59.3	46.1	-:-	58.9	57.7	49.2	46.2	46.2	----	-----	223872.1	56.0
649	9/10/2025	18:38:25	00d	01:00.0	57	74.8	64.5	47	-:-	64.3	61.7	54	47.4	47.1	----	-----	501187.2	56.0
650	9/10/2025	18:39:25	00d	01:00.0	53.9	71.7	58.5	46.6	-:-	57.9	57.2	53.6	47	46.9	----	-----	245470.9	56.0
651	9/10/2025	18:40:25	00d	01:00.0	55.3	73.1	59.8	46.5	-:-	59.7	58.2	54.7	47.2	47	----	-----	338844.2	56.0

652	9/10/2025	18:41:25	00d	01:00.0	56.4	74.2	61.5	46.5	-:-	60.9	60.1	54	47	46.6	----	-----	436515.8	56.0
653	9/10/2025	18:42:25	00d	01:00.0	56.4	74.2	61.8	47.5	-:-	61.4	60.3	54.4	48.3	47.7	----	-----	436515.8	55.9
654	9/10/2025	18:43:25	00d	01:00.0	54.4	72.2	60.8	46	-:-	60.4	58.9	51.7	46.7	46.4	----	-----	275422.9	55.9
655	9/10/2025	18:44:25	00d	01:00.0	56	73.8	61.7	46.1	-:-	61.3	60.2	52.9	46.6	46.4	----	-----	398107.2	55.9
656	9/10/2025	18:45:25	00d	01:00.0	54.3	72.1	59.3	46.2	-:-	58.7	58	53.5	46.4	46.3	----	-----	269153.5	55.9
657	9/10/2025	18:46:25	00d	01:00.0	56.5	74.3	60.5	50.3	-:-	60.1	59.1	56	51.9	50.7	----	-----	446683.6	55.9
658	9/10/2025	18:47:25	00d	01:00.0	57.2	75	61.5	49.1	-:-	61.2	60.7	55.6	50.7	49.7	----	-----	524807.5	55.9
659	9/10/2025	18:48:25	00d	01:00.0	57.1	74.9	63.2	46.2	-:-	62.7	61.5	55.5	46.8	46.3	----	-----	512861.4	55.9
660	9/10/2025	18:49:25	00d	01:00.0	52.8	70.6	58.5	45.5	-:-	58.4	57.9	49.1	45.8	45.6	----	-----	190546.1	55.9
661	9/10/2025	18:50:25	00d	01:00.0	54.4	72.2	60.1	45.2	-:-	59.7	59.5	49	45.5	45.4	----	-----	275422.9	55.9
662	9/10/2025	18:51:25	00d	01:00.0	55.3	73.1	59.7	46.7	-:-	59.6	58.8	54.6	48	47.6	----	-----	338844.2	55.9
663	9/10/2025	18:52:25	00d	01:00.0	50.1	67.9	55.8	45.6	-:-	55.7	53.9	48.4	46	45.7	----	-----	102329.3	55.9
664	9/10/2025	18:53:25	00d	01:00.0	56.8	74.6	60.4	50.6	-:-	60.1	59.5	56.1	51.7	50.7	----	-----	478630.1	56.1
665	9/10/2025	18:54:25	00d	01:00.0	56.9	74.7	60.7	50.5	-:-	60	59.8	56.7	53	51.3	----	-----	489778.8	56.0
666	9/10/2025	18:55:25	00d	01:00.0	55.4	73.2	58.7	48.4	-:-	57.8	57.1	55.9	49.9	48.9	----	-----	346736.9	56.0
667	9/10/2025	18:56:25	00d	01:00.0	59.8	77.6	66.9	49.1	-:-	66.3	65.1	57.6	51.2	49.8	----	-----	954992.6	56.0
668	9/10/2025	18:57:25	00d	01:00.0	55.7	73.5	59.9	48.9	-:-	59.3	58.4	55.4	50.7	49.8	----	-----	371535.2	55.8
669	9/10/2025	18:58:25	00d	01:00.0	55.2	73	59.7	45.2	-:-	59.3	59	53.1	46.6	46.1	----	-----	331131.1	55.9
670	9/10/2025	18:59:25	00d	01:00.0	49.7	67.5	54.9	44.4	-:-	54.9	54.3	47.9	44.7	44.6	----	-----	93325.4	55.9
671	9/10/2025	19:00:25	00d	01:00.0	51.2	69	57.5	44.4	-:-	57.3	55.1	48.4	44.7	44.6	----	-----	131825.7	55.9
672	9/10/2025	19:01:25	00d	01:00.0	55.7	73.5	64	47.1	-:-	63.6	58.3	52.6	47.6	47.2	----	-----	371535.2	55.9
673	9/10/2025	19:02:25	00d	01:00.0	58	75.8	63.8	51.5	-:-	60.7	60.2	58	52.8	52.1	----	-----	630957.3	55.9
674	9/10/2025	19:03:25	00d	01:00.0	56.7	74.5	61.1	48.9	-:-	60.8	60.1	55.7	49.9	49.2	----	-----	467735.1	55.9
675	9/10/2025	19:04:25	00d	01:00.0	52.1	69.9	57.2	47.1	-:-	56.7	55.9	50.2	47.9	47.6	----	-----	162181.0	55.9
676	9/10/2025	19:05:25	00d	01:00.0	52.9	70.7	58.3	46.3	-:-	57.4	57.1	51.4	46.8	46.7	----	-----	194984.5	55.9
677	9/10/2025	19:06:25	00d	01:00.0	59	76.8	64.6	47.6	-:-	64.2	62.8	59.4	48.2	47.9	----	-----	794328.2	55.9
678	9/10/2025	19:07:25	00d	01:00.0	55	72.8	58.8	47	-:-	58.2	58	54.4	48.9	47.3	----	-----	316227.8	55.8
679	9/10/2025	19:08:25	00d	01:00.0	55.2	73	59.8	46.2	-:-	59.2	58.2	55.5	46.8	46.6	----	-----	331131.1	55.9
680	9/10/2025	19:09:25	00d	01:00.0	55.6	73.4	59.4	47	-:-	59.1	58.7	54.5	47.7	47.3	----	-----	363078.1	55.8
681	9/10/2025	19:10:25	00d	01:00.0	51.7	69.5	56.5	46.6	-:-	54.9	54.3	51.5	47.4	46.9	----	-----	147910.8	55.9
682	9/10/2025	19:11:25	00d	01:00.0	55.4	73.2	59.4	49.8	-:-	59.1	58.5	54	51.4	50.7	----	-----	346736.9	56.0
683	9/10/2025	19:12:25	00d	01:00.0	57.6	75.4	64	49.1	-:-	63.3	61.6	55.5	49.4	49.3	----	-----	575439.9	56.0
684	9/10/2025	19:13:25	00d	01:00.0	57	74.8	61.3	47.8	-:-	61	60.6	56.3	49.1	48.2	----	-----	501187.2	56.0
685	9/10/2025	19:14:25	00d	01:00.0	56.8	74.6	60.4	46.3	-:-	60.5	60	56.7	49.8	47.4	----	-----	478630.1	56.0
686	9/10/2025	19:15:25	00d	01:00.0	55.3	73.1	60.1	45.2	-:-	59.7	59.2	54.1	45.8	45.3	----	-----	338844.2	55.9
687	9/10/2025	19:16:25	00d	01:00.0	52.8	70.6	58.1	48.2	-:-	55.2	54.6	52.8	49.6	48.7	----	-----	190546.1	55.9
688	9/10/2025	19:17:25	00d	01:00.0	57.5	75.3	62.5	49.8	-:-	61.9	59.5	56.8	53.9	53.2	----	-----	562341.3	55.9
689	9/10/2025	19:18:25	00d	01:00.0	56.4	74.2	62.2	44.5	-:-	61.8	61.6	52.2	44.9	44.8	----	-----	436515.8	55.8
690	9/10/2025	19:19:25	00d	01:00.0	53.7	71.5	58.3	45.1	-:-	58.1	57.5	51.8	45.4	45.2	----	-----	234422.9	55.8
691	9/10/2025	19:20:25	00d	01:00.0	55.8	73.6	60.4	46.2	-:-	60.1	59.3	54.7	50.6	49.7	----	-----	380189.4	55.8
692	9/10/2025	19:21:25	00d	01:00.0	56.4	74.2	62	46.2	-:-	61.9	60.7	55.3	47.1	46.7	----	-----	436515.8	55.8
693	9/10/2025	19:22:25	00d	01:00.0	56.5	74.3	62	46.2	-:-	61.9	60.6	54.6	46.8	46.4	----	-----	446683.6	55.8
694	9/10/2025	19:23:25	00d	01:00.0	55.6	73.4	62.6	45.2	-:-	62	60.6	53.3	45.8	45.6	----	-----	363078.1	55.8
695	9/10/2025	19:24:25	00d	01:00.0	56.8	74.6	61.9	45.1	-:-	61.4	60.9	55.7	45.9	45.6	----	-----	478630.1	55.8
696	9/10/2025	19:25:25	00d	01:00.0	55.1	72.9	59.7	46.1	-:-	59.1	58	55.2	48.2	47.9	----	-----	323593.7	55.8
697	9/10/2025	19:26:25	00d	01:00.0	57.6	75.4	64.3	45.5	-:-	63.2	59.8	57.5	46.1	46	----	-----	575439.9	55.7
698	9/10/2025	19:27:25	00d	01:00.0	57.9	75.7	61.2	45.9	-:-	61	60.6	57.6	50.4	47.2	----	-----	616595.0	55.7
699	9/10/2025	19:28:25	00d	01:00.0	54	71.8	60.5	45.9	-:-	59.4	58.9	51.5	46.2	46.1	----	-----	251188.6	55.7
700	9/10/2025	19:29:25	00d	01:00.0	58.3	76.1	63.6	48.4	-:-	63	62.5	55.4	49.4	48.7	----	-----	676083.0	55.7
701	9/10/2025	19:30:25	00d	01:00.0	55	72.8	59.2	47.1	-:-	59.1	58.5	53.8	48.3	47.9	----	-----	316227.8	55.6
702	9/10/2025	19:31:25	00d	01:00.0	58.6	76.4	65.2	48	-:-	65	62.9	57.2	49.4	48.4	----	-----	724436.0	55.6
703	9/10/2025	19:32:25	00d	01:00.0	58.3	76.1	67	48.4	-:-	65.8	60.9	56	49.4	49.2	----	-----	676083.0	55.5
704	9/10/2025	19:33:25	00d	01:00.0	56.4	74.2	59.8	47.2	-:-	59.6	59.1	56.9	48	47.7	----	-----	436515.8	55.5
705	9/10/2025	19:34:25	00d	01:00.0	54.4	72.2	60.4	45.9	-:-	60.1	59.3	51.2	46.5	46.3	----	-----	275422.9	55.4
706	9/10/2025	19:35:25	00d	01:00.0	54.2	72	60.4	46.8	-:-	59.1	58.8	51.3	47.5	47.3	----	-----	263026.8	55.5
707	9/10/2025	19:36:25	00d	01:00.0	55.6	73.4	60.2	47.7	-:-	60	59.4	54.5	48.2	47.9	----	-----	363078.1	55.5
708	9/10/2025	19:37:25	00d	01:00.0	56.1	73.9	60.3	48.6	-:-	59.7	59.1	54.8	49.2	49.1	----	-----	407380.3	55.5
709	9/10/2025	19:38:25	00d	01:00.0	53.9	71.7	59.2	47.5	-:-	58.3	58.1	50.2	48	47.7	----	-----	245470.9	55.5
710	9/10/2025	19:39:25	00d	01:00.0	56.7	74.5	61.2	49.6	-:-	60.9	60.4	56.3	50.4	50.2	----	-----	467735.1	55.9
711	9/10/2025	19:40:25	00d	01:00.0	55.4	73.2	61.1	49.2	-:-	60.9	57.5	54.5	51.6	49.7	----	-----	346736.9	55.9
712	9/10/2025	19:41:25	00d	01:00.0	52.4	70.2	57.8	48.4	-:-	56.8	56.4	49.6	48.6	48.5	----	-----	173780.1	55.9
713	9/10/2025	19:42:25	00d	01:00.0	55.1	72.9	59.1	50.8	-:-	59	57.6	54.4	51.6	50.9	----	-----	323593.7	55.9
714	9/10/2025	19:43:25	00d	01:00.0	53.1	70.9	58.8	48.7	-:-	57.3	57	50.7	49.2	48.9	----	-----	204173.8	55.9
715	9/10/2025	19:44:25	00d	01:00.0	56.5	74.3	60.5	48.3	-:-	60.4	60	56.1	48.7	48.4	----	-----	446683.6	56.0
716	9/10/2025	19:45:25	00d	01:00.0	52.9	70.7	59.5	48.9	-:-	58.7	56.3	50.7	49.1	49	----	-----	194984.5	56.0
717	9/10/2025	19:46:25	00d	01:00.0	54.9	72.7	59.6	49.1	-:-	59.1	58.9	53.3	49.5	49.3	----	-----	309029.5	56.0
718	9/10/2025	19:47:25	00d	01:00.0	58.1	75.9	63.2	51.8	-:-	62.6	61.3	56.7	52.7	52.1	----	-----	645654.2	56.0
719	9/10/2025	19:48:25	00d	01:00.0	54.7	72.5	58.8	50.6	-:-	57.8	57.6	53.9	51.2	50.7	----	-----	295120.9	55.9
720	9/10/2025	19:49:25	00d	01:00.0	56.9	74.7	61	50.2	-:-	60.7	60.5	55.9	50.6	50.3	----	-----	489778.8	56.0
721	9/10/2025	19:50:25	00d	01:00.0	53.6	71.4	58.2	49.6	-:-	58	57.5	51.6	50	49.9	----	-----	229086.8	55.9
722	9/10/2025	19:51:25	00d	01:00.0	53.8	71.6	57.9	49.7	-:-	57.6	56.7	52.3	49.8	49.8	----	-----	239883.3	56.0
723	9/10/2025	19:52:25	00d	01:00.0	57.2	75	63.1	50	-:-	61.4	59.9	56.3	51.2	51	----	-----	524807.5	56.0
724	9/10/2025	19:53:25	00d	01:00.0	59.3	77.1	69.9	49.9	-:-	66.8	60.4	54.8	50.3	50.1	----	-----	851138.0	55.9
725	9/10/2025	19:54:25	00d	01:00.0	55.8	73.6	62.6	49.4	-:-	62	59.7	52.6	49.7	49.5	----	-----	380189.4	55.8
726	9/10/2025	19:55:25	00d	01:00.0	54.2	72	59.7	49.5	-:-	58.9	56.9	54	49.8	49.7	----	-----	263026.8	55.8
727	9/10/2025	19:56:25	00d	01:00.0	54.2	72	59.6	49.8	-:-	59.1	58.2	52	50.2	50	----	-----	263026.8	55.8
728	9/10/2025	19:57:25	00d	01:00.0	51.7	69.5	58.5	49.6	-:-	58.5	53.5	50.2	49.7	49.7	----	-----	147910.8	55.8
729	9/10/2025	19:58:25	00d	01:00.0	56.4	74.2	60.4	50.7	-:-	60.3	59.2	56.4	51.5	51	----	-----	436515.8	55.8
730	9/10/2025	19:59:25	00d	01:00.0	54.8	72.6	59.9	50.2	-:-	59.3	57.9	53.4	50.4	50.3	----	-----	301995.2	55.8
731	9/10/2025	20:00:25	00d	01:00.0	52	69.8	55.2	50	-:-	54.7	53.7	51.4	50.5	50.4	----	-----	158489.3	55.8
732	9/10/2025	20:01:25	00d	01:00.0	56.6	74.4	60.4	51.1	-:-	60.3	59.8	55.6	51.5	51.3	----	-----	457088.2	55.8
733	9/10/2025	20:02:25	00d	01:00.0	57	74.8	63.3	51.1	-:-	62.6	60.9	55.3	51.7	51.4	----	-----	501187.2	55.8
734	9/10/2025	20:03:25	00d	01:00.0	55.3	73.1	58.9	50.4	-:-	58.8	57.8	54.8	50.7	50.5	----	-----	338844.2	55.8
735	9/10/2025	20:04:25	00d	01:00.0	54.1	71.9	59.1	49.4	-:-	58.9	58	51.5	50.1	49.9	----	-----	257039.6	56.0
736	9/10/2025	20:05:25	00d	01:00.0	55.1	72.9	58.3	49.7	-:-	58.1	57.9	55.1	50.6	50.3	----	-----	323593.7	56.0
737	9/10/2025	20:06:25	00d	01:00.0	53.8	71.6	59.2	49.7	-:-	59.1	57.4	51.2	49.9	49.8	----	-----	239883.3	56.0
738	9/10/2025	20:07:25	00d	01:00.0	54.3	72.1	57.8	51	-:-	57.6	56.6	53.3	51.8	51.5	----	-----	269153.5	56.0
739	9/10/2025	20:08:25	00d	01:00.0	58.2	76	66	50.6	-:-	65.2	62.8	54.7	51	50.9	----	-----	660693.4	56.1
740	9/10/2025	20:09:25	00d	01:00.0	54.4	72.2	63.5	49.5	-:-	62.5	59.4	50.3	49.7	49.6	----	-----	275422.9	56.1
741	9/10/2025	20:10:25	00d	01:00.0	58.1	75.9	65.5	50.1	-:-	64.4	61.9	56	51.7	51.1	----	-----	645654.2	56.1
742	9/10/2025	20:11:25	00d	01:00.0	57.5	75.3	62.7	49.6	-:-	62.6	60.9	57.8	49.9	49.8	----	-----	562341.3	56.0
743	9/10/2025	20:12:25	00d	01:00.0	57.1	74.9	64.6	52	-:-	62.1	60.2	54.9	52.5	52.3	----	-----	512861.4	56.0
744	9/10/2025	20:13:25	00d	01:00.0	55.6	73.4	60.5	50.2	-:-	60.1	59.6	52.8	50.5	50.5	----	-----	363078.1	56.0
745	9/10/2025	20:14:25	00d	01:00.0	56.3	74.1	59.9	50.4	-:-	59.6	59.4	56	50.9	50.6	----	-----	426579.5	56.0
746	9/10/2025	20:15:25	00d	01:00.0	53.1	70.9	59.4	49.3	-:-	59.3	57.2	50.3	49.7	49.6	----	-----	204173.8	56.0
747	9/10/2025	20:16:25	00d	01:00.0	52.7	70.5	57.8	49.1	-:-	57.7	56.9	50.3	49.4	49.3	----	-----	186208.7	56.1
748	9/10/2025	20:17:25	00d	01:00.0	54.8	72.6	60.8	49	-:-	60.6	58.4	50	49.3	49.1	----	-----	301995.2	56.0
749	9/10/2025	20:18:25	00d	01:00.0	54.6	72.4	58.1	49.8	-:-	58	57.8	53.6	50.3	50	----	-----	288403.2	56.0
750	9/10/2025	20:19:25	00d	01:00.0	55.9	73.7	61.8	49.9	-:-	61.4	60	52.5	50.3	50.1	----	-----	389045.1	56.1
751	9/10/2025	20:20:25	00d	01:00.0	54.8	72.6	59.7	50	-:-	59.4	58.4	53.4	50.4	50.2	----	-----	301995.2	56.0
752	9/10/2025	20:21:25	00d	01:00.0	52.3	70.1	58.9	49.5	-:-	58.8	56.6	50.1	49.7	49.6	----	-----	169824.4	56.0
753	9/10/2025	20:22:25	00d	01:00.0	55.3	73.1	60.6	50.4	-:-	60.2	58.7	53.2	50.6	50.5	----	-----	338844.2	56.0
754	9/10/2025	20:23:25	00d	01:00.0	56.4	74.2	61.4	50.5	-:-	61.1	59.8	54.5	52.4	50.9	----	-----	436515.8	56.0
755	9/10/2025	20:24:25	00d	01:00.0	56	73.8	60.8	50.6	-:-	60.5	60.1	54.4	51.4	50.9	----	-----	398107.2	55.9
756	9/10/2025	20:25:25	00d	01:00.0	54.6	72.4	60.1	49.6	-:-	58	57.4	54.2	50.2	49.8	----	-----	288403.2	55.9
757	9/10/2025	20:26:25	00d	01:00.0	53.1	70.9	57.9	49.7	-:-	57.6	56.3	52.1	50.2	50.1	----	-----	204173.8	55.9
758	9/10/2025	20:27:25	00d	01:00.0	56.8	74.6	61.2	51.9	-:-	60.5	60.3	54.8	52.2	52.1	----	-----	478630.1	55.9
759	9/10/2025	20:28:25	00d	01:00.0	58	75.8	60.4	53.5	-:-	60.2	59.8	58.1	55.1	54.2	----	-----	630957.3	55.8
760	9/10/2025	20:29:25	00d	01:00.0	51.5	69.3	56.4	49.7	-:-	54.5	53.9	50.5	50	49.9	----	-----	141253.8	55.8

761	9/10/2025	20:30:25	00d	01:00.0	55.1	72.9	58.5	50.1	-:-	58.1	57.7	54.8	50.7	50.4	----	-----	323593.7	55.8
762	9/10/2025	20:31:25	00d	01:00.0	53.4	71.2	57.5	50.5	-:-	56.4	55.8	52.6	50.9	50.8	----	-----	218776.2	55.8
763	9/10/2025	20:32:25	00d	01:00.0	54.6	72.4	58.4	49.8	-:-	58.2	57.8	53.7	50.2	50	----	-----	288403.2	55.8
764	9/10/2025	20:33:25	00d	01:00.0	55.2	73	61.3	49.9	-:-	60.8	59.9	52.6	50.3	50.2	----	-----	331131.1	55.8
765	9/10/2025	20:34:25	00d	01:00.0	55.9	73.7	60.6	50.2	-:-	60.5	60.2	53.3	50.3	50.3	----	-----	389045.1	55.8
766	9/10/2025	20:35:25	00d	01:00.0	55.7	73.5	59.2	50.5	-:-	59	58.6	54.8	50.9	50.6	----	-----	371535.2	55.7
767	9/10/2025	20:36:25	00d	01:00.0	53.8	71.6	60.8	49.7	-:-	59	57.6	50.7	50	49.9	----	-----	239883.3	55.7
768	9/10/2025	20:37:25	00d	01:00.0	55.7	73.5	61.1	51.6	-:-	59.6	58.9	54.6	52.2	51.8	----	-----	371535.2	55.7
769	9/10/2025	20:38:25	00d	01:00.0	57.2	75	60.7	52	-:-	60.6	60.2	57	52.6	52.3	----	-----	524807.5	55.7
770	9/10/2025	20:39:25	00d	01:00.0	63.6	81.4	77.5	50.7	-:-	67.3	64.4	56.5	51.1	50.9	----	-----	2290867.7	55.6
771	9/10/2025	20:40:25	00d	01:00.0	56.8	74.6	62	50.8	-:-	61.3	60.2	54.9	51.2	50.9	----	-----	478630.1	55.2
772	9/10/2025	20:41:25	00d	01:00.0	55.1	72.9	60.4	51.2	-:-	59.5	56.5	54.4	51.8	51.6	----	-----	323593.7	55.1
773	9/10/2025	20:42:25	00d	01:00.0	57.3	75.1	62.4	50.3	-:-	62.1	60.1	55.9	50.9	50.7	----	-----	537031.8	55.1
774	9/10/2025	20:43:25	00d	01:00.0	52.6	70.4	56.9	49.5	-:-	56.6	56.1	51.5	49.9	49.9	----	-----	181970.1	55.1
775	9/10/2025	20:44:25	00d	01:00.0	55.7	73.5	62.5	49.5	-:-	60.9	60.1	53.4	49.8	49.6	----	-----	371535.2	55.1
776	9/10/2025	20:45:25	00d	01:00.0	58	75.8	62.3	52.8	-:-	61.1	60.4	57.6	53.6	53.2	----	-----	630957.3	55.0
777	9/10/2025	20:46:25	00d	01:00.0	54.2	72	60	50.9	-:-	59.5	58.1	52.7	51.2	51.1	----	-----	263026.8	54.9
778	9/10/2025	20:47:25	00d	01:00.0	52.3	70.1	57.2	50.2	-:-	57.2	55.7	50.7	50.4	50.3	----	-----	169824.4	54.9
779	9/10/2025	20:48:25	00d	01:00.0	57.2	75	61.1	51.8	-:-	60.4	60.2	56.8	52.3	52.1	----	-----	524807.5	54.9
780	9/10/2025	20:49:25	00d	01:00.0	55.7	73.5	59.9	50.2	-:-	59.6	58.6	55.3	50.7	50.6	----	-----	371535.2	54.8
781	9/10/2025	20:50:25	00d	01:00.0	53.8	71.6	57.8	50	-:-	57.4	57	51.7	50.3	50.2	----	-----	239883.3	54.8
782	9/10/2025	20:51:25	00d	01:00.0	57	74.8	60	51.1	-:-	60	59.8	56.4	52.5	52.1	----	-----	501187.2	54.8
783	9/10/2025	20:52:25	00d	01:00.0	54.2	72	58	50.6	-:-	57.4	56.7	53.4	51.1	50.9	----	-----	263026.8	54.7
784	9/10/2025	20:53:25	00d	01:00.0	52.5	70.3	58.4	49.7	-:-	58	55.2	50.8	50.2	49.9	----	-----	177827.9	54.7
785	9/10/2025	20:54:25	00d	01:00.0	54	71.8	57.3	50.4	-:-	57.3	56.5	53.5	51.7	51.1	----	-----	251188.6	54.6
786	9/10/2025	20:55:25	00d	01:00.0	53.1	70.9	57.8	50.1	-:-	57.6	57.3	51	50.2	50.2	----	-----	204173.8	54.6
787	9/10/2025	20:56:25	00d	01:00.0	55.5	73.3	61.4	49.9	-:-	61.2	60.4	51.8	50.3	50.1	----	-----	354813.4	54.6
788	9/10/2025	20:57:25	00d	01:00.0	55.3	73.1	61.5	49.8	-:-	60	59.3	53.7	50.4	50.2	----	-----	338844.2	54.5
789	9/10/2025	20:58:25	00d	01:00.0	53.5	71.3	59.4	50.1	-:-	58.8	55.7	52.3	50.5	50.3	----	-----	223872.1	54.5
790	9/10/2025	20:59:25	00d	01:00.0	55.9	73.7	60.7	50.4	-:-	60.3	60	54.3	51.3	50.6	----	-----	389045.1	54.5
791	9/10/2025	21:00:25	00d	01:00.0	54.8	72.6	59.5	49.8	-:-	59	58.7	52.8	50.2	50.1	----	-----	301995.2	54.4
792	9/10/2025	21:01:25	00d	01:00.0	55.7	73.5	60.8	49.9	-:-	60	58.9	54.5	50.3	50.2	----	-----	371535.2	54.3
793	9/10/2025	21:02:25	00d	01:00.0	53.7	71.5	57	50.6	-:-	56.6	56.4	53.4	50.9	50.8	----	-----	234422.9	54.3
794	9/10/2025	21:03:25	00d	01:00.0	55	72.8	61.2	50.4	-:-	60.6	59.4	53.4	50.8	50.7	----	-----	316227.8	54.7
795	9/10/2025	21:04:25	00d	01:00.0	61.6	79.4	71.8	50.3	-:-	69.4	67.6	52.9	50.7	50.6	----	-----	1445439.8	54.8
796	9/10/2025	21:05:25	00d	01:00.0	55.5	73.3	61.1	49.6	-:-	60.4	59.2	53.4	50	49.7	----	-----	354813.4	54.6
797	9/10/2025	21:06:25	00d	01:00.0	55.9	73.7	59.8	50.1	-:-	59.5	59.1	54.7	51.2	50.9	----	-----	389045.1	54.5
798	9/10/2025	21:07:25	00d	01:00.0	53.2	71	59.1	50.4	-:-	57	55.8	52	50.7	50.6	----	-----	208929.6	54.5
799	9/10/2025	21:08:25	00d	01:00.0	58.7	76.5	66.1	49.8	-:-	65	63.2	56.8	50.2	50.1	----	-----	741310.2	54.4
800	9/10/2025	21:09:25	00d	01:00.0	57.6	75.4	66.4	50	-:-	65.6	62.1	52.3	50.4	50.3	----	-----	575439.9	54.3
801	9/10/2025	21:10:25	00d	01:00.0	55.7	73.5	60.3	49.7	-:-	60.3	59.6	54.8	50	50	----	-----	371535.2	54.2
802	9/10/2025	21:11:25	00d	01:00.0	56.6	74.4	60.9	49.9	-:-	60.6	60.4	54.8	50.3	50.1	----	-----	457088.2	54.2
803	9/10/2025	21:12:25	00d	01:00.0	56.2	74	61.5	50.7	-:-	60.9	60.6	54.3	51.1	51	----	-----	416869.4	54.1
804	9/10/2025	21:13:25	00d	01:00.0	54.8	72.6	58.7	50.4	-:-	58.6	57.5	53.1	51	50.6	----	-----	301995.2	54.0
805	9/10/2025	21:14:25	00d	01:00.0	57.4	75.2	62.8	50.8	-:-	61.9	60.9	57.2	51.2	51.1	----	-----	549540.9	54.0
806	9/10/2025	21:15:25	00d	01:00.0	56.6	74.4	61.2	50.2	-:-	60.8	60.1	55.9	50.6	50.4	----	-----	457088.2	53.9
807	9/10/2025	21:16:25	00d	01:00.0	56.1	73.9	60.4	50.4	-:-	59.4	58.8	55.1	51.7	51.3	----	-----	407380.3	53.8
808	9/10/2025	21:17:25	00d	01:00.0	51.4	69.2	55.4	49.7	-:-	55.4	54.3	50.3	49.9	49.8	----	-----	138038.4	53.9
809	9/10/2025	21:18:25	00d	01:00.0	54.7	72.5	58.6	49.9	-:-	58.3	58.1	53.9	50.1	50.1	----	-----	295120.9	53.9
810	9/10/2025	21:19:25	00d	01:00.0	54.9	72.7	59.7	50.5	-:-	59.3	58	53.8	51.1	50.8	----	-----	309029.5	53.8
811	9/10/2025	21:20:25	00d	01:00.0	51.1	68.9	54.7	49.5	-:-	54.6	53.2	50.2	49.7	49.6	----	-----	128825.0	53.8
812	9/10/2025	21:21:25	00d	01:00.0	54.5	72.3	60.4	49.9	-:-	59.8	57.6	52.9	50.3	50.1	----	-----	281838.3	53.7
813	9/10/2025	21:22:25	00d	01:00.0	51.9	69.7	56.2	49.7	-:-	55	54.2	50.8	50.1	49.9	----	-----	154881.7	53.7
814	9/10/2025	21:23:25	00d	01:00.0	53.3	71.1	58.5	49.1	-:-	58.2	57.6	50	49.4	49.2	----	-----	213796.2	53.7
815	9/10/2025	21:24:25	00d	01:00.0	53.7	71.5	58.3	49.5	-:-	58.2	58	51.2	50	49.8	----	-----	234422.9	53.7
816	9/10/2025	21:25:25	00d	01:00.0	54.3	72.1	59.4	50.4	-:-	59.4	57.1	52.8	50.6	50.5	----	-----	269153.5	53.6
817	9/10/2025	21:26:25	00d	01:00.0	54	71.8	58.5	49.7	-:-	58.1	57.8	51.7	49.9	49.9	----	-----	251188.6	53.6
818	9/10/2025	21:27:25	00d	01:00.0	51.7	69.5	54.2	49.2	-:-	54.1	53.8	50.9	49.4	49.3	----	-----	147910.8	53.5
819	9/10/2025	21:28:25	00d	01:00.0	52.8	70.6	58.2	49	-:-	58.1	57.4	50	49.2	49.1	----	-----	190546.1	53.5
820	9/10/2025	21:29:25	00d	01:00.0	53.8	71.6	59.7	49.2	-:-	59.5	58.1	51	49.6	49.4	----	-----	239883.3	53.5
821	9/10/2025	21:30:25	00d	01:00.0	55.1	72.9	59.4	49.1	-:-	59.2	58.5	54.2	49.5	49.4	----	-----	323593.7	53.5
822	9/10/2025	21:31:25	00d	01:00.0	51.3	69.1	55.5	49.3	-:-	54.2	53.8	50.3	49.5	49.5	----	-----	134896.3	53.4
823	9/10/2025	21:32:25	00d	01:00.0	54.3	72.1	57.6	49.7	-:-	57.3	57.2	54.1	50.3	50.1	----	-----	269153.5	53.4
824	9/10/2025	21:33:25	00d	01:00.0	53.7	71.5	58.9	49.6	-:-	58.9	57.7	51.5	49.7	49.7	----	-----	234422.9	53.3
825	9/10/2025	21:34:25	00d	01:00.0	53.8	71.6	59.6	49.6	-:-	59	57.9	51.4	49.8	49.7	----	-----	239883.3	53.3
826	9/10/2025	21:35:25	00d	01:00.0	54.8	72.6	60.4	49.2	-:-	60.2	58.5	52.4	49.6	49.5	----	-----	301995.2	53.3
827	9/10/2025	21:36:25	00d	01:00.0	53.7	71.5	60.4	49.2	-:-	60.4	58.4	49.9	49.3	49.3	----	-----	234422.9	53.2
828	9/10/2025	21:37:25	00d	01:00.0	54.3	72.1	57.6	49.5	-:-	57.5	57.2	53.6	49.8	49.6	----	-----	269153.5	53.2
829	9/10/2025	21:38:25	00d	01:00.0	52.1	69.9	58.4	49.2	-:-	57.7	55	50.4	49.5	49.5	----	-----	162181.0	53.1
830	9/10/2025	21:39:25	00d	01:00.0	52.5	70.3	56.9	49.4	-:-	56.4	55.9	50.8	49.6	49.5	----	-----	177827.9	53.1
831	9/10/2025	21:40:25	00d	01:00.0	54.3	72.1	60.5	49.1	-:-	60.4	59.8	51.1	49.5	49.3	----	-----	269153.5	53.0
832	9/10/2025	21:41:25	00d	01:00.0	52.1	69.9	57	48.9	-:-	56	55.5	49.6	49	48.9	----	-----	162181.0	53.0
833	9/10/2025	21:42:25	00d	01:00.0	54.4	72.2	58.6	49.6	-:-	58.2	58	53.3	50.1	49.9	----	-----	275422.9	53.0
834	9/10/2025	21:43:25	00d	01:00.0	56.4	74.2	61.9	49.9	-:-	61.6	60.7	53.6	50.5	50	----	-----	436515.8	53.0
835	9/10/2025	21:44:25	00d	01:00.0	50.6	68.4	54.7	48.7	-:-	54.5	54.1	49.5	49.1	49	----	-----	114815.4	52.9
836	9/10/2025	21:45:25	00d	01:00.0	52.9	70.7	57.5	48.8	-:-	57	56.3	51	49.4	49.2	----	-----	194984.5	52.9
837	9/10/2025	21:46:25	00d	01:00.0	50.4	68.2	56	48.4	-:-	55.3	53.5	49	48.6	48.5	----	-----	109647.8	52.8
838	9/10/2025	21:47:25	00d	01:00.0	52.9	70.7	58.6	48.1	-:-	58.4	57.4	50.2	48.7	48.4	----	-----	194984.5	52.8
839	9/10/2025	21:48:25	00d	01:00.0	54.9	72.7	59.5	49	-:-	59.3	58.4	53.6	49.3	49.3	----	-----	309029.5	52.8
840	9/10/2025	21:49:25	00d	01:00.0	51.2	69	55.7	48	-:-	55.4	54.7	49	48.2	48	----	-----	131825.7	52.7
841	9/10/2025	21:50:25	00d	01:00.0	48.2	66	49.4	47.3	-:-	48.9	48.6	48.2	47.7	47.6	----	-----	66069.3	52.7
842	9/10/2025	21:51:25	00d	01:00.0	55.1	72.9	61	48.1	-:-	60.1	59.2	53.1	48.6	48.5	----	-----	323593.7	52.7
843	9/10/2025	21:52:25	00d	01:00.0	51.2	69	57.7	47.8	-:-	57.4	55.5	48.9	48.1	47.9	----	-----	131825.7	52.6
844	9/10/2025	21:53:25	00d	01:00.0	48.1	65.9	48.6	47.5	-:-	48.6	48.6	48.1	47.8	47.6	----	-----	64565.4	52.6
845	9/10/2025	21:54:25	00d	01:00.0	50.8	68.6	58.6	47.5	-:-	57.9	53.6	48.3	47.8	47.6	----	-----	120226.4	52.6
846	9/10/2025	21:55:25	00d	01:00.0	49.7	67.5	53.8	47.6	-:-	53.6	52.9	48.6	47.9	47.8	----	-----	93325.4	52.6
847	9/10/2025	21:56:25	00d	01:00.0	49.1	66.9	53.3	47.3	-:-	53	52.1	48.1	47.6	47.5	----	-----	81283.1	52.6
848	9/10/2025	21:57:25	00d	01:00.0	52.9	70.7	59.2	47.6	-:-	58.9	57.7	49.3	48	47.8	----	-----	194984.5	52.6
849	9/10/2025	21:58:25	00d	01:00.0	50.1	67.9	54.5	47.2	-:-	54.2	53.8	48.3	47.6	47.5	----	-----	102329.3	52.5
850	9/10/2025	21:59:25	00d	01:00.0	52.2	70	57.6	47.7	-:-	57.5	55.9	50.8	48.6	48.1	----	-----	165958.7	52.5
851	9/10/2025	22:00:25	00d	01:00.0	51.2	69	58.6	47	-:-	57.9	57.4	47.9	47.3	47.1	----	-----	131825.7	52.5
852	9/10/2025	22:01:25	00d	01:00.0	47.7	65.5	48.7	46.9	-:-	48.5	48.2	47.7	47.2	47	----	-----	58884.4	52.5
853	9/10/2025	22:02:25	00d	01:00.0	52.2	70	58.8	48	-:-	56.5	55.3	50.8	48.5	48.2	----	-----	165958.7	52.5
854	9/10/2025	22:03:25	00d	01:00.0	62.8	80.6	72.9	49.6	-:-	71.8	69	54	50.4	50	----	-----	1905460.7	52.6
855	9/10/2025	22:04:25	00d	01:00.0	59.7	77.5	70.1	47	-:-	68.7	64.9	49.1	47.3	47.1	----	-----	933254.3	51.9
856	9/10/2025	22:05:25	00d	01:00.0	53.7	71.5	62.3	47.5	-:-	61.9	60	48.9	47.9	47.7	----	-----	234422.9	51.5
857	9/10/2025	22:06:25	00d	01:00.0	50.7	68.5	57.1	47.1	-:-	56.8	53.4	48.9	47.3	47.2	----	-----	117489.8	51.4
858	9/10/2025	22:07:25	00d	01:00.0	54.7	72.5	60.8	48.7	-:-	60.5	57.6	53.8	49	48.8	----	-----	295120.9	51.3
859	9/10/2025	22:08:25	00d	01:00.0	47.4	65.2	48.8	46.8	-:-	48.3	47.9	47.4	46.9	46.8	----	-----	54954.1	51.2
860	9/10/2025	22:09:25	00d	01:00.0	51.4	69.2	57.3	46.9	-:-	57	55.6	48.7	47.3	47.2	----	-----	138038.4	51.3
861	9/10/2025	22:10:25	00d	01:00.0	53.6	71.4	57.4	50.1	-:-	57.2	56	52.8	51	50.5	----	-----	229086.8	51.2
862	9/10/2025	22:11:25	00d	01:00.0	56.2	74	62.6	47.5	-:-	62.4	60.6	50.6	47.7	47.6	----	-----	416869.4	51.1
863	9/10/2025	22:12:25	00d	01:00.0	51.6	69.4	59.4	46.6	-:-	57.3	55.8	49	47.2	46.8	----	-----	144544.0	50.9
864	9/10/2025	22:13:25	00d	01:00.0	52.3	70.1	59	46.5	-:-	58.7	56.6	48.5	46.8	46.6	----	-----	169824.4	51.9
865	9/10/2025	22:14:25	00d	01:00.0	51.3	69.1	59.1	46.4	-:-	59	56.4	47.3	46.6	46.5	----	-----	134896.3	51.8
866	9/10/2025	22:15:25	00d	01:00.0	53	70.8	60.5	46.4	-:-	60.2	56.3	50.3	46.5	46.4	----	-----	199526.2	51.8
867	9/10/2025	22:16:25	00d	01:00.0	54.9	72.7	62.8	46.6	-:-	62.6	60.7	49.5	46.9	46.8	----	-----	309029.5	51.7
868	9/10/2025	22:17:25	00d	01:00.0	57	74.8	64.7	47.7	-:-	63.4	62	53.6	48.3	47.7	----	-----	501187.2	51.6
869	9/10/2025	22:18:25	00d	01:00.0	51.4	69.2	57.2	46.5	-:-	56.9	55.6	49.7	46.7	46.7	----	-----	138038.4	51.4

870	9/10/2025	22:19:25	00d	01:00.0	50.6	68.4	55.8	46.1	-:-	55.7	55.3	48.6	46.5	46.4	----	-----	114815.4	51.4
871	9/10/2025	22:20:25	00d	01:00.0	49.4	67.2	56.5	45.9	-:-	56.3	54.1	46.8	46.1	46	----	-----	87096.4	51.3
872	9/10/2025	22:21:25	00d	01:00.0	48.3	66.1	56.2	46.2	-:-	53.3	49.9	46.9	46.5	46.3	----	-----	67608.3	51.3
873	9/10/2025	22:22:25	00d	01:00.0	52.3	70.1	59	47	-:-	57	56.3	49.3	47.3	47.2	----	-----	169824.4	51.3
874	9/10/2025	22:23:25	00d	01:00.0	50.9	68.7	59.1	46.5	-:-	57.9	56.4	47.4	46.7	46.7	----	-----	123026.9	51.3
875	9/10/2025	22:24:25	00d	01:00.0	51.5	69.3	56.4	46.6	-:-	55.6	54.4	49.9	47.1	46.8	----	-----	141253.8	51.3
876	9/10/2025	22:25:25	00d	01:00.0	49.7	67.5	55.3	46.4	-:-	55.2	54.2	47.3	46.5	46.4	----	-----	93325.4	51.2
877	9/10/2025	22:26:25	00d	01:00.0	49.2	67	54.3	46.4	-:-	54.3	52	47.8	46.8	46.6	----	-----	83176.4	51.2
878	9/10/2025	22:27:25	00d	01:00.0	51.1	68.9	55.9	46.4	-:-	55.5	54.9	48.9	46.7	46.6	----	-----	128825.0	51.2
879	9/10/2025	22:28:25	00d	01:00.0	47	64.8	48.3	46	-:-	48.3	47.8	47	46.2	46	----	-----	50118.7	51.2
880	9/10/2025	22:29:25	00d	01:00.0	51.9	69.7	56.6	46.2	-:-	56.3	55.9	49.3	46.8	46.5	----	-----	154881.7	51.2
881	9/10/2025	22:30:25	00d	01:00.0	50.7	68.5	56.1	46.1	-:-	55.9	55.3	47.9	46.4	46.3	----	-----	117489.8	51.1
882	9/10/2025	22:31:25	00d	01:00.0	51.8	69.6	56.4	47.4	-:-	55.5	55.3	50.3	47.7	47.6	----	-----	151356.1	51.2
883	9/10/2025	22:32:25	00d	01:00.0	48.8	66.6	54.5	45.5	-:-	54.3	52.3	47.1	46	45.8	----	-----	75857.8	51.2
884	9/10/2025	22:33:25	00d	01:00.0	46.7	64.5	48.6	45.9	-:-	47.8	47.5	46.7	46.1	46	----	-----	46773.5	51.2
885	9/10/2025	22:34:25	00d	01:00.0	54.1	71.9	59.7	46.2	-:-	59.7	59.4	50	47	46.7	----	-----	257039.6	51.2
886	9/10/2025	22:35:25	00d	01:00.0	52.1	69.9	59.6	47.9	-:-	58.6	54	50.1	48.4	48.2	----	-----	162181.0	51.1
887	9/10/2025	22:36:25	00d	01:00.0	46.8	64.6	48.5	46.2	-:-	47.6	47.4	46.9	46.3	46.3	----	-----	47863.0	51.5
888	9/10/2025	22:37:25	00d	01:00.0	51.6	69.4	58	46.2	-:-	58.1	55.7	47.1	46.4	46.2	----	-----	144544.0	51.6
889	9/10/2025	22:38:25	00d	01:00.0	46.9	64.7	50	45.9	-:-	48.2	47.7	46.8	46.2	46	----	-----	48977.9	51.5
890	9/10/2025	22:39:25	00d	01:00.0	49.7	67.5	56.3	45.8	-:-	56	54.2	47.1	46.4	46.2	----	-----	93325.4	51.5
891	9/10/2025	22:40:25	00d	01:00.0	50.2	68	57.5	46	-:-	55	53.6	47.8	46.5	46.2	----	-----	104712.9	51.5
892	9/10/2025	22:41:25	00d	01:00.0	54.7	72.5	60.6	48.1	-:-	59.8	58.9	52.4	48.8	48.3	----	-----	295120.9	51.5
893	9/10/2025	22:42:25	00d	01:00.0	49.9	67.7	55.7	46.3	-:-	55.5	53	48.5	46.8	46.6	----	-----	97723.7	51.4
894	9/10/2025	22:43:25	00d	01:00.0	50.7	68.5	57.1	46	-:-	56.8	56	48.2	46.3	46	----	-----	117489.8	51.4
895	9/10/2025	22:44:25	00d	01:00.0	53.4	71.2	59.5	46.4	-:-	59.4	57.8	50.4	46.7	46.5	----	-----	218776.2	51.4
896	9/10/2025	22:45:25	00d	01:00.0	49.3	67.1	54.9	45.9	-:-	54.1	53.5	47.2	46.3	46.2	----	-----	85113.8	51.4
897	9/10/2025	22:46:25	00d	01:00.0	49.9	67.7	55.2	46.1	-:-	54.9	53.6	47.8	46.4	46.3	----	-----	97723.7	51.4
898	9/10/2025	22:47:25	00d	01:00.0	50.7	68.5	58.6	45.7	-:-	58.4	55	46.9	46	45.9	----	-----	117489.8	51.4
899	9/10/2025	22:48:25	00d	01:00.0	46.1	63.9	47	45.5	-:-	47	46.7	46.1	45.6	45.5	----	-----	40738.0	51.4
900	9/10/2025	22:49:25	00d	01:00.0	51.3	69.1	60.3	45.7	-:-	60.1	54.9	46.7	45.9	45.8	----	-----	134896.3	51.4
901	9/10/2025	22:50:25	00d	01:00.0	46.2	64	48.2	45.6	-:-	47.1	46.8	46.2	45.7	45.7	----	-----	41686.9	51.3
902	9/10/2025	22:51:25	00d	01:00.0	49.7	67.5	57.1	45.6	-:-	56.7	53.3	46.8	46	45.8	----	-----	93325.4	51.3
903	9/10/2025	22:52:25	00d	01:00.0	46.1	63.9	48.5	45.3	-:-	47.7	46.9	45.9	45.5	45.4	----	-----	40738.0	51.3
904	9/10/2025	22:53:25	00d	01:00.0	50.3	68.1	56	46	-:-	55.4	53.7	48.6	46.4	46	----	-----	107151.9	51.4
905	9/10/2025	22:54:25	00d	01:00.0	48	65.8	51.7	45.3	-:-	51.5	50.9	46.8	45.7	45.4	----	-----	63095.7	51.3
906	9/10/2025	22:55:25	00d	01:00.0	52.7	70.5	57.3	46.3	-:-	57	55.9	51.6	47.9	46.9	----	-----	186208.7	51.3
907	9/10/2025	22:56:25	00d	01:00.0	45.8	63.6	46.9	45	-:-	46.5	46.4	45.9	45.4	45.2	----	-----	38018.9	51.3
908	9/10/2025	22:57:25	00d	01:00.0	47	64.8	51.5	45	-:-	51.2	50.7	45.7	45.3	45.1	----	-----	50118.7	51.3
909	9/10/2025	22:58:25	00d	01:00.0	48.3	66.1	54.9	45.1	-:-	54.7	50.8	46.1	45.3	45.2	----	-----	67608.3	51.2
910	9/10/2025	22:59:25	00d	01:00.0	50.5	68.3	56.2	45.5	-:-	55.5	54.5	47.7	45.7	45.7	----	-----	112201.8	51.2
911	9/10/2025	23:00:25	00d	01:00.0	46.8	64.6	51.8	44.6	-:-	51.4	50.4	45.7	44.9	44.9	----	-----	47863.0	51.2
912	9/10/2025	23:01:25	00d	01:00.0	53	70.8	60.5	44.9	-:-	58.8	58.2	47.2	45.3	45.1	----	-----	199526.2	51.2
913	9/10/2025	23:02:25	00d	01:00.0	48.5	66.3	55.7	44.5	-:-	55.3	52.3	45.8	45	44.8	----	-----	70794.6	51.1
914	9/10/2025	23:03:25	00d	01:00.0	56	73.8	67.3	45	-:-	65.9	60.1	47	45.3	45.2	----	-----	398107.2	51.1
915	9/10/2025	23:04:25	00d	01:00.0	53.4	71.2	65.4	45.2	-:-	62.1	56.4	48.1	45.5	45.3	----	-----	218776.2	51.0
916	9/10/2025	23:05:25	00d	01:00.0	47.3	65.1	52.4	44.6	-:-	52.2	51	45.7	44.8	44.7	----	-----	53703.2	51.0
917	9/10/2025	23:06:25	00d	01:00.0	46.8	64.6	51.3	44.5	-:-	51.2	50.4	45.3	44.5	44.4	----	-----	47863.0	51.0
918	9/10/2025	23:07:25	00d	01:00.0	45	62.8	47.7	44.4	-:-	46	45.8	44.9	44.4	44.4	----	-----	31622.8	51.0
919	9/10/2025	23:08:25	00d	01:00.0	48.5	66.3	56.7	44.3	-:-	56.1	52.2	45	44.5	44.3	----	-----	70794.6	51.0
920	9/10/2025	23:09:25	00d	01:00.0	52.4	70.2	62.2	44.3	-:-	59.6	57.7	46.7	44.7	44.5	----	-----	173780.1	51.1
921	9/10/2025	23:10:25	00d	01:00.0	48.9	66.7	57.8	44.3	-:-	57.4	51.7	45.1	44.4	44.4	----	-----	77624.7	51.1
922	9/10/2025	23:11:25	00d	01:00.0	46.4	64.2	57.3	44.1	-:-	51.1	48.9	45.1	44.3	44.2	----	-----	43651.6	51.2
923	9/10/2025	23:12:25	00d	01:00.0	48.6	66.4	55.8	44.7	-:-	55.4	52.6	45.8	45	45	----	-----	72443.6	51.2
924	9/10/2025	23:13:25	00d	01:00.0	62.9	80.7	74	45.2	-:-	73.2	68.7	50.3	46.2	45.8	----	-----	1949844.6	51.1
925	9/10/2025	23:14:25	00d	01:00.0	48.5	66.3	54.5	44.8	-:-	54.5	52.2	46.3	45.2	45	----	-----	70794.6	49.9
926	9/10/2025	23:15:25	00d	01:00.0	49.7	67.5	55.7	44.4	-:-	55.1	53.7	47.2	44.9	44.7	----	-----	93325.4	49.9
927	9/10/2025	23:16:25	00d	01:00.0	44.4	62.2	45.2	43.8	-:-	45.3	45.1	44.3	44	43.9	----	-----	27542.3	49.9
928	9/10/2025	23:17:25	00d	01:00.0	48.1	65.9	55.7	44.1	-:-	55.5	51.7	45.4	44.5	44.4	----	-----	64565.4	49.8
929	9/10/2025	23:18:25	00d	01:00.0	49.4	67.2	54.4	44.3	-:-	54.2	53.4	46.2	44.6	44.5	----	-----	87096.4	49.9
930	9/10/2025	23:19:25	00d	01:00.0	48.9	66.7	57.3	44.3	-:-	56.8	53.2	45.2	44.5	44.5	----	-----	77624.7	49.8
931	9/10/2025	23:20:25	00d	01:00.0	47.5	65.3	57.3	43.8	-:-	55	49.6	44.4	44.1	44	----	-----	56234.1	49.8
932	9/10/2025	23:21:25	00d	01:00.0	50.1	67.9	58.5	43.7	-:-	58.2	54.7	45.7	44.2	43.9	----	-----	102329.3	49.8
933	9/10/2025	23:22:25	00d	01:00.0	47.8	65.6	56.2	44.5	-:-	56	49.6	45.2	44.6	44.6	----	-----	60256.0	49.7
934	9/10/2025	23:23:25	00d	01:00.0	51.1	68.9	57.1	44.6	-:-	57.1	55.4	48.6	44.8	44.7	----	-----	128825.0	49.8
935	9/10/2025	23:24:25	00d	01:00.0	44.4	62.2	46	43.4	-:-	45.3	45.2	44.4	43.7	43.5	----	-----	27542.3	49.8
936	9/10/2025	23:25:25	00d	01:00.0	44	61.8	44.8	43.2	-:-	45.1	44.7	43.8	43.4	43.3	----	-----	25118.9	49.8
937	9/10/2025	23:26:25	00d	01:00.0	50.4	68.2	56.3	43.8	-:-	56.2	55.4	46.4	44.2	43.9	----	-----	109647.8	49.9
938	9/10/2025	23:27:25	00d	01:00.0	47.9	65.7	55.7	43.5	-:-	55.4	53.1	44.6	43.8	43.5	----	-----	61659.5	49.8
939	9/10/2025	23:28:25	00d	01:00.0	48.2	66	55.9	43.4	-:-	55.5	52	44.8	43.6	43.6	----	-----	66069.3	49.8
940	9/10/2025	23:29:25	00d	01:00.0	50.8	68.6	58.4	43.9	-:-	58.2	56.2	45.3	44.3	44.2	----	-----	120226.4	49.8
941	9/10/2025	23:30:25	00d	01:00.0	45.3	63.1	50.9	44.3	-:-	48.4	46.3	45	44.4	44.3	----	-----	33884.4	49.7
942	9/10/2025	23:31:25	00d	01:00.0	53.5	71.3	60.6	44.9	-:-	59.7	57.7	49.5	46.7	45.6	----	-----	223872.1	49.8
943	9/10/2025	23:32:25	00d	01:00.0	52	69.8	61.7	43.5	-:-	61.4	57	46.1	43.7	43.6	----	-----	158489.3	49.6
944	9/10/2025	23:33:25	00d	01:00.0	44.3	62.1	45.3	43.6	-:-	45.1	45	44.2	43.8	43.8	----	-----	26915.3	49.5
945	9/10/2025	23:34:25	00d	01:00.0	50.5	68.3	58.2	44.5	-:-	56.7	55.2	47.3	45.4	45.3	----	-----	112201.8	49.6
946	9/10/2025	23:35:25	00d	01:00.0	51.7	69.5	59.4	45.4	-:-	57.6	56	48.8	46.2	46	----	-----	147910.8	49.5
947	9/10/2025	23:36:25	00d	01:00.0	59.2	77	69.3	44	-:-	68.9	65.7	48.1	45.2	44.8	----	-----	831763.8	49.4
948	9/10/2025	23:37:25	00d	01:00.0	52	69.8	57.9	43.8	-:-	57.9	57.1	45.6	44.1	44	----	-----	158489.3	48.7
949	9/10/2025	23:38:25	00d	01:00.0	48.3	66.1	54	44.5	-:-	53.9	52	46.3	45.3	44.7	----	-----	67608.3	48.5
950	9/10/2025	23:39:25	00d	01:00.0	47.2	65	53.8	43.9	-:-	53.1	51.7	44.8	44.3	44.1	----	-----	52480.7	48.5
951	9/10/2025	23:40:25	00d	01:00.0	50	67.8	56.3	43.9	-:-	56.3	53.5	46.2	44.2	44	----	-----	100000.0	48.5
952	9/10/2025	23:41:25	00d	01:00.0	51.3	69.1	59.6	43.7	-:-	59.5	57.6	45	44.1	44	----	-----	134896.3	48.4
953	9/10/2025	23:42:25	00d	01:00.0	49.1	66.9	57	44.3	-:-	54.6	53.9	46	44.5	44.4	----	-----	81283.1	48.3
954	9/10/2025	23:43:25	00d	01:00.0	50.1	67.9	56.5	44	-:-	56.4	55.5	45.6	44.3	44.3	----	-----	102329.3	48.2
955	9/10/2025	23:44:25	00d	01:00.0	49.6	67.4	58.6	44.8	-:-	56.1	53.6	46.1	45.1	45	----	-----	91201.1	48.1
956	9/10/2025	23:45:25	00d	01:00.0	51.7	69.5	60.7	45.3	-:-	59.7	54.4	48	45.8	45.7	----	-----	147910.8	48.0
957	9/10/2025	23:46:25	00d	01:00.0	49.7	67.5	57.1	44.8	-:-	56.5	53.3	46.6	45.2	44.8	----	-----	93325.4	47.9
958	9/10/2025	23:47:25	00d	01:00.0	48.7	66.5	54.2	45	-:-	53.9	52.6	47.1	45.5	45.4	----	-----	74131.0	47.8
959	9/10/2025	23:48:25	00d	01:00.0	50.8	68.6	55.4	46.4	-:-	55.2	54.9	49.1	46.9	46.6	----	-----	120226.4	47.8
960	9/10/2025	23:49:25	00d	01:00.0	49.8	67.6	57.5	44.4	-:-	57.3	54.2	45.5	44.6	44.5	----	-----	95499.3	47.9
961	9/10/2025	23:50:25	00d	01:00.0	44.9	62.7	45.6	44.1	-:-	45.8	45.5	44.7	44.4	44.3	----	-----	30903.0	47.9
962	9/10/2025	23:51:25	00d	01:00.0	45	62.8	45.8	44.5	-:-	45.8	45.6	45	44.5	44.5	----	-----	31622.8	47.8
963	9/10/2025	23:52:25	00d	01:00.0	49	66.8	56.5	44.6	-:-	56.2	53.4	45.9	44.8	44.6	----	-----	79432.8	47.8
964	9/10/2025	23:53:25	00d	01:00.0	49.5	67.3	58.6	43.6	-:-	58.2	53.1	45.2	43.8	43.7	----	-----	89125.1	47.8
965	9/10/2025	23:54:25	00d	01:00.0	49	66.8	57	44.2	-:-	56.8	52.6	45.6	44.6	44.5	----	-----	79432.8	47.7
966	9/10/2025	23:55:25	00d	01:00.0	44.5	62.3	45.8	43.8	-:-	45.3	45.2	44.4	44	43.9	----	-----	28183.8	47.7
967	9/10/2025	23:56:25	00d	01:00.0	47.7	65.5	53.6	43.7	-:-	53.4	52.4	45.3	44.1	43.9	----	-----	58884.4	47.7
968	9/10/2025	23:57:25	00d	01:00.0	44.3	62.1	45.1	43.6	-:-	45.3	45	44.2	43.6	43.5	----	-----	26915.3	47.6
969	9/10/2025	23:58:25	00d	01:00.0	44.4	62.2	45.2	43.7	-:-	45.2	45	44.3	44	43.9	----	-----	27542.3	47.7
970	9/10/2025	23:59:25	00d	01:00.0	44.5	62.3	45.3	43.9	-:-	45.4	45.3	44.3	43.9	43.8	----	-----	28183.8	47.8
971	9/11/2025	0:00:25	00d	01:00.0	44.2	62	45.1	43.2	-:-	45.1	45	44.1	43.5	43.4	----	-----	26302.7	47.7
972	9/11/2025	0:01:25	00d	01:00.0	46.7	64.5	52.6	44.1	-:-	52.2	49.7	45.1	44.4	44.4	----	-----	46773.5	47.7
973	9/11/2025	0:02:25	00d	01:00.0	48.5	66.3	56.4	43.6	-:-	55.8	52.7	45.6	44.1	43.9	----	-----	70794.6	47.7
974	9/11/2025	0:03:25	00d	01:00.0	48.2	66	54.7	43.9	-:-	54.5	53.1	45.4	44.2	44.1	----	-----	66069.3	47.7
975	9/11/2025	0:04:25	00d	01:00.0	52.7	70.5	59.4	45.6	-:-	58.7	58	49.4	46.1	45.7	----	-----	186208.7	47.7
976	9/11/2025	0:05:25	00d	01:00.0	53.1	70.9	60.2	45.7	-:-	59.6	57.2	50.5	46.1	45.9	----	-----	204173.8	47.5
977	9/11/2025	0:06:25	00d	01:00.0	48.6	66.4	54.6	43.7	-:-	54.3	53.3	44.9	43.9	43.8	----	-----	72443.6	47.3
978	9/11/2025	0:07:25	00d	01:00.0	44.7	62.5	45.4	44.2	-:-	45.6	45.4	44.5	44.2	44.2	----	-----	29512.1	47.4

979	9/11/2025	0:08:25	00d	01:00.0	51.2	69	58.3	43.6	-:-	57.4	56.1	45.8	43.8	43.8	----	-----	131825.7	47.4
980	9/11/2025	0:09:25	00d	01:00.0	50.5	68.3	58.5	44.5	-:-	58.1	54.5	47.4	44.9	44.9	----	-----	112201.8	47.4
981	9/11/2025	0:10:25	00d	01:00.0	54.5	72.3	64	44	-:-	63.6	60.3	45.3	44.2	44	----	-----	281838.3	47.9
982	9/11/2025	0:11:25	00d	01:00.0	52.7	70.5	60.5	43.5	-:-	59.6	56.9	47.8	44.1	43.8	----	-----	186208.7	47.6
983	9/11/2025	0:12:25	00d	01:00.0	44.9	62.7	53	43.2	-:-	48.8	46.1	44.2	43.6	43.6	----	-----	30903.0	47.4
984	9/11/2025	0:13:25	00d	01:00.0	44	61.8	44.8	43.3	-:-	44.8	44.7	43.9	43.5	43.4	----	-----	25118.9	47.5
985	9/11/2025	0:14:25	00d	01:00.0	44.2	62	45	43.7	-:-	44.9	44.8	44.1	43.9	43.8	----	-----	26302.7	47.5
986	9/11/2025	0:15:25	00d	01:00.0	43.8	61.6	44.3	43.4	-:-	44.2	44.2	43.9	43.5	43.5	----	-----	23988.3	47.6
987	9/11/2025	0:16:25	00d	01:00.0	43.8	61.6	44.6	43.3	-:-	44.3	44.2	43.7	43.5	43.5	----	-----	23988.3	47.7
988	9/11/2025	0:17:25	00d	01:00.0	44	61.8	44.5	43.4	-:-	44.4	44.3	44	43.7	43.5	----	-----	25118.9	47.7
989	9/11/2025	0:18:25	00d	01:00.0	48.4	66.2	56.5	43.6	-:-	56.1	52.8	45.1	43.9	43.8	----	-----	69183.1	47.7
990	9/11/2025	0:19:25	00d	01:00.0	44.2	62	44.8	43.1	-:-	44.7	44.6	44.3	43.6	43.5	----	-----	26302.7	47.6
991	9/11/2025	0:20:25	00d	01:00.0	48.2	66	55.6	43.1	-:-	55.3	51.9	44.8	44	43.5	----	-----	66069.3	47.6
992	9/11/2025	0:21:25	00d	01:00.0	44.1	61.9	44.6	43.6	-:-	44.5	44.4	44.1	43.7	43.7	----	-----	25704.0	47.5
993	9/11/2025	0:22:25	00d	01:00.0	44.2	62	44.6	43.7	-:-	44.5	44.5	44.2	43.9	43.9	----	-----	26302.7	47.5
994	9/11/2025	0:23:25	00d	01:00.0	53.3	71.1	62.1	43.8	-:-	61.2	59.7	45.5	44.2	44.1	----	-----	213796.2	47.5
995	9/11/2025	0:24:25	00d	01:00.0	44.5	62.3	47.6	43.5	-:-	46.8	46.2	44.1	43.7	43.6	----	-----	28183.8	47.3
996	9/11/2025	0:25:25	00d	01:00.0	48.8	66.6	57.2	43.9	-:-	56.4	52.9	44.6	44.1	44	----	-----	75857.8	47.3
997	9/11/2025	0:26:25	00d	01:00.0	51	68.8	57.9	43.7	-:-	57.9	55.8	48.1	44	43.8	----	-----	125892.5	47.2
998	9/11/2025	0:27:25	00d	01:00.0	48.3	66.1	55.2	43.8	-:-	54.6	52.3	45.8	44.1	44.1	----	-----	67608.3	47.1
999	9/11/2025	0:28:25	00d	01:00.0	46.4	64.2	52.4	43.4	-:-	52.4	50.1	44.1	43.6	43.6	----	-----	43651.6	47.0
1000	9/11/2025	0:29:25	00d	01:00.0	43.7	61.5	44.2	43.2	-:-	44.2	44	43.6	43.4	43.3	----	-----	23442.3	47.0
1001	9/11/2025	0:30:25	00d	01:00.0	44	61.8	44.5	43.6	-:-	44.4	44.3	44	43.7	43.7	----	-----	25118.9	47.0
1002	9/11/2025	0:31:25	00d	01:00.0	49.5	67.3	56.9	43.8	-:-	56.7	53.4	47.1	44.4	44.2	----	-----	89125.1	47.1
1003	9/11/2025	0:32:25	00d	01:00.0	44	61.8	46.8	43.1	-:-	45.5	45.3	43.7	43.4	43.3	----	-----	25118.9	47.0
1004	9/11/2025	0:33:25	00d	01:00.0	47.8	65.6	55.8	43.2	-:-	55.4	52.8	43.9	43.4	43.4	----	-----	60256.0	47.0
1005	9/11/2025	0:34:25	00d	01:00.0	48.5	66.3	55.1	43.8	-:-	55	52.6	45.8	44	43.9	----	-----	70794.6	46.9
1006	9/11/2025	0:35:25	00d	01:00.0	43.5	61.3	44.1	43.1	-:-	43.9	43.8	43.5	43.4	43.2	----	-----	22387.2	46.8
1007	9/11/2025	0:36:25	00d	01:00.0	43.5	61.3	44.1	42.9	-:-	44.1	44	43.5	43.1	43.1	----	-----	22387.2	46.8
1008	9/11/2025	0:37:25	00d	01:00.0	43.5	61.3	44.1	42.9	-:-	43.9	43.8	43.5	43	43	----	-----	22387.2	46.8
1009	9/11/2025	0:38:25	00d	01:00.0	43.2	61	44	42.5	-:-	43.9	43.7	43.2	42.8	42.7	----	-----	20893.0	46.8
1010	9/11/2025	0:39:25	00d	01:00.0	43.1	60.9	43.5	42.5	-:-	43.4	43.4	43.1	42.8	42.7	----	-----	20417.4	46.8
1011	9/11/2025	0:40:25	00d	01:00.0	42.7	60.5	43.1	42.2	-:-	43.1	43	42.7	42.4	42.3	----	-----	18620.9	46.8
1012	9/11/2025	0:41:25	00d	01:00.0	42.8	60.6	43.2	42.4	-:-	43.1	43.1	42.8	42.5	42.5	----	-----	19054.6	47.0
1013	9/11/2025	0:42:25	00d	01:00.0	42.7	60.5	43.3	42.2	-:-	43.2	43.2	42.7	42.5	42.4	----	-----	18620.9	47.0
1014	9/11/2025	0:43:25	00d	01:00.0	42.8	60.6	43.3	42.5	-:-	43.2	43.1	42.8	42.5	42.5	----	-----	19054.6	47.0
1015	9/11/2025	0:44:25	00d	01:00.0	42.9	60.7	43.6	42.5	-:-	43.4	43.3	42.9	42.7	42.7	----	-----	19498.4	47.0
1016	9/11/2025	0:45:25	00d	01:00.0	46	63.8	51.7	42.8	-:-	51.3	50.4	43.4	42.9	42.9	----	-----	39810.7	46.9
1017	9/11/2025	0:46:25	00d	01:00.0	43.2	61	43.7	42.6	-:-	43.6	43.6	43.2	42.8	42.8	----	-----	20893.0	46.9
1018	9/11/2025	0:47:25	00d	01:00.0	45.7	63.5	50.9	42.5	-:-	50.6	50.3	43.5	42.9	42.8	----	-----	37153.5	46.9
1019	9/11/2025	0:48:25	00d	01:00.0	48.7	66.5	57.1	43.5	-:-	56.8	52.6	44.8	43.6	43.6	----	-----	74131.0	47.0
1020	9/11/2025	0:49:25	00d	01:00.0	53.1	70.9	62.4	43.5	-:-	60.9	59.1	47.2	43.9	43.8	----	-----	204173.8	47.0
1021	9/11/2025	0:50:25	00d	01:00.0	45.2	63	52.2	42.5	-:-	52	48.2	43.2	42.8	42.7	----	-----	33113.1	46.7
1022	9/11/2025	0:51:25	00d	01:00.0	42.8	60.6	44.5	42.2	-:-	44.4	43.9	42.7	42.4	42.4	----	-----	19054.6	46.7
1023	9/11/2025	0:52:25	00d	01:00.0	42.8	60.6	44.2	42	-:-	44.5	44.4	42.5	42.2	42.1	----	-----	19054.6	46.7
1024	9/11/2025	0:53:25	00d	01:00.0	43	60.8	44.6	42.2	-:-	44.6	44.3	42.8	42.3	42.3	----	-----	19952.6	46.7
1025	9/11/2025	0:54:25	00d	01:00.0	48.5	66.3	55.4	42.4	-:-	55.1	54.2	43.4	42.7	42.6	----	-----	70794.6	46.7
1026	9/11/2025	0:55:25	00d	01:00.0	45	62.8	53.7	42.3	-:-	50.9	47.7	43.3	42.4	42.3	----	-----	31622.8	46.6
1027	9/11/2025	0:56:25	00d	01:00.0	43.2	61	44.5	42.4	-:-	44.5	44.1	42.9	42.7	42.6	----	-----	20893.0	46.5
1028	9/11/2025	0:57:25	00d	01:00.0	44.7	62.5	52.5	42	-:-	49.3	46.5	43.1	42.6	42.6	----	-----	29512.1	46.5
1029	9/11/2025	0:58:25	00d	01:00.0	49.9	67.7	57	43	-:-	56.6	55.2	44.3	43.2	43.2	----	-----	97723.7	46.5
1030	9/11/2025	0:59:25	00d	01:00.0	47.5	65.3	55.2	42.7	-:-	55.2	51.8	43.7	43	42.9	----	-----	56234.1	46.4
1031	9/11/2025	1:00:25	00d	01:00.0	43.5	61.3	48	42.1	-:-	45.8	44.8	43.2	42.5	42.3	----	-----	22387.2	46.3
1032	9/11/2025	1:01:25	00d	01:00.0	43.3	61.1	45.1	42.3	-:-	44.9	44.9	43	42.4	42.2	----	-----	21379.6	46.3
1033	9/11/2025	1:02:25	00d	01:00.0	43.2	61	44.6	42.2	-:-	44.8	44.4	43	42.5	42.3	----	-----	20893.0	46.3
1034	9/11/2025	1:03:25	00d	01:00.0	43.2	61	44.6	42.1	-:-	45	44.7	42.9	42.3	42.3	----	-----	20893.0	46.3
1035	9/11/2025	1:04:25	00d	01:00.0	49.3	67.1	58	42.2	-:-	57.7	54	44.7	42.4	42.2	----	-----	85113.8	46.3
1036	9/11/2025	1:05:25	00d	01:00.0	47.7	65.5	56.4	42.2	-:-	56.3	51.2	43.9	42.4	42.4	----	-----	58884.4	46.2
1037	9/11/2025	1:06:25	00d	01:00.0	43.4	61.2	45.3	42.2	-:-	44.9	44.7	43.2	42.4	42.3	----	-----	21877.6	46.1
1038	9/11/2025	1:07:25	00d	01:00.0	51.7	69.5	60.6	42.1	-:-	60.2	57.3	45.1	42.3	42.3	----	-----	147910.8	46.1
1039	9/11/2025	1:08:25	00d	01:00.0	43.9	61.7	45.6	43	-:-	45.3	45.3	43.6	43.2	43.2	----	-----	24547.1	45.9
1040	9/11/2025	1:09:25	00d	01:00.0	51.4	69.2	60.5	43.7	-:-	60.1	56.5	45.5	43.9	43.7	----	-----	138038.4	45.9
1041	9/11/2025	1:10:25	00d	01:00.0	57.5	75.3	69.9	43.8	-:-	67.8	58.3	46.5	43.9	43.9	----	-----	562341.3	45.7
1042	9/11/2025	1:11:25	00d	01:00.0	44	61.8	45.6	42.9	-:-	45.6	45.2	43.6	43.2	43.2	----	-----	25118.9	44.4
1043	9/11/2025	1:12:25	00d	01:00.0	44	61.8	46.1	42.2	-:-	46	45.6	43.6	42.8	42.3	----	-----	25118.9	44.4
1044	9/11/2025	1:13:25	00d	01:00.0	49	66.8	57.2	43.1	-:-	57.1	53.4	44.9	43.4	43.4	----	-----	79432.8	44.4
1045	9/11/2025	1:14:25	00d	01:00.0	43.4	61.2	45	41.9	-:-	44.8	44.5	43.4	42.1	42	----	-----	21877.6	44.2
1046	9/11/2025	1:15:25	00d	01:00.0	51.7	69.5	61.5	42.1	-:-	61.2	56.9	43.4	42.2	42.1	----	-----	147910.8	44.2
1047	9/11/2025	1:16:25	00d	01:00.0	46.2	64	58	42.3	-:-	52.4	49.5	44	42.5	42.4	----	-----	41686.9	43.8
1048	9/11/2025	1:17:25	00d	01:00.0	46	63.8	54.3	42	-:-	54.2	48.5	43.1	42.2	42.1	----	-----	39810.7	43.7
1049	9/11/2025	1:18:25	00d	01:00.0	42.9	60.7	44.5	41.9	-:-	44.6	44.4	42.4	42.1	42	----	-----	19498.4	43.6
1050	9/11/2025	1:19:25	00d	01:00.0	42.8	60.6	44.7	41.7	-:-	44.6	44.3	42.3	41.9	41.8	----	-----	19054.6	43.7
1051	9/11/2025	1:20:25	00d	01:00.0	43.1	60.9	44.7	42	-:-	44.9	44.7	42.7	42.2	42.2	----	-----	20417.4	43.7
1052	9/11/2025	1:21:25	00d	01:00.0	42.9	60.7	44.6	41.7	-:-	44.6	44.1	42.4	41.9	41.8	----	-----	19498.4	43.8
1053	9/11/2025	1:22:25	00d	01:00.0	42.8	60.6	44.8	41.5	-:-	44.7	44.6	42.4	42	41.7	----	-----	19054.6	43.7
1054	9/11/2025	1:23:25	00d	01:00.0	42.7	60.5	44.7	41.4	-:-	44.7	44.5	42.3	41.8	41.6	----	-----	18620.9	43.7
1055	9/11/2025	1:24:25	00d	01:00.0	42.4	60.2	44.6	41	-:-	44.7	44.3	42	41.4	41.3	----	-----	17378.0	43.7
1056	9/11/2025	1:25:25	00d	01:00.0	44.4	62.2	50.9	41.4	-:-	50.6	47.4	42.6	41.6	41.4	----	-----	27542.3	43.7
1057	9/11/2025	1:26:25	00d	01:00.0	43.6	61.4	50.8	41	-:-	48.4	45.8	42.1	41.4	41.3	----	-----	22908.7	43.7
1058	9/11/2025	1:27:25	00d	01:00.0	47.6	65.4	52.4	41.3	-:-	52.1	51.9	44.2	41.5	41.3	----	-----	57544.0	43.6
1059	9/11/2025	1:28:25	00d	01:00.0	42.7	60.5	46.7	41.3	-:-	45	44.3	41.9	41.5	41.4	----	-----	18620.9	43.6
1060	9/11/2025	1:29:25	00d	01:00.0	42.2	60	43.8	41.2	-:-	44.2	44	41.7	41.4	41.3	----	-----	16595.9	43.7
1061	9/11/2025	1:30:25	00d	01:00.0	42.3	60.1	44.6	41.5	-:-	44.3	43.6	41.8	41.6	41.6	----	-----	16982.4	43.9
1062	9/11/2025	1:31:25	00d	01:00.0	48.9	66.7	56.8	42	-:-	56.5	53.5	45.1	42.1	42	----	-----	77624.7	43.8
1063	9/11/2025	1:32:25	00d	01:00.0	45.1	62.9	52.5	41.2	-:-	50.8	49.3	42.9	41.4	41.3	----	-----	32359.4	43.6
1064	9/11/2025	1:33:25	00d	01:00.0	41.7	59.5	44	40.9	-:-	43.9	43.6	41.3	41.1	41.1	----	-----	14791.1	43.9
1065	9/11/2025	1:34:25	00d	01:00.0	42	59.8	44.2	41	-:-	44.1	43.9	41.5	41.2	41.1	----	-----	15848.9	43.9
1066	9/11/2025	1:35:25	00d	01:00.0	42	59.8	43.9	40.9	-:-	44.1	43.7	41.6	41.2	41.1	----	-----	15848.9	43.9
1067	9/11/2025	1:36:25	00d	01:00.0	41.8	59.6	44.1	40.8	-:-	43.8	43.6	41.3	40.9	40.8	----	-----	15135.6	43.8
1068	9/11/2025	1:37:25	00d	01:00.0	41.7	59.5	43.6	40.7	-:-	44	43.6	41.3	40.9	40.8	----	-----	14791.1	43.8
1069	9/11/2025	1:38:25	00d	01:00.0	41.6	59.4	43.5	40.7	-:-	43.5	43	41.2	40.9	40.9	----	-----	14454.4	43.8
1070	9/11/2025	1:39:25	00d	01:00.0	41.5	59.3	43.4	40.8	-:-	43.3	42.1	41.4	41.1	40.8	----	-----	14125.4	43.8
1071	9/11/2025	1:40:25	00d	01:00.0	47.1	64.9	54.3	41.1	-:-	53.9	52.2	43.5	41.3	41.2	----	-----	51286.1	43.8
1072	9/11/2025	1:41:25	00d	01:00.0	50.8	68.6	58.1	41.4	-:-	58	54.4	47.7	42	41.6	----	-----	120226.4	43.7
1073	9/11/2025	1:42:25	00d	01:00.0	42.1	59.9	44.1	41.1	-:-	44.2	44	41.7	41.3	41.2	----	-----	16218.1	43.3
1074	9/11/2025	1:43:25	00d	01:00.0	42	59.8	42.6	41.2	-:-	42.5	42.4	41.9	41.6	41.6	----	-----	15848.9	43.3
1075	9/11/2025	1:44:25	00d	01:00.0	41.5	59.3	42	41	-:-	41.9	41.8	41.6	41.3	41.1	----	-----	14125.4	43.3
1076	9/11/2025	1:45:25	00d	01:00.0	41	58.8	41.6	40.5	-:-	41.5	41.4	41	40.7	40.7	----	-----	12589.3	43.6
1077	9/11/2025	1:46:25	00d	01:00.0	45.7	63.5	53	40.8	-:-	52.6	51	41.9	41	40.9	----	-----	37153.5	43.6
1078	9/11/2025	1:47:25	00d	01:00.0	40.6	58.4	41	40.3	-:-	40.9	40.9	40.6	40.4	40.4	----	-----	11481.5	43.6
1079	9/11/2025	1:48:25	00d	01:00.0	49.3	67.1	59	40.4	-:-	58.9	53.2	42	40.7	40.5	----	-----	85113.8	43.6
1080	9/11/2025	1:49:25	00d	01:00.0	47.5	65.3	53.8	40.9	-:-	53.3	52.8	43.5	41.3	41.3	----	-----	56234.1	43.3
1081	9/11/2025	1:50:25	00d	01:00.0	41.2	59	42.2	40.6	-:-	41.7	41.5	41.2	40.8	40.7	----	-----	13182.6	43.2
1082	9/11/2025	1:51:25	00d	01:00.0	45.2	63	52.1	40.7	-:-	51.7	50.4	41.6	40.9	40.8	----	-----	33113.1	43.4
1083	9/11/2025	1:52:25	00d	01:00.0	41.1	58.9	41.4	40.7	-:-	41.4	41.3	41.2	40.8	40.8	----	-----	12882.5	43.5
1084	9/11/2025	1:53:25	00d	01:00.0	40.9	58.7	41.2	40.3	-:-	41.2	41.1	40.9	40.6	40.6	----	-----	12302.7	43.6
1085	9/11/2025	1:54:25	00d	01:00.0	40.9	58.7	42.5	40.3	-:-	41.2	41.1	40.9	40.5	40.5	----	-----	12302.7	43.6
1086	9/11/2025	1:55:25	00d	01:00.0	40.8	58.6	42.8	40.2	-:-	42.9	41	40.6	40.3	40.3	----	-----	12022.6	43.6
1087	9/11/2025	1:56:25	00d	01:00.0	41.1	58.9	43.1	40.4	-:-	43	42.4	40.8	40.6	40.6	----	-----	12882.5	43.6

1088	9/11/2025	1:57:25	00d	01:00.0	41.1	58.9	41.8	40.4	-:-	41.6	41.5	41.1	40.6	40.6	----	-----	12882.5	43.6
1089	9/11/2025	1:58:25	00d	01:00.0	41.2	59	43	40.7	-:-	42.4	41.5	41.1	40.8	40.7	----	-----	13182.6	43.6
1090	9/11/2025	1:59:25	00d	01:00.0	40.8	58.6	41.2	40.4	-:-	41.1	41	40.8	40.6	40.6	----	-----	12022.6	43.6
1091	9/11/2025	2:00:25	00d	01:00.0	46.2	64	54	40.7	-:-	53.6	51	42.2	41	40.9	----	-----	41686.9	43.5
1092	9/11/2025	2:01:25	00d	01:00.0	40.9	58.7	43.1	40.2	-:-	42	41.2	40.8	40.5	40.4	----	-----	12302.7	43.4
1093	9/11/2025	2:02:25	00d	01:00.0	40.3	58.1	40.8	39.9	-:-	40.7	40.6	40.3	40.1	40	----	-----	10715.2	43.4
1094	9/11/2025	2:03:25	00d	01:00.0	40.3	58.1	40.6	39.9	-:-	40.6	40.5	40.3	40.1	40	----	-----	10715.2	43.9
1095	9/11/2025	2:04:25	00d	01:00.0	40.8	58.6	43.1	39.7	-:-	43	42	40.4	40.1	40	----	-----	12022.6	43.9
1096	9/11/2025	2:05:25	00d	01:00.0	43.5	61.3	48.9	40.9	-:-	48.7	46.5	41.8	41.2	41	----	-----	22387.2	45.3
1097	9/11/2025	2:06:25	00d	01:00.0	44.6	62.4	47.8	40.6	-:-	48	47.3	44	40.6	40.6	----	-----	28840.3	45.2
1098	9/11/2025	2:07:25	00d	01:00.0	45.4	63.2	52.9	40.7	-:-	52.5	50.2	42.1	40.9	40.9	----	-----	34673.7	45.2
1099	9/11/2025	2:08:25	00d	01:00.0	40.4	58.2	41	40	-:-	40.8	40.7	40.5	40.3	40.2	----	-----	10964.8	45.3
1100	9/11/2025	2:09:25	00d	01:00.0	41.2	59	44.2	40.3	-:-	43.8	42.5	40.8	40.5	40.4	----	-----	13182.6	45.4
1101	9/11/2025	2:10:25	00d	01:00.0	44.9	62.7	51.4	40.2	-:-	51	49.6	41	40.4	40.3	----	-----	30903.0	45.4
1102	9/11/2025	2:11:25	00d	01:00.0	40.6	58.4	41	40.1	-:-	41	40.9	40.7	40.4	40.3	----	-----	11481.5	45.3
1103	9/11/2025	2:12:25	00d	01:00.0	40.9	58.7	41.4	40.3	-:-	41.3	41.3	41	40.6	40.5	----	-----	12302.7	45.3
1104	9/11/2025	2:13:25	00d	01:00.0	40.9	58.7	41.5	40.1	-:-	41.3	41.3	40.9	40.4	40.3	----	-----	12302.7	45.3
1105	9/11/2025	2:14:25	00d	01:00.0	40.5	58.3	40.9	40.1	-:-	40.8	40.8	40.6	40.3	40.3	----	-----	11220.2	45.5
1106	9/11/2025	2:15:25	00d	01:00.0	40.3	58.1	43.1	39.7	-:-	40.6	40.5	40.3	40	39.8	----	-----	10715.2	45.5
1107	9/11/2025	2:16:25	00d	01:00.0	40.3	58.1	40.7	39.8	-:-	40.7	40.6	40.3	40	40	----	-----	10715.2	45.6
1108	9/11/2025	2:17:25	00d	01:00.0	40.2	58	41.3	39.8	-:-	40.6	40.5	40.2	40	39.9	----	-----	10471.3	45.6
1109	9/11/2025	2:18:25	00d	01:00.0	40.5	58.3	41.2	39.9	-:-	41	40.9	40.5	40.2	40.1	----	-----	11220.2	45.7
1110	9/11/2025	2:19:25	00d	01:00.0	45.9	63.7	52.6	39.9	-:-	52.1	51.7	41.8	40.1	40.1	----	-----	38904.5	45.7
1111	9/11/2025	2:20:25	00d	01:00.0	46.4	64.2	54.1	40.2	-:-	53.8	50.7	42.9	41	40.5	----	-----	43651.6	45.7
1112	9/11/2025	2:21:25	00d	01:00.0	44.7	62.5	49.8	39.7	-:-	49.8	49.3	41.8	40.1	39.9	----	-----	29512.1	45.6
1113	9/11/2025	2:22:25	00d	01:00.0	40.3	58.1	41.2	39.6	-:-	40.9	40.6	40.3	39.9	39.9	----	-----	10715.2	45.6
1114	9/11/2025	2:23:25	00d	01:00.0	40.5	58.3	41.1	39.8	-:-	41.1	40.9	40.5	40.2	40.1	----	-----	11220.2	45.7
1115	9/11/2025	2:24:25	00d	01:00.0	42.9	60.7	48.6	40	-:-	47.9	47.3	40.6	40.2	40.1	----	-----	19498.4	45.8
1116	9/11/2025	2:25:25	00d	01:00.0	41.9	59.7	45.3	40.8	-:-	43.8	43.1	41.4	41	41	----	-----	15488.2	45.8
1117	9/11/2025	2:26:25	00d	01:00.0	41	58.8	41.7	40.2	-:-	41.6	41.5	41.1	40.5	40.5	----	-----	12589.3	45.8
1118	9/11/2025	2:27:25	00d	01:00.0	41.4	59.2	42.2	40.9	-:-	42	41.9	41.3	41.1	41	----	-----	13803.8	45.8
1119	9/11/2025	2:28:25	00d	01:00.0	46.2	64	54.2	40.3	-:-	53.8	51	41.7	40.8	40.5	----	-----	41686.9	45.8
1120	9/11/2025	2:29:25	00d	01:00.0	48.6	66.4	58	40.4	-:-	57.4	53.2	42.5	40.7	40.7	----	-----	72443.6	45.8
1121	9/11/2025	2:30:25	00d	01:00.0	47.5	65.3	55.5	40.8	-:-	55.4	52.7	42.6	41.1	41	----	-----	56234.1	45.6
1122	9/11/2025	2:31:25	00d	01:00.0	40.6	58.4	41.1	40.1	-:-	41	40.9	40.7	40.5	40.3	----	-----	11481.5	45.5
1123	9/11/2025	2:32:25	00d	01:00.0	40.6	58.4	41.1	40.3	-:-	41	40.8	40.6	40.4	40.4	----	-----	11481.5	45.5
1124	9/11/2025	2:33:25	00d	01:00.0	50.5	68.3	59.2	40.5	-:-	58.9	56.4	42.8	41	40.8	----	-----	112201.8	45.5
1125	9/11/2025	2:34:25	00d	01:00.0	40.5	58.3	41.1	39.5	-:-	41	40.9	40.6	39.9	39.7	----	-----	11220.2	45.3
1126	9/11/2025	2:35:25	00d	01:00.0	40.3	58.1	41	39.7	-:-	40.8	40.7	40.3	39.9	39.9	----	-----	10715.2	45.3
1127	9/11/2025	2:36:25	00d	01:00.0	40.5	58.3	41.4	39.7	-:-	41.2	41.1	40.5	40	40	----	-----	11220.2	45.4
1128	9/11/2025	2:37:25	00d	01:00.0	40.1	57.9	40.6	39.4	-:-	40.5	40.4	40.1	39.8	39.6	----	-----	10232.9	45.4
1129	9/11/2025	2:38:25	00d	01:00.0	40.4	58.2	41.3	39.6	-:-	41	40.9	40.3	39.9	39.8	----	-----	10964.8	45.7
1130	9/11/2025	2:39:25	00d	01:00.0	39.7	57.5	40.3	38.7	-:-	40.3	40.2	39.8	39.1	38.9	----	-----	9332.5	45.7
1131	9/11/2025	2:40:25	00d	01:00.0	40.1	57.9	40.8	39.6	-:-	40.5	40.5	40.1	39.8	39.7	----	-----	10232.9	45.8
1132	9/11/2025	2:41:25	00d	01:00.0	40.3	58.1	40.9	39.8	-:-	40.8	40.6	40.3	39.9	39.9	----	-----	10715.2	46.1
1133	9/11/2025	2:42:25	00d	01:00.0	40.1	57.9	40.5	39.6	-:-	40.4	40.4	40.1	39.8	39.8	----	-----	10232.9	46.1
1134	9/11/2025	2:43:25	00d	01:00.0	40	57.8	40.6	39.5	-:-	40.5	40.4	39.9	39.7	39.7	----	-----	10000.0	46.2
1135	9/11/2025	2:44:25	00d	01:00.0	43.2	61	48.9	39.7	-:-	48.4	47.5	40.8	40	39.9	----	-----	20893.0	46.2
1136	9/11/2025	2:45:25	00d	01:00.0	49.5	67.3	56.3	41	-:-	56	54.2	45.8	42	41.9	----	-----	89125.1	46.2
1137	9/11/2025	2:46:25	00d	01:00.0	40.2	58	41.1	39.4	-:-	40.8	40.8	40.1	39.7	39.6	----	-----	10471.3	46.1
1138	9/11/2025	2:47:25	00d	01:00.0	46.5	64.3	54.1	40	-:-	53.8	51.6	41.3	40.2	40.2	----	-----	44668.4	46.1
1139	9/11/2025	2:48:25	00d	01:00.0	40.5	58.3	41	39.6	-:-	40.9	40.9	40.5	40	39.9	----	-----	11220.2	46.1
1140	9/11/2025	2:49:25	00d	01:00.0	40.4	58.2	41.3	39.6	-:-	41.2	40.9	40.4	40.1	40	----	-----	10964.8	46.0
1141	9/11/2025	2:50:25	00d	01:00.0	44.4	62.2	51	39.8	-:-	50.9	49.1	41	40.1	40	----	-----	27542.3	46.0
1142	9/11/2025	2:51:25	00d	01:00.0	48.8	66.6	56.7	39.7	-:-	55.6	54.7	43.1	40.2	40.1	----	-----	75857.8	46.0
1143	9/11/2025	2:52:25	00d	01:00.0	47.4	65.2	54.7	39.6	-:-	54.2	52.9	42.3	39.9	39.8	----	-----	54954.1	45.9
1144	9/11/2025	2:53:25	00d	01:00.0	46.8	64.6	55	39.2	-:-	54.8	51.7	41.1	39.5	39.4	----	-----	47863.0	45.9
1145	9/11/2025	2:54:25	00d	01:00.0	40.1	57.9	42.2	39.3	-:-	41.5	41	39.9	39.5	39.4	----	-----	10232.9	45.8
1146	9/11/2025	2:55:25	00d	01:00.0	39.6	57.4	40.1	39.2	-:-	40	39.9	39.6	39.4	39.4	----	-----	9120.1	46.0
1147	9/11/2025	2:56:25	00d	01:00.0	39.6	57.4	40.2	39	-:-	40.2	40	39.7	39.3	39.2	----	-----	9120.1	46.0
1148	9/11/2025	2:57:25	00d	01:00.0	39.3	57.1	40	38.7	-:-	40	39.9	39.3	38.9	38.8	----	-----	8511.4	45.9
1149	9/11/2025	2:58:25	00d	01:00.0	39.1	56.9	39.5	38.6	-:-	39.4	39.3	39.1	38.8	38.7	----	-----	8128.3	45.9
1150	9/11/2025	2:59:25	00d	01:00.0	39.3	57.1	40.1	38.4	-:-	40.1	39.9	39.3	38.8	38.8	----	-----	8511.4	45.9
1151	9/11/2025	3:00:25	00d	01:00.0	39.4	57.2	40.3	38.7	-:-	40.1	39.9	39.4	39	38.9	----	-----	8709.6	45.9
1152	9/11/2025	3:01:25	00d	01:00.0	39.3	57.1	40	38.6	-:-	39.8	39.7	39.3	38.8	38.7	----	-----	8511.4	45.9
1153	9/11/2025	3:02:25	00d	01:00.0	39.2	57	40.4	38.5	-:-	39.8	39.5	39.2	38.8	38.8	----	-----	8317.6	45.9
1154	9/11/2025	3:03:25	00d	01:00.0	52.4	70.2	60.7	39.2	-:-	60.4	58.7	43.4	39.8	39.7	----	-----	173780.1	46.3
1155	9/11/2025	3:04:25	00d	01:00.0	40.2	58	46.1	39	-:-	44.6	40.7	39.4	39.2	39	----	-----	10471.3	46.1
1156	9/11/2025	3:05:25	00d	01:00.0	57.5	75.3	69.6	38.5	-:-	67.7	61.4	40.6	39	38.9	----	-----	562341.3	46.1
1157	9/11/2025	3:06:25	00d	01:00.0	39.3	57.1	39.8	38.9	-:-	39.7	39.6	39.4	39	38.9	----	-----	8511.4	45.1
1158	9/11/2025	3:07:25	00d	01:00.0	39.5	57.3	40.4	38.6	-:-	40.1	39.9	39.6	39.1	39	----	-----	8912.5	45.1
1159	9/11/2025	3:08:25	00d	01:00.0	48.7	66.5	57.3	39.2	-:-	56.7	55.4	41.2	39.5	39.4	----	-----	74131.0	45.3
1160	9/11/2025	3:09:25	00d	01:00.0	47.2	65	56.5	39.5	-:-	56	51.8	41	39.7	39.6	----	-----	52480.7	45.6
1161	9/11/2025	3:10:25	00d	01:00.0	39.7	57.5	40	39.3	-:-	40	39.9	39.7	39.5	39.4	----	-----	9332.5	45.5
1162	9/11/2025	3:11:25	00d	01:00.0	39.7	57.5	40.3	39	-:-	40.1	40.1	39.8	39.2	39.2	----	-----	9332.5	45.6
1163	9/11/2025	3:12:25	00d	01:00.0	40.2	58	41.1	39.4	-:-	41	40.8	40.1	39.7	39.6	----	-----	10471.3	45.9
1164	9/11/2025	3:13:25	00d	01:00.0	40.4	58.2	41	39.9	-:-	40.9	40.8	40.5	40.1	40	----	-----	10964.8	45.9
1165	9/11/2025	3:14:25	00d	01:00.0	49.2	67	57.4	39.8	-:-	56.6	55.5	40.5	40	39.8	----	-----	83176.4	46.4
1166	9/11/2025	3:15:25	00d	01:00.0	45.8	63.6	52.9	39.3	-:-	51.7	50.6	40.2	39.6	39.4	----	-----	38018.9	46.3
1167	9/11/2025	3:16:25	00d	01:00.0	46.8	64.6	54.1	39.7	-:-	53.6	52.8	41.9	40	39.9	----	-----	47863.0	46.7
1168	9/11/2025	3:17:25	00d	01:00.0	39.8	57.6	40.2	39.5	-:-	40.2	40	39.8	39.6	39.5	----	-----	9549.9	46.8
1169	9/11/2025	3:18:25	00d	01:00.0	48.4	66.2	55.6	39.8	-:-	55.2	54.3	45.5	40.7	40.1	----	-----	69183.1	47.0
1170	9/11/2025	3:19:25	00d	01:00.0	44	61.8	55.1	39.5	-:-	51.7	47.7	40	39.6	39.6	----	-----	25118.9	47.0
1171	9/11/2025	3:20:25	00d	01:00.0	39.7	57.5	41	39	-:-	40.9	40.7	39.5	39.2	39.2	----	-----	9332.5	47.3
1172	9/11/2025	3:21:25	00d	01:00.0	39.3	57.1	39.9	38.6	-:-	39.9	39.8	39.2	38.9	38.8	----	-----	8511.4	47.3
1173	9/11/2025	3:22:25	00d	01:00.0	40	57.8	41.8	39.3	-:-	41.5	40.5	39.9	39.5	39.5	----	-----	10000.0	47.4
1174	9/11/2025	3:23:25	00d	01:00.0	47.7	65.5	54.5	39.8	-:-	54.3	51.2	45.4	40	40	----	-----	58884.4	47.5
1175	9/11/2025	3:24:25	00d	01:00.0	49.1	66.9	56.6	39.9	-:-	56.5	54.4	45.2	40.2	40	----	-----	81283.1	47.5
1176	9/11/2025	3:25:25	00d	01:00.0	39.4	57.2	44.8	38.1	-:-	42.2	41	38.8	38.4	38.4	----	-----	8709.6	47.5
1177	9/11/2025	3:26:25	00d	01:00.0	39	56.8	39.8	38.4	-:-	39.5	39.3	39	38.6	38.5	----	-----	7943.3	47.6
1178	9/11/2025	3:27:25	00d	01:00.0	39.1	56.9	40	38.6	-:-	39.9	39.8	39.1	38.8	38.8	----	-----	8128.3	47.7
1179	9/11/2025	3:28:25	00d	01:00.0	44.1	61.9	50.2	38.8	-:-	49.7	48.7	39.9	39	38.9	----	-----	25704.0	47.7
1180	9/11/2025	3:29:25	00d	01:00.0	44.8	62.6	53.2	37.8	-:-	53	50.5	38.6	37.9	37.9	----	-----	30199.5	47.8
1181	9/11/2025	3:30:25	00d	01:00.0	38	55.8	38.4	37.6	-:-	38.4	38.2	38.1	37.8	37.7	----	-----	6309.6	47.8
1182	9/11/2025	3:31:25	00d	01:00.0	38.2	56	38.8	37.6	-:-	38.8	38.6	38.2	37.8	37.7	----	-----	6606.9	47.8
1183	9/11/2025	3:32:25	00d	01:00.0	38.3	56.1	39	37.7	-:-	38.9	38.8	38.3	38	37.9	----	-----	6760.8	48.0
1184	9/11/2025	3:33:25	00d	01:00.0	38.1	55.9	38.9	37.3	-:-	38.8	38.7	38	37.6	37.5	----	-----	6456.5	48.0
1185	9/11/2025	3:34:25	00d	01:00.0	38.7	56.5	39.9	37.6	-:-	39.7	39.7	38.6	38	37.8	----	-----	7413.1	48.0
1186	9/11/2025	3:35:25	00d	01:00.0	38.3	56.1	38.7	37.7	-:-	38.7	38.6	38.3	38	37.8	----	-----	6760.8	48.0
1187	9/11/2025	3:36:25	00d	01:00.0	48.9	66.7	58.5	37.9	-:-	58.4	53.3	41.3	38.1	38.1	----	-----	77624.7	48.0
1188	9/11/2025	3:37:25	00d	01:00.0	40.4	58.2	47.2	38.1	-:-	44.5	41.5	39.3	38.4	38.1	----	-----	10964.8	48.0
1189	9/11/2025	3:38:25	00d	01:00.0	52	69.8	57.3	43.9	-:-	57.2	56.9	49.3	44.7	44.2	----	-----	158489.3	48.0
1190	9/11/2025	3:39:25	00d	01:00.0	39.6	57.4	44.7	38.3	-:-	42.2	41.1	39.2	38.6	38.5	----	-----	9120.1	47.9
1191	9/11/2025	3:40:25	00d	01:00.0	47.5	65.3	52.6	39.6	-:-	52.3	51.1	45.7	41	40.6	----	-----	56234.1	48.1
1192	9/11/2025	3:41:25	00d	01:00.0	52.9	70.7	57.7	43.1	-:-	57.8	57.3	51.9	44.3	43.6	----	-----	194984.5	48.2
1193	9/11/2025	3:42:25	00d	01:00.0	40.4	58.2	48.8	37.6	-:-	45.4	44	38.5	37.8	37.8	----	-----	10964.8	48.3
1194	9/11/2025	3:43:25	00d	01:00.0	43.2	61	49.2	38.3	-:-	48.7	48.1	39.7	38.5	38.5	----	-----	20893.0	48.4
1195	9/11/2025	3:44:25	00d	01:00.0	44.4	62.2	52.5	37.9	-:-	52.2	48.6	39.6	38.4	38.4	----	-----	27542.3	48.4
1196	9/11/2025	3:45:25	00d	01:00.0	46.2	64	53.9	38	-:-	53.3	52.1	40.2	38.3	38.1	----	-----	41686.9	48.6

1197	9/11/2025	3:46:25	00d	01:00.0	39.1	56.9	41	38	-:-	40.7	40.3	38.9	38.3	38.1	----	-----	8128.3	48.6
1198	9/11/2025	3:47:25	00d	01:00.0	41.1	58.9	47.4	38.4	-:-	45.6	43	39.7	38.8	38.7	----	-----	12882.5	48.6
1199	9/11/2025	3:48:25	00d	01:00.0	44.4	62.2	51.9	37.6	-:-	51.3	49.9	38.6	37.9	37.8	----	-----	27542.3	48.7
1200	9/11/2025	3:49:25	00d	01:00.0	38.2	56	38.5	37.8	-:-	38.5	38.4	38.2	37.9	37.9	----	-----	6606.9	48.8
1201	9/11/2025	3:50:25	00d	01:00.0	38	55.8	38.6	37.4	-:-	38.5	38.4	37.9	37.6	37.5	----	-----	6309.6	48.8
1202	9/11/2025	3:51:25	00d	01:00.0	37.9	55.7	38.2	37.5	-:-	38.2	38.1	37.9	37.7	37.6	----	-----	6166.0	48.9
1203	9/11/2025	3:52:25	00d	01:00.0	38.2	56	39.3	37.6	-:-	38.9	38.8	38.2	37.8	37.7	----	-----	6606.9	49.0
1204	9/11/2025	3:53:25	00d	01:00.0	47.7	65.5	56.5	38.6	-:-	55.7	53.2	41	39.3	39.1	----	-----	58884.4	49.0
1205	9/11/2025	3:54:25	00d	01:00.0	40.9	58.7	42.9	39.4	-:-	42.6	42.1	40.6	39.7	39.5	----	-----	12302.7	49.0
1206	9/11/2025	3:55:25	00d	01:00.0	49.4	67.2	54.8	40.8	-:-	54.5	54	46.3	41.5	41	----	-----	87096.4	49.0
1207	9/11/2025	3:56:25	00d	01:00.0	39.5	57.3	42.7	37.2	-:-	42.1	41	39.3	37.8	37.4	----	-----	8912.5	49.2
1208	9/11/2025	3:57:25	00d	01:00.0	37.6	55.4	38.7	36.9	-:-	38.7	38.2	37.6	37.2	37.1	----	-----	5754.4	49.3
1209	9/11/2025	3:58:25	00d	01:00.0	38.5	56.3	39.8	36.9	-:-	39.6	39.6	38.5	37.3	37.1	----	-----	7079.5	49.3
1210	9/11/2025	3:59:25	00d	01:00.0	37.9	55.7	39.4	37	-:-	38.9	38.8	37.8	37.3	37.2	----	-----	6166.0	49.3
1211	9/11/2025	4:00:25	00d	01:00.0	37.9	55.7	38.6	37.3	-:-	38.6	38.4	38	37.5	37.4	----	-----	6166.0	49.3
1212	9/11/2025	4:01:25	00d	01:00.0	38.7	56.5	40.9	37.3	-:-	40	39.8	38.3	37.6	37.5	----	-----	7413.1	49.4
1213	9/11/2025	4:02:25	00d	01:00.0	39.1	56.9	44.3	37.5	-:-	43.7	42.7	37.9	37.6	37.5	----	-----	8128.3	49.4
1214	9/11/2025	4:03:25	00d	01:00.0	53.7	71.5	59.2	43.2	-:-	59.1	58.9	53.2	43.7	43.4	----	-----	234422.9	49.5
1215	9/11/2025	4:04:25	00d	01:00.0	46.3	64.1	54.6	39.2	-:-	54	51.7	41	39.4	39.4	----	-----	42658.0	49.4
1216	9/11/2025	4:05:25	00d	01:00.0	41.4	59.2	50.8	38	-:-	46.4	43.5	40.5	38.2	38.1	----	-----	13803.8	49.5
1217	9/11/2025	4:06:25	00d	01:00.0	48	65.8	57.7	37.6	-:-	56.7	52.8	40.4	38.1	37.9	----	-----	63095.7	49.6
1218	9/11/2025	4:07:25	00d	01:00.0	38.5	56.3	39.9	37.4	-:-	39.8	39.6	38.4	37.6	37.5	----	-----	7079.5	49.7
1219	9/11/2025	4:08:25	00d	01:00.0	49.8	67.6	59.3	38.9	-:-	58.6	55.9	41.4	39.9	39.5	----	-----	95499.3	49.8
1220	9/11/2025	4:09:25	00d	01:00.0	53.1	70.9	62.3	37.5	-:-	61.9	58.8	43.9	37.9	37.8	----	-----	204173.8	49.8
1221	9/11/2025	4:10:25	00d	01:00.0	38.1	55.9	40.1	37.3	-:-	40	38.8	37.9	37.7	37.5	----	-----	6456.5	49.7
1222	9/11/2025	4:11:25	00d	01:00.0	49	66.8	57.1	38	-:-	56.2	55.3	41.6	38.3	38.1	----	-----	79432.8	49.7
1223	9/11/2025	4:12:25	00d	01:00.0	51.5	69.3	57.8	39.8	-:-	56.7	55.5	48.8	41.2	40.4	----	-----	141253.8	49.7
1224	9/11/2025	4:13:25	00d	01:00.0	43.2	61	55.1	37.5	-:-	49.7	47.5	39.5	38	37.7	----	-----	20893.0	49.6
1225	9/11/2025	4:14:25	00d	01:00.0	54.7	72.5	59.7	38	-:-	59.4	58.8	54.5	39.6	38.7	----	-----	295120.9	49.7
1226	9/11/2025	4:15:25	00d	01:00.0	43.3	61.1	46.2	40.1	-:-	45	44.8	43.6	40.7	40.5	----	-----	21379.6	49.6
1227	9/11/2025	4:16:25	00d	01:00.0	54.8	72.6	63	44.2	-:-	62.6	59.7	50	45.2	44.8	----	-----	301995.2	49.8
1228	9/11/2025	4:17:25	00d	01:00.0	50.3	68.1	58.2	40.5	-:-	58	54.9	46	41.8	41.1	----	-----	107151.9	49.6
1229	9/11/2025	4:18:25	00d	01:00.0	52.5	70.3	57	40.8	-:-	56.6	56	51.6	41.8	41.5	----	-----	177827.9	49.6
1230	9/11/2025	4:19:25	00d	01:00.0	47.3	65.1	56.2	38.1	-:-	56	51.8	41.7	38.6	38.5	----	-----	53703.2	49.5
1231	9/11/2025	4:20:25	00d	01:00.0	53.2	71	60.8	39.6	-:-	60.4	59.2	45.9	40.4	40	----	-----	208929.6	49.5
1232	9/11/2025	4:21:25	00d	01:00.0	40.3	58.1	43.1	39.1	-:-	42.2	42	40	39.3	39.2	----	-----	10715.2	49.4
1233	9/11/2025	4:22:25	00d	01:00.0	50.7	68.5	56.9	39.7	-:-	56.6	56	47.3	40	39.9	----	-----	117489.8	52.5
1234	9/11/2025	4:23:25	00d	01:00.0	49.6	67.4	57.9	40	-:-	57.6	52.9	45.6	41.7	41.2	----	-----	91201.1	52.6
1235	9/11/2025	4:24:25	00d	01:00.0	46.2	64	53.2	38.4	-:-	52.9	51.5	41.2	39.8	38.7	----	-----	41686.9	52.6
1236	9/11/2025	4:25:25	00d	01:00.0	48.4	66.2	56.9	38.4	-:-	56.8	54.4	41.6	38.7	38.6	----	-----	69183.1	52.7
1237	9/11/2025	4:26:25	00d	01:00.0	50.3	68.1	58.6	39.2	-:-	58.1	55.1	45.3	39.9	39.4	----	-----	107151.9	52.7
1238	9/11/2025	4:27:25	00d	01:00.0	50.9	68.7	59.5	39.2	-:-	58.8	57.5	42.8	39.4	39.3	----	-----	123026.9	52.8
1239	9/11/2025	4:28:25	00d	01:00.0	40.3	58.1	49.5	37	-:-	45.4	43	38.8	37.4	37.3	----	-----	10715.2	52.8
1240	9/11/2025	4:29:25	00d	01:00.0	46.1	63.9	53.3	37.4	-:-	53.1	51.8	40.5	39	38.6	----	-----	40738.0	52.9
1241	9/11/2025	4:30:25	00d	01:00.0	43.3	61.1	50.7	37.9	-:-	50.4	47.9	39.7	38.2	38	----	-----	21379.6	52.8
1242	9/11/2025	4:31:25	00d	01:00.0	48.6	66.4	57.5	37.8	-:-	57.3	54.5	39.7	38.2	38	----	-----	72443.6	52.9
1243	9/11/2025	4:32:25	00d	01:00.0	51.7	69.5	58.7	38.2	-:-	58	57.4	48	39.3	38.6	----	-----	147910.8	53.0
1244	9/11/2025	4:33:25	00d	01:00.0	38.1	55.9	39	37.3	-:-	38.9	38.8	37.9	37.6	37.5	----	-----	6456.5	53.0
1245	9/11/2025	4:34:25	00d	01:00.0	39.4	57.2	42	37.5	-:-	41.8	41.5	38.8	37.9	37.9	----	-----	8709.6	53.0
1246	9/11/2025	4:35:25	00d	01:00.0	38	55.8	40.7	37	-:-	39.4	38.9	37.7	37.2	37.2	----	-----	6309.6	53.1
1247	9/11/2025	4:36:25	00d	01:00.0	46.9	64.7	56.7	37.7	-:-	56.5	50.7	39.4	37.9	37.7	----	-----	48977.9	53.2
1248	9/11/2025	4:37:25	00d	01:00.0	39	56.8	41.7	36.9	-:-	41.3	40.3	38.7	37.2	37	----	-----	7943.3	53.2
1249	9/11/2025	4:38:25	00d	01:00.0	49.2	67	56.5	36.9	-:-	56.2	55.6	41.9	37.7	37.4	----	-----	83176.4	53.4
1250	9/11/2025	4:39:25	00d	01:00.0	47.2	65	57.9	39.2	-:-	55.5	51.8	41	39.5	39.4	----	-----	52480.7	53.4
1251	9/11/2025	4:40:25	00d	01:00.0	52.6	70.4	58.6	41.8	-:-	57.7	57.1	50.9	42.7	42.1	----	-----	181970.1	53.4
1252	9/11/2025	4:41:25	00d	01:00.0	52.3	70.1	59.2	41.6	-:-	58.6	57.8	49.8	42.4	42	----	-----	169824.4	53.4
1253	9/11/2025	4:42:25	00d	01:00.0	54.3	72.1	63.8	39.2	-:-	63	60.3	45.5	40.4	39.5	----	-----	269153.5	53.4
1254	9/11/2025	4:43:25	00d	01:00.0	46.8	64.6	55.2	37.3	-:-	55	52.1	41.2	38.3	37.8	----	-----	47863.0	53.4
1255	9/11/2025	4:44:25	00d	01:00.0	49.8	67.6	55.5	37.1	-:-	55.4	55.2	46.7	37.9	37.3	----	-----	95499.3	53.5
1256	9/11/2025	4:45:25	00d	01:00.0	52.8	70.6	63.4	37.8	-:-	63	57.6	39.5	38	37.9	----	-----	190546.1	53.5
1257	9/11/2025	4:46:25	00d	01:00.0	41.1	58.9	52.8	36	-:-	46.7	45.6	38.8	36.5	36.3	----	-----	12882.5	53.5
1258	9/11/2025	4:47:25	00d	01:00.0	41.6	59.4	52.3	36.3	-:-	49.3	43.4	37.5	36.8	36.8	----	-----	14454.4	53.6
1259	9/11/2025	4:48:25	00d	01:00.0	52.3	70.1	59	39.5	-:-	58.5	57.7	43.7	40.1	39.9	----	-----	169824.4	53.6
1260	9/11/2025	4:49:25	00d	01:00.0	51.5	69.3	60.8	39.1	-:-	60	57	45.9	39.7	39.4	----	-----	141253.8	53.7
1261	9/11/2025	4:50:25	00d	01:00.0	38.6	56.4	40.2	36.7	-:-	40.1	39.9	38.8	37	36.9	----	-----	7244.4	53.7
1262	9/11/2025	4:51:25	00d	01:00.0	48.6	66.4	58	36.9	-:-	57.4	54.2	40.9	37.2	37.1	----	-----	72443.6	53.7
1263	9/11/2025	4:52:25	00d	01:00.0	51.5	69.3	59.1	43.1	-:-	58.9	55.3	49	43.3	43.2	----	-----	141253.8	53.7
1264	9/11/2025	4:53:25	00d	01:00.0	38.1	55.9	45.8	36.4	-:-	42	40	37.2	36.6	36.6	----	-----	6456.5	53.8
1265	9/11/2025	4:54:25	00d	01:00.0	44.4	62.2	53.4	36.1	-:-	53.4	50.5	38	36.4	36.4	----	-----	27542.3	53.9
1266	9/11/2025	4:55:25	00d	01:00.0	42.4	60.2	53.4	37.3	-:-	48	45.1	40.3	37.8	37.5	----	-----	17378.0	53.9
1267	9/11/2025	4:56:25	00d	01:00.0	55	72.8	62.1	38	-:-	61.3	60.4	51.4	38.9	38.5	----	-----	316227.8	53.9
1268	9/11/2025	4:57:25	00d	01:00.0	48.6	66.4	54.1	36.9	-:-	53.9	53.4	45.9	37.7	37	----	-----	72443.6	53.9
1269	9/11/2025	4:58:25	00d	01:00.0	38.7	56.5	49.1	36	-:-	44.2	40.8	37.1	36.4	36.1	----	-----	7413.1	53.9
1270	9/11/2025	4:59:25	00d	01:00.0	37.2	55	39.2	35.9	-:-	38.8	38.5	37	36.2	36.1	----	-----	5248.1	53.9
1271	9/11/2025	5:00:25	00d	01:00.0	49.9	67.7	55.7	37.4	-:-	55.4	54.5	45.2	37.9	37.8	----	-----	97723.7	53.9
1272	9/11/2025	5:01:25	00d	01:00.0	47.5	65.3	54.8	39.5	-:-	53.7	53.2	43.2	40.2	39.8	----	-----	56234.1	53.9
1273	9/11/2025	5:02:25	00d	01:00.0	46.3	64.1	55.6	37.9	-:-	55.3	51	40.1	38.4	38.2	----	-----	42658.0	54.0
1274	9/11/2025	5:03:25	00d	01:00.0	51.6	69.4	58	37.3	-:-	57.6	56.5	45.8	37.7	37.5	----	-----	144544.0	54.0
1275	9/11/2025	5:04:25	00d	01:00.0	47.7	65.5	55.2	39.1	-:-	54.9	53.5	43.1	39.4	39.2	----	-----	58884.4	54.1
1276	9/11/2025	5:05:25	00d	01:00.0	52.3	70.1	61.1	38.5	-:-	61	58.1	44.6	39.2	39.1	----	-----	169824.4	54.1
1277	9/11/2025	5:06:25	00d	01:00.0	53.5	71.3	59.5	41.1	-:-	59.2	58.6	52.2	44.4	42.2	----	-----	223872.1	54.1
1278	9/11/2025	5:07:25	00d	01:00.0	49.3	67.1	58.5	37.8	-:-	58.2	53.2	43	38.5	38.2	----	-----	85113.8	54.2
1279	9/11/2025	5:08:25	00d	01:00.0	52.2	70	60.6	37.4	-:-	60.2	56.9	43.6	37.7	37.6	----	-----	165958.7	54.2
1280	9/11/2025	5:09:25	00d	01:00.0	49.5	67.3	57.7	37.1	-:-	57.4	56.2	41.8	38.5	37.5	----	-----	89125.1	54.2
1281	9/11/2025	5:10:25	00d	01:00.0	50.3	68.1	57.5	36.3	-:-	56.9	55.6	40.2	36.6	36.5	----	-----	107151.9	54.2
1282	9/11/2025	5:11:25	00d	01:00.0	47.1	64.9	55.7	37.4	-:-	55.2	51.2	42.3	38.8	38.5	----	-----	51286.1	54.3
1283	9/11/2025	5:12:25	00d	01:00.0	37.9	55.7	41.6	36.4	-:-	41.4	40.7	37	36.5	36.5	----	-----	6166.0	54.3
1284	9/11/2025	5:13:25	00d	01:00.0	50.2	68	58.2	39.3	-:-	57.9	56.6	42.7	39.6	39.6	----	-----	104712.9	54.4
1285	9/11/2025	5:14:25	00d	01:00.0	50.1	67.9	58.8	40.1	-:-	58	57.1	42.7	40.9	40.4	----	-----	102329.3	54.4
1286	9/11/2025	5:15:25	00d	01:00.0	51.9	69.7	58.5	37.6	-:-	58.7	58.1	45.4	38.1	37.8	----	-----	154881.7	54.5
1287	9/11/2025	5:16:25	00d	01:00.0	54.7	72.5	61.8	39.7	-:-	61.5	59.8	49.6	41.7	41.1	----	-----	295120.9	54.5
1288	9/11/2025	5:17:25	00d	01:00.0	49.1	66.9	56.2	36.7	-:-	56.1	55.1	39.5	37	36.9	----	-----	81283.1	54.5
1289	9/11/2025	5:18:25	00d	01:00.0	48.7	66.5	56.7	37.1	-:-	56.4	53.9	44.4	38.3	37.3	----	-----	74131.0	54.5
1290	9/11/2025	5:19:25	00d	01:00.0	39.1	56.9	40.7	37.8	-:-	40.1	40	39	38.4	38.3	----	-----	8128.3	54.5
1291	9/11/2025	5:20:25	00d	01:00.0	46.7	64.5	55	36.7	-:-	54.8	52.8	39.7	37.2	36.9	----	-----	46773.5	54.5
1292	9/11/2025	5:21:25	00d	01:00.0	47.3	65.1	57.7	36.9	-:-	55.5	53.7	37.8	37.1	37.1	----	-----	53703.2	54.6
1293	9/11/2025	5:22:25	00d	01:00.0	67.5	85.3	79.3	49.6	-:-	77.2	70.3	58.7	51.9	50.2	----	-----	5623413.3	54.6
1294	9/11/2025	5:23:25	00d	01:00.0	53.6	71.4	59	44.7	-:-	57.3	57.1	53.2	44.9	44.8	----	-----	229086.8	53.2
1295	9/11/2025	5:24:25	00d	01:00.0	53.4	71.2	57.8	45.5	-:-	57.5	56.1	52.9	48.6	47.8	----	-----	218776.2	53.2
1296	9/11/2025	5:25:25	00d	01:00.0	54.7	72.5	62.5	43.5	-:-	60.7	59.8	52.2	44	43.7	----	-----	295120.9	53.3
1297	9/11/2025	5:26:25	00d	01:00.0	52.5	70.3	59.7	44.5	-:-	57	56	51	45.2	44.7	----	-----	177827.9	53.3
1298	9/11/2025	5:27:25	00d	01:00.0	54.2	72	58.7	46.7	-:-	58.5	58	52.4	47.2	46.9	----	-----	263026.8	53.3
1299	9/11/2025	5:28:25	00d	01:00.0	48.3	66.1	55.2	39.3	-:-	54.6	54	44.1	40.1	39.5	----	-----	67608.3	53.2
1300	9/11/2025	5:29:25	00d	01:00.0	53.3	71.1	61.3	37.8	-:-	60.7	59	47.3	38.3	38.1	----	-----	213796.2	53.2
1301	9/11/2025	5:30:25	00d	01:00.0	42.2	60	48.5	39.3	-:-	47.3	45.4	40.9	39.7	39.5	----	-----	16595.9	53.2
1302	9/11/2025	5:31:25	00d	01:00.0	53.6	71.4	59.7	40.7	-:-	59.3	58.1	49.8	42	41	----	-----	229086.8	53.3
1303	9/11/2025	5:32:25	00d	01:00.0	53.2	71	59.1	41.5	-:-	58.4	57.3	48.3	42.2	41.8	----	-----	208929.6	53.4
1304	9/11/2025	5:33:25	00d	01:00.0	52.9	70.7	57.9	41.5	-:-	57.7	57.2	51.2	45	43.1	----	-----	194984.5	53.4
1305	9/11/2025	5:34:25	00d	01:00.0	49.6	67.4	58.1	39.3	-:-	55.6	53.7	43.2	39.9	39.5	----	-----	91201.1	53.5

1306	9/11/2025	5:35:25	00d	01:00.0	52.6	70.4	57.3	41.4	-:-	57.1	56.7	49.5	42.5	41.7	----	-----	181970.1	53.5
1307	9/11/2025	5:36:25	00d	01:00.0	56.1	73.9	58.7	50.1	-:-	58.8	58.4	56.1	50.7	50.3	----	-----	407380.3	53.5
1308	9/11/2025	5:37:25	00d	01:00.0	51.5	69.3	58.9	40.5	-:-	58.4	56.4	45	40.9	40.6	----	-----	141253.8	53.5
1309	9/11/2025	5:38:25	00d	01:00.0	55.1	72.9	61.7	41.3	-:-	61.1	59.7	52.1	44.7	42.1	----	-----	323593.7	53.6
1310	9/11/2025	5:39:25	00d	01:00.0	55	72.8	61.2	45.7	-:-	60.7	58.9	52.8	47.2	46.3	----	-----	316227.8	53.6
1311	9/11/2025	5:40:25	00d	01:00.0	49.4	67.2	53.8	40.8	-:-	53.4	53	48.6	41.2	40.9	----	-----	87096.4	53.7
1312	9/11/2025	5:41:25	00d	01:00.0	51.2	69	57.1	42.6	-:-	57	56.2	47.6	43.2	42.8	----	-----	131825.7	53.9
1313	9/11/2025	5:42:25	00d	01:00.0	53.4	71.2	61.8	38.4	-:-	61.6	60.4	43.4	38.8	38.6	----	-----	218776.2	53.9
1314	9/11/2025	5:43:25	00d	01:00.0	53.6	71.4	58.4	41.9	-:-	58.1	57.4	52.4	42.5	42.3	----	-----	229086.8	54.0
1315	9/11/2025	5:44:25	00d	01:00.0	52.8	70.6	58.2	43	-:-	57.7	56.7	49.1	43.4	43.3	----	-----	190546.1	54.0
1316	9/11/2025	5:45:25	00d	01:00.0	51.2	69	60.7	41.4	-:-	60.7	54.5	45.9	41.9	41.5	----	-----	131825.7	54.2
1317	9/11/2025	5:46:25	00d	01:00.0	51.1	68.9	57.5	39.6	-:-	56.9	56.4	45.6	39.9	39.8	----	-----	128825.0	54.4
1318	9/11/2025	5:47:25	00d	01:00.0	54.5	72.3	60.1	40.5	-:-	60.1	59.7	50.7	42	41.8	----	-----	281838.3	54.4
1319	9/11/2025	5:48:25	00d	01:00.0	54.7	72.5	61.5	44.4	-:-	61.1	59.1	52.5	46	45	----	-----	295120.9	54.4
1320	9/11/2025	5:49:25	00d	01:00.0	55.2	73	61.2	44.9	-:-	61	59.9	50.9	45.4	45.1	----	-----	331131.1	54.5
1321	9/11/2025	5:50:25	00d	01:00.0	51.5	69.3	60.2	42	-:-	59	56	45.4	42.4	42.3	----	-----	141253.8	54.5
1322	9/11/2025	5:51:25	00d	01:00.0	52.4	70.2	58.1	44.5	-:-	58	56	51.1	46.6	46	----	-----	173780.1	54.5
1323	9/11/2025	5:52:25	00d	01:00.0	46.9	64.7	54.6	39.7	-:-	54.5	52.4	42.1	40	39.8	----	-----	48977.9	54.6
1324	9/11/2025	5:53:25	00d	01:00.0	53.4	71.2	58.4	40.9	-:-	58.4	57.7	51.6	43.3	41.2	----	-----	218776.2	54.6
1325	9/11/2025	5:54:25	00d	01:00.0	55.4	73.2	63.7	41.3	-:-	63.1	61.5	47.8	42.6	42	----	-----	346736.9	54.7
1326	9/11/2025	5:55:25	00d	01:00.0	53.2	71	59.2	42.9	-:-	58.9	58.6	47.2	43.3	43.2	----	-----	208929.6	54.7
1327	9/11/2025	5:56:25	00d	01:00.0	47.3	65.1	55	39.5	-:-	54.6	50.9	42.7	40	39.8	----	-----	53703.2	54.7
1328	9/11/2025	5:57:25	00d	01:00.0	53.1	70.9	58.1	42.3	-:-	57.9	57.2	52	45.3	44.9	----	-----	204173.8	54.9
1329	9/11/2025	5:58:25	00d	01:00.0	48.4	66.2	57.5	38.4	-:-	57.2	54.4	40.1	38.8	38.6	----	-----	69183.1	54.9
1330	9/11/2025	5:59:25	00d	01:00.0	44.1	61.9	56.2	39.1	-:-	50.7	46.7	42	39.8	39.3	----	-----	25704.0	54.9
1331	9/11/2025	6:00:25	00d	01:00.0	42.2	60	44.5	40.2	-:-	44.5	43.6	41.9	40.7	40.4	----	-----	16595.9	55.0
1332	9/11/2025	6:01:25	00d	01:00.0	53.6	71.4	59.3	43.2	-:-	58.7	57.5	51.7	43.6	43.4	----	-----	229086.8	55.0
1333	9/11/2025	6:02:25	00d	01:00.0	53	70.8	57.9	40.7	-:-	57.4	57.4	50.6	41	40.8	----	-----	199526.2	55.1
1334	9/11/2025	6:03:25	00d	01:00.0	52.9	70.7	59.3	40.8	-:-	58.9	58.2	50.1	42.1	41.1	----	-----	194984.5	55.1
1335	9/11/2025	6:04:25	00d	01:00.0	55.3	73.1	64	40.8	-:-	63.4	61.5	48.7	42	41.1	----	-----	338844.2	55.1
1336	9/11/2025	6:05:25	00d	01:00.0	53.9	71.7	59.4	41.5	-:-	58.7	58.3	52	42	41.9	----	-----	245470.9	55.2
1337	9/11/2025	6:06:25	00d	01:00.0	53.5	71.3	60	40.6	-:-	59.6	58.8	49.2	41	40.9	----	-----	223872.1	55.2
1338	9/11/2025	6:07:25	00d	01:00.0	54.7	72.5	59.9	42.6	-:-	59.7	58.5	53.8	43.9	42.7	----	-----	295120.9	55.3
1339	9/11/2025	6:08:25	00d	01:00.0	54.3	72.1	60.7	42.3	-:-	60.3	58.9	51	43.2	42.9	----	-----	269153.5	55.3
1340	9/11/2025	6:09:25	00d	01:00.0	50.6	68.4	55.8	41.8	-:-	55.3	55	48.1	42.6	42.1	----	-----	114815.4	55.3
1341	9/11/2025	6:10:25	00d	01:00.0	53.6	71.4	57	43	-:-	56.5	56.3	53.3	44.4	43.2	----	-----	229086.8	55.4
1342	9/11/2025	6:11:25	00d	01:00.0	54.5	72.3	61.9	44.4	-:-	61	58.5	51.8	45.6	45	----	-----	281838.3	55.5
1343	9/11/2025	6:12:25	00d	01:00.0	52.7	70.5	63.7	42.1	-:-	58.1	55.3	46.4	42.8	42.5	----	-----	186208.7	55.5
1344	9/11/2025	6:13:25	00d	01:00.0	54.6	72.4	64.1	43	-:-	59.5	57.5	52.6	43.4	43.1	----	-----	288403.2	55.6
1345	9/11/2025	6:14:25	00d	01:00.0	55.2	73	62.2	42	-:-	61.9	60.8	49.4	42.6	42.5	----	-----	331131.1	55.6
1346	9/11/2025	6:15:25	00d	01:00.0	53.3	71.1	59.5	40.7	-:-	59.1	58.7	48.1	41.8	41.1	----	-----	213796.2	55.6
1347	9/11/2025	6:16:25	00d	01:00.0	51.6	69.4	57.3	44.9	-:-	57.1	56.1	50	45.4	45.2	----	-----	144544.0	55.7
1348	9/11/2025	6:17:25	00d	01:00.0	54.4	72.2	60.4	43.3	-:-	60.2	59.6	50.7	44.2	43.6	----	-----	275422.9	55.7
1349	9/11/2025	6:18:25	00d	01:00.0	49.5	67.3	56.8	41.5	-:-	56.3	55.2	45.5	42.2	41.9	----	-----	89125.1	55.7
1350	9/11/2025	6:19:25	00d	01:00.0	54.9	72.7	60.4	41.2	-:-	59.7	59.3	53.7	43.4	42.2	----	-----	309029.5	55.7
1351	9/11/2025	6:20:25	00d	01:00.0	46.1	63.9	55.9	39.5	-:-	53.9	51.3	41.6	39.7	39.5	----	-----	40738.0	55.8
1352	9/11/2025	6:21:25	00d	01:00.0	54.5	72.3	62.6	43	-:-	60.7	57.4	52.6	43.8	43.2	----	-----	281838.3	56.0
1353	9/11/2025	6:22:25	00d	01:00.0	54.2	72	59.8	44.3	-:-	59.5	57.5	52.4	47.6	45.2	----	-----	263026.8	56.0
1354	9/11/2025	6:23:25	00d	01:00.0	56.7	74.5	62.9	42.9	-:-	62	61.7	54.2	43.5	43.4	----	-----	467735.1	56.1
1355	9/11/2025	6:24:25	00d	01:00.0	55.9	73.7	62	44.1	-:-	60.3	59.4	55	45.6	44.6	----	-----	389045.1	56.1
1356	9/11/2025	6:25:25	00d	01:00.0	55.7	73.5	62.8	41.3	-:-	62.6	60.5	50.9	42.3	42.1	----	-----	371535.2	56.1
1357	9/11/2025	6:26:25	00d	01:00.0	56.3	74.1	64.2	47.4	-:-	64	60.2	53.4	48.4	47.7	----	-----	426579.5	56.2
1358	9/11/2025	6:27:25	00d	01:00.0	50.8	68.6	55.7	44.1	-:-	55.5	55.2	49	44.4	44.3	----	-----	120226.4	56.1
1359	9/11/2025	6:28:25	00d	01:00.0	46	63.8	52.8	41	-:-	52.4	50.3	44.1	42.1	41.6	----	-----	39810.7	56.2
1360	9/11/2025	6:29:25	00d	01:00.0	51.2	69	58.3	43.4	-:-	57.7	55	48.7	44.3	43.8	----	-----	131825.7	56.3
1361	9/11/2025	6:30:25	00d	01:00.0	50.9	68.7	56.6	40.9	-:-	56.1	55.4	48.3	41.3	41.1	----	-----	123026.9	56.3
1362	9/11/2025	6:31:25	00d	01:00.0	54.5	72.3	60.2	41.6	-:-	59.8	58.9	53.1	42.1	41.8	----	-----	281838.3	56.4
1363	9/11/2025	6:32:25	00d	01:00.0	56.9	74.7	62.6	41.5	-:-	61.8	61.1	54.2	42.9	41.9	----	-----	489778.8	56.5
1364	9/11/2025	6:33:25	00d	01:00.0	54.7	72.5	60.8	41.5	-:-	60	58.6	53.8	42.4	42.1	----	-----	295120.9	56.5
1365	9/11/2025	6:34:25	00d	01:00.0	55.2	73	60.5	46.5	-:-	60.2	59.3	52.6	47.8	47.1	----	-----	331131.1	56.6
1366	9/11/2025	6:35:25	00d	01:00.0	55.9	73.7	60.8	43.2	-:-	60.7	60.1	53.9	46.2	44.1	----	-----	389045.1	56.6
1367	9/11/2025	6:36:25	00d	01:00.0	50.1	67.9	55.9	41	-:-	55.9	54.1	47.8	41.4	41.3	----	-----	102329.3	56.6
1368	9/11/2025	6:37:25	00d	01:00.0	54.1	71.9	59.1	41.6	-:-	59.1	58.7	52.5	42.2	42	----	-----	257039.6	56.8
1369	9/11/2025	6:38:25	00d	01:00.0	55.8	73.6	60.9	44.2	-:-	60.7	60.3	52.3	45.2	44.4	----	-----	380189.4	56.8
1370	9/11/2025	6:39:25	00d	01:00.0	56.2	74	62.3	42.2	-:-	62	61.1	51.7	43.2	42.6	----	-----	416869.4	56.9
1371	9/11/2025	6:40:25	00d	01:00.0	58.8	76.6	62.2	52.5	-:-	61.9	61	59	54.2	52.9	----	-----	758577.6	56.9
1372	9/11/2025	6:41:25	00d	01:00.0	58	75.8	62.3	48.8	-:-	62	61.6	57.1	50.8	49.5	----	-----	630957.3	56.8
1373	9/11/2025	6:42:25	00d	01:00.0	53.3	71.1	59.6	44.7	-:-	59.5	57.9	50.5	45.8	45	----	-----	213796.2	56.8
1374	9/11/2025	6:43:25	00d	01:00.0	56.5	74.3	60.7	45.8	-:-	60.2	59.6	56	47.7	46.3	----	-----	446683.6	56.8
1375	9/11/2025	6:44:25	00d	01:00.0	56.7	74.5	61.9	47	-:-	61.7	60.2	55.5	48.3	47.4	----	-----	467735.1	56.8
1376	9/11/2025	6:45:25	00d	01:00.0	59.1	76.9	67.6	44.1	-:-	67	64.1	54.3	44.8	44.1	----	-----	812830.5	56.9
1377	9/11/2025	6:46:25	00d	01:00.0	58.3	76.1	62.7	50.2	-:-	62.5	62.1	57.9	51.6	51.4	----	-----	676083.0	56.8
1378	9/11/2025	6:47:25	00d	01:00.0	54.4	72.2	60.7	40.8	-:-	59.6	59.1	52.7	42.8	41.4	----	-----	275422.9	56.8
1379	9/11/2025	6:48:25	00d	01:00.0	56.1	73.9	60.1	45.8	-:-	59.9	59.6	54.8	47.3	46.2	----	-----	407380.3	56.9
1380	9/11/2025	6:49:25	00d	01:00.0	57.1	74.9	64.7	49	-:-	64.6	61.1	54.2	50.6	50	----	-----	512861.4	56.9
1381	9/11/2025	6:50:25	00d	01:00.0	54.3	72.1	58.7	46.7	-:-	58.4	58.1	53.9	48.2	47.5	----	-----	269153.5	56.9
1382	9/11/2025	6:51:25	00d	01:00.0	53.7	71.5	58.8	43.4	-:-	58.3	57.7	52.5	44.1	43.6	----	-----	234422.9	57.0
1383	9/11/2025	6:52:25	00d	01:00.0	57.7	75.5	61.1	47.9	-:-	61.1	60.6	57.6	49.4	48.3	----	-----	588843.7	57.0
1384	9/11/2025	6:53:25	00d	01:00.0	53.5	71.3	61.4	43.3	-:-	60.3	58.6	49.2	44.3	43.9	----	-----	223872.1	57.0
1385	9/11/2025	6:54:25	00d	01:00.0	55.7	73.5	61.6	44.7	-:-	61.2	60.8	50.7	45.5	44.8	----	-----	371535.2	57.0
1386	9/11/2025	6:55:25	00d	01:00.0	55.5	73.3	61.7	44.3	-:-	61.4	60.2	52.7	45.2	44.7	----	-----	354813.4	57.1
1387	9/11/2025	6:56:25	00d	01:00.0	52.8	70.6	61.1	40.4	-:-	59.6	58.3	47.5	41.3	41.1	----	-----	190546.1	57.1
1388	9/11/2025	6:57:25	00d	01:00.0	59.5	77.3	68.3	47.5	-:-	67.4	61.9	56.2	49.9	47.9	----	-----	891250.9	57.1
1389	9/11/2025	6:58:25	00d	01:00.0	54.2	72	58.5	44.2	-:-	58	57.9	53	45.2	44.9	----	-----	263026.8	57.1
1390	9/11/2025	6:59:25	00d	01:00.0	51.6	69.4	57.1	41.4	-:-	57	56.4	47	42.2	41.7	----	-----	144544.0	57.1
1391	9/11/2025	7:00:25	00d	01:00.0	57.2	75	63.4	49.1	-:-	63.1	61.5	54.9	50	49.8	----	-----	524807.5	57.2
1392	9/11/2025	7:01:25	00d	01:00.0	51.8	69.6	58.6	38.9	-:-	58.2	57.4	43.8	39.5	39.2	----	-----	151356.1	57.2
1393	9/11/2025	7:02:25	00d	01:00.0	55.2	73	59.2	43.9	-:-	59.2	58.5	54.4	49.5	48.3	----	-----	331131.1	57.2
1394	9/11/2025	7:03:25	00d	01:00.0	55	72.8	60.2	43.8	-:-	59.7	59	53.6	45.3	44.2	----	-----	316227.8	57.3
1395	9/11/2025	7:04:25	00d	01:00.0	55.3	73.1	59.7	43.3	-:-	59.4	59.1	52.8	44.7	44	----	-----	338844.2	57.3
1396	9/11/2025	7:05:25	00d	01:00.0	58.3	76.1	64	41.9	-:-	63.8	63.1	56.6	42.4	42.2	----	-----	676083.0	57.3
1397	9/11/2025	7:06:25	00d	01:00.0	55.8	73.6	62.3	42.3	-:-	62.2	61.6	52.3	42.7	42.4	----	-----	380189.4	57.3
1398	9/11/2025	7:07:25	00d	01:00.0	57.6	75.4	62.6	46.6	-:-	62.5	60.6	56.9	48.7	47.3	----	-----	575439.9	57.3
1399	9/11/2025	7:08:25	00d	01:00.0	54.8	72.6	59.8	45.3	-:-	59.8	58.6	53.6	46.5	45.8	----	-----	301995.2	57.3
1400	9/11/2025	7:09:25	00d	01:00.0	55.8	73.6	59.9	48.2	-:-	58.9	58.5	55.5	49.4	48.9	----	-----	380189.4	57.4
1401	9/11/2025	7:10:25	00d	01:00.0	58.1	75.9	64.4	42.8	-:-	64	62.4	55.4	44.3	43.1	----	-----	645654.2	57.4
1402	9/11/2025	7:11:25	00d	01:00.0	57.1	74.9	62.2	49.9	-:-	61.6	60.9	56.1	52	50.4	----	-----	512861.4	57.4
1403	9/11/2025	7:12:25	00d	01:00.0	56.7	74.5	59.5	49.6	-:-	59.4	59	56.8	51.7	50.2	----	-----	467735.1	57.4
1404	9/11/2025	7:13:25	00d	01:00.0	56.9	74.7	66.6	41.6	-:-	64.9	61.4	51.4	43.4	42.4	----	-----	489778.8	57.4
1405	9/11/2025	7:14:25	00d	01:00.0	55	72.8	61.3	40.5	-:-	60.8	59.5	54	41.4	41.2	----	-----	316227.8	57.4
1406	9/11/2025	7:15:25	00d	01:00.0	57.1	74.9	61.7	42.8	-:-	61.4	60.3	56.6	44	43.3	----	-----	512861.4	57.5
1407	9/11/2025	7:16:25	00d	01:00.0	57	74.8	62.9	41.4	-:-	62.2	60.1	56.7	42.6	41.7	----	-----	501187.2	57.5
1408	9/11/2025	7:17:25	00d	01:00.0	52	69.8	60.9	39.2	-:-	59	57.7	45.3	39.7	39.3	----	-----	158489.3	57.5
1409	9/11/2025	7:18:25	00d	01:00.0	56.9	74.7	62.2	40.8	-:-	62.1	60.6	55.8	43.2	41.9	----	-----	489778.8	57.6
1410	9/11/2025	7:19:25	00d	01:00.0	51.5	69.3	56.6	40.6	-:-	56.3	55.7	50.1	41.5	41.2	----	-----	141253.8	57.6
1411	9/11/2025	7:20:25	00d	01:00.0	57.7	75.5	61.7	52	-:-	61.5	60.4	57.4	54.8	54.3	----	-----	588843.7	57.7
1412	9/11/2025	7:21:25	00d	01:00.0	60	77.8	64.3	49.3	-:-	64.2	63.8	59	50.9	49.7	----	-----	1000000.0	57.7
1413	9/11/2025	7:22:25	00d	01:00.0	58.1	75.9	63.9	43.3	-:-	62.5	62.3	57.9	44.9	43.6	----	-----	645654.2	57.6
1414	9/11/2025	7:23:25	00d	01:00.0	57	74.8	61.3	46.8	-:-	61	60	56.6	48.1	47	----	-----	501187.2	57.6

1415	9/11/2025	7:24:25	00d	01:00.0	56.4	74.2	62.5	45.2	-:-	61.7	60.6	54.1	45.7	45.3	----	-----	436515.8	57.6
1416	9/11/2025	7:25:25	00d	01:00.0	55.2	73	62.8	42	-:-	62.6	60.4	48.7	42.9	42.4	----	-----	331131.1	57.7
1417	9/11/2025	7:26:25	00d	01:00.0	59.7	77.5	63.9	54.4	-:-	63.7	63.1	59.2	54.6	54.5	----	-----	933254.3	57.7
1418	9/11/2025	7:27:25	00d	01:00.0	55.8	73.6	63.8	45.7	-:-	63.7	60.5	52.5	47.2	46.3	----	-----	380189.4	57.6
1419	9/11/2025	7:28:25	00d	01:00.0	58.2	76	63.6	48.7	-:-	63.2	62.3	56.5	50.3	48.9	----	-----	660693.4	57.7
1420	9/11/2025	7:29:25	00d	01:00.0	55.8	73.6	60.6	49.2	-:-	59.9	59	55.4	50.2	49.8	----	-----	380189.4	57.7
1421	9/11/2025	7:30:25	00d	01:00.0	56.4	74.2	59.7	50.6	-:-	59.4	58.7	56.4	51.6	51.2	----	-----	436515.8	57.7
1422	9/11/2025	7:31:25	00d	01:00.0	58.4	76.2	62.9	45.2	-:-	62.5	62.4	57.4	46.8	45.6	----	-----	691831.0	57.8
1423	9/11/2025	7:32:25	00d	01:00.0	57.2	75	62.6	44.4	-:-	62.3	61.7	55.8	45.2	45	----	-----	524807.5	57.8
1424	9/11/2025	7:33:25	00d	01:00.0	58.5	76.3	61.1	52.8	-:-	60.4	60.4	58.7	54.6	53	----	-----	707945.8	57.8
1425	9/11/2025	7:34:25	00d	01:00.0	58.5	76.3	62.6	51.1	-:-	61.9	61.2	58.3	52.3	51.4	----	-----	707945.8	57.8
1426	9/11/2025	7:35:25	00d	01:00.0	56.8	74.6	60.5	49	-:-	60.4	60.1	55.8	50.2	49.6	----	-----	478630.1	57.7
1427	9/11/2025	7:36:25	00d	01:00.0	58.4	76.2	61.5	51.6	-:-	61.5	60.4	58.8	53.9	52.2	----	-----	691831.0	57.8
1428	9/11/2025	7:37:25	00d	01:00.0	59	76.8	65.4	47.4	-:-	65.3	63.8	56.4	49	48	----	-----	794328.2	57.7
1429	9/11/2025	7:38:25	00d	01:00.0	59.4	77.2	63.2	55.2	-:-	63	62.2	58.8	55.6	55.5	----	-----	870963.6	57.6
1430	9/11/2025	7:39:25	00d	01:00.0	57.2	75	63.3	46	-:-	62.6	61.6	56.5	46.8	46.6	----	-----	524807.5	57.4
1431	9/11/2025	7:40:25	00d	01:00.0	57.1	74.9	63	44.9	-:-	62.6	61	54.8	45.7	45.2	----	-----	512861.4	57.4
1432	9/11/2025	7:41:25	00d	01:00.0	56.6	74.4	63.8	40.5	-:-	63.5	61.5	55.1	41.2	40.9	----	-----	457088.2	57.4
1433	9/11/2025	7:42:25	00d	01:00.0	55.8	73.6	60.9	40.8	-:-	60.8	60.5	54	44.6	42.1	----	-----	380189.4	57.5
1434	9/11/2025	7:43:25	00d	01:00.0	55	72.8	59.9	38.4	-:-	59.7	59.4	53.6	40.1	39.1	----	-----	316227.8	57.7
1435	9/11/2025	7:44:25	00d	01:00.0	58.1	75.9	63.3	38.1	-:-	63.2	62.7	57.4	39.6	38.8	----	-----	645654.2	58.0
1436	9/11/2025	7:45:25	00d	01:00.0	59.3	77.1	63.5	47.6	-:-	63.4	63.3	57.7	50.1	48.2	----	-----	851138.0	58.0
1437	9/11/2025	7:46:25	00d	01:00.0	53.1	70.9	60.1	40.6	-:-	60	59.1	46.9	41.6	40.8	----	-----	204173.8	57.6
1438	9/11/2025	7:47:25	00d	01:00.0	58.4	76.2	64.9	51.7	-:-	61	60.5	58.1	52.3	51.9	----	-----	691831.0	58.3
1439	9/11/2025	7:48:25	00d	01:00.0	60.4	78.2	74	50.4	-:-	68.1	60.3	56.7	51.9	50.9	----	-----	1096478.2	58.2
1440	9/11/2025	7:49:25	00d	01:00.0	56.3	74.1	61.5	48.9	-:-	60	59.5	55.9	49.8	49	----	-----	426579.5	56.6
1441	9/11/2025	7:50:25	00d	00:04.9	56.8	63.7	58.8	50.6	-:-	58.4	58.4	56.8	51.9	51.9	----	-----	478630.1	56.8

HARRISBURG OFFICE
150 CORPORATE CENTER DRIVE, SUITE 200
CAMP HILL, PA 17011
703-430-7500

ALTOONA OFFICE
700 PARK AVENUE, SUITE 1
ALTOONA, PA 16602
814-650-9089

BALTIMORE
BLACKSBURG
HARRISONBURG
GREENVILLE
LARGO
HERNDON
NEWPORT NEWS
RALEIGH
RICHMOND

4000 Crums Mill Road, Suite 102, Harrisburg, PA 17112
717.234.1430 | INFO@TPDINC.COM
WWW.TPDINC.COM

MEMO

To: Archbald I LLC
108 Lakeland Avenue
Dover, DE 19901

From: Craig D. Melott, P.E., PTOE

Date: November 24, 2025

Re: **Traffic Assessment – Archbald I LLC**
Scranton Carbondale Highway / Eynon Jermyn Road
Borough of Archbald, Lackawanna County, PA
TPD# PRRE.00001

The purpose of this letter is to provide a traffic assessment for a proposed data center located between Eynon Jermyn Road (SR 1023) & Business Route 6/Scranton Carbondale Highway (SR 6006), which is being provided in support of the conditional use application to the Borough of Archbald.

INTRODUCTION

The project site is located between Eynon Jermyn Road (SR 1023) and Business Route 6/Scranton Carbondale Highway (SR 6006), north of Ed Staback Regional Park and Archbald Pothole State Park in the Borough of Archbald, Lackawanna County, PA. The Applicant intends to develop a proposed data center consisting of approximately 5,574,600 square feet spread across 18 buildings. Access is currently proposed via three new driveways to Business Route 6 (SR 6006) and two new driveways to Eynon Jermyn Road (SR 1023).

TRIP GENERATION

Trip generation for the proposed data center was determined using Institute of Transportation Engineers (ITE) data. The trip generation data was obtained from the *Trip Generation Manual*, 12th Edition an ITE Informational Report. The data is categorized by Land Use Codes, with total vehicular trips for a given land use estimated using an independent variable and statistically generated rates or equations. For this proposed development, Land Use 160 (Data Center) was used to calculate the number of vehicular trips during the following time periods: (1) Average Weekday, (2) weekday A.M. peak hour, and (3) weekday P.M. peak hour.

The trip generation rates and directional splits for the analyzed time periods are shown in **Table 1**.

TABLE 1: TRIP GENERATION DATA

Land Use Code	Time Period	Equations/Rates	Directional Splits	
			Enter	Exit
160 (Data Center)	Weekday Daily	Ln (T) = 0.71 Ln (X) + 1.51	50%	50%
	Weekday AM Peak	T = 0.05 (X) + 9.87	71%	29%
	Weekday PM Peak	T = 0.05 * (X)	19%	81%

T = number of site-generated vehicular trips *X = independent variable (1000 Square Feet of Gross Floor Area)*

The calculated trip generation for the proposed data center is shown in **Table 2**.

TABLE 2: TRIP GENERATION SUMMARY – PROPOSED DATA CENTER

Time Period	Trips: All Vehicles		
	Total	Enter	Exit
Average Weekday	2,068	1,034	1,034
Weekday AM Peak Hour	289	205	84
Weekday PM Peak Hour	279	53	226

As shown in **Table 2**, the proposed data center is expected to generate 289 AM peak trips, 279 PM peak trips, and 2,068 weekday trips at full build-out.

TRANSPORTATION IMPACT STUDY (TIS) CRITERIA

SALDO TRAFFIC CRITERIA

Per Section 204.f.8.b.1) of Archbald Borough's subdivision and land development ordinance (SALDO), requirements for preparation of a TIS are as follows:

1) *A transportation impact study shall be required for all subdivisions and land development that meet one (1) of the following criteria:*
    a. *A residential subdivision or land development of fifty (50) or more or more dwelling units.*
    b. *A non-residential land development of one hundred thousand (100,000) square feet or more of the total floor area.*
    c. *A development which will generate an ADT of at least 1,000 vehicles.*
    d. *When a study is required by another provision of a Borough ordinance.*

Based on the size of the proposed data center and a projected ADT of greater than 1,000 vehicles per day, a TIS will be required for the proposed data center development.

BOROUGH CONDITIONAL USE TRAFFIC CRITERIA

Section 1416.C(3) of the Borough's zoning ordinance indicates the following traffic-related requirement for conditional use applications:

The applicant shall establish that the traffic from the proposed use will be accommodated in a safe and efficient manager that will minimize hazards and congestion, after considering any improvements proposed to be made by the applicant as a condition of approval.

Based on review of the proposed site plan and considering the trip generation estimates provided within this report, traffic from the proposed use can be accommodated in a safe and efficient manner that will minimize hazards and congestion. The site will provide multiple access points to Eynon Jermyn Road and Scranton Carbondale Highway, which will spread out site traffic across multiple access points and will therefore minimize congestion. Additionally, since both Scranton Carbondale Highway and Eynon Jermyn Road are State Highways, all such proposed access points will be designed and constructed with all applicable requirements of the Borough's Zoning Ordinance, SALDO and PennDOT driveway regulations. PennDOT classifies the proposed driveways serving the site as "low volume", which further supports the notion that the trip generation for the project site is not significant and will not result in hazards or undue congestion.

PENNDOT CRITERIA

The proposed development will access State-owned roadways, and therefore a PennDOT Highway Occupancy Permit (HOP) will be required for site access. Pursuant to PennDOT *Publication 282* (*Highway Occupancy Permit Manual)*, a PennDOT TIS is required based on satisfaction of the following conditions:

- **Condition 1 – Daily Volume:** The site is expected to generate 3,000 or more trips per day (1,500 vehicles per day).
- **Condition 2 – Hourly Volume:** During any one-hour time period of any day of the week, the development is expected to generate 150 or more trips entering the development or 150 or more trips exiting the development. For existing sites being redeveloped, trip credits may be applied to the TIS conditions on a case-by-case basis as described in Step 4, Trip Generation.
- **Condition 3 – Engineering Judgment:** In the opinion of PennDOT, the development or redevelopment is expected to have a significant impact on highway safety or traffic flow on the state transportation network or interstate highway system, even if conditions 1 or 2 above are not met.

The proposed development is expected to meet PennDOT TIS Condition 2, Hourly Volume, and therefore it is anticipated that a TIS will be required in conjunction with PennDOT's HOP process.

CONCLUSIONS

Based on the evaluation contained within this letter, the following conclusions were reached:

- The proposed data center is expected to generate 289 AM peak trips, 279 PM peak trips, and 2,068 weekday trips at full build-out.
- Based on typical PennDOT classification criteria, the proposed driveways serving the development would meet ***PennDOT's low volume driveway classification***. The site driveways will be designed and constructed to comply with all applicable Borough zoning/SALDO requirements and PennDOT's driveway regulations.

- The proposed development meets the general traffic criteria identified in Section 1416.C(3) of the Borough's zoning ordinance related to conditional use applications, as the design of access and the trip generation of the site can be accommodated in a safe and efficient manner while minimizing congestion and hazards.
- Based on a review of Archbald Borough's SALDO and PennDOT *Publication 282*, a formal TIS will be required in conjunction with the land development and HOP applications, and the TIS will identify the improvements required both on-site and off-site to accommodate traffic associated with the development. In conjunction with preparation of the TIS, the following issues will be evaluated in greater detail:
  - **Site Access Requirement:** the number, location, configuration and traffic control required for the proposed site access points will be evaluated to ensure safe and efficient access to/from the site. Sight distances and the need for auxiliary turn lanes approaching the driveways will also be evaluated.
  - **Off-Site Traffic Impacts:** the traffic-related impact of the development will be evaluated at off-site intersections in conjunction with preparation of the TIS, and if impacts are identified based on applicable standards, improvements will be recommended to mitigate those impacts. The extent of the off-site study area will be confirmed with PennDOT and the Borough during the TIS scoping process.

CONDITIONAL USE APPLICATION NARRATIVE

ARCHBALD I LLC

SCRANTON CARBONDALE HIGHWAY / EYNON JERMYN ROAD

Archbald Borough, Lackawanna County, PA

Prepared by:

McNees Wallace & Nurick LLC
100 Pine Street,
PO Box 1166
Harrisburg, PA 17108-1166

and

HYLAND Engineering
718 N. Front Street
Wormleysburg, PA 17043

and

Southland CONSULTING ENGINEERS
10210 N Central Expressway #212
Dallas, TX 75231

TRAFFIC PLANNING AND DESIGN, INC.
4000 Crums Mill Road, #102
Harrisburg, PA 17112

and

ATCS
150 Corporate Center Drive, Suite 200
Camp Hill, PA 17011

and

BARRY ISETT & associates INC
1444 East Lackawanna Avenue, Suite 214
Olyphant, PA 18447

December 15, 2025

TABLE OF CONTENTS Page

I. INTRODUCTION 1

II. BACKGROUND 2

A. THE PROPERTY 2

B. SURROUNDING AREA 3

C. PROPOSED FACILITY 3

III. APPLICABLE ZONING ORDINANCE STANDARDS FOR DATA CENTERS 5

A. DC DISTRICT PROVISIONS (SECTIONS 201.L, 206, 303 AND 402) 6

B. ADDITIONAL STANDARDS FOR DATA CENTERS (SECTIONS 507, 502,D AND 602. A(62)) 9

C. FLOODPLAIN REGULATIONS (OVERLAY DISTRICT) (ARTICLE 9) 26

D. ENVIRONMENTAL PROTECTION (ARTICLE 10) 26

E. OFF-STREET PARKING AND LOADING (ARTICLE 11) 34

F. SIGNS (ARTICLE 12) 50

G. GENERAL REGULATIONS (ARTICLE 13) 50

H. GENERAL CRITERIA FOR ALL CONDITIONAL USE APPLICATIONS (SECTION 1417.A) 61

IV. CONCLUSION 64

I. INTRODUCTION

Archbald I LLC is the equitable owner of approximately 400.76 acres of land ("Property") located between Scranton Carbondale Highway (Business Route 6, SR 6006) and Eynon Jermyn Road (SR 1023) in Archbald Borough ("Borough"), Lackawanna County ("County"), Pennsylvania. As depicted on the conditional use site plan ("Site Plan") prepared by HYLAND Engineering ("HYLAND"), consisting of five (5) sheets and enclosed as part of this Application, Applicant intends to redevelop the Property so as to establish a data center campus, including 18 buildings for housing data centers, along with essential accessory and supporting uses and equipment ("Facility"). While portions of the Property are located in four (4) of the Borough's base zoning districts, the entire Property is located in the Borough's Data Center Overlay Zoning District ("DC District").[1]

As set forth in Sections 206, 301, 303, 401 and 402 of the Borough's Zoning Ordinance ("Zoning Ordinance"), data center campuses, including data centers, data center accessory uses and data center equipment, are permitted within the DC District by conditional use approval. Therefore, pursuant to Sections 206, 301, 303, 401 and 402 of the Zoning Ordinance, this Application requests that the Borough Council grant conditional use approval to permit the Facility as a data center campus on the Property in the DC District.

As more and more people, businesses and other entities incorporate and rely upon cloud-based operations for storing, managing, processing, and transmitting the vast amounts of digital data and information continuously being generated, the need for larger and more powerful data centers connected to and served by reliable sources of energy and a full range of infrastructure and utilities increases. On November 24, 2025, the Borough Council recognized these emerging trends and needs, and physical and locational conditions, by adopting Borough Ordinance No. 04-2025 that amended the Zoning Ordinance by creating the DC District, applying it to certain land, including the Property, and defining and permitting data center campuses, data centers, data center accessory uses and data center equipment in the DC District by conditional use approval and subject to certain standards.

Therefore, the Application is timely, appropriate and justified. The conditional use approval, if granted, would permit reasonable redevelopment of the Property by providing a desirable and appropriate site for the proposed Facility, a use and form of development expressly permitted in the DC District, including the Property. The Application is generally consistent with, and implements elements of, the Borough's community planning and development initiatives. The conditional use approval, if granted, will provide opportunities for employment and increased tax revenues for the Borough, Valley View School District, and the County. The purpose of this Narrative is to demonstrate compliance with the

[1] Portions of the Property are located in the following base zoning districts: (i) General Industrial District ("I-2 District"); (ii) Commercial/Light Industrial District ("C/LI District"); (iii) General Commercial District ("C-2 District"); and (iv) Medium Density Residential District ("R-2 District").

applicable requirements of the Zoning Ordinance and entitlement to conditional use approval.

II. BACKGROUND

A. THE PROPERTY

As depicted on Sheet 1 (Existing Conditions) of the Site Plan and listed in Table II-1 below, the approximately 400.76-acre Property is comprised of 14 adjoining lots which are proposed to be combined as part of a subsequent subdivision and land development plan approval process:

TABLE II-1

	Parcel ID No.	Address	General Land Use	Zoning District(s)
1	0840101000103	1001 Eynon Jermyn Road	Wooded / Open Space	C/LI – majority C-2 – along Scranton Carbondale Highway frontage
2	0840101000102	1 Domiano Drive	Wooded / Open Space	R-2
3	0840101000106	2 Domiano Drive	Residential	R-2
4	0840101000104	1 Domiano Drive	Residential	R-2
5	0840101000107	3 Domiano Drive	Residential	R-2
6	0730301000202	Domiano Drive Off Route 6	Wooded / Open Space	C/LI
7	08401020001	Off Route 6	Residential	C/LI
8	0730301000204	Off Route 6	Wooded / Open Space	C/LI
9	0730301000210	Scranton Carbondale Highway L4	Wooded / Open Space	C/LI
10	0730301000209	Eynon Jermyn Road, Lot 5	Wooded / Open Space	C/LI I-2 – majority, along Eynon Jermyn Road
11	0730301000208	Eynon Jermyn Road	Wooded / Open Space	C/LI – majority I-2 – along Eynon Jermyn Road frontage
12	08404010001	State Highway Route 648	Wooded / Open Space	I-2
13	0840401000101	State Highway Route 648	Wooded / Open Space	I-2
14	08404030002	Eynon Jermyn Road	Wooded / Open Space	I-2

The Property is large, irregularly shaped and fronts along two (2), generally parallel PennDOT roadways, including: (i) Scranton Carbondale Highway, classified as a freeway/expressway (i.e., principal arterial) and located to the west; and (ii) Eynon Jermyn Road classified as a minor arterial and located to the east.[2] As compared to local, Borough-owned streets, these roadways are classified as such because they are intended, planned,

[2] *Borough of Archbald Comprehensive Plan: A Comprehensive Plan for the Development and Conservation of the Borough of Archbald*; Adopted March 15, 2023; Road Classification map, p. 16 ("Comprehensive Plan")

designed and/or constructed so as to accommodate moderate to larger volumes of traffic at moderate to higher speeds.

While the majority of the Property is identified as "undeveloped/agriculture",[3] historically, most of the Property has been subject to anthracite mining operations and related activities. There are a few dwellings in proximity to Scranton Carbondale Highway, and a few commercial or nonresidential uses, structures and appurtenances spread across the Property. Also, there are overhead high-voltage electric transmission lines (230/500 kV) and towers within a 350-foot-wide easement tracking along the Property's northeastern perimeter line. Finally, the Property includes natural features, including wooded areas with trees and other mature vegetation, open areas and some wetlands.

B. SURROUNDING AREA

The Property is in the northwestern quadrant of the Borough, in an area of the Borough which is planned and zoned for, and developed primarily with a mix of nonresidential uses and some scattered, moderate to larger lot residential uses, along Scranton Carbondale Highway and Eynon Jermyn Road corridors. The Property is in an area that is served or intended to be served by a range of utilities, infrastructure and services, including public water and public sewer.

Land adjoining to the northeast includes one (1) large lot classified as General Commercial and zoned C-2 District, and a small lot classified as Commercial/Light Industrial and zoned C/LI District. Land adjoining to the east is mostly the right-of-way of Eynon Jermyn Road, but there is one (1) lot classified as General Industrial and zoned as I-2 District. Land adjoining to the south is mainly classified as Public Recreation and zoned Resource Conservation District ("R-C District"), but a portion is zoned C-2 District. Land adjoining to the northwest is mainly the right-of-way of Scranton Carbondale Highway, but two (2) lots are classified General Commercial and zoned C-2 District.[4]

Adjoining and nearby nonresidential uses include a variety of commercial businesses and nonresidential uses, including: (i) vehicle sales; (ii) vehicle services; (iii) vehicle salvage and parts sales facility; (iv) PennDOT stockpile yard, (v) professional/administrative offices; (vi) personal services; (vii) eating establishments; (viii) retail sales; (ix) public parkland; and (x) wireless communications facility.

C. PROPOSED FACILITY

As depicted on Sheet 2 (Concept Plan) of the Site Plan, Applicant intends to demolish the existing buildings and structures and raze the site so as to redevelop the Property in order to establish the Facility as a campus with an integrated grouping of data center buildings ("Buildings"), accessory uses and equipment, and other appurtenances and improvements designed and developed as a unified development.

[3] Comprehensive Plan; Generalized Existing Land Use and Undeveloped Land map, pp. 6 and 9

[4] Comprehensive Plan; Draft Comprehensive Plan map, p. 11 and Zoning Map

Eighteen (18) Buildings are designed and proposed to include dedicated space primarily for the housing, operation and/or co-location of computer and/or communications equipment and/or for the handling, storage and backing up of the data or other information necessary for the operation of businesses and/or organizational entities, such as telecommunications systems, storage systems, internet systems and/or artificial intelligence and telecommunications and storage systems.

As depicted on Sheets 2 and 3 (Site & Landscaping Plan) of the Site Plan, each Building is designed and proposed to have an overall floor area of approximately 154,850 square feet per level, two (2) levels (i.e., 309,700 SF total both levels), and an overall height of up to approximately 90 feet. The Data Hall in each Building is designed with a floor area of approximately 147,000 square feet (approx. 688' x 213') per level (i.e., 294,000 SF total both levels) and is proposed to include dedicated space primarily for computing and networking equipment, such as servers, storage systems, and network switches, organized in racks. The Data Hall portion of each Building also includes space for network and computing support infrastructure and systems, such as emergency backup generators (for use in case of emergencies), batteries, cooling and ventilation systems and fire suppression systems.

The Office/Support Facility in each Building is designed with a floor area per level of approximately 7,850 square feet (approx. 41' x 193') per level (i.e., 15,700 SF total both levels) and is proposed to include dedicated space primarily to be accessible regularly by employees, including network operations centers, offices, conference rooms and other employee amenities, such as restrooms. Conceptual Building elevations are depicted on an exhibit ("Elevation Exhibit") prepared by Ci Design Inc., consisting of five (5) sheets, which is enclosed as part of this Application.

Further, each Building is designed and proposed to include an adjoining approximately 74,970-square-foot generator yard. Generator yards are designed and intended to include accessory uses and equipment, such as utilities, utility lines, transformers, emergency backup generators, switchgears, electrical fields, mechanical fields, pump stations, water towers, heating and cooling equipment, mechanical equipment and environmental controls (e.g., air conditioning, chillers, cooling towers, fire suppression, etc.), battery and power storage facilities and equipment, redundant/backup power supplies, storage facilities for water, natural gas and propane, including pumps, compressors, redundant data communications connections, and related other facilities and equipment, operations directly supporting the Building. Each Building is designed to include two (2) loading spaces, for an overall total of 36 spaces in the Facility. Finally, each Building is designed with an adjoining parking lot of 40 parking spaces, for an overall total of 720 spaces in the Facility.

Three (3) electrical substations are designed and proposed to be located toward the northern portion of the Facility, in close proximity to the electric lines. Other appurtenant site improvements include perimeter security fencing with a height of approximately eight (8) feet, guard houses at the primary/main driveways, stormwater management facilities,

outdoor lighting and landscaping. Additionally, although one (1) switch station is proposed to be fenced, it is located outside of the perimeter security fencing for the Facility.

The Facility is designed to have five (5) points of gated access connecting to one (1) of the two (2) PennDOT roadways adjoining the Property. Three (3) points of access are designed to connect to Scranton Carbondale Highway, and two (2) to Eynon Jermyn Road. These roadways are classified as such because they are intended, planned, designed and/or constructed so as to accommodate existing and projected volumes of traffic and types of vehicles anticipated to access the Facility. The proposed driveways are designed in compliance with the applicable PennDOT and Borough standards. The driveways are designed as part of the onsite, interconnected circulation network that also includes accessways, aisles, parking, loading and other vehicle areas designed to be several thousand feet in length so as to be able to accommodate the queuing of dozens of vehicles entering and leaving the Facility.

Additionally, trash and recycling dumpster areas are designed to be located outside of the Facility's perimeter security fencing, near the driveway connections with the public streets. These facilities are designed and proposed to be enclosed within decorative masonry walls and a gate.

The Facility is proposed to be connected to or served by a range of utilities, infrastructure and services, including Pennsylvania American Water's ("PA American") public water system and Lackawanna River Basin Sewer Authority's ("LRBSA") public sewer system.

Although there are no specific tenants secured at this time, Applicant anticipates up to approximately 30 employees on the largest shift for each Building. Finally, as is the industry standard to ensure uninterrupted service and data flow, Applicant anticipates that the Facility's hours of operation will be 24 hours/day, seven (7) days/week, 365 days/year.

III. APPLICABLE ZONING ORDINANCE STANDARDS FOR DATA CENTERS

Pursuant to Sections 206, 301, 303, 401 and 402 of the Zoning Ordinance, data centers, including campuses, and accessory uses and equipment, are permitted by conditional use approval in the DC District, subject to specific standards. The Borough Council contemplated the elements and impacts of data centers and data center campuses when it adopted a recent amendment to the Zoning Ordinance, which expressly defines and permits data center campuses, including data centers and data center accessory uses and equipment within the DC District. Therefore, pursuant to Sections 206, 301, 303, 401 and 402 of the Zoning Ordinance, the Application requests conditional use approval to permit the Facility as a data center campus on the Property in the DC District.

The standards and requirements of the Zoning Ordinance that apply to the Application are reproduced (or summarized) in bold below. A brief discussion follows each requirement.

A. DC DISTRICT PROVISIONS (SECTIONS 201.L, 206, 303 AND 402)

Section 201.L	**To allow for the orderly and efficient development of data centers, data center campuses, data center accessory uses, data center equipment (DCE) and related technology uses, the Data Center Overlay Zoning District, or "DC" Zoning District is hereby created and is set forth on the Amendment to the Archbald Borough Zoning Map attached hereto and made a part hereof as Exhibit "A". The Data Center overlay Zoning District shall be an overlay zoning district available for development subject to the standards set forth in Section 206.**

As depicted on Sheet 2 of the Site Plan, the Facility is proposed to be located on the Property in the DC District. Given the foregoing, the Application complies with this requirement.

Section 206	**Data centers, data center campuses, data center accessory uses, data center equipment (DCE) and related technology uses, which may be a single or multitenant building or campus, may be permitted by conditional use as a development option if the following standards are met:**
Section 206.1	**The Lot or tract must be comprised of at least 120 acres.**

As depicted on Sheet 2 of the Site Plan, the Facility is proposed to be located on the Property, which is approximately 400.76 acres. See response to Section 507.1 of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 206.2	**The Lot or tract must be located in close proximity to a high voltage power transmission line or facility with the capacity to transmit 230k[V] or greater.**

As depicted on Sheet 2 of the Site Plan, the Facility is proposed to be located on the Property, which is traversed by overhead high-voltage electric transmission lines with the capacity to transmit 230/500 kV and towers within a 350-foot-wide easement tracking along the Property's northeastern perimeter line. Given the foregoing, the Application complies with this requirement.

Section 206.3 **A Data Center development must comply with all criteria set forth in §507, and §602.A.(62).**

As depicted on the Site Plan, the Facility is designed and proposed to comply with the applicable criteria set forth in Sections 507 and 602.A(62) of the Zoning Ordinance. See responses to Sections 507 and 602.A(62) of the Zoning Ordinance describing compliance with the applicable requirements for data center campuses. Given the foregoing, the Application complies with this requirement.

Section 206.4 **The tract shall have direct access to an arterial or collector street.**

As depicted on Sheet 2 of the Site Plan, the Facility is designed to be located on the Property that abuts and has direct access connecting to two (2) PennDOT roadways, including: (i) Scranton Carbondale Highway, classified as a freeway/expressway (i.e., principal arterial); and (ii) Eynon Jermyn Road, classified as a minor arterial. Given the foregoing, the Application complies with this applicable requirement.

Section 303 **Conditional Uses in the Data Center Overlay Zoning District**

1. Data Centers
2. Data Center Campus
3. Data Center Accessory Uses
4. Data Center Equipment ("DCE").
5. Full-time electrical generators, subject to the requirements of §1417 and the following standards:

a. Nuclear, coal and oil powered generation is prohibited for full-time electrical generators. For avoidance of doubt, emergency generators and similar emergency and back-up facilities and equipment may operate on diesel fuel.
b. All generators must operate and comply with applicable state and federal guidelines and permitting standards.

6. Accessory Uses in the Data Center Overlay Zoning District

a. **Office space related to Data Center or Data Center Campus use.**
b. **Support and logistics buildings related to Data Center or Data Center Campus use.**
c. **Security buildings and related facilities related to Data Center or Data Center Campus use.**
d. **Utility infrastructure facilities such as electrical switch yards, substations, water storage and treatment pump stations related to Data Center or Data Center Campus use.**
e. **Emergency power generators, including diesel fuel power generators.**

As depicted on Sheet 2 of the Site Plan and described above, the Facility is designed and proposed to include a data center campus comprised of 18 data center Buildings, data center accessory uses and data center equipment, including offices, security facilities, utility infrastructure and emergency backup generators. As stated above, this Application requests conditional use approval pursuant to Section 303 of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 402 **Conditional Uses in the Data Center Overlay Zoning District**

1. **Data Centers**
2. **Data Center Campus**
3. **Data Center Accessory Uses**
4. **Data Center Equipment ("DCE").**
5. **Full-time electrical generators, subject to the requirements of §1417 and the following standards:**

    a. **Nuclear, coal and oil powered generation is prohibited for full-time electrical generators. For avoidance of doubt, emergency generators and similar emergency and back-up facilities and equipment may operate on diesel fuel.**

b. All generators must operate and comply with applicable state and federal guidelines and permitting standards.

6. Accessory Uses in the Data Center Overlay Zoning District

a. Office space related to Data Center or Data Center Campus use.
b. Support and logistics buildings related to Data Center or Data Center Campus use.
c. Security buildings and related facilities related to Data Center or Data Center Campus use.
d. Utility infrastructure facilities such as electrical switch yards, substations, water storage and treatment pump stations related to Data Center or Data Center Campus use.
e. Emergency power generators, including diesel fuel power generators.

See response to Section 303 of the Zoning Ordinance describing the permitted and proposed uses of the Facility on the Property. As stated above, this Application requests conditional use approval pursuant to Section 402 of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

B. ADDITIONAL STANDARDS FOR DATA CENTERS (SECTIONS 507, 502,D AND 602. A(62))

Section 507 **Dimensional Standards for Data Centers.**

Section 507.1 **Minimum Lot Area: 120 acres.**

As depicted on Sheet 2 of the Site Plan, the Facility is proposed to be located on the Property, which is approximately 400.76 acres. See response to Section 206.1 of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 507.2 **Minimum Lot Width Measured at the Minimum Building Setback Line: 300 feet.**

As depicted on Sheet 2 of the Site Plan, the Property has widths of at least 300 feet as measured along the street rights-of-way line of Scranton Carbondale Highway and Eynon Jermyn Road. Given the foregoing, the Application complies with this requirement.

Section 507.3	**Maximum Building Height:**
Section 507.3.a	**Data Center Building: 90 feet maximum, unless a greater height is permitted under Section 502 D.**

As depicted on Sheet 2 of the Site Plan and the Elevation Exhibit included with the Application, the height of each Building is designed and proposed to be up to approximately 90 feet, as measured from the average of the finished ground level along the front of each Building to the highest roof surface, but not including any permitted rooftop projection listed in Sections 507.3.c and 502.B of the Zoning Ordinance.[5] Except for any permitted rooftop projection, no Building is designed or proposed to exceed a height greater than 90 feet. Given the foregoing, the Application complies with the applicable height requirement.

Section 507.3.b	**Data Center Accessory building: 50 feet maximum.**

As depicted on Sheet 2 of the Site Plan, the height of any accessory building is proposed so as not to exceed 50 feet. Given the foregoing, the Application complies with this requirement.

Section 507.3.c	**Building Height shall not include parapets, chimneys, spires, towers, mechanical equipment and penthouses, elevator structures, tanks and similar projections. Appropriate screening of such elements is required.**

[5] Section 502.B of the Zoning Ordinance states:

> The maximum height specified for each District shall not apply to the following, provided there is compliance with other provisions of this Ordinance: antenna and communications towers, water towers, clock or bell towers, steeples and religious symbols attached to places of worship, utility lines and poles and towers, elevator shafts, agricultural silos and conveyer equipment, rooftop stairways, wind turbines that comply with this Ordinance including the height limits in Sections 602 and 603, skylights, chimneys, heating/ventilation/air conditional equipment, industrial mechanical equipment areas that are not occupied by humans and that are not used for inventory storage, smokestacks of up to 300 total feet above the surrounding ground level, or other appurtenances usually required to be and customarily placed above the roof level and not intended for human occupancy. [emphasis added]

Acknowledged. No response necessary.

Section 507.4	**Minimum Building Setbacks:**
Section 507.4.a	**Data Center Buildings - Front, Side and Rear Yard Setbacks shall be two (200) hundred feet or the height of the building whichever is greater; In addition, the minimum required setback shall be increased to a minimum of three (300) hundred feet from any property boundary of a lot in an R-1, R-2 or R-3 zoning district except such lots that are: (i) contained within the Data Center Overlay, or (ii) owned in common with the Data Center operator.**

Since the Buildings are designed and proposed to have heights no greater than 90 feet, the minimum yard setback requirement is 200 feet. As depicted on Sheet 2 of the Site Plan, all Buildings are designed and proposed to be set back distances of at least 200 feet from all Property lines.

Additionally, all Buildings are designed and proposed to be set back distances of at least 300 feet of the lot line of any lot in the: (i) Low Density Residential District ("R-1 District"); (ii) Medium Density Residential District ("R-2 District"); or (iii) Medium High Density Residential District ("R-3 District"). No unauthorized encroachment is designed or proposed into any required setback. Given the foregoing, the Application complies with this requirement.

Section 507.4.b	**Data Center Accessory Structures- Front, Side and Rear Yard Setbacks shall be 50 feet or the height of the building, whichever is greater, except that one-story security sheds or similar structures may be setback 25 feet.**

As depicted on Sheet 2 of the Site Plan, all accessory buildings are designed and proposed to be set back distances of at least 50 feet from all Property lines. No unauthorized encroachment is designed or proposed into any required setback. Given the foregoing, the Application complies with this requirement.

Section 507.5	**Maximum Building Coverage: 50%**

As depicted on Sheet 2 of the Site Plan, not more than 25% of the Property is proposed to be covered by Buildings. Given the foregoing, the Application complies with this requirement.

Section 507.6	**Maximum Impervious Coverage: 75%**

As depicted on Sheet 2 of the Site Plan, not more than 40% of the Property is proposed to be covered by impervious surfaces. Given the foregoing, the Application complies with this requirement.

Section 507.7	**Architectural Design Guidelines:**
Section 507.7.a	**With the exception of materials related to rooftop solar or a vegetated green roof, all rooftop equipment shall be screened from view or setback adequately from the building edge so as to not be visible from adjoining properties[.]**

As depicted on the Elevation Exhibit, all rooftop equipment is designed and proposed to be setback from the edge of each Building and screened from view via parapets and architectural screen fencing on the roof. When combined with the required buffer yard screen plantings along all Property lines, as depicted on Sheets 2 and 3 of the Site Plan, such rooftop equipment is designed so as not to be visible from adjoining lot lines. See responses to Sections 507.8 and 507.9 of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 507.7.b	**Blank facades or walls exceeding 100 feet in length shall not be permitted. To mitigate the appearance and perception of a large monolithic building, developers may consider but are not limited to the following: decorative patterns on exterior finishes, masonry, fenestration, horizontal banding, vertical or horizontal offsets of 1 foot or more, and vegetated "green" walls or a combination thereof.**

As depicted on the Elevation Exhibit, all exterior Building walls are designed and proposed to include a combination of architectural and design features and treatments, including variations in patterns, colors, materials, finishes, fenestration and horizontal banding, as well as other treatments. No blank Building facade or exterior wall exceeding 100 feet is permitted or proposed. Given the foregoing, the Application complies with this requirement.

Section 507.7.c	**Minimum five-foot-wide sidewalks shall be provided adjacent to buildings for safe access by employees.**

As depicted on Sheet 3 of the Site Plan, sidewalks with a minimum width of five (5) feet are designed and proposed adjacent to the Buildings for safe access by employees. Given the foregoing, the Application complies with this requirement.

Section 507.7.d **Building articulation and fenestration shall also be provided for data center facilities with an accessory office component, specifically in the areas of the facility related to employee entrances and office spaces. Such areas shall maximize natural lighting and incorporate the following:**

As depicted on the Elevation Exhibit, the Office/Support Facilities of the Buildings are designed and proposed to include a series of architectural and design features and treatments, including articulation and fenestration, on exterior walls. The Office/Support Facilities of the Buildings are designed to include glass, so as to maximize natural lighting. Given the foregoing, the Application complies with this requirement.

Section 507.7.d.1) **No blank facades or walls are permitted.**

As depicted on the Elevation Exhibit, no blank Building facade or exterior wall of the Office/Support Facilities of the Buildings (i.e., offices) is permitted or proposed. Given the foregoing, the Application complies with this requirement.

Section 507.7.d.2) **Minimum area of window opening on facades of office spaces and employee entrances: 40%[.]**

As depicted on the Elevation Exhibit, the Office/Support Facilities of the Buildings are designed and proposed to include at least 40% window and door openings. Given the foregoing, the Application complies with this requirement.

Section 507.7.d.3) **Spandrel glass may be utilized in the design.**

As depicted on the Elevation Exhibit, the Office/Support Facilities of the Buildings are permitted and proposed to include spandrel glass windows. Given the foregoing, the Application complies with this requirement.

Section 507.7.e **Fronts of buildings (i.e., yards) must be fully appointed with landscaping of trees, shrubs, ornamental grasses or ground cover, see additional requirements below and Section 1304.**

As depicted on Sheets 2 and 3 of the Site Plan, the yard areas in front of the Office/Support Facilities of the Buildings are designed and proposed to be planted with landscaping treatment, including trees, shrubs, ornamental grasses or other permitted vegetative ground cover. See responses to Section 1304 of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 507.7.f	**Outdoor storage shall be fully enclosed and comply with requirements in Section 603 outdoor storage.**

To the extent any outdoor storage occurs, it is designed and proposed to be fully enclosed and comply with the applicable requirements of Section 603.D(13) of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 507.7.g	**Lighting shall comply with the requirements in [A]rticle 10 Section 1007 and the latest IESNA guidelines.**

As depicted on Sheet 4 (Lighting Plan) of the Site Plan, all exterior lighting is designed and proposed to comply with the applicable requirements of Section 1007 of the Zoning Ordinance. Further, to the extent feasible and applicable, the proposed exterior lighting complies with the latest guidelines of the Illuminating Engineering Society of North America. Given the foregoing, the Application complies with the applicable lighting requirement.

Section 507.8	**Buffer Requirements: Each edge of the site is unique and requires different setback and buffering requirements tailored to that edge's characteristics and its neighboring land use. All buffer types must be continuously effective all year round and are to be a combination of berms, deciduous and evergreen planted material, sound wall and horizontal green space and shall be employed to the satisfaction of the Borough to achieve sufficient screening of sight and sounds from adjacent properties.**

As depicted on Sheets 2 and 3 of the Site Plan, required buffer yards are designed and proposed along all Property lines, including a combination of berms, a mix of preserved existing mature and newly planted deciduous and evergreen material, and horizontal green space, tailored to the applicable characteristics and neighboring land uses. At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to maintain the required buffer yards in compliance with the applicable requirements of Section 507.8 of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 507.8.a	**A buffer of at least fifty (50) feet in depth shall be maintained adjacent to all exterior property boundaries of the Data Center development.**

As depicted on Sheets 2 and 3 of the Site Plan, required buffer yards with depths of at least 50 feet are designed and proposed along all Property lines. Given the foregoing, the Application complies with this requirement.

Section 507.8.b **No activity, material storage, or parking of vehicles shall be permitted within a buffer or screen area except for freestanding signage.**

As depicted on Sheets 2 and 3 of the Site Plan, no unauthorized activity, material storage or parking of vehicles is designed or proposed within any required buffer yard. No unauthorized encroachment is designed or proposed into any required buffer yard. Given the foregoing, the Application complies with this requirement.

Section 507.9 **Berm Requirements:**

Section 507.9.a **Where existing topography does not provide adequate screening, as determined by the Borough of Archbald Code Enforcement Office, earthen berms shall be required to be constructed within the buffer area in the following locations.**

1) **Adjacent to R-1, R-2 and R-3 zoning districts, with a minimum of 6-foot height.**
2) **Along arterial or collector roadways where Data Center buildings exceed 50 feet in height**
3) **Where Data Center Equipment will be visible from public rights-of-way.**

As depicted on Sheets 2 and 3 of the Site Plan, except where existing topography does not provide adequate screening, required buffer yards are designed and proposed to include a combination of berms, a mix of preserved existing mature and newly planted deciduous and evergreen material, and horizontal green space in the areas along Scranton/Carbondale Highway and Eynon Jermyn Road. Given the foregoing, the Application complies with this requirement.

Section 507.9.b **Berms shall have a minimum height of 4 feet and maximum height of 8 feet[.]**

As depicted on Sheet 3 of the Site Plan, all required landscape berms are designed and proposed to have heights of at least four (4) feet, but not greater than eight (8) feet. Given the foregoing, the Application complies with this requirement.

Section 507.9.c **Berms shall maintain a maximum slope ratio of 3:1 for stability and maintenance access[.]**

As depicted on Sheet 3 of the Site Plan, all required landscape berms are designed and proposed to have slope ratios not exceeding 3:1. Given the foregoing, the Application complies with this requirement.

Section 507.9.d **Berms shall have a minimum base width of 12 feet to support required vegetation[.]**

As depicted on Sheet 3 of the Site Plan, all required landscape berms are designed and proposed to have bases with widths of 12 feet. Given the foregoing, the Application complies with this requirement.

Section 507.9.e **Berms shall be designed with proper drainage to prevent water pooling and erosion[.]**

As depicted on Sheets 2 and 3 of the Site Plan, all required landscape berms are designed and proposed so as to prevent water pooling and erosion. Given the foregoing, the Application complies with this requirement.

Section 507.9.f. **Vegetation on Berms:**

Section 507.9.f.1) **Berms shall be planted with a combination of evergreen and deciduous trees, shrubs, and ground cover[.]**

As depicted on Sheets 2 and 3 of the Site Plan, all required landscape berms are designed and proposed to be planted with a combination of vegetative plantings, including evergreen and deciduous trees, shrubs, and ground cover. Given the foregoing, the Application complies with this requirement.

Section 507.9.f.2) **Trees shall be planted at maximum 20-foot centers along berm crests and slopes[.]**

As depicted on Sheets 2 and 3 of the Site Plan, trees proposed to be planted on required landscape berms are designed with tree centers spaced no farther than 20 feet apart on berm crests and slopes. Given the foregoing, the Application complies with this requirement.

Section 507.9.f.3) **Minimum 60% evergreen tree coverage for year-round screening[.]**

As depicted on Sheets 2 and 3 of the Site Plan, all required landscape berms are designed and proposed to have year-round evergreen tree coverage of at least 60%. Given the foregoing, the Application complies with this requirement.

Section 507.9.f.4) **Shrubs shall be planted at 12-foot centers to provide dense screening between trees[.]**

As depicted on Sheets 2 and 3 of the Site Plan, shrubs proposed to be planted on required landscape berms are designed with shrub centers spaced 12 feet apart. Given the foregoing, the Application complies with this requirement.

Section 507.9.f.5) **All slopes shall be stabilized with appropriate ground cover or low shrubs within 30 days of construction[.]**

At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to stabilize the slopes of all required landscape berms with appropriate ground cover or low shrubs within 30 days of construction. Given the foregoing, the Application complies with this requirement.

Section 507.9.f.6) **Plant materials shall be native or adaptive species suitable for local climate conditions[.]**

As depicted on Sheet 3 of the Site Plan, plant materials proposed to be planted on required landscape berms are designed to include native and/or adaptive species suitable for local climate conditions. Given the foregoing, the Application complies with this requirement.

Section 507.9.g **Maintenance Requirements:**

1) **Property owner shall maintain all berms and associated vegetation in perpetuity[.]**
2) **An annual inspection and maintenance plan shall be submitted to Borough[.]**
3) **Dead or diseased vegetation shall be replaced within one growing season[.]**
4) **Erosion control measures shall be maintained and repaired as needed[.]**

At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to maintain any required landscape berm in compliance with the applicable requirements of Section 507.g of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 507.9.h **Landscape Bond:**

1) **The developer or landowner shall deposit with the Borough a sum of money equal to the amount necessary to cover the cost of purchasing, planting, maintaining, and replacing all**

vegetative materials for a period of eighteen (18) months.

2) Any tree or shrub on the berm which, within eighteen (18) months of planting or replanting is deemed, in the opinion of the Borough, not to have survived or to have grown in a manner uncharacteristic of its type shall be replaced. Substitutions for certain species of plants may be made only when approved by the Borough.

At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to provide the required landscape bond and maintain the required landscape berm plantings in compliance with the applicable requirements of Section 507.9.h of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 507.9.i. **Alternative Compliance:**

Section 507.9.i.1) **Where berms are not feasible due to utilities, topography, or other constraints, alternative screening methods may be approved including:**

i Decorative walls with integrated landscaping (minimum 6-foot height)[.]

ii Dense evergreen hedge plantings (minimum 8-foot mature height)[.]

iii Combination of existing vegetation preservation and supplemental planting[.]

As depicted on Sheets 2 and 3 of the Site Plan, in areas where berms are not feasible due to utilities, topography or other constraints, the required buffer yards are permitted and proposed to include a mix of preserved healthy existing mature and newly planted trees and other vegetation. Given the foregoing, the Application complies with this requirement.

Section 502.D **Data Center buildings in excess of 90 feet may be permitted as a conditional use subject to the requirements of §1417 and subject to the following standards:**

1. Data Center Accessory Uses such as water and cooling towers may be higher than 90 feet upon proof that

such additional height is required for required water pressure and fire suppression systems.

2. **The Data Center operator must provide an emergency management plan demonstrating to the Borough's satisfaction that the building or accessory structure can be adequately served by fire, police and emergency services.**
3. **Data Center Buildings in excess of 90 feet in height must comply with the additional setback requirements of 507.4.**

As depicted on Sheet 2 of the Site Plan and the Elevation Exhibit, no Building is designed or proposed to have a building height, as defined in Section 1502 of the Zoning Ordinance, exceeding 90 feet. See response to Section 507.3 of the Zoning Ordinance. Therefore, this requirement is not applicable.

Section 602.A(62) **Additional Standards for Data Centers.**

Section 602.A(62)1 **As a part of any applicant's Land Development Application, all Data Center applications shall include a sound study conducted by a professional acoustical expert, paid for by the applicant and approved by the Borough of Archbald's professional acoustical expert. Should the study results demonstrate that the installation of sound reducing materials or systems is/are needed to comply with the standards found in Section 1005 and Section 602.A.(62)(a) of the Borough of Archbald's Zoning Ordinance, such items shall be installed at the applicant's expense and approved by the Borough's professional acoustical expert. A sound study shall be conducted in the following phases:**

a. **A preliminary sound study for the Data Center and associated DCE shall be conducted as part of the applicant's application for a zoning permit. The preliminary sound study shall recommend, if needed, the sound reducing materials or systems to meet**

the Borough's Environmental Protection Requirements in Article 10 as well as the requirements of Section 602.A.(62) herein.

b. An as-built sound study shall be conducted nine (9) months after issuance of the certificate of occupancy and at full occupancy for any Data Center and associated DCE prior to the final escrow release for any Data Center land development phase and shall be paid for by the applicant. An as-built sound study may also be required thereafter by the Borough upon request. If it is determined by the as-built sound study that there is a violation of the aforesaid sound limits, then the owner or occupant of the Data Center shall promptly remediate the violation into compliance with the aforesaid sound limits.

c. Study Requirements: All sound studies shall be conducted by a professional acoustical expert using applicable ANSI standards and generally accepted criteria.

d. Violation Remediation: If violations are found, the owner/occupant shall promptly remediate to compliance. In addition to all other remedies and penalties available to the Borough of Archbald for a violation of the Borough of Archbald Zoning Ordinance, any failure to remediate may result in permit revocation.

ATCS, Inc. of PA has prepared an initial noise monitoring study ("Initial Noise Monitoring Study") regarding the current ambient noise conditions and measurements of the Property, which is enclosed as part of this Application. At the hearing, Applicant will present testimony of a professional acoustical expert, summarizing the findings of the Initial Noise Monitoring Study and confirming that it was conducted in accordance with all applicable ANSI standards and generally accepted criteria regarding sound studies.

Also at the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to provide required sound studies in compliance with the

applicable requirements of Sections 602.A(62)1, 602.A(62)2 and 1005 of the Zoning Ordinance as part of the subsequent land development, zoning permit and certificate of occupancy permit approval processes, as well as at full occupancy of the Facility. Given the foregoing, the Application complies with the applicable sound requirement.

Section 602.A(62)2 **Data Centers, Data Center Campuses, Data Center Accessory Uses, and DCEs shall comply with the Borough's Noise Regulations set forth in Section 1005, except that:**

a. Maximum dBA limitations shall not apply during a power outage or similar emergency and for a period of two hours after power is restored.

b. Maximum dBA limitations shall not apply during routine testing and maintenance of back-up generators, such testing shall not occur before 7 am or after 8 pm.

c. Future sound levels attributable to Project Operation ("Project Sound") shall not exceed the measured preconstruction ambient sound level by more than 5 dBA, as assessed at any lot line of the property where residential uses exist within 2,500 feet, or at the site of any other residential uses within 2,500 feet.

d. The pre-construction ambient sound level shall be quantified through a continuous, long-term sound measurement survey paid for by the applicant. The measurement survey shall be performed, to the extent practicable, per the methodology described in ANSI S12.9-1992, Part 2, "American National Standard Quantities and Procedures for Description and Measurement of Environmental Sound, Part 2, Measurement of Long-Term, Wide-Area Sound". Specific measurement locations and survey durations shall be established on a per-Project basis within a sound survey protocol drafted

in consultation with an acoustical consultant approved by the Borough of Archbald Code Enforcement Office and paid for by the applicant.

e. Project Sound determined to be five (5) decibels above the determined ambient noise level shall be a violation of the Borough of Archbald Zoning Ordinance, subjecting the applicant to all penalties and remedial provisions of the Borough of Archbald Zoning Ordinance, and shall be attenuated and mitigated to comply with the terms of the Borough of Archbald Zoning Ordinance as soon as possible.

As depicted on the Site Plan, the Facility is designed and proposed to be operated in compliance with the applicable requirements of Sections 602.A(62)2 and 1005 of the Zoning Ordinance. At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to operate and maintain the Facility in compliance with the applicable requirements of Sections 602.A(62)1, 602.A(62)2 and 1005 of the Zoning Ordinance. See responses to Section 1005 of the Zoning Ordinance. Given the foregoing, the Application complies with the applicable sound requirement.

Section 602.A(62)3 — **A Lot may include lots, tracts parcels or assemblages owned in common or otherwise developed in common and considered contiguous for the purpose of all bulk, area and land mass calculations. Lots, tracts, parcels or assemblages shall be deemed contiguous even if separated by rights of way so long as they are owned or developed in common.**

Acknowledged. No response necessary.

Section 602.A(62)4 — **Public water and sewer facilities shall be provided. If existing public water and sewer facilities are insufficient, compliance with §402(e) and §402(f) of the Borough of Archbald's Subdivision and Land Development Ordinance (SALDO) shall be demonstrated.**

As depicted on the Site Plan, the Facility is designed and proposed to be connected to and served by PA American's public water system and LRBSA's public sewer system. At the

hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to provide documentation from PA American and LRBSA confirming adequate capacity is available and commitment to serve the Facility, as part of the subsequent subdivision and land development plan approval process. Given the foregoing, the Application complies with this requirement.

Section 602.A(62)4.a **If the Data Center is to rely upon non-public sources of water, a water feasibility study shall be provided including:**

1) Calculations of projected water needs[.]
2) Geologic map of the area with a radius of at least one mile from the site[.]
3) Location of all existing and proposed wells within 1,000 feet[.]
4) Location of all streams within 1,000 feet and known pollution sources[.]
5) Long-term safe yield determination[.]
6) Effects on nearby wells, streams, and groundwater table[.]
7) Water recycling and release plans[.]

Not applicable. No response necessary.

Section 602.A(62)4.b **Depending on location, proof of review and approval from the appropriate local, state and/or federal regulatory agencies for projects with water withdrawals of 100,000 gpd or more, or consumptive use of 20,000 gpd or more[.]**

Not applicable. No response necessary.

Section 602.A(62)5 **The applicant shall provide a fully executed Letter of Authorization from the applicable electric service provider indicating the necessary capacity is available.**

At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to provide documentation from PPL Electric Utilities indicating the necessary capacity is available to serve the Facility, as such documentation becomes available. Given the foregoing, the Application complies with this requirement.

Section 602.A(62)6 **Secondary means of ingress and egress shall be provided to the satisfaction of the**

Borough's fire and emergency management officials.

As depicted on Sheet 2 of the Site Plan, the Facility is designed to have five (5) points of access connecting to one (1) of the two (2) PennDOT roadways adjoining the Property. Three (3) points of access each are designed to connect to Scranton Carbondale Highway, and two (2) to Eynon Jermyn Road. The proposed driveways are designed and proposed to be constructed in compliance with the applicable PennDOT and Borough standards, such that emergency vehicles are able to make all required turning movements. See responses to Sections 1105.A, 1105.B and 1303.A(2) of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 602.A(62)7 **Data Centers shall have a campus security plan prepared in consultation with the Borough's police and emergency management officials.**

Although no specific tenants are secured at this time, a conceptual campus security plan ("Campus Security Plan") is enclosed as part of the Application. At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to work in consultation with the Borough's police and emergency management officials in order to develop a more detailed Campus Security Plan for the applicable tenant(s). Given the foregoing, the Application complies with this requirement.

Section 602.A(62)8 **All disturbance of wetlands, riparian buffers, streams and similar water resources shall comply with standards and requirements of the Pennsylvania Department of Environmental Protection.**

As depicted on Sheet 2 of the Site Plan, no riparian buffer, stream or similar water resource is proposed to be disturbed on the Property by the Application. See responses to Section 1004 of the Zoning Ordinance regarding waterways and wetlands. At the hearing, Applicant will present testimony confirming that if the Application is approved, to the extent that any of these water features are to be disturbed, such disturbance will be designed in compliance with the applicable standards and requirements of the Pennsylvania Department of Environmental Protection ("PADEP"). Given the foregoing, the Application complies with this requirement.

Section 602.A(62)9 **Data Center developments shall be exempt from the Steep Slope provisions of §1003, provided that all proposed grading is in accordance with an Erosion and Sedimentation Control Plan approved by the Lackawanna County Conservation District and/or the Pennsylvania Department of**

Environmental Protection (PADEP). Such approval shall be evidenced by the issuance of the applicable Erosion and Sedimentation Control Permit, including, where applicable, an NPDES permit.

At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to provide copies of the approved Erosion and Sedimentation ("E&S") Control Permit and National Pollutant Discharge Elimination System ("NPDES") Permit for the Facility on the Property, as applicable and as they become available. See responses to Sections 1001 and 1103.E(5) of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 602.A(62)10 **Development within a floodplain shall comply with standards and requirements of the PADEP and Section related to Floodplains.**

As depicted on Sheets 1 and 2 of the Site Plan, no floodplains exist or are proposed to be disturbed on the Property by the Application. See responses to Article 9 and Section 1004 of the Zoning Ordinance. See Section III.C of this Narrative. Therefore, this requirement is not applicable.

Section 602.A(62)11 **Ground mounted Noise Generating Data Center Equipment shall not be located in any front yard between the Data Center buildings and arterial or collector roads and shall be separated from all adjacent residential uses by principal buildings.**

As depicted on Sheet 2 of the Site Plan, no ground-mounted, noise-generating data center equipment is designed or proposed to be located in any front yard area between a Building and the nearest arterial or collector road. Additionally, all ground-mounted, noise-generating data center equipment is designed and proposed to be separated from all adjacent residential uses by at least one (1) of the Buildings. Given the foregoing, the Application complies with this requirement.

Section 602.A(62)12 **Data Centers, Data Center Campuses, Data Center Accessory Uses, and Data Center Equipment (DCE) shall comply with the general regulations in Article 13 of the Borough of Archbald's Zoning Ordinance.**

As depicted on the Site Plan, except as modified by the requirements of Sections 507 and 602.A(62) of the Zoning Ordinance, the Facility is designed and proposed in compliance with all applicable requirements of Article 13 of the Zoning Ordinance. See Section III.G of

this Narrative for responses to applicable regulations of Article 13 of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 602.A(62)13	**The minimum parking requirement shall be one (1) space per eight thousand (8,000) square feet of floor area of the portions of a Data Center building designed and intended to be accessible regularly by employees, or one (1) space for every one (1) employee, based upon the maximum number of employees onsite during the largest shift, whichever is lesser.**

As depicted on Sheets 2 and 3 of the Site Plan, each Building is designed and proposed to include approximately 15,700 square feet of floor area for the Office/Support Facility. Therefore, while each Building is required to provide two (2) parking spaces (15,700 SF / 8,000 SF), 40 spaces are proposed for each Building. For the entire Facility, 36 parking spaces are required, and 720 spaces are proposed (18 Buildings x 40 spaces). Given the foregoing, the Application complies with this requirement.

Section 602.A(62)14	**The minimum loading space requirement shall be one (1) space per Data Center building.**

As depicted on Sheets 2 and 3 of the Site Plan, each Building is designed and proposed to include two (2) loading spaces, even though only one (1) is required. For the entire Facility, 18 loading spaces are required, and 36 spaces are proposed (18 Buildings x 2 spaces). Given the foregoing, the Application complies with this requirement.

C. FLOODPLAIN REGULATIONS (OVERLAY DISTRICT) (ARTICLE 9)

No floodplains exist or are proposed to be disturbed on Property by the Application. See responses to Sections 602.A(62)10 and 1004 of the Zoning Ordinance. Therefore, the floodplain provisions are not applicable.

D. ENVIRONMENTAL PROTECTION (ARTICLE 10)

Section 1001	**Erosion and Stormwater Control. See the State erosion and sedimentation control regulations (25 PA. Code Chapter 102) and the Subdivision and Land Development Ordinance. (Note – A NPDES Permit is typically required whenever all phases of earth disturbance total one acre or more. Compliance with the State erosion and sedimentation control regulations shall be an**

automatic condition of any zoning permit for work that involves earth disturbance. The Zoning Officer may require that evidence of compliance with such regulations be submitted to the Borough.

A. A proper method shall be used to direct runoff so the runoff does not harm adjacent properties. For example, buildings shall include proper gutters along the roof and drainage pipes so that water does not spray onto the neighbor's property or damage the neighbor's foundation.

B. See the Borough Stormwater Ordinance.

As depicted on Sheet 2 of the Site Plan, the layout of the Facility is designed and proposed to be laid out so as to direct runoff so that it does not harm adjacent properties based on the standards set forth in Section 1001 of the Zoning Ordinance. At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to submit an E&S Control Plan as required by the Borough's Subdivision and Land Development Ordinance ("SLDO") and the Borough's Stormwater Management Ordinance, as applicable, as well as an NPDES Permit application, as part of the subsequent subdivision and land development plan approval process. Given the foregoing, the Application complies with the requirement.

Section 1002 **Nuisances and Hazards to Public Safety.**

Section 1002.A **No land owner, tenant nor lessee shall use or allow to be used any land or structures in a way that results or threatens to result in any of the following conditions:**

(1) Transmission of communicable disease, including conditions that may encourage the breeding of insects or rodents.

(2) A physical hazard to the public, or a physical hazard that could be an attractive nuisance that would be accessible by children.

(3) Significant risks to public health and safety, such as but not limited to, explosion, fire or biological hazards.

As described in this Narrative and depicted on the Site Plan, the layout of the Facility is designed so as not to create or cause a nuisance or hazard to public safety relating to transmission of communicable diseases, explosion, fire or biological factors. At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to operate and maintain the Facility in compliance with the applicable standards of Section 1002.A of the Zoning Ordinance, so as not to create or cause a nuisance or hazard to public safety. See response to Section 602.A(62)7 of the Zoning Ordinance regarding the required Campus Security Plan. Given the foregoing, the Application complies with the requirement.

Section 1002.B	**Additional Information. If the Zoning Officer has reason to believe that the proposed use may have difficulty complying with the standards of this Ordinance, then the Zoning Officer may require an applicant to provide written descriptions of proposed machinery, hazardous substances, operations and safeguards.**

Acknowledged. The information contained in this Narrative and depicted on the Site Plan, as provided in support of the Application, is sufficient to demonstrate compliance with the applicable standards of Section 1002.A of the Zoning Ordinance. At the hearing, Applicant will present testimony and supporting documentation, confirming that the Facility is designed and proposed to be operated in compliance with the applicable provisions of Section 1002.A of the Zoning Ordinance.

…

Section 1004	**Waterway Setbacks and Wetlands. Uses, structures and development shall comply with the Borough Floodplain Ordinance as a condition of this Ordinance.**

As depicted on Sheets 1 and 2 of the Site Plan, no floodplains exist or are proposed to be disturbed on the Property by the Application. See responses to Section 602.A(62)10 and Article 9 of the Zoning Ordinance. Therefore, this requirement is not applicable.

Section 1004.A	**Wetland Studies. It shall be the responsibility of each applicant to determine whether land areas proposed for alteration meet the Federal or State definition of a wetland. Such determination shall be made prior to submittal of development plans to the Borough. If the Zoning Officer has reason to believe that wetlands may be present on a site proposed for development or**

subdivision, the Zoning Officer may require that the applicant provide a suitable wetland delineation study prepared by a qualified professional. Where disturbance is proposed in an area that may be wetlands, the Zoning Officer may place a condition on a zoning permit to require that the applicant submit evidence that a wetland delineation has been officially confirmed under U.S. Army of Engineers-approved procedures.

(1) Note – An indicator of possible wetlands involves the presence of hydric soils in soil mapping of the U.S. Natural Resources Conservation Service.

As depicted on Sheet 1 of the Site Plan, the Property includes wetlands delineated by ARM Group, a qualified wetlands professional. As depicted on Sheet 2 of the Site Plan, while small portions of the wetlands are proposed to be disturbed, Applicant intends to mitigate the wetland disturbance via onsite mitigation, mitigation banking and/or paying an in-lieu fee, all of which are permitted by PADEP and United States Army Corps of Engineers ("USACE"). The proposed disturbance of the wetlands are subject to a E&S Control Plan as required by the SLDO and well as required by the Borough's Stormwater Management Ordinance. At the hearing, Applicant will present testimony confirming that the proposed disturbance is designed in compliance with all applicable Lackawanna County Conservation District, PADEP and USACE standards and/or permitting requirements, including Chapters 102 and 105, as applicable. See response to Section 602.A(62)8 of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 1004.B **River and Creek Setbacks. No new or expanded building, vehicle parking area or business storage area shall be located within the area 30 feet from the top of the primary bank of any perennial creek and 75 feet from the top of the primary bank of the Lackawanna River. These distances shall be reduced to 20 feet within the C-1 district. This setback shall not apply to open sided public picnic pavilions. U.S. Geological Survey topographic mapping shall be used to determine whether a creek is considered perennial or not.**

As depicted on Sheets 1 and 2 of the Site Plan, no Building, vehicle parking area or business storage area is designed or proposed to be located within: (i) 30 feet from the top

of the primary bank of any perennial creek; or (ii) 75 feet from the top of the primary bank of the Lackawanna River. Given the foregoing, the Application complies with this requirement.

Section 1005 **Noise.**

Section 1005.A **No principal commercial or industrial uses or their operations on their lot shall generate a reoccurring sound level exceeding the limits established in the table below, when measured at the specified locations:**

Sound Level Limits by Receiving Land Use/ District

Land Use or Zoning District Receiving the Noise	Hours / Days	Maximum Sound Level
1. At a Lot Line of a Residential Use in a Residential District	1) 7 a.m. to 10 p.m., other than anytime on: Christmas Day, Thanksgiving Day, New Years Day, Easter Sunday, Labor Day, 4th of July, and Memorial Day 2) 10 p.m. to 7 a.m., plus anytime on any of the following days: Christmas, Thanksgiving, New Years, Easter Sunday, Labor Day, 4th of July and Memorial Day	1) 55 dBA 2) 45 dBa
2. At a Lot Line of a Commercial or R-C District	All times and days	65 dBA
3. Any "2."	All times and days	70 dBA

Note- dBA means "A" weighted decibel.

As depicted on Sheets 2 and 3 of the Site Plan, the Facility is designed and proposed to be laid out so as to comply with the applicable sound requirements of Sections 602.A(62)1, 602.A(62)2 and 1005 of the Zoning Ordinance. See response to Section 602.A(62)2 of the Zoning Ordinance. At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to operate and maintain the Facility in compliance with the applicable requirements of Sections 602.A(62)1, 602.A(62)2 and 1005 of the Zoning Ordinance. Given the foregoing, the Application complies with the applicable sound requirement.

…

Section 1005.C **The maximum permissible sound level limits set forth in the above table shall not apply to any of the following noise sources:**

(1) Sound needed to alert people about an emergency.
(2) Repair or installation of utilities or construction of structures, sidewalks, or streets.
(3) Lawnmowers, snowblowers, leaf blowers and similar equipment.
(4) Household power tools.
(5) Agricultural activities and animals.
(6) Public celebrations authorized by Borough Council or a Borough, County, State or Federal Government agency or body.
(7) Unamplified human voices.
(8) Routine ringing of bells and chimes by a place of worship or municipal clock.
(9) Vehicles lawfully operating on a public street, railroads, and aircraft.
(10) Activities where the applicant provides evidence that municipal noise regulations are preempted by State regulations, or for blasting meeting State regulations.
(11) Noise as measured at a receiving property line where the receiving property is in common ownership with the source of the noise.

Acknowledged. No response necessary.

Section 1006 **Odors, Dust and Smoke.**

Section 1006.A **No use shall generate odors or dust that are offensive to persons of average sensitivities beyond the boundaries of the subject lot.**

As depicted on the Site Plan, the layout of the Facility is designed so as not to generate odors or dust that are offensive to persons of average sensitivities beyond the boundaries of the Property. At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to operate and maintain the Facility in compliance with the applicable standards of Section 1006.A of the Zoning Ordinance. Given the foregoing, the Application complies with the requirement.

…

Section 1007 **Control of Light and Glare. This section shall only regulate exterior lighting that spills across lot lines or onto public streets.**

Section 1007.A **Street Lighting Exempted. This section shall not apply to:**

a) street lighting that is owned, financed or maintained by the Borough or the State, or
b) an individual light of less than 10 feet total height in a front yard or attached to the front of a building.

Acknowledged. No response necessary.

Section 1007.B **Height of Lights. No luminary that is within 150 feet of a lot line of an existing dwelling, and which can be seen from the dwelling, shall be placed at a height exceeding 35 feet above the average surrounding ground level. This limitation shall not apply to lights needed for air safety nor lights intended solely to illuminate an architectural feature of a building, or lighting of outdoor public recreation facilities.**

As depicted on Sheets 4 and 5 of the Site Plan, any exterior luminary proposed to be located within 150 feet of a lot line of an existing dwelling, and which can be seen from such dwelling, is designed with a height of 35 feet or less. Given the foregoing, the Application complies with this requirement.

Section 1007.C **Diffused. All light sources, including signs, shall be properly diffused as needed with a translucent or similar cover and/or shielded to prevent exposed lighting elements from being directly visible from streets, public sidewalks, dwellings or adjacent lots.**

As depicted on Sheets 4 and 5 of the Site Plan, all exterior light sources are designed and proposed to be diffused with a translucent cover and shielded, so as to prevent exposed lighting elements from being directly visible from streets, public sidewalks, dwellings and adjacent lots. Given the foregoing, the Application complies with this requirement.

Section 1007.D **Shielding. All light sources, including signs, shall be shielded around the light source and**

carefully directed and placed to prevent the lighting from creating a nuisance to reasonable persons in adjacent dwellings, and to prevent the lighting from shining into the eyes of passing motorists.

As depicted on Sheets 4 and 5 of the Site Plan, all exterior light sources are designed and proposed to include cut-off and shielding measures around the light source and carefully directed and placed to prevent the lighting from: (i) creating a nuisance to reasonable persons in adjacent dwellings; and (ii) shining into the eyes of passing motorists. Given the foregoing, the Application complies with this requirement.

Section 1007.E **Flickering. Flashing, flickering or strobe lighting are prohibited, except for non-advertising seasonal lights between October 25th and January 10th.**

No flashing, flickering or strobe lighting is proposed by the Application. Given the foregoing, the Application complies with this requirement.

Section 1007.F **Lighting of Horizontal Surfaces. For the lighting of predominantly horizontal surfaces such as parking areas and vehicle sales areas), lighting fixtures shall be aimed downward and shall include cut-off measures as needed to properly direct the light to the intended locations, with no uplighting.**

As depicted on Sheets 4 and 5 of the Site Plan, all exterior lighting fixtures for predominantly horizontal surfaces, including parking lots, are designed and proposed to be aimed downward and include cut-off measures to properly direct the light to the intended locations. No uplighting is proposed for such predominantly horizontal surfaces. Given the foregoing, the Application complies with this requirement.

…

Section 1007.H **Spillover. Lighting of a commercial or industrial property or a sign shall not cause the illumination level on a principal residential lot in a residential district to exceed 0.5 footcandle.**

As depicted on Sheet 4 of the Site Plan, all exterior lighting sources are designed and proposed to be arranged so as not to cause a spillover of light onto a residential lot exceeding 0.5 horizontal footcandle measured at a distance of 10 feet inside such residential lot line. Given the foregoing, the Application complies with this requirement.

Section 1008 **Vibration.**

A. The provisions of this Section 1008 shall not apply to the following:
- **1) temporary activities that are necessary to construct buildings, roads or utilities,**
- **2) blasting activities occurring in compliance with a DEP permit, in situations where municipal regulation of vibration impacts is pre-empted under State law, or**
- **3) vehicles on public roads, trains or aircraft.**

B. No use shall generate earth-shaking vibrations that extend onto another lot upon which the vibration is perceptible by a human without the aid of an instrument.

At the hearing, Applicant will present testimony confirming that, except as necessary and permitted during the construction and development phase of the Facility, the Facility is designed and proposed to be operated so as not to generate earth-shaking vibrations that extend onto another lot upon which vibration is perceptible by a human without the aid of an instrument. Given the foregoing, the Application complies with this requirement.

E. OFF-STREET PARKING AND LOADING (ARTICLE 11)

…

Section 1102 **General Regulations for Off-Street Parking.**

Section 1102.A **General. Parking spaces and accessways shall be laid out to result in safe and orderly use, and to fully take into account all of the following:**

- **1) vehicular access onto and off the site,**
- **2) vehicular movement within the site,**
- **3) loading areas,**
- **4) pedestrian patterns and**
- **5) any drive-thru facilities.**

No parking area shall cause a safety hazard, or an impediment to traffic off the lot.

As depicted on Sheets 2 and 3 of the Site Plan, all required parking spaces and accessways are designed and laid in a safe and orderly manner, accounting for: (i) vehicular access onto and off the site; (ii) vehicular movement within the site; (iii) loading areas; and (iv) pedestrian patterns. Further, all required parking areas are designed and laid out so as not to cause a safety hazard or an impediment to traffic off of the Property. Given the foregoing, the Application complies with this requirement.

...

Section 1102.D **Continuing Obligation of Parking and Loading Spaces. All required numbers of parking spaces and off-street loading spaces shall be available as long as the use or building which the spaces serve still exist, and such spaces shall not be reduced in number below the minimum required by this Ordinance. No required parking area or off-street loading spaces shall be used for any other use (such as storage or display of materials) that interferes with the area's availability for parking.**

At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to comply with the continuing obligation of required parking and loading spaces set forth in Section 1102.D of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 1102.E **Location of Parking.**

(1) Required off-street parking spaces shall be on the same lot or abutting lot with the principal use served, unless the applicant proves to the satisfaction of the Zoning Officer that a method of providing the spaces is guaranteed to be available during all of the years the use is in operation within 300 feet walking distance from the entrance of the principal use being served. The 300 feet distance may be increased to 600 feet for parking serving employees or company vehicles. A written and signed lease shall be provided, if applicable. A sign shall direct persons to the parking spaces.

A. The Zoning Officer may require evidence at any time that shows that the parking continues to be available for the use. If such parking is not available in the future, the zoning permit shall be considered to have been revoked, unless the applicant proves that other parking is provided that meets the requirement.

B. This requirement may be met by a legally binding commitment by the applicant to lease a specific number of parking spaces in an accessible public parking lot or deck.

As depicted on Sheets 2 and 3 of the Site Plan, all required parking spaces that are intended to serve the Buildings of the Facility on the Property are designed and proposed to be located on the Property. No required parking spaces are designed or proposed to be located offsite on another lot abutting the Property. Given the foregoing, the Application complies with the applicable requirement.

Section 1103	**Design Standards for Off-Street Parking.**
Section 1103.A	**General Requirements.**
Section 1103.A(1)	**Backing Onto a Street. No parking area of 4 or more parking spaces shall be designed to require or encourage parked vehicles to back into a public street in order to leave a parking space, except for a driveway that enters onto a local street or a parking court. Parking spaces may back onto an alley.**

As depicted on Sheets 2 and 3 of the Site Plan, none of the required parking areas are designed or proposed so as to require or encourage parked vehicles to back into a public street in order to leave a parking space. Given the foregoing, the Application complies with the applicable requirement.

Section 1103.A(2)	**Except for spaces serving one household, every required parking space shall be designed so that each motor vehicle may proceed to and from the parking space**

provided for it without requiring the moving of any other vehicle.

As depicted on Sheets 2 and 3 of the Site Plan, all required parking spaces are designed and proposed so that each motor vehicle may proceed to and from the parking space provided for it without requiring another vehicle to be moved. Given the foregoing, the Application complies with this requirement.

Section 1103.A(3) **Parking areas shall not extend into a required buffer yard. New parking spaces shall only be allowed within a street right-of-way where they are specifically approved by the Borough.**

As depicted on Sheets 2 and 3 of the Site Plan, none of the parking areas is designed or proposed to be located within any required buffer yard or street right-of-way. Given the foregoing, the Application complies with this requirement.

Section 1103.A(4) **Separation from Street. Except for parking spaces immediately in front of individual dwellings, all areas for off-street parking, off-street loading and unloading and the storage or movement of motor vehicles shall be physically separated from the street by a continuous grass or landscaped planting strip, except for necessary and approved vehicle entrances and exits to the lot. See landscaping provisions in Section 1304.**

As depicted on Sheets 2 and 3 of the Site Plan, all off-street parking areas, off-street loading/unloading areas and areas intended for the storage or movement of motor vehicles are designed and proposed to be physically separated from all public streets by a continuous grass and landscaped planting strip, except for necessary and approved vehicle entrances and exits (i.e., driveways) and other permitted encroachments. Given the foregoing, the Application complies with this requirement.

Section 1103.A(5) **Stacking and Obstructions. Each lot shall provide adequate area upon the lot to prevent back-up of vehicles on a public street while awaiting entry to the lot, or while waiting for service at a drive-through facility.**

As depicted on Sheet 2 of the Site Plan, the Facility is designed and proposed to have five (5) gated driveway connections with public streets. All of the driveways are designed as part of the onsite, interconnected circulation network that also includes accessways, aisles, parking, loading and other vehicle areas designed to be several thousand feet in length so

as to be able to accommodate the queuing of dozens of vehicles entering and leaving the Facility.

Two (2) of the driveways are designed and intended to be primary/main driveways with approximately 290 feet or more of queuing space between the rights-of-way and the gates. While these driveways are designed to be two (2) lanes at the intersections with the streets, they open up into four (4) lanes near the guard houses. These driveways are also designed to include vehicle turnaround spaces.

The three (3) other driveways are designed and intended primarily for employees and emergency service providers. They have two (2) lanes and approximately 40 feet or more of queuing space between the rights-of-way and gates. Therefore, the Facility is designed and proposed so as to prevent the backup of vehicles on a public street while awaiting entry to the Facility. Given the foregoing, the Application complies with the applicable requirement.

…

Section 1103.B	**Size and Marking of Parking Spaces.**
Section 1103.B(1)	**Each parking space shall be a rectangle with a minimum width of 9 feet and a minimum length of 18 feet, except the minimum sized rectangle shall be 8 feet by 22 feet for parallel parking, except as provided for parking for persons with disabilities in Section "G." below. Larger parking spaces are required for persons with disabilities, as provided below.**

As depicted on Sheets 2 and 3 of the Site Plan, except for the parking required for persons with disabilities, all other spaces are designed and proposed to be rectangular-shaped with dimensions of at least nine (9) feet wide and 18 feet long. See responses to Section 1103.G of the Zoning Ordinance describing compliance with the applicable parking standards for persons with disabilities. Given the foregoing, the Application complies with this requirement.

Section 1103.B(2)	**All spaces shall be marked to indicate their location, except those of a one or two family dwelling, and except where stone parking may be allowed.**

As depicted on Sheets 2 and 3 of the Site Plan, all parking space locations are designed and proposed to be paved, and marked and delineated by white painted lines and curbing. Given the foregoing, the Application complies with the requirement.

…

Section 1103.C **Parking Aisles. The aisle width of required parking shall comply with the following table:**

Parking Angle (in degrees)	Minimum Aisle Width (in feet)*
Parallel to 25	12 (except 20 feet for two-way traffic)
25 to 47	13 (one-way traffic only)
48 to 52	14 (one-way traffic only)
53 to 58	15 (one-way traffic only)
59 to 62	16 (one-way traffic only)
63 to 68	17 (one-way traffic only)
69 to 72	18 (one-way traffic only)
73 to 85	20 (one-way traffic only)
86 to 90	20 (except 24 feet for two-way traffic)

For parking at an angle of 45 degrees or greater, the minimum aisle width may be reduced one foot where the adjacent parking spaces have a width of 10 feet or greater.

Within an underground parking structure or an above-ground parking structure, the minimum aisle width may be reduced by one foot.

As depicted on Sheets 2 and 3 of the Site Plan, all surface parking lots are designed and proposed to include two-way aisles with widths of at least 24 feet, connecting to parking spaces at 90-degree angles. Given the foregoing, the Application complies with this requirement.

Section 1103.D **Driveways.**

Section 1103.D(1)

Width of Driveway at Entrance onto a Public Street, at the Edge of the Cartway*	One-Way Use*	Two-Way Use*
Minimum	10 feet	20 feet
Maximum	24 feet	28 feet

*** This standard may be revised where PennDOT requires a different standard for an entrance to a State road, or where the applicant demonstrates to the Zoning Officer that a wider width is needed for truck access.**

As depicted on Sheet 2 of the Site Plan, five (5) driveways are designed and proposed to connect to one (1) of the two (2) PennDOT (i.e., public) roadways, requiring PennDOT

Highway Occupancy Permit (“HOP”) approval during the subsequent land development plan approval process. Three (3) driveways are designed to connect to Scranton Carbondale Highway, and two (2) are to connect to Eynon Jermyn Road. The driveways are designed and proposed to provide for two-way travel (i.e., at least two (2) lanes). Since the driveways are designed and proposed to: (i) serve trucks and emergency vehicles; and (ii) to connect to PennDOT roadways, to the extent necessary, such driveways are permitted, designed, and proposed to have widths exceeding 28 feet as measured at the edge of the cartways of such roadways. Given the foregoing, the Application complies with this requirement.

Section 1103.D(2)	**Drainage. Adequate provisions shall be made to maintain uninterrupted parallel drainage along a public street at the point of driveway entry. The Borough may require an applicant to install an appropriate type and size of pipe at a driveway crossing.**

As depicted on Sheet 2 of the Site Plan, all driveways are designed and arranged in conjunction with the overall design of stormwater management facilities of the Facility, so as to ensure that surface water flow along the public rights-of-way is not impeded. At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to submit the required stormwater management plan as required by the SLDO and the Stormwater Management Ordinance, as applicable, as part of the subsequent subdivision and land development plan approval process. Further, if the Application is approved, Applicant agrees to maintain these required stormwater management facilities in accordance with the applicable provisions of Section 1103.D(2) of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 1103.D(3)	**Clear Sight Distances. A driveway shall be designed and located to minimize obstructions to vision by motorists and pedestrians of other traffic. PennDOT also has sight distance requirements for driveways entering onto a State road.**

As depicted on Sheet 2 of the Site Plan, all driveways are designed and proposed to connect to PennDOT roadways. Such driveways are also designed and located so as to minimize obstructions to motorists' and pedestrians' vision of other traffic on such roadways, in compliance with all applicable PennDOT requirements. Given the foregoing, the Application complies with this requirement.

Section 1103.D(4)	**Driveway Setbacks. A new driveway shall be setback a minimum of 5 feet from a utility pole or fire hydrant.**

As depicted on Sheet 2 of the Site Plan, all driveways are designed and proposed to be set back distances of at least five (5) feet from all utility poles and fire hydrants. Given the foregoing, the Application complies with this requirement.

Section 1103.D(5) **Slope and Width. The slope of a driveway shall not exceed 10 percent within 20 feet of a street right-of-way. The slope and width of a driveway and the clear height above it shall be sufficient to allow access by emergency vehicles.**

As depicted on Sheet 2 of the Site Plan, all driveways are designed and proposed to have slopes no greater than 10% within 20 feet of the nearest street right-of-way to which they connect. The proposed slopes, widths and clear heights above such driveways are sufficient to allow access by emergency vehicles. Given the foregoing, the Application complies with this requirement.

Section 1103.D(6) **Driveway Grading. Grading shall allow drainage to continue to gutters, unless an alternative method of drainage is approved.**

As depicted on Sheet 2 of the Site Plan, all driveways are designed and proposed to be graded so as to allow drainage to continue toward gutters, as applicable. At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to submit the required E&S Control Plan, which includes driveway grading as part of the subsequent subdivision and land development plan approval process. Given the foregoing, the Application complies with this requirement.

Section 1103.D(7) **Number. A lot shall have a maximum of two points of vehicle access onto a street, unless specifically approved otherwise by PennDOT or by the Borough as part of a subdivision or land development. Note - a PennDOT Highway Occupancy Permit is needed for access to a State road, and a similar County permit is needed for access to a County road.**

As depicted on Sheet 2 of the Site Plan, all driveways are designed and proposed to connect to PennDOT roadways, requiring PennDOT HOP approval during the subsequent land development plan approval process. Three (3) driveways are permitted, designed and proposed to connect to Scranton Carbondale Highway and two (2) to Eynon Jermyn Road. At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to submit for PennDOT HOP approval as part of the subsequent land development plan approval process. Given the foregoing, the Application complies with this requirement.

Section 1103.D(8) **Setback. Driveways and parking areas must be located a minimum of one foot from the side and rear lot line. However, a residential driveway may be located on the lot if it physically abuts a driveway on the adjacent lot. This location will only be allowed if agreed to by the owners of each lot, and such approval is recorded as a shared driveway on a Borough-approved plan.**

As depicted on Sheet 2 of the Site Plan, all driveways and parking areas are designed and proposed to be set back distances of at least one (1) foot from all side and rear Property lines. Given the foregoing, the Application complies with the applicable requirement.

Section 1103.E **Paving, Grading and Drainage.**

Section 1103.E(1) **Parking and loading facilities and related driveways shall be graded and adequately drained to prevent erosion or excessive water flow across streets or adjoining properties. See State regulations for erosion control, which may require the preparation of an Erosion and Sedimentation Control Plan.**

As depicted on Sheets 2 and 3 of the Site Plan, all parking and loading facilities, including aisles and driveways, are designed and proposed to be graded and adequately drained so as to prevent erosion or excessive water flow across streets and properties adjoining the Property. At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to submit the required E&S Control Plan as part of the subsequent subdivision and land development plan approval process. Given the foregoing, the Application complies with this requirement.

Section 1103.E(2) **Except for landscaped areas, all portions of required parking areas for commercial, industrial, multi-family and institutional uses involving 4 or more spaces, off-street loading facilities and driveways serving such uses shall be surfaced with asphalt, concrete, paving block, or other low-dust materials pre-approved by the Borough.**

As depicted on Sheets 2, 3 and 5 of the Site Plan, except for required landscaped areas, all other portions of required parking areas are designed and proposed to be surfaced with asphalt or concrete. Given the foregoing, the Application complies with this requirement.

…

Section 1103.E(3) **Curb Cuts. Entrances to parking spaces shall only occur at lawful driveway locations.**

As depicted on Sheet 2 of the Site Plan, entrances to parking spaces are designed and proposed to be from permitted driveway locations in compliance with the applicable requirements of PennDOT and the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

…

Section 1103.E(5) **See Section 1001 regarding erosion and sedimentation control, and State regulations that may require a NPDES permit.**

At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to submit the required E&S Control Plan and NPDES Permit application as part of the subsequent subdivision and land development plan approval process. See response to Section 1001 of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 1103.F **Lighting of Parking Areas. See "Light and Glare Control" in Section 1007.**

As depicted on Sheet 4 of the Site Plan, the proposed parking lot lighting is designed in compliance with the applicable requirements of Section 1007 of the Zoning Ordinance. See response to Section 1007 of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 1103.G **Parking for Persons With Disabilities.**

Section 1103.G(1) **Number of Spaces. See State requirements, which as of 2022 were within the Accessibility section of the 2021 International Building Code, with that section being adopted by Pennsylvania in 2022. The following is a summary of some of the relevant requirements in effect as of the enactment of this Ordinance.**

TOTAL NO. OF PARKING SPACES ON THE LOT	REQUIRED MINIMUM NO./ PERCENT OF ADA-ACCESSIBLE PARKING SPACES
1 to 25	1
26 to 50	2
51 to 75	3
76 to 100	4

TOTAL NO. OF PARKING SPACES ON THE LOT	REQUIRED MINIMUM NO./ PERCENT OF ADA-ACCESSIBLE PARKING SPACES
101 to 150	5
151 to 200	6
201 to 300	7
301 to 400	8
401 to 500	9
501 to 1,000	2% of total number of spaces
1,001 or more	20 plus 1 space for each 100 spaces, or fraction thereof, for spaces over 1,000

As depicted on Sheets 2 and 3 of the Site Plan, a total of 40 vehicle parking spaces are designed for each Building. Two (2) of each parking lot's spaces are required to be designated as handicap accessible parking spaces in accordance with Section 1103.G(1) of the Zoning Ordinance, and two (2) are proposed. For the entire Facility, 36 handicap accessible parking spaces are required and proposed (18 Buildings x 2 spaces). Given the foregoing, the Application complies with this requirement.

Section 1103.G(2) **Location. Handicapped parking spaces shall be located where they would result in the shortest reasonable accessible distance to a handicapped accessible building entrance. Curb cuts shall be provided as needed to provide access from the handicapped spaces.**

As depicted on Sheets 2 and 3 of the Site Plan, all handicapped parking spaces are designed and proposed to be located so as to provide the shortest reasonable accessible distance to a handicapped accessible building entrance. As applicable, curb cuts are designed and proposed to be provided to provide access from the handicapped spaces. Given the foregoing, the Application complies with the requirement.

Section 1103.G(3) **Minimum Size and Slope. See the International Building Code. For every 6 or fraction of 6 ADA-accessible parking spaces, at least one space shall be van-accessible.**

As depicted on Sheets 2, 3 and 5 of the Site Plan, the handicap accessible parking spaces are designed and arranged in compliance with the applicable requirements of the International Building Code. The required van-accessible spaces are designed and proposed to be provided. Given the foregoing, the Application complies with this requirement.

Section 1103.G(4) **Marking. All required handicapped spaces shall be well-marked in compliance with the Americans With Disabilities Act, and should include a statement on a sign about the penalties for unauthorized parking. Such signs and/or markings shall be maintained over time.**

As depicted on Sheets 2, 3 and 5 of the Site Plan, all of the required handicap accessible spaces are designed and proposed to be marked and provided with signage in compliance with the Americans with Disabilities Act, as applicable. At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to maintain all such required signs and markings. Given the foregoing, the Application complies with this requirement.

Section 1103.G(5) **Paving. Handicapped parking spaces and adjacent areas needed to access them with a wheelchair shall be covered with a smooth surface that is usable with a wheelchair.**

As depicted on Sheets 2, 3 and 5 of the Site Plan, all required handicap accessible parking spaces and adjacent areas are designed and proposed to have a smooth surface appropriate for use of a wheelchair. Given the foregoing, the Application complies with this requirement.

Section 1103.G(6) **Note - This section does not address on-street parking permits for a handicapped parking space.**

Acknowledged. No response necessary.

Section 1103.H **Paved Area Setbacks (including Off-Street Parking Setbacks).**

Section 1103.H(1) **Intent. To ensure that parked or moving vehicles within a lot do not obstruct sight distance or interfere with pedestrian traffic, to aid in storm water management along streets, and to prevent vehicles from entering or exiting a lot other than at approved driveways.**

Acknowledged. No response necessary.

Section 1103.H(2) **Any new or expanded vehicle parking or vehicle storage area of 4 or more parking**

spaces that serves a principal non-residential use shall be separated from a public street by a planting strip. The planting strip shall have a minimum width of 6 feet and be maintained in grass or other attractive vegetative groundcover. The planting strip may be on one or both sides of any sidewalk, provided the planting width totals 6 feet. This 6 feet width shall be increased to 15 feet for a lot including 30 or more parking spaces that are visible from the street.

As depicted on Sheets 2 and 3 of the Site Plan, all parking areas are designed and arranged so as to be separated from public street rights-of-way by planting strips with widths of at least 15 feet. All required planting strips are designed and proposed to be planted with grass or other attractive vegetative groundcover. At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to maintain the planting strips with grass or other attractive vegetative groundcover. Given the foregoing, the Application complies with the requirement.

Section 1103.H(2)A — **The planting strip shall not include heights or locations of plants that would obstruct safe sight distances, but may include deciduous trees that allow motorists to maintain views under the leaf canopy.**

As depicted on Sheets 2 and 3 of the Site Plan, all required planting strips are designed and proposed to include plantings at heights and locations that do not obstruct required safe sight distances. Given the foregoing, the Application complies with this requirement.

Section 1103.H(2)A.1 — **The planting strip may be placed inward from the shoulder of an uncurbed street or inward from the curb of a curbed street. The planting strip may overlap the street right-of-way, provided it does not conflict with PennDOT requirements, and provided that the Borough and PennDOT as applicable maintain the right to replace planting areas within the right-of-way with future street improvements.**

As depicted on Sheets 2 and 3 of the Site Plan, all required planting strips are designed and arranged in compliance with the applicable requirements of Section 1103.H(2)A.1 of the Zoning Ordinance. Given the foregoing, the Application complies with the applicable requirement.

Section 1103.H(2)C **The planting strip may be crossed perpendicularly by driveways.**

As depicted on Sheets 2 and 3 of the Site Plan, the required planting strips are permitted, designed and proposed to be crossed perpendicularly by the driveways. Given the foregoing, the Application complies with this requirement.

Section 1103.H(2)D **The planting strip may consist of vegetative stormwater channels.**

Acknowledged. No response necessary.

Section 1103.H(2)E **The following shall be prohibited within the planting strip:**

1. **paving, except for perpendicular driveway crossings, and except for public street widenings that may occur after the development is completed,**
2. **fences, and**
3. **parking, storage or display of vehicles or manufactured homes or items for sale or rent or junk.**

As depicted on Sheets 2 and 3 of the Site Plan, none of the other prohibited elements or activities listed in Section 1103.H(2)E of the Zoning Ordinance are designed or proposed to be located in any required planting strip. No unauthorized encroachment into the required planting is proposed by the Application. Given the foregoing, the Application complies with the requirement.

Section 1103.H(2)F **Where feasible, where a sidewalk is not installed, this setback should include an unobstructed generally level width running parallel to a street that is suitable for a person to walk.**

As depicted on Sheets 2 and 3 of the Site Plan, no sidewalks are designed or proposed to be located in any required planting strip. Except for the areas along Scranton Carbondale Highway and Eynon Jermyn Road where existing slopes prohibit, to the extent feasible, all other required planting strips are designed and proposed to include an unobstructed, generally level width running parallel to the applicable street, which is generally suitable for persons to walk. Given the foregoing, the Application complies with this requirement.

Section 1103.H(3) **See landscaping requirements in Section 1304.**

See responses to Section 1304 of the Zoning Ordinance demonstrating compliance with the applicable landscaping requirements. Given the foregoing, the Application complies with this requirement.

…

Section 1103.J **Parking of Unregistered or Junk Motor Vehicles.**

(1) This subsection J. shall apply unless a more restrictive provision applies under another section of this Ordinance or another Borough Code or Ordinance.

(2) If a lot is approved as a Junkyard, Auto Service Station, Auto Repair Garage or Auto Sales Use, the parking regulations for such use shall apply instead of this subsection J.

(3) A "junk vehicle" (as defined by Section 1502) shall not be kept outside of an enclosed building for more than 60 days. No more than one junk vehicle shall be kept outside of an enclosed building per calendar year.

(4) For unlicensed or unregistered motor vehicles or vehicles that do not display a current safety inspection sticker, see the Borough Quality of Life Ordinance.

At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to maintain the Facility in compliance with the applicable requirements of Section 1103.J of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 1104 **Off-Street Loading.**

…

Section 1104.B **At the time of review under this Ordinance, the applicant shall provide evidence to the Zoning Officer on whether the use will have sufficient numbers and sizes of loading facilities. The Planning Commission and/or Borough Council may provide advice to the Zoning Officer on this matter as part of any**

plan review by such boards. For the purposes of this Section, the words "loading" and "unloading" are used interchangeably.

As depicted on Sheets 2 and 3 of the Site Plan, each Building is designed and proposed to include two (2) loading spaces, which exceeds the minimum number of spaces required for data center buildings as set forth in Section 602.A(62)14 of the Zoning Ordinance. Given the foregoing, the Application complies with the applicable loading requirement.

Section 1104.C **Each space and the needed maneuvering room shall not intrude into approved buffer areas and landscaped areas.**

As depicted on Sheets 2 and 3 of the Site Plan, none of the loading spaces or related maneuvering areas are designed or proposed so as to encroach into any required buffer yard or required landscape planting strip area. Given the foregoing, the Application complies with this requirement.

Section 1104.D **To the maximum extent feasible, tractor-trailer loading docks shall be designed so that they are buffered from view of dwellings or from adjacent streets by walls or landscaping. However, areas that are only used for short-term unloading of trucks and that do not require use of a dock are not required to be buffered.**

As depicted on Sheets 2 and 3 of the Site Plan, all loading docks are designed and proposed to be buffered from view of dwellings on abutting lots and from adjacent streets by Building walls and landscaping. See responses to Section 507.8 of the Zoning Ordinance describing the required and proposed buffer yards and screening for data centers. Given the foregoing, the Application complies with this requirement.

Section 1105 **Fire Lanes and Access.**

Section 1105.A **Fire lanes shall be provided where required by State or Federal regulations or other local ordinances.**

No fire lanes are required or proposed. Therefore, this requirement is not applicable. Regardless, as depicted on Sheet 2 of the Site Plan, the Facility is designed to have five (5) two-way driveways connecting to one (1) of the two (2) public street rights-of-way. The proposed Facility, including the Buildings, driveways, accessways and aisles, are designed so that emergency vehicles, including ladder trucks, can make all required turning movements and reach all sides of the Buildings. Also, the Buildings are proposed to have incombustible exterior (i.e., concrete) walls, steel support columns, and steel roofs with rigid

insulation and EPDM (ethylene propylene diene terpolymer) or TPO (thermoplastic polyolefin) roof membrane or similar. The Buildings are proposed to be, and as a matter of law must be, designed in accordance with all applicable building and fire codes, and other applicable local, state and federal requirements. The Buildings are proposed to be equipped with ESFR (early suppression fast response) sprinkler systems. Access for firefighters is proposed to be provided to the Buildings through external doors, and access to the roofs is proposed to be provided via internal ladder systems. If the Application is approved, Applicant agrees to ensure that the emergency access is maintained in a passable condition. See responses to Sections 1105.B and 1303.A(2) of the Zoning Ordinance.

Section 1105.B	**Access shall be also provided so that fire equipment can reach all sides of principal non-residential buildings and multi-family/apartment buildings. This access shall be able to support a loaded fire pumper truck, but shall not necessarily be paved.**

As depicted on Sheets 2 and 3 of the Site Plan, access is designed and proposed to be provided so that fire equipment can reach all sides of each Building. Such access is designed and proposed to support a loaded fire pumper truck. See responses to Sections 1105.A and 1303.A(2) of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 1105.C	**The specific locations of fire lanes and fire equipment access are subject to approval by the Borough, after review by Borough Fire Officials.**

Acknowledged. No response necessary.

F. SIGNS (ARTICLE 12)

The Application does not propose any specific exterior signs at this time. In the future, if the Application is approved, and Applicant desires to install exterior signs, to the extent applicable, Applicant agrees to apply for a zoning permit in accordance with Section 1201.B of the Zoning Ordinance prior to the installation of such exterior signs.

G. GENERAL REGULATIONS (ARTICLE 13)

Section 1301	**Frontage Onto Improved Streets, Number of Uses or Buildings, Minimum Size of Dwellings.**
Section 1301.A	**Frontage Required onto Improved Street. Each proposed new lot, each land**

development and each proposed principal building shall be on a lot which directly abuts a public street, a street proposed to be dedicated to the Borough by the subdivision plan which created or creates such lot, or a private street which meets all of the requirements of the Subdivision and Land Development Ordinance. This requirement for frontage shall not be met by an "alley," except that a lot with frontage onto a street may be approved to have its vehicle access onto an alley, if the alley has suitable access to the street.

…

As depicted on Sheet 2 of the Site Plan, the proposed Facility is located on the Property that is designed and proposed to directly abut two (2) existing public street rights-of-way owned by PennDOT, including: (i) Scranton Carbondale Highway that is to the west; and (ii) Eynon Jermyn Road that is to the east. Given the foregoing, the Application complies with this requirement.

Section 1301.B	**Number of Principal Uses and Principal Buildings Per Lot.**
Section 1301.B(1)	**A lot may include more than one permitted principal use per lot and/or more than one permitted principal building per lot, provided that all of the requirements are met for each use and each building. If differing dimensional requirements apply for different uses on the lot, then the most restrictive requirement shall apply.**

(a) For example, if Use One requires a 10,000 square feet lot area and Use Two on the same lot requires a 20,000 square feet lot area, then the lot shall have a minimum lot area of 20,000 square feet.

(b) The applicant shall submit a site plan that demonstrates that each structure would meet the requirements of this Ordinance.

(c) The uses and buildings shall be in common ownership. However, a

condominium form of ownership of individual buildings, with a legally binding property-owners association, may be established if the applicant proves to the satisfaction of the Zoning Officer, based upon review by the Borough Solicitor, that there will be appropriate legal mechanisms in place.

As depicted on Sheet 2 of the Site Plan, as a data center campus, the Facility is permitted, designed and proposed to include 18 Buildings located on the Property, as the Facility is the only principal use. Further, all Buildings are designed and proposed in compliance with all applicable requirements for data center campuses in the DC District of the Zoning Ordinance. At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to comply with the applicable ownership requirements of Section 1301.B(1) of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

…

Section 1303	**Special Lot and Yard Requirements, Sight Distance and Buffer Yards.**
Section 1303.A	**In General.**
Section 1303.A(1)	**No lot, structure or use shall be created or developed in such a way that it would result in another lot, building or use not being able to meet the requirements of this Ordinance. This includes, but is not limited to: setback areas, non-impervious areas and off-street parking areas.**

As depicted on the Site Plan, the Facility on Property is designed and laid out so as not to prevent any other lot, building, or use from meeting the applicable requirements of the Zoning Ordinance, including setback areas, non-impervious areas, and off-street parking areas. Given the foregoing, the Application complies with this requirement.

Section 1303.A(2)	**Emergency Access. All uses and structures shall have adequate provisions for access by emergency vehicles and fire ladders. See also the Uniform Construction Code Appendices. Such access shall be maintained in a passable condition by the owner of the lot, or where applicable by the property-owner association.**

See responses to Sections 1105.A and 1105.B of the Zoning Ordinance describing compliance with the applicable emergency access requirements. As depicted on the Site Plan, the Facility is designed and proposed to be constructed with the applicable requirements of the Uniform Construction Code Appendices. See response to Section 602.A.(62)6 of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 1303.C(2) **For driveway sight clearance, see Section 1103.D.**

See response to Section 1103.D(3) of the Zoning Ordinance describing compliance with the applicable clear sight distance requirements for the proposed driveways. Given the foregoing, the Application complies with this requirement.

…

Section 1303.D(6) **Buffer Yard Plans. Prior to the issuance of a permit under this Ordinance where a buffer yard would be required, and on any required subdivision or land development plan, the applicant shall submit plans showing:**

(a) the location and arrangement of each buffer yard,
(b) the placement, general selection of species and initial size of all plant materials, and
(c) the placement, size, materials and type of all fences to be placed in such buffer yard.

Sheets 2 and 3 of the Site Plan generally depict the applicable buffer yard and screen planting locations and information for data center campuses as required in Sections 507.8 and 507.9 of the Zoning Ordinance. At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to submit the required buffer yard and screen planting information as part of the subsequent subdivision and land development plan approval process. Given the foregoing, the Application complies with the applicable requirement.

Section 1304 **Landscaping.**

Section 1304.A **A minimum of 10 percent of each lot shall be landscaped in trees, shrubs and vegetative ground cover. The 10 percent shall be reduced to 5 percent for a lot in the C-1 district. Within a subdivision or land**

development, such 10 percent shall apply to the entire project, but does not need to be met for each lot, provided that the plan includes standards for each lot to assure compliance with the overall requirement. See also the buffer yard provisions in Section 1303.C.

As depicted on Sheet 2 of the Site Plan, at least 10% of the Property is required and proposed to be covered by landscaped areas, including trees, shrubs and vegetative ground cover. Given the foregoing, the Application complies with this requirement.

Section 1304.A(1) **Any part of a commercial, industrial, institutional or apartment lot which is not used for structures, loading areas, parking spaces and aisles, sidewalks and designated storage areas shall be provided with an all-season, well-maintained vegetative groundcover, and shall be landscaped with trees and shrubs, except where rocky conditions make it infeasible.**

As depicted on Sheets 2 and 3 of the Site Plan, all portions of the Facility, which are not designed or proposed to be occupied by structures, loading areas, parking spaces and aisles, sidewalks, designated storage areas and other permitted improvements, excluding rocky conditions near the surface, are designed and proposed to be provided with an all-season, well-maintained vegetation groundcover, and as applicable, landscaped with trees and shrubs. Given the foregoing, the Application complies with the requirement.

Section 1304.A(2) **Landscaped areas shall be kept free of junk, debris, rubbish and noxious weeds.**

At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to maintain the required landscaped areas free of junk, debris, rubbish and noxious weeds. Given the foregoing, the Application complies with the requirement.

…

Section 1304.B **Parking Lot Trees. For each 10 new off-street parking spaces, one new deciduous shade tree shall be planted that meets the street tree requirements of Section D. below.**

As depicted on Sheets 2 and 3 of the Site Plan, each Building is designed with an adjoining parking lot of 40 parking spaces. Four (4) parking lot trees are required and proposed for

each parking lot (i.e., 40 spaces / 10 spaces). For the entire Facility, 72 parking lot trees are required and proposed ([18 parking lots x 40 spaces] / 10 spaces). The proposed trees are required to be of a species listed in Section 1304.D of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 1304.C	**Landscape Maintenance. All trees and other landscaping required by this Ordinance or the Subdivision and Land Development Ordinance shall be perpetually maintained by the propertyowner. If any landscaping that is needed to meet an Ordinance requirement dies, is removed, or is severely damaged, it shall be replaced by the current property-owner, within a maximum of 180 days. Note - In certain cases the developer will be responsible for replacement within an initial time period under a subdivision requirement.**

At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to maintain all required trees and other landscaping in compliance with the applicable provisions of Section 1304.C of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 1304.D	**Street Trees. Street trees shall be required when a new principal non-residential or multi-family apartment building is proposed, or along a new street or an extension of an existing street. Street trees are not required where the Borough determines that existing healthy trees proposed to be preserved will serve the same function.**

As depicted on Sheets 2 and 3 of the Site Plan, a mix of preserved healthy existing mature and newly planted trees is proposed along Scranton Carbondale Highway and Eynon Jermyn Road. Given the foregoing, the Application complies with this requirement.

…

Section 1304.D(2)	**A tree required by this Section shall be of the following species. This list shall not regulate types of trees that are not required to be planted by this Ordinance.** **<u>Trees Intended to Mature Have a Height of 30 Feet or Less (such as under powerlines):</u>**

- **Acer buergeranum - Trident Maple**
- **Acer campestre- Hedge Maple**
- **Acer tararicum - Tatarian Maple**
- **Acer truncatum - Pacific Sunset Maple**
- **Amelanchier x grandiflora – Serviceberry (beware of sensitivity to road salt)**
- **Carpinus caroliniana – American Hornbeam (beware of sensitivity to road salt)**
- **Cercis canadensis – Eastern Red Bud**
- **Cornus kousa - Kousa Dogwood - Single-stem tree form only**
- **Crataegus crus-galli var. 'Inermis' – Thornless Cockspur Hawthorn (low branches need to be removed on Hawthorns so that the thorns do not harm pedestrians)**
- **Crataegus flava – Yellowleaf Hawthorn**
- **Crataegus laevigata 'Superba' – English Hawthorn**
- **Crataegus viridis – Green Hawthorn**
- **Crataegus x lavallei (tree form) – Lavalle Hawthorn**
- **Crataegus punctata 'Ohio Pioneer' – Ohio Pioneer Hawthorn**
- **Crataegus viridis 'Winter King' – Winter King Green Hawthorn**
- **Prunus x Snow Goose - Snow Goose Cherry**
- **Styrax japonica - Japanese Snowbell**

<u>Trees Intended to Have a Mature Height of 30 to 40 Feet:</u>

- **Acer truncatum – Purpleblow Maple**
- **Acer truncatum x Acer platanoides 'Keithsform' – Norwegian Sunset Maple**
- **Carpinus betulus – European Hornbeam (beware of sensitivity to road salt)**
- **Carpinus betulus 'Fastigiata' – Upright European Hornbeam (beware of sensitivity to road salt)**

- **Gleditsia triacanthos var. inermis – Thornless Honeylocust**
- **Ginkgo biloba (male only) – Maidenhair Tree**
- **Maackia amurensis – Amus Maackia**
- **Parrotia persica (tree form) – Persian Parrotia**

<u>Trees Intended to Have a Mature Height of Over 30 Feet:</u>

- **Acer rubrum – Red Maple**
- **Acer saccharum – Sugar Maple**
- **Celtis occidentalis – Common Hackberry**
- **Eucommia ulmoides – Hardy Rubber Tree**
- **Platanus occidentalis – London Planetree**
- **Platanus x acerifolia 'Bloodgood' – Bloodgood London Planetree**
- **Quercus imbricaria – Shingle Oak**
- **Quercus rubra – Red Oak**
- **Quercus shumardii – Shumard Oak**
- **Tilia americana - American Linden**
- **Tilia cordata - Little Leaf Linden**
- **Ulmus Americana 'Valley Forge' – American Elm 'Valley Forge' (Dutch Elm**
- **Disease resistant tree)**
- **Ulmus parvifolia 'Dynasty' – Lacebark Elm**
- **Zelkova serrata 'Green Vase' – Zelkova**

<u>Trees Intended for Planting Where There is a Narrow Width Available for a Canopy:</u>

- **Carpinus betulus 'Columnaris' – Columnar European Hornbeam (beware of sensitivity to road salt)**
- **Carpinus betulus 'Fastigiata' – Upright European Hornbeam (beware of sensitivity to road salt)**
- **Ginkgo biloba 'Magyar' – Magyar Upright Ginkgo**

- **Ginkgo biloba 'Princeton Sentry' – Princeton Sentry Ginkgo**
- **Quercus robur 'Fastigiata' – Columnar English Oak**
- **Quercus robus x Q. alba 'Crimsmidt' – Crimson Spire Oak**
- **Quercus x warei 'Long' Regal Prince – Regal Prince Oak**
- **Zelkova serrata 'Musashino' - Musashino Columnar Zelkova**

The following species of trees, as well as other trees with weak trunks, shall specifically not be used to meet Borough requirements, but may be planted on private property in addition to required trees:

- **Acer sccharinum - Silver Maple**
- **Acer platanoides - Norway Maple**
- **Aesculous species - Horsechestnut**
- **Betula species - Birches**
- **Catalpa species - Catalpas**
- **Malus species - Apple or Crabapple**
- **Ginkgo biloba female - Female Ginkgo**
- **Morus species - Mulberry**
- **Populus species - Poplars**
- **Evergreens - unless the Borough should specifically allow them to be placed on private property adjacent to a street right-of-way in lieu of a street tree if needed to serve as a visual buffer.**

At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees that any new tree required to be planted will be from the list of permitted trees set forth in Section 1304.D(2) of the Zoning Ordinance. For purposes of demonstrating compliance with Section 1304.D(2) of the Zoning Ordinance, Sheet 3 of the Site Plan identifies the following permitted deciduous trees: (i) Acer campestre- Hedge Maple; (ii) Acer truncatum – Purpleblow Maple; and (iii) Quercus rubra – Red Oak. Given the foregoing, the Application complies with this requirement.

Section 1304.D(3) **If more than 10 trees are required to be planted, then no more than 50 percent shall be of one species.**

As depicted on Sheet 3 of the Site Plan, no more than 50% of the required trees are proposed to be of one (1) species. Given the foregoing, the Application complies with this requirement.

Section 1304.D(4)	**Quality of Trees. Trees shall be of symmetrical growth, free of insect pests and disease and durable under the maintenance contemplated. The developer shall water trees as needed until a property is sold.**

As depicted on Sheet 3 of the Site Plan, the required trees are proposed to be of symmetrical growth, free of insect pests and disease, and durable under the maintenance contemplated. At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to maintain the required trees in compliance with Section 1304.D(4) of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 1304.D(5)	**Minimum Sizes and Standards. The trunk diameter (measured at a height of 4.5 feet above the finished grade level) of deciduous shade trees required by this Ordinance shall be a minimum of 2 inches.**

As depicted on Sheet 3 of the Site Plan, the required trees are proposed to have trunk diameters at least two (2) inches, as measured at a height of 4.5 feet above the finished grade level. Given the foregoing, the Application complies with this requirement.

Section 1304.D(6)	**Planting and Maintenance.**
Section 1304.D(6)(a)	**Trees shall be planted in conformance with good landscaping practices.**

As depicted on Sheet 3 of the Site Plan, the required trees are proposed to be planted in accordance with industry-recognized good landscaping practices. At the hearing, Applicant will present testimony confirming the required trees are proposed to be planted in compliance with Section 1304.D(6)(a) of the Zoning Ordinance. Given the foregoing, the Application complies with this requirement.

Section 1304.D(6)(b)	**Trees adjacent to or within parking areas shall be properly protected from damage by vehicles by raised curbs, raised earth, protective devices and/or sufficient setback.**

As depicted on Sheet 3 of the Site Plan, trees adjacent to or within parking areas are designed to be protected from damage by vehicles by raised curbs. Given the foregoing, the Application complies with this requirement.

Section 1304.D(7)	**Required Number and Spacing of Street Trees. Where required, an average of one street tree shall be planted for every 50 feet of distance along the street right-of-way line on each affected side of the street. Trees shall be distributed along the length of the street, but are not required to be evenly spaced.**

As depicted on Sheet 3 of the Site Plan, an average of one (1) required street tree is proposed to be planted for each 50 feet of distance along Scranton Carbondale Highway and Eynon Jermyn Road. Given the foregoing, the Application complies with this requirement.

Section 1304.D(8)	**Location of Street Trees. The trunks of required street trees shall be planted outside of but immediately adjacent to the street right-of-way, unless an alternative location is specifically approved by the Borough or required by PennDOT.**

As depicted on Sheet 3 of the Site Plan, the trunks of the required street trees are proposed to be planted outside of but immediately adjacent to the street rights-of-way of Scranton Carbondale Highway and Eynon Jermyn Road. Given the foregoing, the Application complies with this requirement.

…

Section 1306	**Dumpster Screening and Location.**
Section 1306.A	**This Section addresses waste dumpsters that are not placed within a public street right-of-way. Whenever a site plan is required to be submitted to the Borough, it shall show the proposed location of any waste dumpsters. The Zoning Officer may require that such proposed location be modified to provide compatibility with nearby dwellings, such as to maintain a minimum 70 feet setback from any dwelling to the maximum extent feasible.**

As depicted on Sheets 2 and 3 of the Site Plan, the proposed dumpsters are designed and proposed to be located on the Property and not in any public street right-of-way. There are no dwellings located within a distance of less than 70 feet of any proposed dumpster. Given the foregoing, the Application complies with this requirement.

…

Section 1306.C — **If a waste dumpster is not stored within a building and is on the lot for more than 120 days in a calendar year, then it shall be screened from view of any public street or dwelling by decorative masonry wall or weather-resistant solid board fence, with a mostly solid gate.**

As depicted on Sheets 2 and 3 of the Site Plan, the proposed dumpsters are designed and proposed to be surrounded and screened from view from a public street or dwelling by decorative masonry walls, with a mostly solid gate. Given the foregoing, the Application complies with this requirement.

…

H. GENERAL CRITERIA FOR ALL CONDITIONAL USE APPLICATIONS (SECTION 1417.A)

Pursuant to Section 1417.A of the Zoning Ordinance, the general criteria for conditional use applications are set forth in Section 1416.C.

Section 1416.C(1) — **Compliance with this Ordinance. The applicant shall establish by credible evidence that the application complies with all applicable requirements of this Ordinance. The applicant shall provide the Board with sufficient plans, studies or other data to demonstrate this compliance. The applicant shall also prove compliance with regulations of the Subdivision and Land Development Ordinance that have direct impact upon the zoning site plan, provided that stormwater, grading, profiles and similar engineering information may be addressed as part of a separate SALDO application.**

For the reasons stated in this Narrative, along with the supporting Site Plan, documents and reports, and testimony provided at the hearing, the Application complies with all applicable requirements of the Zoning Ordinance, as well as the SLDO. At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to comply with all applicable requirements of the SLDO as part of the subsequent subdivision and land development plan approval process. Given the foregoing, the Application complies with this criterion.

Section 1416.C(2) — **Compliance with Other Laws. The approval may be conditioned upon the applicant later**

showing proof of compliance with other specific applicable Borough, state and federal laws, regulations and permits, such as PennDOT and DEP permits. All zoning permits are automatically conditioned upon an applicant showing compliance with the Borough Stormwater and SALDO ordinances prior to construction, if they are applicable. See Section 1403.E. regarding other permits and approvals.

For the reasons stated in this Narrative, along with the supporting Site Plan, documents and reports, and testimony provided at the hearing, the Application complies with the applicable Borough, state and federal laws, regulations and permits. At the hearing, Applicant will present testimony confirming that if the Application is approved, Applicant agrees to: (i) comply with all other specific applicable Borough, state and federal laws, regulations and permits; and (ii) provide the Borough with proof of such compliance prior to construction. Given the foregoing, the Application complies with this criterion.

Section 1416.C(3) **Traffic. The applicant shall establish that the traffic from the proposed use will be accommodated in a safe and efficient manner that will minimize hazards and congestion, after considering any improvements proposed to be made by the applicant as a condition on approval.**

Traffic Planning and Design, Inc. has prepared and submitted a traffic letter ("Traffic Letter") regarding the expected impact of the proposed Facility on the surrounding roadway network. At the hearing, Applicant will present testimony, including testimony of a professional traffic engineer, confirming that the proposed Facility is designed and located so as to provide for safe and adequate ingress, egress, and circulation of all contemplated vehicular activity.

For the reasons stated in this Narrative, along with the supporting Site Plan, documents and reports, the Facility on the Property in the DC District is designed and located, and proposed to be operated so that the contemplated traffic can be accommodated in a safe and efficient manner and any potential hazards and congestion are mitigated or eliminated. Given the foregoing, the Application complies with this criterion.

Section 1416.C(4) **Site Planning. The application shall include proper site layout, internal circulation, parking layout, and loading facilities in order to safely operate the use with minimal negative impacts upon neighboring properties and streets.**

For the reasons stated in this Narrative, along with the supporting Site Plan, documents and reports, and testimony provided at the hearing, the Facility on the Property in the DC District is properly sited, planned, designed and laid out, and proposed to be operated safely, in compliance with the applicable standards and requirements of the Zoning Ordinance and SLDO, so as to eliminate or mitigate potential negative impacts upon neighboring properties and streets. Given the foregoing, the Application complies with this criterion.

Section 1416.C(5) **Neighborhood. The proposed use shall not substantially negatively change the character of any surrounding residential neighborhood, after considering any proposed conditions upon approval such as limits upon hours of operation and proposed buffering and setbacks.**

For the reasons stated in this Narrative, along with the supporting Site Plan, documents and reports, and testimony provided at the hearing, the Facility on the Property in the DC District is designed and proposed to be operated so as not to substantially negatively change the character of any surrounding residential neighborhood. Given the foregoing, the Application complies with this criterion.

Section 1416.C(6) **Safety. The proposed use shall not create a significant hazard to the public health and safety, such as fire, toxic or explosive hazards.**

For the reasons stated in this Narrative, along with the supporting Site Plan, documents and reports, and testimony provided at the hearing, the Facility on the Property in the DC District is designed and proposed to be operated so as not to create a significant hazard to the public health and safety, regarding fire, toxic or explosive hazards. Given the foregoing, the Application complies with this criterion.

Section 1416.C(7) **Natural Features. The proposed use shall be suitable for the site, considering the disturbance of steep slopes, mature woodland, wetlands, floodplains, springs and other important natural features.**

For the reasons stated in this Narrative, along with the supporting Site Plan, documents and reports, and testimony provided at the hearing, the Facility is suitable for the Property in the DC District given the permitted and proposed disturbance of certain natural features. Given the foregoing, the Application complies with this criterion.

IV. CONCLUSION

Finally, the fact that a use is permitted by conditional use evidences a legislative decision that the particular type of use (in this case, data center campus) is consistent with the zoning plan and presumptively consistent with the health, safety and welfare of the community. *Id*.; *Northampton Area Sch. Dist. v. East Allen Twp. Bd. of Supervisors*, 824 A.2d 372, 376 (Pa. Commw. Ct. 2003); *Abbey v. Zoning Hearing Bd. of East Stroudsburg*, 559 A.2d 107, 109 (Pa. Commw. Ct. 1989); *Warren Cty. Probation Ass'n v. Warren Cty. Zoning Hearing Bd.*, 414 A.2d 398, 399 (Pa. Commw. Ct. 1980); *Foster Grading Co. v. Venango Twp. Zoning Hearing Bd.*, 412 A.2d 647, 629 (Pa. Commw. Ct. 1980).

Therefore, a conditional use application that satisfies objective standards of the Zoning Ordinance must be granted unless opponents present sufficient evidence that the use will generate adverse impacts not normally generated by this type of use and that those impacts will pose a substantial threat to the health and safety of the community. *Greaton Props., Inc. v. Lower Merion Twp.*, 796 A.2d 1038, 1045 (Pa. Commw. Ct. 2002); *In re Cutler Group, Inc.*, 880 A.2d 39, 43 (Pa. Commw. Ct. 2003). Such evidence cannot consist of mere speculation, bald assertions, or personal opinions and perceptions of the effect of the use on the community. *Id*. Rather, opponents must demonstrate that there is a *high degree of probability* that the use will cause a substantial harm that is not normally associated with the proposed use. *Id*.; *Ruddy v. Lower Southampton Twp. Zoning Hearing Bd.*, 669 A.2d 1051, 1057 (Pa. Commw. Ct. 1995).

For the foregoing reasons, Applicant respectfully requests that the Borough Council grant the requested conditional use approval.