


PLAN

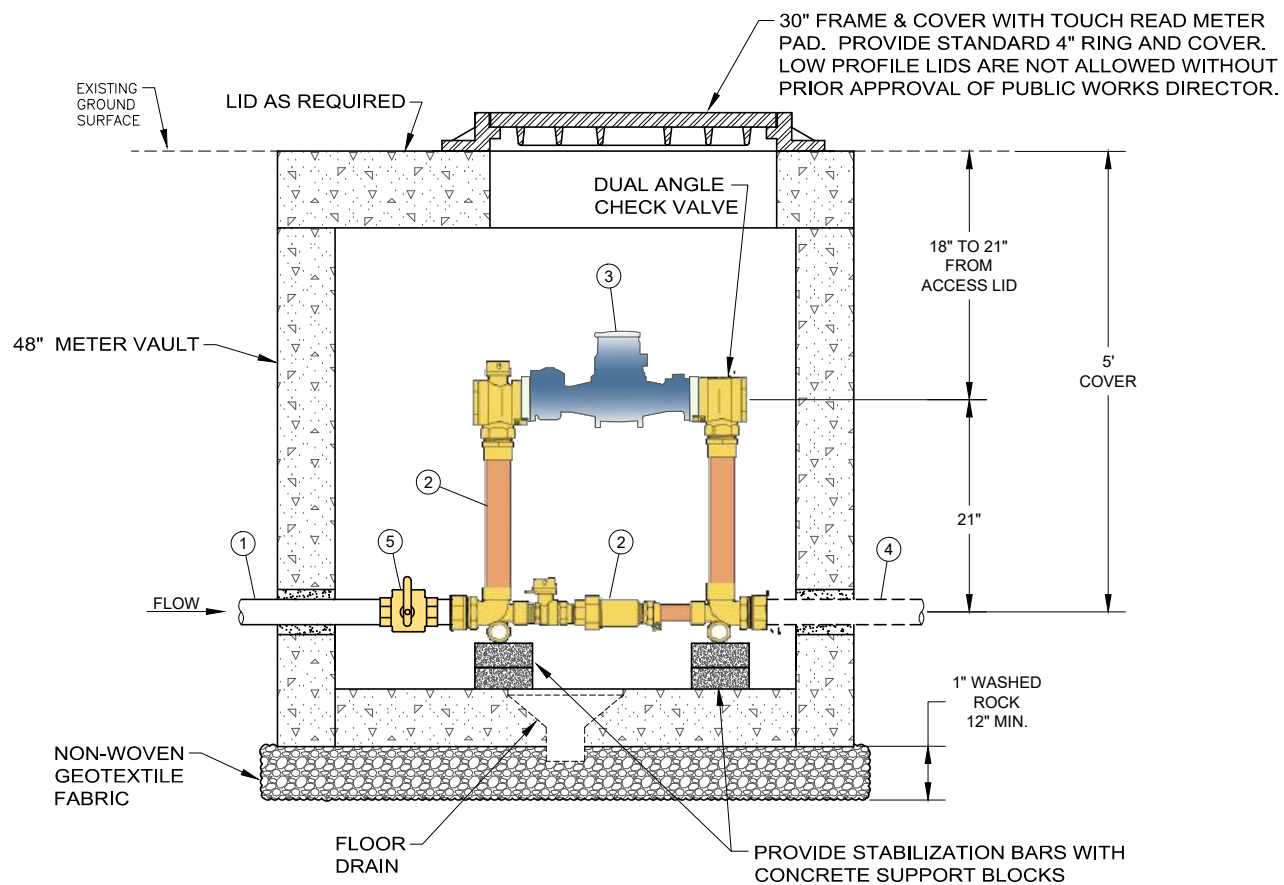

SECTION

METER VAULT VALVE AND FITTING SCHEDULE

NO.	DESCRIPTION	SIZE	JOINT
1.	ASTM D2737 CTS HDPE POLY PIPE (BLUE) W/TRACER WIRE	1.5" OR 2"	COMP.
2.	FORD SERIES 70 COPPER SETTER (H=21"), WITH BALL VALVE INLET & ASSE APPROVED ANGLE DUAL CHECK VALVE OUTLET AND STANDARD BYPASS & CARTRIDGE DUAL CHECK VALVE (2" MODEL VBHC74-21W-11-44-NL) (1½" MODEL VBHC76-21B-11-66-NL)	1.5" OR 2"	FLG
3.	COMPOUND METER (SENSUS OMNI C <sup>2</sup> RADIO READ FURNISHED & INSTALLED BY CITY)	1.5" OR 2"	FLG
4.	OUTLET LINE AS PER PLAN	1.5" OR 2"	-
5.	BRASS BALL VALVE (MUELLER 300 BALL)	1.5" OR 2"	-

NOTE: PROVIDE GRIP JOINT FOR COPPER OR PLASTIC TUBE AS NEEDED. THE METER SETTER SHALL BE NO SMALLER IN SIZE THAN THE LATERAL FROM THE MAIN TO THE METER SETTER INSTALLED.

NOTES:

1. CONTRACTOR SHALL RESTORE ALL SURFACE IMPROVEMENTS TO PRE-CONSTRUCTION CONDITION WHERE REQUIRED.
2. CONTRACTOR SHALL PROVIDE ANY ADDITIONAL PIPE & FITTINGS AS NECESSARY.