


CULINARY WATER

SECONDARY WATER

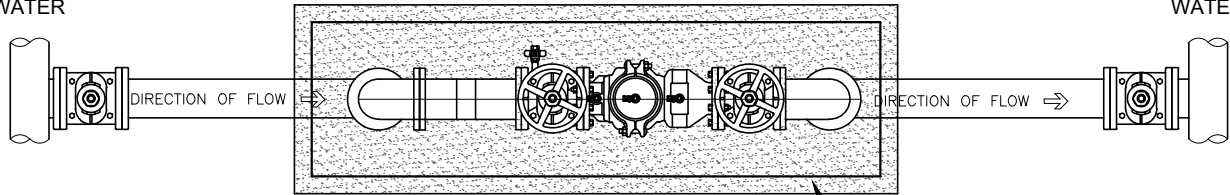


PROVIDE 4" THICK CONCRETE PAD AS REQUIRED BY ENCLOSURE SIZE

PROVIDE LOCKING PROTECTIVE SOLID ENCLOSURE

PROVIDE LOCKING PROTECTIVE SOLID ENCLOSURE SEE NOTE

14 GAUGE TRACER WIRE SEE NOTE

PROVIDE 4" THICK CONCRETE PAD AS REQUIRED BY ENCLOSURE SIZE

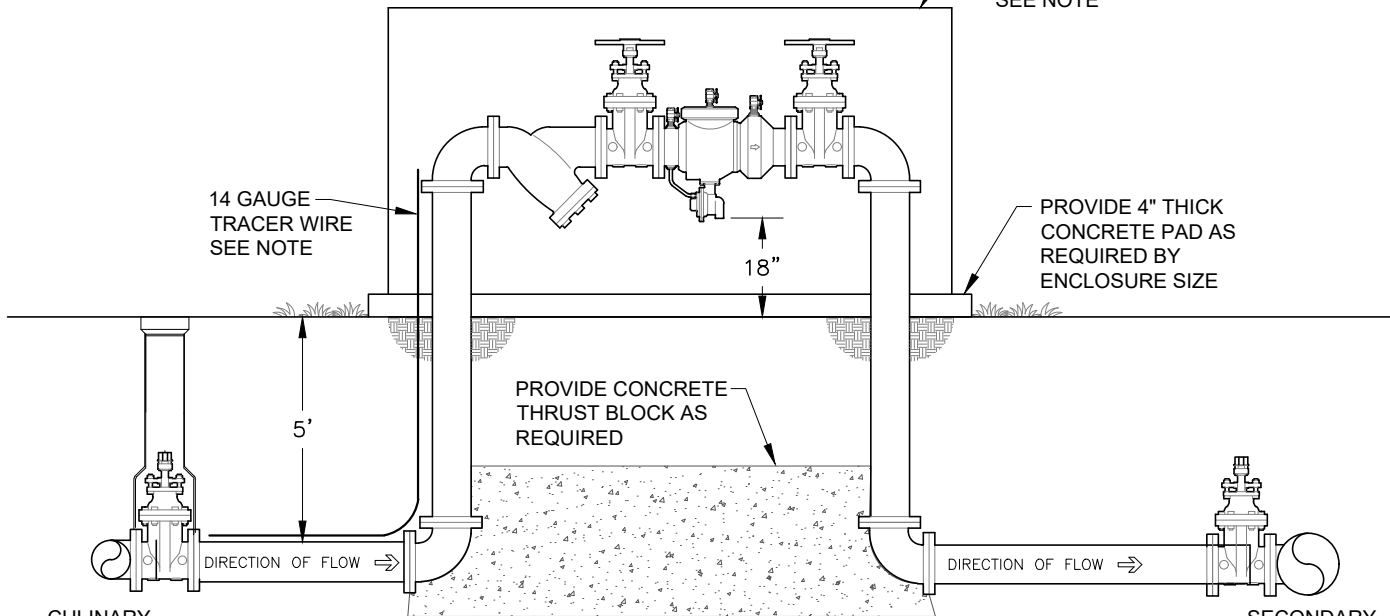

PROVIDE CONCRETE THRUST BLOCK AS REQUIRED

CULINARY WATER

SECONDARY WATER

NOTE:  
 PROVIDE 14-GAUGE TRACER WIRE AND BRING INTO PROTECTIVE SOLID CLOSURE.  
 TEST FOR CONTINUITY.  
 SEE PLAN 381R FOR TRACER WIRE.

WILKINS MODEL 375, FEBCO LF860  
 (OR APPROVED EQUAL)  
 REDUCED PRESSURE PRINCIPLE  
 ASSEMBLY

# REDUCED PRESSURE PRINCIPAL ASSEMBLY STATION