



TOWN OF BARRE, VERMONT

DEPARTMENT OF ENGINEERING &

PUBLIC WORKS

149 Websterville Road

P.O. Box 116

Websterville, VT 05678-0116

476-3522

E-mail: JMartineau@barretown.org

July 19, 2026

DRINKING WATER WARNING - BWN26003

WEBSTERVILLE WATER SYSTEM – WSID 5247

BOIL YOUR WATER BEFORE USING

BOIL WATER NOTICE - WEBSTERVILLE WATER SYSTEM 5247 USERS - Customers in the following areas have been issued a BOIL WATER NOTICE: CHURCH HILL ROAD house #121 through house #171

Due to a water main break causing low pressure and no water for customers, there is a strong possibility that your drinking water supply may become contaminated on the way to the tap. This situation presents a significant health risk to users of the Barre Town Water System. The Barre Town Water System is issuing a Boil Water Notice for users, effective immediately.


What should I do?

DO NOT DRINK THE WATER WITHOUT BOILING IT FIRST. Bring all water to a boil, let it boil for one minute, and let it cool before using, or use bottled water. Boiled or bottled water should be used for drinking, making ice, brushing teeth, washing dishes, and food preparation until further notice. Boiling kills bacteria and other organisms in the water. Coliforms are bacteria which are naturally present in the environment and are used as an indicator that other, potentially-harmful, bacteria may be present. When a water system is experiencing fluctuations in water pressure the possibility exists for bacteria and other harmful organisms to enter the water distribution system and contaminate your drinking water supply. People with severely compromised immune systems, infants, and some elderly may be at increased risk. These people should seek advice about drinking water from their health care providers. General guidelines on ways to lessen the risk of infection by microbes are available from EPA's Safe Drinking Water Hotline at 1 (800) 426-4791.

What happened? What is being done?

The repair has been made however this Boil Water Notice will remain in effect until the water system is able to demonstrate that the quality and quantity of the drinking water meets State and Federal drinking water standards. We will inform you when the necessary system repair has been completed and tests show no bacteria present in the drinking water supply.

General guidelines on ways to lessen the risk of infection by microbes are available from the Drinking Water and Groundwater Protection Division at (802) 828-1535.

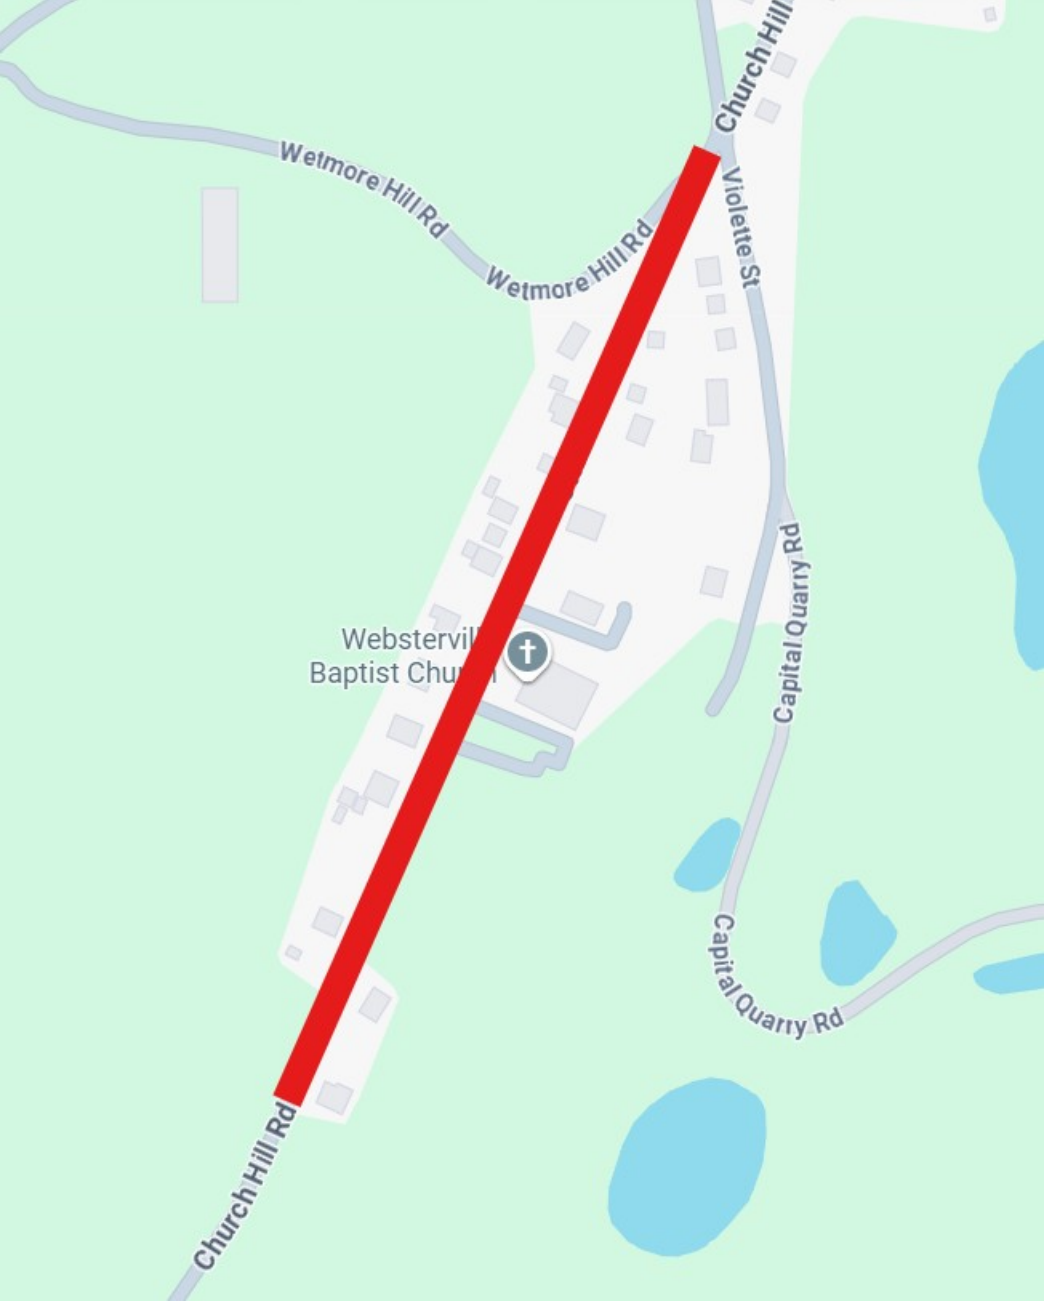

Wetmore Hill Rd

Wetmore Hill Rd

Church Hill Rd

Violet St

Websterville Baptist Church



Capital Quarry Rd

Capital Quarry Rd

Church Hill Rd